

APPENDIX 18
STORMWATER MANAGEMENT DESIGN REPORT



the LA group
Landscape Architecture
and Engineering, P.C.

40 Long Alley
Saratoga Springs
New York 12866

P 518/587-8100
F 518/587-0180
www.thelagroup.com

Stormwater Management Design Report

for:

The Modified Belleayre Resort at Catskill Park

Towns of Shandaken and Middletown
Ulster and Delaware Counties
New York

Applicant:

Crossroads Ventures, LLC
PO Box 267
Mt. Tremper, NY 12457

Prepared By:

The LA Group
Landscape Architecture and Engineering, P.C.
40 Long Alley
Saratoga Springs, NY 12866
Attn. Mr. Kevin Franke
Project No. 07074

Preparation Date:
March 2012



Table of Contents

1.0	INTRODUCTION	4
2.0	PROJECT LOCATION.....	4
3.0	PROJECT DESCRIPTION	5
4.0	EXISTING SITE CONDITIONS	7
5.0	METHODOLOGY.....	10
6.0	PRE-DEVELOPMENT MAPPING AND ANALYSIS	12
7.0	STORMWATER MANAGEMENT PLAN AND DESIGN PROCESS	14
8.0	POST-CONSTRUCTION MAINTENANCE REQUIREMENTS.....	27
9.0	CONCLUSION	27
10.0	REFERENCES	28

Appendices

- A. Figures**
- B. AIP Exhibit F, ‘Stormwater Quantity and Quality Protocols’**
- C. Supporting Calculations and Summary Tables**
- D. HydroCAD Data – Existing**
- E. HydroCAD Data – Proposed – Highmount**
- F. HydroCAD Data – Proposed – Wildacres West**
- G. HydroCAD Data – Proposed – Wildacres East**
- H. Soil Test Pit Logs**

Figures

- 1. Site Location Map**
- 2. 90% Rainfall Map**
- 3. DEIS Figure 3-18, Ecological Communities**

Tables

- 1. Water Quality Volume and Runoff Reduction Volume Summary**
- 2. Water Quality Volume Calculations**
- 3. NYCDEP Water Quality Volume and Impervious Area Summary**
- 4. Green Roof Water Quality Volume Calculations**
- 5. Channel Protection Volume Summary**
- 6. Channel Protection Volume Calculations**
- 7. Rate and Volume Summary at Design Points**

1.0 INTRODUCTION

This report describes the proposed stormwater management plan for the Modified Belleayre Resort at Catskill Park (the Project), and provides the criteria, methodologies and assumptions used to form the basis of the design. The proposed project includes the development of a resort hotels and spa facilities with recreational amenities on +/-739 acres of land to the west of the adjacent to the Belleayre Mountain Ski Center (BMSC), in the Towns of Shandaken and Middletown, New York. The currently proposed project represents a reduction of the originally proposed project, which included an additional 1,400 acres of lands on two parcels, known as the Adelstein and Big Indian parcels. These lands are no longer included in the plans for development, and therefore will remain undisturbed.

The goal of the proposed stormwater management plan is to incorporate stormwater management as part of the overall project design. This includes protecting the site's natural resources and environmentally sensitive areas, minimizing development impacts and impervious areas by using effective site planning principles, and incorporating design features that effectively manage stormwater runoff such as green roofs, bioretention areas and an irrigation pond that captures water for re-use. The plan utilizes these elements in order to achieve the primary goal of meeting water quality objectives, while at the same time mitigating potential impacts associated with increased stormwater runoff. Specifically, the objectives of the stormwater management plan are to enhance the quality of stormwater runoff to prevent water quality degradation, and preserve water quality in receiving water bodies including New York City water supply reservoirs, promote infiltration and evapotranspiration, and to prevent increased runoff from developed land to reduce the potential for flooding, erosion and flood damage.

The management plan was developed in accordance with the procedures presented in the AIP document 'Exhibit F, Stormwater Quantity and Quality Protocols'. Additionally, the plan incorporates the design standards established in The New York State Department of Environmental Conservation Stormwater Management Design Manual, (August, 2010), and the Rules and Regulations for the Protection from Contamination, Degradation, and Pollution of the New York City Water Supply and its sources, 10 NYCRR §128-3.9.

2.0 PROJECT LOCATION

The Project is located in the Central Catskill region of New York State near the intersection of the boundaries of Delaware County, Ulster County and Greene County. The site is located approximately 35 miles west of the City of Kingston, off Exit 19 of the New York State Thruway.

The project site includes lands in the Town of Shandaken in Ulster County and lands in the Town of Middletown in Delaware County, that are located west of the adjacent BMSC. The 739 acres that comprise the Modified Project site are located on either side of Ulster County Route 49A just south and west of the hamlet of Highmount. See Figure 1, Site Location Map, in Appendix A.

3.0 PROJECT DESCRIPTION

The Modified Project consists of two development areas; Wildacres Resort (Wildacres) and Highmount Spa Resort (Highmount). Wildacres is planned to be a 3.5-4 star, 4-season resort with a focus on different types of outdoor recreation including golf, skiing, tennis, hiking, etc. Highmount is planned to be a 5-star, 4-season resort focused on spa and wellness center facilities and providing ski-in/ski-out access to Belleayre Mountain Ski Center trails. In accordance with the AIP, there are two parcels of land that were part of the original project, but are no longer included within the scope of the Modified Project. The western portion of the project site, 203 acres known as the Adelstein parcel, has been put under a Conservation Easement granted to the City of New York. The AIP and the Modified Project also contemplate the conveyance of the Big Indian parcels containing approximately 1,189 acres of undeveloped land into public ownership and potential for eventual inclusion into the State Forest Preserve. Since there is no longer development proposed on these parcels, they are not included in this report. Refer to the Project Master Plan, sheets L-1.00 and L1.01 in the SDEIS plan set, for the overall Modified Project location and design.

Wildacres Resort (Wildacres) is located on approximately 254 acres on the eastern side of the Project site with access from County Route 49A south of the Alpine Osteria and near the upper driveway to BMSC as well as access from Gunnison/Kraft Road. The Wildacres Resort is made up of two large contiguous areas, defined as Wildacres East, (also called the Front-9 Village), and Wildacres West, (also called the West Village).

Wildacres West includes the following development components.

1. A 250-unit hotel with a footprint of 4.0 acres, that has nine levels that step down the existing hillside. Ancillary hotel uses include dining, spa services, tennis courts and limited hotel-related commercial. Parking for the hotel will be located within the building, and within an adjacent parking garage to the west.
2. Adaptive re-use of the existing Marlowe Mansion, to be utilized as a social club for detached lodging unit guests, and resort operational offices.
3. An 18-hole championship golf course, clubhouse, parking and maintenance facility. The clubhouse is attached to the hotel and the maintenance facility is located off of Gunnison Road near the 15th hole. The course itself is spread throughout both the west and east side of Wildacres. Surface parking is provided at the Clubhouse.

-
4. 2 and 3-bedroom detached lodging units in nine and ten-unit buildings. There are 7 lodging buildings (69 units) located on the main parcel near the hotel and Marlowe Mansion, collectively referred to as the West Village. Each unit includes garage parking plus surface parking spaces for guests.

Access to Wildacres West for the Golf Course and detached lodging units is off of County Route 49A west of the Hotel, and off of Gunnison Road. These access points are connected with an internal road that will be privately maintained. Access to the Hotel is across from the main access road/upper driveway to the BMSC and the proposed new Belleayre West lift.

Wildacres East includes the following development components.

1. A portion of the 18-hole golf course.
2. 2 and 3-bedroom detached lodging units in multiple-unit buildings clustered within the front 9 portion of the golf course. There are 11 lodging buildings (94 units) collectively referred to as the Front-9 Village. Each unit includes garage parking plus surface parking spaces for guests.
3. Clubhouse and recreation amenities for the Front-9 Village, including a health club, swimming pool and tennis courts. Surface parking is provided adjacent to the Clubhouse.

Access to Wildacres East is off of County Route 49A in the vicinity of BMSC's lower parking lots.

Highmount Spa Resort (Highmount) is located on approximately 237 acres with development proposed to the south and west of the former Highmount Ski Area with access proposed off of County Route 49A. Development proposed for Highmount includes the following.

1. A 120 unit hotel with spa facilities and 53 "semi-detached lodging units" within the hotel.
2. A multi-level lodge building south of the hotel/spa that includes 27 "semi-detached" lodging units.
3. Sixteen (16) additional detached lodging units in 8 buildings located along the access road to the Hotel.
4. An Auxiliary Conference/Clubhouse facility north of County Route 49A. This will be an adaptive reuse of some of the existing Leach Farm buildings.
5. A ski lift and trails, providing potential ski in/out connections to the old Highmount Ski Area and Belleayre Mountain.
6. A Wilderness Activity Center that will service both Wildacres and Highmount Resorts, located in existing buildings at the base of the former Highmount Ski Area that will be adaptively reused.

The driveway access off of County Route 49A will service the hotel/spa, lodge and all detached units. Parking for the hotel/spa and lodge will be within their respective buildings. Parking for the detached units will include two (2) surface parking spaces per unit at each lodging building along the access road.

The Project will have its own central water supply system and the source of potable water will be wells that are located in the valley near NY Route 28. The K-well property is located off Todd Mountain Road and the Q-well or Quarry parcel is located off Moran Road. The Project will also have its own central wastewater collection system, and wastewater will be sent to the Pine Hill wastewater treatment plant.

4.0 EXISTING SITE CONDITIONS

Vegetation

Vegetation on the 739 acre project site is primarily beech-maple mesic forest present on approximately 588 acres, or nearly $\frac{3}{4}$ of the project site. The next most prevalent vegetation covertype is Hemlock-northern hardwoods forest at 72 acres, followed by open meadow, (ski slopes at old Highmount Ski Area), at 41 acres. These ski slopes had previously been mown at least several times each year, however maintenance is no longer being carried out and these slopes are beginning to undergo ecological succession. In addition to these primary vegetation cover types, there are a few seasonal residences and hotel/motels within and directly adjacent to the project site. The grounds around these buildings include areas of maintained lawns and landscape plantings of various trees and shrubs, and open areas with naturally occurring, non-maintained meadow grasses. Refer to Figure 2 in Appendix A, Ecological Communities, and the Existing Subcatchment Maps, sheets L5.00 and L5.01 in the SDEIS plan set, for surveyed vegetation and cover types.

Soils

Detailed mapping of the soils on and around where development is proposed was prepared by an LA Group certified soil scientists, based on extensive research and on-site investigations. Soils mapping for the project site is shown on the Soil Inventory Mapping, sheets L2.02 and L2.03 in the SDEIS plan set, and test pit data is summarized in Appendix H of this report. Additionally Appendix 12, "Soil Test Results", of the project DEIS includes a full inventory of test pit logs, percolation test results, as well as the laboratory reports from analyses of soil samples taken from the project site (sieve analyses and hydrometer testing).

The lands on and around the project site are mostly areas of shallow and moderately deep, very stony soils formed in glacial till derived from red shale and sandstone. There are some areas of deep glacial till soils that have a very firm fragipan. At the base of slopes along the outlet of small streams coming off the slopes there are some broad areas of very gravelly (actually channery and flaggy) glacial outwash. A few areas of the deep till do not have a fragipan. The soils on and around the site have a relatively moderate content of fine, colloidal material that do not settle out readily when they are in solution.

The mapped soils include Elka silt loam, Halcott, Halcott-Udorthents, Halcott-Vly complex, Lairdsville Silt Clay Loam, Lewbeach channery silt loam, Onteora-Suny complex, Rubble Land, Tunkhannock very channery loam, Vly-Elka complex, Vly Halcott complex, Vly channery silt loam and Willowemoc Channery silt loam. The Hydrologic Soil Groups for these soils are predominately C and D, with most of the developed area falling into Hydrologic Soil Group C.

Most of the Lewbeach soils were found to have a fragipan at a depth of 16 to 40 inches with bedrock typically not encountered in the generally seven to eight foot deep test pits. Percolation tests performed above the fragipan had percolation rates that ranged from 5 minutes 35 seconds to 27 minutes. Percolation tests within the fragipan typically had percolation rates that were greater than 60 minutes. Typically there was no evidence of seasonal high ground water in the Lewbeach soils.

The Vly soils did not have a fragipan but bedrock was usually contacted in test pits excavated in Vly soils. Depth to bedrock in Vly soils ranged from 24 inches to 72 inches. Percolation tests performed above the bedrock boundary layer ranged from 5 minutes 10 seconds to fourteen minutes two seconds.

Two test pits were excavated in Willowemoc soils and they, like the Lewbeach and Vly soils, had characteristics consistent with County soil survey descriptions. Fragipan depth ranged from 28 to 40 inches and bedrock was not encountered. Mottling at 28 inches is indicative of the seasonal high water that occurs from October to May.

The test pits in Halcott soil confirmed their shallow depth to bedrock. In the five test pits in Halcott soil the depth to bedrock ranged from 12 to 22 inches. As a result of the test pit work done on the site, the preliminary high intensity soils maps were revised to reflect a lesser amount of Halcott soils on the project site. Some of the areas originally mapped as Halcott rock outcropping were merely areas of other soils with large rock, rather than bedrock, on the soil surface.

A test pit excavated in Elka soils to confirm this mapping unit did confirm the correct soil series and characteristics described in the County soil survey. The characteristics include a bedrock depth greater than six feet and a very stony and channery soil profile.

Based on the extensive soil investigations, mapping and test pit confirmations, the silt/clay soils, fragipans, shallow depths to bedrock and seasonally high groundwater are limiting factors in the design of stormwater management facilities.

Hydrology

Overall, the site drains from south to north. Existing drainage patterns on the site and on adjacent contributing areas are illustrated on the Existing Subcatchment Plans, sheets L5.00 and L5.01 in the SDEIS plan set. These plans also including the watershed divide between the Ashokan and Pepacton watersheds (source: NYSDEC). Essentially all of the site is within the Pepacton watershed, with only a very small portion of the Wildacres site along the lower section of County Route 49A being within the Ashokan watershed. Additional wetland and watercourse mapping for the site is included on the Wetland Inventory, sheets L2.06-2.09 in the SDEIS plan set.

At Highmount, drainage currently runs as sheet flow overland from the high point at the top of the old ski area overland and is collected in drainage swales on the uphill side of County Route 49A. This drainage passes underneath County Route 49A via a number of culverts including a 52-inch concrete culvert near the base of the Highmount Ski Area.

At Wildacres West, existing runoff from lands south of County Route 49A, including the western portion of the Belleayre Mountain Ski Area and lands east of Highmount, is conveyed through culverts under Route 49A, runs in channelized streams through the property, collects in an east/west channel along the railroad corridor north of the site, and exits the channel via a number of culverts that pass under the railroad bed to the north.

At Wildacres east, drainage in the Pepacton watershed runs overland and is collected in the same channel along the railroad corridor, before it is conveyed through culverts under the railbed. Drainage in the Ashokan watershed also runs overland, and is collected in a roadside ditch on County Rt. 49A, which eventually drains to a 30" culvert under 49A to a ditch along Rt. 28.

There are three primary drainage courses through the site, all located at Wildacres. (See Wetland Inventory, sheets L2.06-2.09 in the SDEIS plan set). The first is an intermittent stream with a substrate consisting of rock, boulder and gravel that originates on State lands east of the former Highmount Ski Area and flows north through the Resort. This drainage is located within Wetland 16, and is a mapped intermittent tributary of the Bush Kill. To the east of the existing Wildacres Hotel (Marlowe Mansion) there is a second drainage that originates in a seepy area south of the Mansion. In the vicinity of the existing Hotel driveway seasonal or storm flow becomes channelized, then passes under the existing driveway and continues north and down the slope. This unmapped intermittent watercourse is identified as being within Wetlands 19-22. The third drainage originates on the western portion of the BMSC, crosses under County Rt. 49A, then flows as channelized drainage to the point where it enters the western corner of Wildacres East. This mapped intermittent tributary of the Bush Kill is within Wetland 24. The drainage then turns northwest and continues to the railroad corridor to the north. All three of the primary drainages are rocky, cobbly channels that convey storm flows and seasonal flows. Their locations and contributing watersheds are further illustrated on the Existing Subcatchment Plans, sheets L5.00-5.01 in the SDEIS plan set.

Topography

The topography within the portions of the project site proposed to be developed ranges from a maximum elevation of 3,100 feet above mean sea level (AMSL) near the top of the lift at the former Highmount Ski Center to a minimum elevation of 1,734 feet AMSL at the railroad corridor in the north corner of Wildacres West. Detailed topography information at 2 foot, 5 foot and 20 foot contour intervals is illustrated on the Existing Conditions Plans, sheets L2.00-2.01 in the SDEIS plan set. Detailed slope classifications are illustrated on the Slope Mapping, sheets L2.04-2.05 in the SDEIS plan set.

At Highmount, with the exception of the lands at its very top where grades are less steep, the former Highmount Ski Area consists of steep north-facing slopes with elevations ranging from a high point of

approximately 3,400 feet down to 2,260 feet AMSL. To the west of the flatter lands at the top, elevations decrease via a combination of steep slopes and flatter plateaus, typical of the topography of mountains in the Catskills. The less steep areas at the top and the flatter plateaus are more suitable for development.

The Wildacres portions of the project site consist of areas of varying topography. Elevations in this area range from approximately 2,260 to 1,800 feet AMSL. On the western half topography is generally moderate, with the same combination of steep slopes and flatter plateaus mentioned above. The eastern side is generally flatter, and suitable for more dense development.

As per the AIP, proposed lodging units will be built only on slopes less than or equal to 20% and this will provide significant stormwater management benefits for this project. This commitment by Crossroads is an enhancement beyond current NYSDEC and NYCDEP regulatory standards for steep slope construction, and is consistent with the 'site planning as green infrastructure' goals for stormwater management outlined by NYSDEC.

Resource Mapping

Detailed mapping of existing conditions and environmental resources is provided in the SDEIS project plan set as noted in the sections above.

5.0 METHODOLOGY

The Stormwater Management Plan was developed in accordance with the procedures presented in the AIP document 'Exhibit F, Stormwater Quantity and Quality Protocols'. The plan incorporates the design standards established in The NYSDEC New York State Stormwater Management Design Manual, August, 2010 (SMDM), and the Rules and Regulations for the Protection from Contamination, Degradation, and Pollution of the New York City Water Supply and its sources, 10 NYCRR §128-3.9.

Stormwater Model and Analysis

As per the AIP, stormwater modeling was performed using the computer program HydroCAD (version 9.10) produced by HydroCAD Software Solutions, LLC, and all stormwater calculations were completed utilizing the SCS TR-20 and , TR-55 methods, widely accepted engineering practices, and recommended procedures listed in the SMDM. During a September 18, 2008 meeting with NYCDEP, NYSDEC and the NGO's it was again confirmed that the HydroCAD model was the proper model to use.

Storm Events Analyzed

The Type II storm is synthetic rainfall distribution that SCS has mapped for the project site, based on available National Weather Service duration-frequency data. Type II represents the most intense, short duration rainfall of the four different distributions, and is the design storm utilized in the stormwater model as per the AIP and as confirmed during a September 18, 2008 meeting with NYCDEP, NYSDEC and the NGO's.

The return interval storm events analyzed during the development of the plan are those specified in the AIP and in the August 2010 SMDM. However, because the 2007 AIP references the then-current SMDM that was subsequently updated, it was appropriate to update the rainfall amounts of the design storm events to be consistent with the 2010 SMDM.

The storm events analyzed are:

1. The 90% rainfall event totaling **1.1** inches as per Figure 4.1 of the SMDM, used as the basis for the DEC **Water Quality Volume** treatment goals. Since the modified project no longer includes the lands to the east of BMSC, the entire project site now falls directly under the 1.1" contour on the 90% rainfall map that is Figure 4.1 of the SMDM. This is a revision of the 1.3" event listed in Exhibit F of the AIP. See Figure 3 in Appendix A, showing the project site in the context of SMDM Figure 4.1
2. The 1-Year, Type II Design Storm having a 24-hour rainfall total of **2.8** inches as per Figure 4.4 of the Manual, used as the basis for **Channel Protection Volume** extended detention requirements. This storm event is also used to meet **NYC DEP Water Quality Volume** treatment goals. The precipitation map in the updated 2010 SMDM for the 1-yr storm event has been updated from the previous version, and therefore is different than the 3.5 inches listed in the AIP document 'Exhibit F'.
3. The 10-Year, Type II Design Storm having a 24-hour rainfall total of **6.0** inches, as per Figure 4.5 of the Manual, used as the basis for meeting the **Overbank Flood Control** Criteria. This map/figure did not change in the updated 2010 SMDM.
4. The 100-Year, Type II Design Storm having a 24-hour rainfall total of **8.0** inches as per Figure 4.6 of the Manual, used as the basis for meeting the **Extreme Flood Control** criteria. This map/figure did not change in the updated 2010 SMDM.
5. The 25-Year Design Storm having a 24-hour rainfall total of **6.5** inches. The inclusion of this storm is a local and NYC DEP requirement for peak rate attenuation.

Design Process

Once an environmental resources analysis of the project site is complete, the stormwater management design process begins with the identification of design points, typically located at points of confluence where flows can be easily measured, locations that are down gradient of proposed development, and as

close as possible to the areas of proposed development. These are used to develop the subcatchment mapping, and ultimately to compare the rate and volume of runoff in the pre-development and post-development conditions. Once the subcatchment areas are defined, data is collected to determine both quantity and quality requirements. Using this data, the design is then developed in accordance with the SMDM 5-step process in order to meet the required goals.

The August 2010 SMDM includes a five-step process that integrates site planning and stormwater management, and requires the use of green infrastructure practices to treat stormwater. The five steps include;

1. Site planning to preserve natural features and reduce impervious cover,
2. Calculation of the initial Water Quality Volume for the site,
3. Providing Runoff Reduction by incorporation of green infrastructure techniques and standard stormwater management practices (SMP's) with Runoff Reduction Volume (RRv) capacity.
4. Using standard SMP's where applicable, to treat the portion of water quality volume (WQv) not addressed by green infrastructure techniques and standard SMP's with RRv capacity, and
5. Design of volume and peak rate control practices where required.

The original design of this overall project integrated site planning and stormwater management and incorporated green infrastructure practices such as green roofs and cisterning water for re-use, prior to the issuance of the 2010 SMDM update. The Modified Project continues the commitment to these practices and articulates the specific steps from the revised manual listed above. Specific aspects of the design and the process are included in more detail in the body of the report below.

6.0 PRE-DEVELOPMENT MAPPING AND ANALYSIS

Design Points were identified during fall of 2006 field investigations and inspected again in the spring of 2007. The locations of these design points are listed in the AIP Exhibit F, included in Appendix B. After the AIP was issued, additional discussions regarding the Design Points were held with DEC, DEP and the NGO's in September and November of 2008. The discussions addressed how the AIP design points would be analyzed in the context of a proposed stormwater management concept, based on the Modified Project. At the conclusion of the discussions the participants agreed that Design Points 1-6 would be moved closer to the proposed development at Highmount, to create the most accurate storm water model for the Modified Project. Based on these changes, the Design Points were re-numbered, and the adjusted locations were then field verified in October, 2008, by LA Group staff. Design Point 13 was eliminated based on these field investigations. The adjusted Design Points are listed below, and shown on the Existing Subcatchment Plans, sheets L5.00-5.01 in the SDEIS plan set.

Modified Project Design Points

Design Point	Structure Type	Location	Notes
1a	Drainage Ditch at Woods Road	+/-600' west of ex Leach Farm (below HM)	New Design Point
2	24" Culvert	Along Rte. 49A (below Highmount)	Previously DP 14
3	12" Culvert	Along Rte. 49A (below Highmount)	Previously DP 15
4	18" Culvert	Along Rte. 49A (East Side of Highmount)	Adjusted DP
5	18" Culvert	Along Rte. 49A (East Side of Highmount)	Adjusted DP
5a	12" Culvert	Along Rte. 49A (East Side of Highmount)	Adjusted DP
6	52" Culvert	Along Rte. 49A (Bottom of old ski area)	Adjusted DP
6a	28" Culvert	Along Rte. 49A (Bottom of old ski area)	Adjusted DP
7	36"x48" Culvert	At Railbed, ± 70' North of Gunnison Rd.	No Change
8	(2) 18" Culverts	At Railbed ± 190' North of Gunnison Rd.	No Change
9	24"x36" Culvert	At Railbed ± 890' North of Gunnison Rd.	No Change
10	60"x96" Stone Culvert	At Railbed, ± 1405' North of Gunnison Rd.	No Change
11	24"x36" Culvert	At Railbed, ± 2105' North of Gunnison Rd.	No Change
12	30" Culvert	Intersection of Van Loan Road & Rte. 49A	No Change
16	24" culvert	Intersection of Ulster Del. Trnpke & Rte. 49A	New Design Point

**Note: Design Point 13 was eliminated*

Based on these Design Points, individual subcatchments were derived from field observation and mapped data. The individual subcatchments include the following.

Cover Types

Areas of cover type are from the project site survey and vegetation community type mapping derived from field observation. These cover types were used to help determine runoff coefficients, and typically include impervious and vegetated areas.

Soils

Soils types and hydrologic soil groups are identified based on-site high intensity soils mapping and used in conjunction with the cover types to help determine runoff coefficients. Based on the collected soil data, Hydrologic Soil Group C is used throughout the existing analysis.

Time of Concentration Flow Paths

Time of concentration flow paths will begin with a sheet flow segment, transitioning to shallow concentrated flow and channel flow where these conditions exist. Specific flow paths and channel conditions are based on existing conditions mapping, survey and field observation, and the position and orientation of channels was verified using GPS positioning.

At Highmount, the site is divided into eight existing subcatchments, that terminate at design points 1a, 2, 3, 4, 5, 5a, 6 and 6a located along County Route 49A. The eight subcatchments total approximately 183 acres of primarily wooded and meadow cover types, on Hydrologic Group C soils. There are also a few existing structures, driveways, and dirt access roads at the old Highmount ski area.

Wildacres West includes ten existing subcatchments that terminate at design points 7 through 9, and includes runoff from off-site lands to the south. The ten subcatchments total approximately 301 acres of primarily wooded cover type on Hydrologic C soils. Also included are some existing structures, driveways, meadow areas and wetland areas.

Wildacres East includes seventeen existing subcatchments that terminate at design points 10, 11, 12 and 16. Nine of the seventeen are on off-site lands including the western portion of BMSC and its access road, totaling approximately 90 acres. All seventeen subcatchments total approximately 254 acres of primarily wooded and meadow cover types on Hydrologic Group C soils. There are also existing structures, lawn areas, driveways and roads. Design points 12 and 16 include subcatchments that are within the Ashoken watershed. All other project subcatchments are within the Pepacton watershed. The total watershed area at Wildacres, (East and West), is 555 acres.

The existing subcatchments and their characteristics were entered into the HydroCAD model in order to create the pre-development condition that can be used as a baseline comparison for the post-development model. The existing peak discharge rates and volumes at each Design Point for the 10, 25 and 100-yr storm events are summarized in Table 7 in Appendix C. The WQv and 1-yr storm events are analyzed separately.

7.0 STORMWATER MANAGEMENT PLAN AND DESIGN PROCESS

The proposed project incorporates stormwater management as part of the overall project design. This includes protecting the site's natural resources and environmentally sensitive areas, minimizing development impacts and impervious areas by using effective site planning principles, and incorporating design features that effectively manage stormwater runoff such as green roofs, bioretention areas and an irrigation pond that captures water for re-use. The plan utilizes these elements in order to achieve the primary goal of meeting water quality objectives, while at the same time mitigating potential impacts associated with increased stormwater runoff. Specifically, the objectives of the stormwater management plan are to:

- Enhance the quality of stormwater runoff to prevent water quality degradation, and preserve water quality in receiving water bodies including New York City water supply reservoirs,
- Promote infiltration and evapotranspiration,
- Prevent increased runoff from developed land to reduce the potential for flooding, erosion and flood damage.

The plan is developed in accordance with the NYSDEC design criteria and process outlined in Section 5 above, and 10 NYCRR §128-3.9. Specific steps are described in detail later in the report. In general, stormwater is conveyed through a series of stabilized rip rap and grassed swales, storm pipes, culverts and in some cases sheet flow. It is collected, treated and attenuated in catch basins, micropool

extended detention ponds, bioretention areas, dry swales, sections of porous pavement, stormwater planters, wet extended detention ponds, including one that will function as a cistern for irrigation, and a green roof. Controlled release structures within the detention ponds regulate the rate at which stormwater is discharged. The existing soils limit the ability to use infiltration for treatment, so underdrains are included in the bioretention areas, dry swales and stormwater planters. The wet pond used to store irrigation water is an isolated man-made pond with a liner and is not associated with any of the watercourses on the project site. Sufficient freeboard will be maintained in the irrigation ponds so that required treatment and attenuation can be achieved.

Even though there are no direct discharges to Trout Waters, concerns relating to thermal loading were considered in the selection of stormwater management practices. This is one of the reasons Micropool Extended Detention Ponds are primarily used throughout the plan instead of other treatment devices, which could potentially result in increased stream temperatures. Only two Wet Extended Detention Ponds are utilized. The first is the irrigation Pond mentioned above, however since it will be used for irrigation, potential for stormwater discharges from the pond is greatly reduced. The second is at Highmount and functions both as a treatment device and decorative water feature. Using Bioretention and Dry Swales also helps, as it reduces the amount of stormwater that would be required to pond, and potentially warm, prior to being discharged. Even though 24 hours of extended detention of the 1 yr. storm event is required, using these practices and the Micropool Extended Detention Ponds minimize the potential for thermal loading.

Stormwater management devices will be vegetated with plant species adapted to survive in fluctuating hydrologic conditions, and all conveyances will have sufficient erosion protection including rolled erosion control products and/or grasses. Treated stormwater will be discharged at controlled rates to stabilized swales and existing channels and drainage ways throughout the site. Existing hydrologic patterns that include stormwater runoff from off-site areas located above the proposed development areas, are maintained to the maximum extent practicable. This is achieved by ensuring this runoff does not flow over proposed development areas, and allowing it to bypass disturbed areas and proposed stormwater management practices whenever possible.

By implementing these practices and creating positive drainage with effective site grading within each of the drainage areas, the proposed stormwater management systems are capable of minimizing erosion potential, treating stormwater runoff from developed project areas, and reducing post-development runoff rates from the 1, 10, 25 and 100-year storm.

The five steps outlined in the SMDM, (Site Planning to Preserve Natural Features, Water Quality Volume, Runoff Reduction Volume, Channel Protection Volume, and Overbank Flood and Extreme Flood Control), are discussed in the following sections.

Site Planning to Preserve Natural Features

On a larger scale, the preservation of land is a direct result of the AIP process which resulted in the Modified Project. In accordance with the AIP, the 203 acre Adelstein parcel has been placed in a Conservation Easement to the City of New York. The Conservation Easement allows for passive recreational activities on the property. The AIP and the Modified Project contemplate the conveyance of the Big Indian parcels containing approximately 1,189 acres of undeveloped land into public ownership and potential for eventual inclusion into the State Forest Preserve. The lands are contiguous with the Big Indian Wilderness Area and nearby the Shandaken Wild Forest. Together, the Adelstein parcel and the Big Indian parcels represent nearly 1,400 acres of lands to remain undisturbed and preserved as a result of the Modified Project.

As a result of the reduced project scope, the Modified Project entails development of approximately 235 acres as opposed to the 573 acres of development proposed under the original project. Similarly the Modified Project includes a total of 21 acres of impervious surfaces as compared to the 85 acres of impervious surfaces proposed in the original project.

Specific to the current Modified Project, the design process considered site planning strategies that can be beneficial to a stormwater management plan. Some of these are listed in Table 3.1 in Chapter 3 of the SMDM. There are two categories, Preservation of Natural Resources and Reduction of Imperious Cover.

Preservation of Natural Resources includes:

- Preservation of Undisturbed Areas
- Preservation of Buffers
- Reduction of Clearing and Grading
- Locating Development in Less Sensitive Areas
- Open Space Design
- Soil Restoration

Reduction of Impervious Cover includes:

- Roadway Reduction
- Sidewalk Reduction
- Driveway Reduction
- Cul-de-sac Reduction
- Building Footprint Reduction
- Parking Reduction

These planning principles were included during the site design and concept refinement process at Wildacres and Highmount. Based on the existing site conditions and natural resource analysis included in Section 4 above, areas that are more suitable for development were identified, along with natural areas that should be preserved. Development was then clustered in the more suitable areas, (such as the flatter plateaus within the topography), slopes steeper than 20% were avoided, and other natural

resource areas such as wetland and streams were preserved. This allows for significant open space, both as undeveloped natural areas and designed open space areas designated for recreation.

The buildings, being the largest components, are located in the flattest areas and designed to fit into the topography, to reduce as much as possible the necessary clearing and grading. Roads were then strategically located to connect the developed areas, using the same principles of avoiding sensitive areas and minimizing grading as much as possible. Potential impacts to wetland and stream buffer areas are also minimized by avoidance, spanning streams with bridges, and minimizing grading within buffer areas to the maximum extent practicable. Soils with high capacity for infiltration do not exist on the site, however the development of the golf course will include the installation of topsoil with a much higher infiltration potential, thereby increasing groundwater recharge. Post-construction soil restoration is also specified as part of the stormwater pollution prevention plan (SWPPP).

As part of the same planning process, impervious areas were also minimized. All cart paths for the golf course will be constructed of porous pavement. Even though the soils have limited infiltration capacity, this approach maximizes the opportunity for infiltration to occur. Many of the detached lodging units utilize narrow, shared driveways, and in most cases parking underneath the units. Road widths are minimized as much as possible, based on the amount of anticipated traffic and the project components they serve. The Wildacres Hotel incorporates most of its parking within the footprint of the building (underground), and additional hotel parking is provided in a two-story parking garage, further reducing the necessary parking footprint. Roof terraces are planted to reduce the hotel's impervious area. The Highmount Hotel/Spa and adjacent lodge are designed with a green roof, essentially eliminating an impervious rooftop. Parking for the hotel/spa and lodge are again included within the footprint of the building eliminating more potential impervious area.

Proposed Subcatchment Mapping

Subcatchment mapping of the proposed project area was developed based on the previously identified design points and existing subcatchment mapping. The same methodology used in the development of the existing subcatchment mapping with regards to cover types, soils and time of concentration flow paths were used for the proposed mapping, based on the proposed development plan.

Cover types in the proposed conditions include forest, meadow and wetlands in the undisturbed areas, lawn areas, roads and paving, roof area and porous paving. The lawn areas are broken into two categories based on anticipated soils after construction. Hydrologic Group C soils are anticipated in all areas with the exception of the tees, greens and fairways on the golf course. These areas are anticipated as Hydrologic B soils, based on the high porosity requirements typical of the quality soils necessary to establish golf course quality grass on fairways, tees and greens. Soils for these golf course components consist of a sandy loam or loamy sand as defined by the USDA, sand, and may times gravel to facilitate subsurface drainage. Subsurface preparation for building fairways, tees and greens should begin 12"-18" below the anticipated finished grade. Benefits of using these course textured soils include

less compaction and increased infiltration rates, which are crucial to maintaining healthy turf. The porous pavement golf cart paths were considered to be impervious (CN 98), as a conservative measure due to the limiting infiltration capacity of the existing soils. However, it is expected they will function as intended providing infiltration, resulting in a much lower CN value ranging anywhere between 50 and 90. Time of concentration flow paths are based on a combination of the existing topography and proposed grading, and sheet flow is limited to a distance of 100' as required.

At Highmount, the proposed watershed is divided into several subcatchments totaling approximately 182 acres. At Wildacres, the proposed watershed is divided into several subcatchments totaling approximately 558 acres. This is the same watershed area identified in the pre-development condition. In the proposed condition, proposed grading results in 2.5 acres of the 26 acres draining to the Ashoken reservoir under existing conditions now draining to the Pepacton reservoir.

The data collected during the subcatchment mapping process is then entered into the HydroCAD model and used as part of the basis for the stormwater management design.

Water Quality Volume Calculations

The required water quality volume (WQv) was calculated for each drainage area contributing to a design point, based on the proposed design. The calculation was performed in accordance with the equation presented in Table 4.1 in Chapter 4 of the Manual, utilizing both the 1.1 inch storm event required by DEC, and the 2.8 inch storm event required by DEP. The resulting volumes determined the amount of treatment required, and were then used as the basis for the Runoff Reduction Volume calculation required by NYSDEC. A summary of the WQv required by drainage area is included in Tables 1 and 3, Appendix C, and detailed supporting calculations can be found in Table 2, Water Quality Volume Calculation Table, also in Appendix C.

As part of the above calculation, the percent of impervious area within each drainage area is also calculated. This is used not only to determine the WQv, but also to identify additional DEP treatment requirements above and beyond what is required by DEC, in accordance with DEP's April 2010 updated regulations. Section 18-39(c)(6) of the April 2010 DEP regulations states that if impervious surfaces cover 20% or more of a drainage area for which stormwater practices are designed, runoff from that drainage area shall be treated by two different types of stormwater management practices in series. Based on our analysis of this DEP requirement and its relationship to DEC's SMDM requirements, it is our understanding that the calculation to determine the percentage of impervious area is performed at the design point which defines the contributing drainage area. There appears to be a potential correlation between the DEC design process and this DEP requirement, however the regulations do not include sufficient language or information about how the DEC and DEP calculations and process could integrate with one another.

Based on the above, all of the drainage areas in this project for which stormwater management practices are designed do not include impervious surfaces greater than 20% of the total drainage area.

A summary of this information is in the DEP WQv summary, Table 2 in Appendix C, and supporting calculations can be found in the Water Quality Volume Calculation Table 3, in Appendix C.

Runoff Reduction Volume Calculations (RRv)

Section 4.3 of the SMDM states the RRv requirement can be accomplished by application of on-site green infrastructure techniques, standard stormwater management practices with runoff reduction capacity, and good operation and maintenance. If by using these techniques the calculated RRv is greater than the required WQv, the RRv requirement is met. If the RRv is less than the required WQv, then the design must at a minimum, reduce a percentage of the runoff from impervious areas to be constructed on the site. The percent reduction is based on the Hydrologic Soil Group of the site, and is determined by the Specific Reduction Factor (S). The Specific Reduction Factor (S) for this project is 0.30, based on the 'C' soils present.

Green Infrastructure Practices

Listed below are the green infrastructure techniques and standard stormwater management practices with runoff reduction capacity acceptable for runoff reduction, as noted in Tables 3.2 and 3.5 of the Manual, and an evaluation of its use within this project.

Conservation of Natural Areas

As described in the Site Planning section above, there are several natural areas throughout and around the project site that have been protected. These natural areas are a critical component of the design, from both an environmental standpoint and an aesthetic standpoint. These areas provide context and setting for the Resort as a whole, integrating it with the surrounding landscape. These preserved areas at Wildacres and Highmount are clearly marked on the project plans, and designated for protection during construction as shown on the Erosion and Sediment Control Plans, sheets L3.02-3.21 in the SDEIS plan set. While these areas are clearly protected and will be maintained by the Resort, no conservation easements are planned.

In an effort to maintain the existing hydrology of the site as much as possible, runoff from these undisturbed areas does not flow into stormwater management practices (SMP's), before reaching the design points. These areas are included in the initial WQv calculation; however, since they do not drain to a Stormwater management Practice (SMP), the areas are not included in the adjusted WQv calculations, and no area reductions are taken for the RRv calculation.

Even though there are no conservation easements planned within Wildacres or Highmount, the 203-acre Adelstein parcel to the west of Highmount and County Route 49A has been placed in a Conservation Easement with the City of New York. This represents the protection and conservation of a

significant parcel of land, adjacent to the project site. However since it is separate from the project site and not included in the site's watershed, it is not included or accounted for in the RRV calculation.

Sheetflow to Riparian Buffers/Filter Strips

This technique is not used for this Project primarily due to the slope requirements and the maximum length of overland flow restrictions in the SMDM. Most portions of the project site where this technique could be applied are steeper than the allowable maximum contributing slope ranging from 6%-15%. Additionally as part of this plan, all runoff from developed areas is typically treated and attenuated prior to being discharged into these naturally occurring areas, so the natural hydrology can be maintained as much as possible.

Vegetated Open Swales

RRV is not applied for this technique due to site topography prohibiting the required design flows and flow depths, and exceeding slope requirements of 4 percent. However, vegetated swales are an integral part of the design with respect to stormwater conveyance. And in many cases, Dry Swales are used instead.

Tree Planting/Tree Box

There are several natural areas with existing trees that are being preserved, and an extensive tree planting plan is included as part of this project. However RRV is not applied for this technique due to limiting slope requirements of 5% for proposed trees and 6%-15% for existing trees and distance limitations based on proximity to impervious areas. There appears to be several other limiting factors related to the applicability of this technique, such as a correlation to Rooftop Disconnection, Sheet Flow to Filter Strip and Natural Conservation Areas, but it is not clear how all these factors and/or restrictions can be integrated into a project of this size and scope. This is another reason why this technique is not applied to the RRV calculation, however this appears to be a conservative measure based on the existing wooded areas to be preserved and the extensive tree planting plan.

Disconnection of Rooftop Runoff

RRV is not applied for this technique due to the limiting infiltration capabilities of the project site soils.

Stream Daylighting

An impervious area reduction is not taken for this practice because the project does not qualify as a re-development project as defined in the SMDM, and therefore stream daylighting is not an applicable practice. However in one location there is a culvert approximately 25' long that will be removed and replaced with bridge that will span a portion of a stream and the area where the culvert is removed.

Rain Garden

RRV is not applied for this technique. Rain gardens are typically applied within very small drainage areas usually associated with residential development. The contributing drainage areas for individual homes

exceeds the maximum contributing area of 1,000 sf (for a rain garden), specified in SMDM. Instead, Bioretention practices are incorporated as part of the plan. In addition to this practice being more appropriate for larger contributing drainage areas, this results in fewer practices for a larger area which can simplify operations and maintenance.

Green Roof

The Highmount Hotel and Spa and adjacent Lodge building will be constructed with Green Roofs covering the entirety of the structures. This represents a significant reduction in impervious area, as the roofs are planned to total 8.5 acres in size. The Green Roof will be an 'intensive system', including a lightweight growing media with depths ranging from 12" to 36", a filter fabric type layer and drainage aeration layer. Excess water will be drained away in small collection pipes. The roof will contain a mix of herbaceous and low growing woody vegetation that will be regularly maintained. In the stormwater model, it is assumed that herbaceous lawn will cover the entire roof and the growing media will be 12" deep. Additional plantings and greater soil depths will increase the performance of the roof.

There are 2 possible ways to model the green roof within hydrocad. If you were to model the roof as a pond, you would include the storage within the growing media and drainage layer. The outlets would be exfiltration, representing surface water percolating through the growing media, and horizontal orifices at the bottom of the drainage layer to collect the water that exfiltrates through the growing media. After exploring this option and it's reaction within the model, it was decided that modeling the roof as a subcatchment only was the most accurate, and conservative method to use.

In the HydroCAD model, the green roof is modeled as a subcatchment with a specific CN value. The CN value was provided by the green roof manufacturer based on TR-55 calculations and data acquired from lab testing of green roof materials. The manufacturer also provided a runoff rate for certain storm events, based on the CN value of 72. We modeled the project scenario independently and found that the rates generated were consistent with the rates provided by the manufacturer. Based on the scenario above and the information provided by the manufacturer, it is our opinion that this is the most accurate way to model the green roof within HydroCAD. Refer to Appendix C for supporting calculations provided by the manufacturer.

The entire required WQv is applied towards the RRv. Refer to Table 4 in Appendix C for the Green Roof WQv calculations.

Stormwater Planters

The Wildacres Hotel will include a series of stormwater planters on the rooftop terraces. The planters are designed as flow through planters with a 12" ponding depth, 18" of soil media, a 12" gravel drainage layer and an underdrain. A small overflow pipe is included for larger storm events. Collectively, the planters will treat nearly an acre of impervious roof terrace, before discharging to a collection system. As a flow-through planter on 'C' soils, 45% of the provided WQv is applied towards the RRv. See sheet L8.01 in the SDEIS plan set for the planter detail, and the Stormwater Management Plans for the location.

Rain Tanks/Cisterns

There are no traditional rain tanks and cisterns proposed as part of this project. However, the proposed irrigation pond located in the Front-9 Village portion of Wildacres east will function exactly like a cistern, storing stormwater runoff for re-use as irrigation for the golf course. Forty five (45) acres of proposed development, including the Wildacres Hotel, adjacent parking garage, portions of the golf course and the entire Front-9 Village drain to the irrigation pond. The pond is designed as a 'traditional' stormwater management practice, (Wet Pond), with a static water elevation, and sufficient freeboard to store the entire WQv and attenuate the larger storm events. None of this storage is applied to the RRV because of the uncertainty of how the calculation would be applied, since the pond will function both as a treatment and attenuation device and a storage device for re-use.

Porous Pavement

The infiltration capacity of the existing soils is a limiting factor preventing the widespread use of porous pavement on this project. However, porous pavement will be used to construct all of the golf cart paths along the golf course. The cross section of the paving design, (See sheet L8.02 in the SDEIS plan set), will include a perforated underdrain in the event adequate infiltration is not realized. As a conservative measure, no storage credit is applied to the RRV and they are not used to provide WQv treatment, due to the limited infiltration capacity of the existing soil. Any runoff from the cart paths will infiltrate as the soils allow, then sheet flow across the golf course or other grassed areas into a stormwater management practice. However it is expected they will function as intended, providing infiltration and reducing runoff, since the construction of the cart paths in many areas will be in fill soils and infiltration will be realized. As a conservative measure, the CN value for all cart paths was set at 98.

Bioretention

Bioretention is a primary treatment device used throughout the project, used mostly to treat the WQv in small drainage areas with high percentages of impervious areas. The bioretention areas are designed with a 6" maximum ponding depth, an overflow pipe, a 48" depth of soil filter media, a 12" gravel drainage layer and an underdrain. In most cases where these practice are used, the WQv requirement for the DEC storm is met, and overflow from larger events is directed via the overflow pipe, or over a weir to a standard SMP for attenuation. In many cases the Bioretention areas are oversized and the WQv requirement for the DEP storm is met, and therefore in a few cases these practices meet the total RRV requirement for a specific drainage area. As a bioretention practice on 'C' soils, 40% of the provided WQv is applied towards the RRV.

Dry Swale

Dry Swales are used throughout the project primarily to convey and treat the WQv associated with runoff from the golf course, which in most cases is all pervious. The dry swales are designed with an 18" ponding depth, a 30" depth of soil filter media, a 12" gravel drainage layer and an underdrain. In almost all cases where these practice are used, the WQv requirement for the DEC storm and DEP storm is met. Overflow from larger events is either directed over a weir to a standard SMP for attenuation and additional treatment, or discharged to conveyance swales or existing drainage channels at a controlled

rate to ensure adequate attenuation is provided. As an open channel practice on 'C' soils, 20% of the provided WQv is applied towards the RRv.

RRv Summary

The RRv goals and the minimum RRv requirements were calculated in accordance with the equations and methodologies presented in Section 4.3 of the Manual, utilizing the 1.1 inch storm event required by DEC. A summary of the WQv and RRv by drainage area is included in Tables 1 and 3 in Appendix C. Detailed supporting calculations can be found in Table 2, also in Appendix C. The calculations show that the minimum RRv is met in every drainage area, and in some area 100% of the RRv requirement is met. Justification evaluating the use of each green infrastructure technique and site limitations is presented in the paragraphs above. Based on this information the project meets the RRv requirements.

Remaining Water Quality Volume

Micropool Extended Detention Ponds (P1) and Wet Extended Detention Ponds (P3) are used to treat the remaining WQv from the drainage areas contributing to those practices. In all cases, the WQv requirements for the DEC 1.1 inch storm and DEP 2.8 inch storm are met. The ponds are typically designed with a forebay, a micropool or permanent pool, and a controlled release structure that regulates discharge from the pond. Emergency spillways or weirs are also provided. See sheet L8.01 in the SDEIS plan set for details. Treated water is discharged from the ponds to conveyance swales or existing drainage channels at a controlled rate to ensure adequate attenuation. Detailed supporting calculations listing required and provided WQv can be found in Table 2, Appendix C. Based on the plans and supporting calculations, the necessary WQv for both the 1.1 inch (DEC) and 2.8" (DEP) storm events is provided, and therefore the requirements are met.

Volume and Peak Rate Control

Channel Protection Volume (CPv)

Stream Channel Protection Volume (CPv) requirements are designed to protect stream channels from erosion, by providing 24-hour (12-hour in trout waters) extended detention of the one-year, 24-hour storm event. For this project, the 1-year event is **2.8 inches** as per Figure 4.4 of the Manual. The required CPv is calculated utilizing the Plug Flow Calculation in HydroCAD (TR-20) or the figures and calculations, (TR-55) in Appendix B of the SMDM. The CPv requirements are typically met using Micropool Extended Detention Ponds and Wet Extended Detention to provide the necessary attenuation. A summary of the required and provided CPv and supporting calculations can be found in Tables 5 and 6, Appendix C. Where detailed calculations are not provided, refer to the plug flow detention time listed in the HydroCAD report (Appendices E, F and G). Based on the plans and supporting calculations, the CPv requirements are met.

Overbank Flood (Qp) and Extreme Flood (Qf) Control

The primary purpose of the Overbank Flood (Qp) control sizing criterion is to prevent an increase in the frequency and magnitude of out-of-bank flooding generated by urban development. It requires storage and attenuation of the 10-year, 24-hour storm to ensure post-development peak discharge rates do not exceed the pre-development condition. For this project, the 10-yr event is **6.0 inches**, as per Figure 4.5 of the SMDM.

In addition to DEC requirements, a local and DEP requirement is the analysis of the 25-Year Design Storm to ensure peak rate attenuation. For this project, the 25-yr event is **6.5 inches**.

The intent of the Extreme Flood (Qf) criteria is to (a) prevent the increased risk of flood damage from large storm events, (b) maintain the boundaries of the pre-development 100-year floodplain, and (c) protect the physical integrity of stormwater management practices. It requires storage and attenuation of the 100-year, 24-hour storm to ensure post-development peak discharge rates do not exceed the pre-development condition. For this project, the 100-yr event is **8.0 inches** as per Figure 4.6 of the SMDM.

For this project, the 25-year storm, Qp and Qf requirements listed above are met using Micropool Extended Detention Ponds (P-1), Wet Ponds, (P-2) and standard Detention basins (no treatment, attenuation only) to provide the attenuation necessary to match the pre-development conditions. Stormwater is routed by conveyance swales, closed system piping or overland sheet flow to these Detention Ponds where it is stored for a period of time and released at a controlled rate through a controlled release structure, and/or over a broad crested weir. Treated storm water is typically discharged from the ponds directly to existing drainage courses, or to constructed conveyance swales that distribute the runoff to existing drainage courses. In most cases runoff cannot be discharged as sheet flow due to the presence of slopes over 10 percent. In all cases conveyance swales are constructed with a stabilized surface, such as grass, grass with turf reinforcement mat, cobbles or rip rap, designed to support anticipated velocities without experiencing erosion. The swale surface materials along with the proposed grading controls flow rates.

All of the project data and calculations mentioned in previous sections is collected and included in the HydroCAD model, to determine the peak rate flows at each of the design points in the post development condition. This information is then compared to the pre-development rates at each design point to ensure the pre-development peak discharge rates are not exceeded. Refer to Table 7, Appendix C, for a comparison of pre and post-development peak discharge rates and volumes. Based on this comparison, post-development peak discharge rates do not exceed the pre-development condition at any of the identified design points, and therefore the requirements are met.

Comprehensive Management Plan

Using the design process described above, the proposed techniques and stormwater management practices are incorporated into the overall project design. The Grading and Drainage Plans, supported by the Proposed Subcatchment mapping, (sheets L4.00-4.11 and L5.03-L5.15 in the SDEIS plan set), show how the specific components are integrated into the overall project. Specific descriptions are as follows.

Along the proposed Highmount access road from County Route 49A to the Hotel, stormwater is primarily collected in catch basins and conveyed through a closed pipe system to the detention pond north of the proposed hotel. There is one dry swale north of the hotel that treats runoff from the three buildings west of the Hotel and adjacent paved surfaces. The green roof on the Hotel and Lodge are designed to infiltrate only rainfall that falls directly on the roof. Sheet flow from adjacent areas is directed around the roof areas, and does not enter the green roof system. Any potential overflow or drainage from the green roofs will be routed through the detention pond to the north. The detention pond to the north is a Wet Extended Detention Pond (P-3). Runoff is directed to the Wet Extended detention pond, which will function both as an aesthetic pond and an attenuation device, where it is treated and released at a controlled rate into an adjacent roadside ditch on Route 49A which leads to Design Point 4. The pond is designed with a static water elevation and adequate freeboard to pass the 100-year storm event.

The Leach Farm north of Route 49A utilizes a single bioretention area for treatment and attenuation. Flows are conveyed through a piping system from the building roof and paved areas to a stable outlet before it enters the bioretention area via surface flow. Once treated, stormwater is discharged to a drainage ditch along an existing woods road, which eventually drains to Design Point 1A.

Design Points 2 and 3 have minimal runoff directed to them in the proposed condition, mostly associated with undisturbed areas. Design Points 5, 5a and 6a also have very few changes as a result of the proposed condition, with no runoff from developed areas flowing to the points.

At Wildacres West, runoff is either directed to Design Points 7, 8 and 9, or to the irrigation pond located north of the Front-9 Village at Wildacres East. On the western side of Wildacres west, sheet flow over the proposed golf course is directed to dry swales using grading and shaping of the landform. Runoff is treated in the dry swales and discharged via standard conveyance swales to existing adjacent drainage courses. In this area, existing wooded areas including the existing riparian corridor are preserved to the maximum extent practicable.

Runoff from the first portion of the Wildacres West access road, (Route 49A to the first lodging building), is collected in a series of catch basins and roadside swales, treated in a bioretention area adjacent to the 18th tee, and released into a proposed roadside swale leading eventually to an existing drainage channel. Runoff from the central portion of the access road (first lodging building to the clubhouse), the lodging buildings, the golf course clubhouse and a portion of the clubhouse entry drive are also collected in catch basins and pipes, and conveyed in a closed system to micropool extended detention ponds adjacent to the driving range and the 16th fairway. Stormwater is treated and released from the ponds into conveyance swales, leading directly to an existing drainage course running through the center of the site. Golf course runoff from the central portion of the site is directed via sheet flow to dry swales

using grading and shaping of the landform. Runoff is treated in the dry swales and discharged via standard conveyance swales to existing adjacent drainage courses. These areas drain to Design Points 8 and 9. Runoff from the eastern portion of the access road, (clubhouse to Gunnison Road), the clubhouse parking lot and the 1st hole are also collected in catch basins and roadside swales, and primarily conveyed to a micropool extended detention pond east of the 1st green. Runoff from the rooftop terraces of the Hotel is collected and treated in a series of built in, flow-through stormwater planters, and conveyed to the drainage system leading to the same pond east of the 1st green. Treated water is then released to an existing ditch on Gunnison Road that eventually drains to Design Point 9. The lower portion of the access road is treated in a dry swale behind the 1st green, and released to the same ditch on Gunnison Road.

With the exception of the rooftop terraces, runoff from the Hotel roof, the adjacent parking garage, areas south and east of the Hotel and the 9th hole, is conveyed to the irrigation pond at Wildacres east. Runoff is collected in piping systems and directed to a conveyance swale east of the 9th hole, then under Gunnison Road and the adjacent drainage course in a closed pipe, before being discharged to another surface swale that drains to the irrigation pond.

In the proposed condition, the watershed for Design Point 10 is almost entirely made up of areas outside of the project boundary. The primary drainage course that collects runoff from this watershed has a very small section that crosses the project site in the western corner of Wildacres east. There are no proposed stormwater management practices that discharge to this drainage course or Design Point 10.

At Wildacres East, a majority of the drainage area, along with the portions of Wildacres west noted above, is treated in the irrigation pond. Runoff from the Front-9 Village is directed via sheet flow to a bioretention area in the boulevard of the access driveway, treated, and released through a pipe to the irrigation pond for additional treatment and attenuation. Runoff from the Front-9 Clubhouse and adjacent paved areas is collected in catch basins and also conveyed to the irrigation pond. Lawn areas adjacent to the pond and a portion of the 5th, 6th and 7th holes also drain to the pond. Runoff collected in the pond is stored for re-use as irrigation for the golf course. The pond is designed with sufficient freeboard to treat the required WQv, and provide the necessary attenuation for the 1, 10, 25 and 100-year storm events. Overflow from the pond in severe storm events is conveyed as sheet flow and shallow concentrated flow to a conveyance swale west of the 3rd green, where it is discharged into the existing drainage channel along the railroad bed at the north end of the property, and eventually drains to Design Point 11. Golf course runoff from the 3rd hole and areas north of the irrigation pond is directed via sheet flow to dry swales using grading and shaping of the landform. Runoff is treated in the dry swales and discharged via standard conveyance swales to existing drainage courses along the northern property boundary.

The southern portion of Wildacres east, composed primarily of 7th and 8th holes is the only part of the proposed project within the Ashokan Watershed. Runoff from the golf course is directed via sheet flow to a bioretention area adjacent to the 8th tee using grading and shaping of the landform. Runoff is treated in the bioretention area and discharged in a pipe to the existing drainage ditch along Route 49A.

Overflow from larger storm events will be released over a weir into an adjacent detention basin where it will be attenuated and released at a controlled rate through a pipe into the same drainage ditch along Route 49A, which drains to Design Point 16. Design Point 12 includes only a very small portion of the project area located at the entrance to Wildacres East.

8.0 POST-CONSTRUCTION MAINTENANCE REQUIREMENTS

All operational phase stormwater management practices will be maintained in accordance with the project Stormwater Pollution Prevention Plan required by NYSDEC. This includes, but is not limited to, cleaning of sediment from drainage inlet sumps, removal of sediment from SMPs, cleaning conveyance piping and channels of obstructions, inspection and repair as required of any outlet control mechanisms, and repairing any other detriments in the design that is resulting in the facilities not functioning as intended in the design.

Sediment removed as part of detention basin maintenance will be used on site. As part of golf course maintenance, the application of very thin layers of coarse topdressing to the golf course turf is typical. Much of the materials that will accumulate in the SMP's will be sand from road sanding and other coarse materials. With proper amending, this type of material is suitable for use as topdressing on the golf course.

Two annual inspections will be conducted after completion of the project. They will take place in April and September of each year. Any necessary repairs will occur during the growing season. An annual report will be prepared to report on any maintenance or required repairs.

9.0 CONCLUSION

The stormwater management goals and objectives for this project listed in the introductory paragraph, specifically meeting water quality objectives while at the same time mitigating potential impacts associated with increased stormwater runoff, have been met. The goals are met through the use of thoughtful and careful site planning, preservation of the site's natural resources and environmentally sensitive areas, minimizing development impacts and impervious areas, and incorporating design features such as green infrastructure techniques and standard stormwater management practices that effectively manage stormwater runoff and compliment the overall project design.

Additionally, the information presented above, supporting calculations and project plans demonstrate that the project and associated stormwater management plan has been developed in accordance with the procedures presented in the AIP document 'Exhibit F, Stormwater Quantity and Quality Protocols',

the New York State DEC Stormwater Management Design Manual, (August, 2010), and the Rules and Regulations for the Protection from Contamination, Degradation, and Pollution of the New York City Water Supply and its sources, 10 NYCRR §128-3.9.


10.0 REFERENCES

1. Urban Hydrology for Small Watersheds. Published by the U.S. Soil Conservation Service, Washington, D.C., June 1986.
2. HydroCAD (version 9.10) Stormwater Modeling Software, by HydroCAD Software Solutions, LLC.
3. NYSDEC Stormwater Management Design Manual. Published by the New York State Department of Environmental Conservation, Updated August 2010.
4. Rules and Regulations for the Protection from Contamination, Degradation, and Pollution of the New York City Water Supply and its sources, 10 NYCRR §128-3.9.

G:\Proj-07\07074_Crossroads\07074hydrocad\Storm Report\07074_Stormreport-Final.Doc

APPENDIX A

Figures

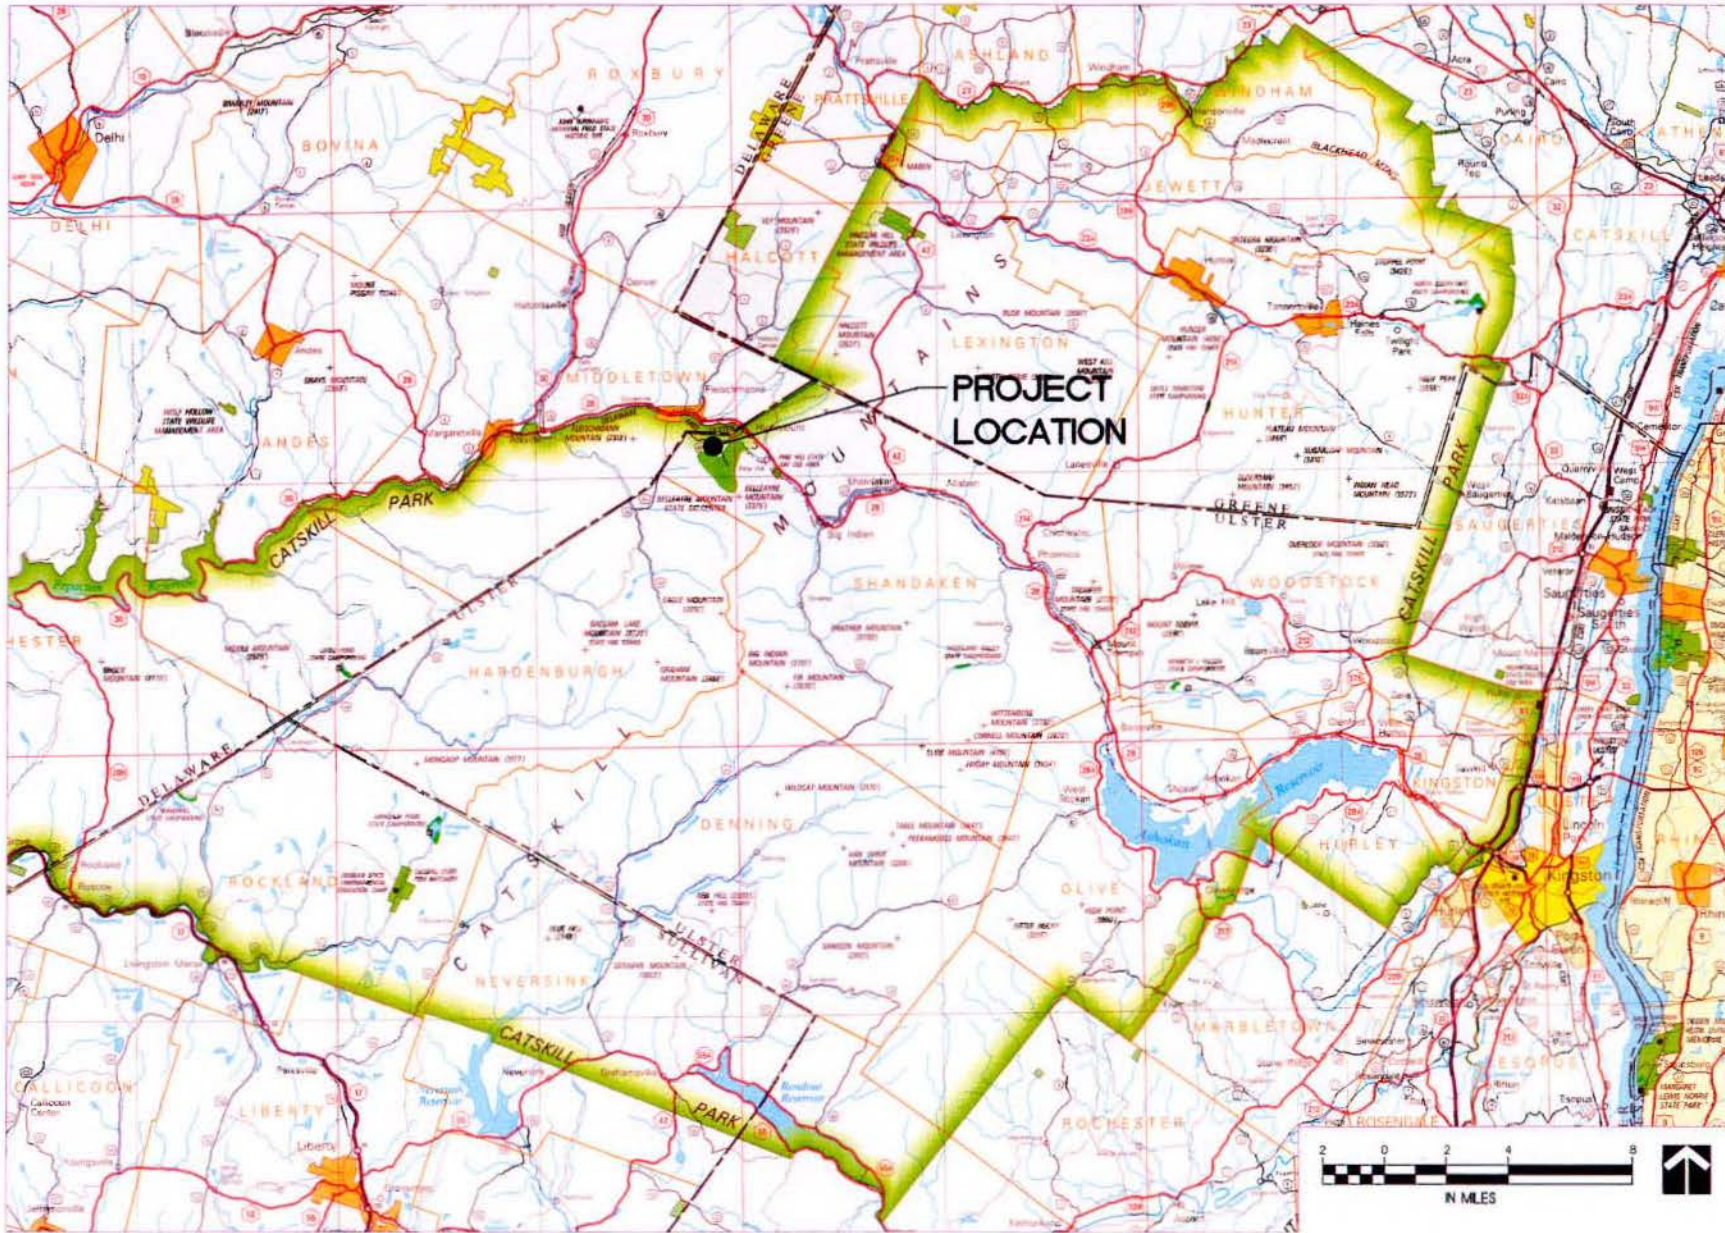

Directory: z:\proj-02\2017\figure\regional.dwg

the LA group
Landscape Architecture
and Engineering, P.C.

40 Long Alley
Saratoga Springs
New York 12861
518/587-8100
Telefax 518/587-8100



Unauthorized alteration or
addition to this document
is a violation of Section
2009 of the New York State
Education Law.

© the LA Group 2009

BELLEAYRE
RESORT AT
CATSKILL
PARK

REGIONAL
LOCATION
MAP

Project: 00052
Date: _____

FIG. 1


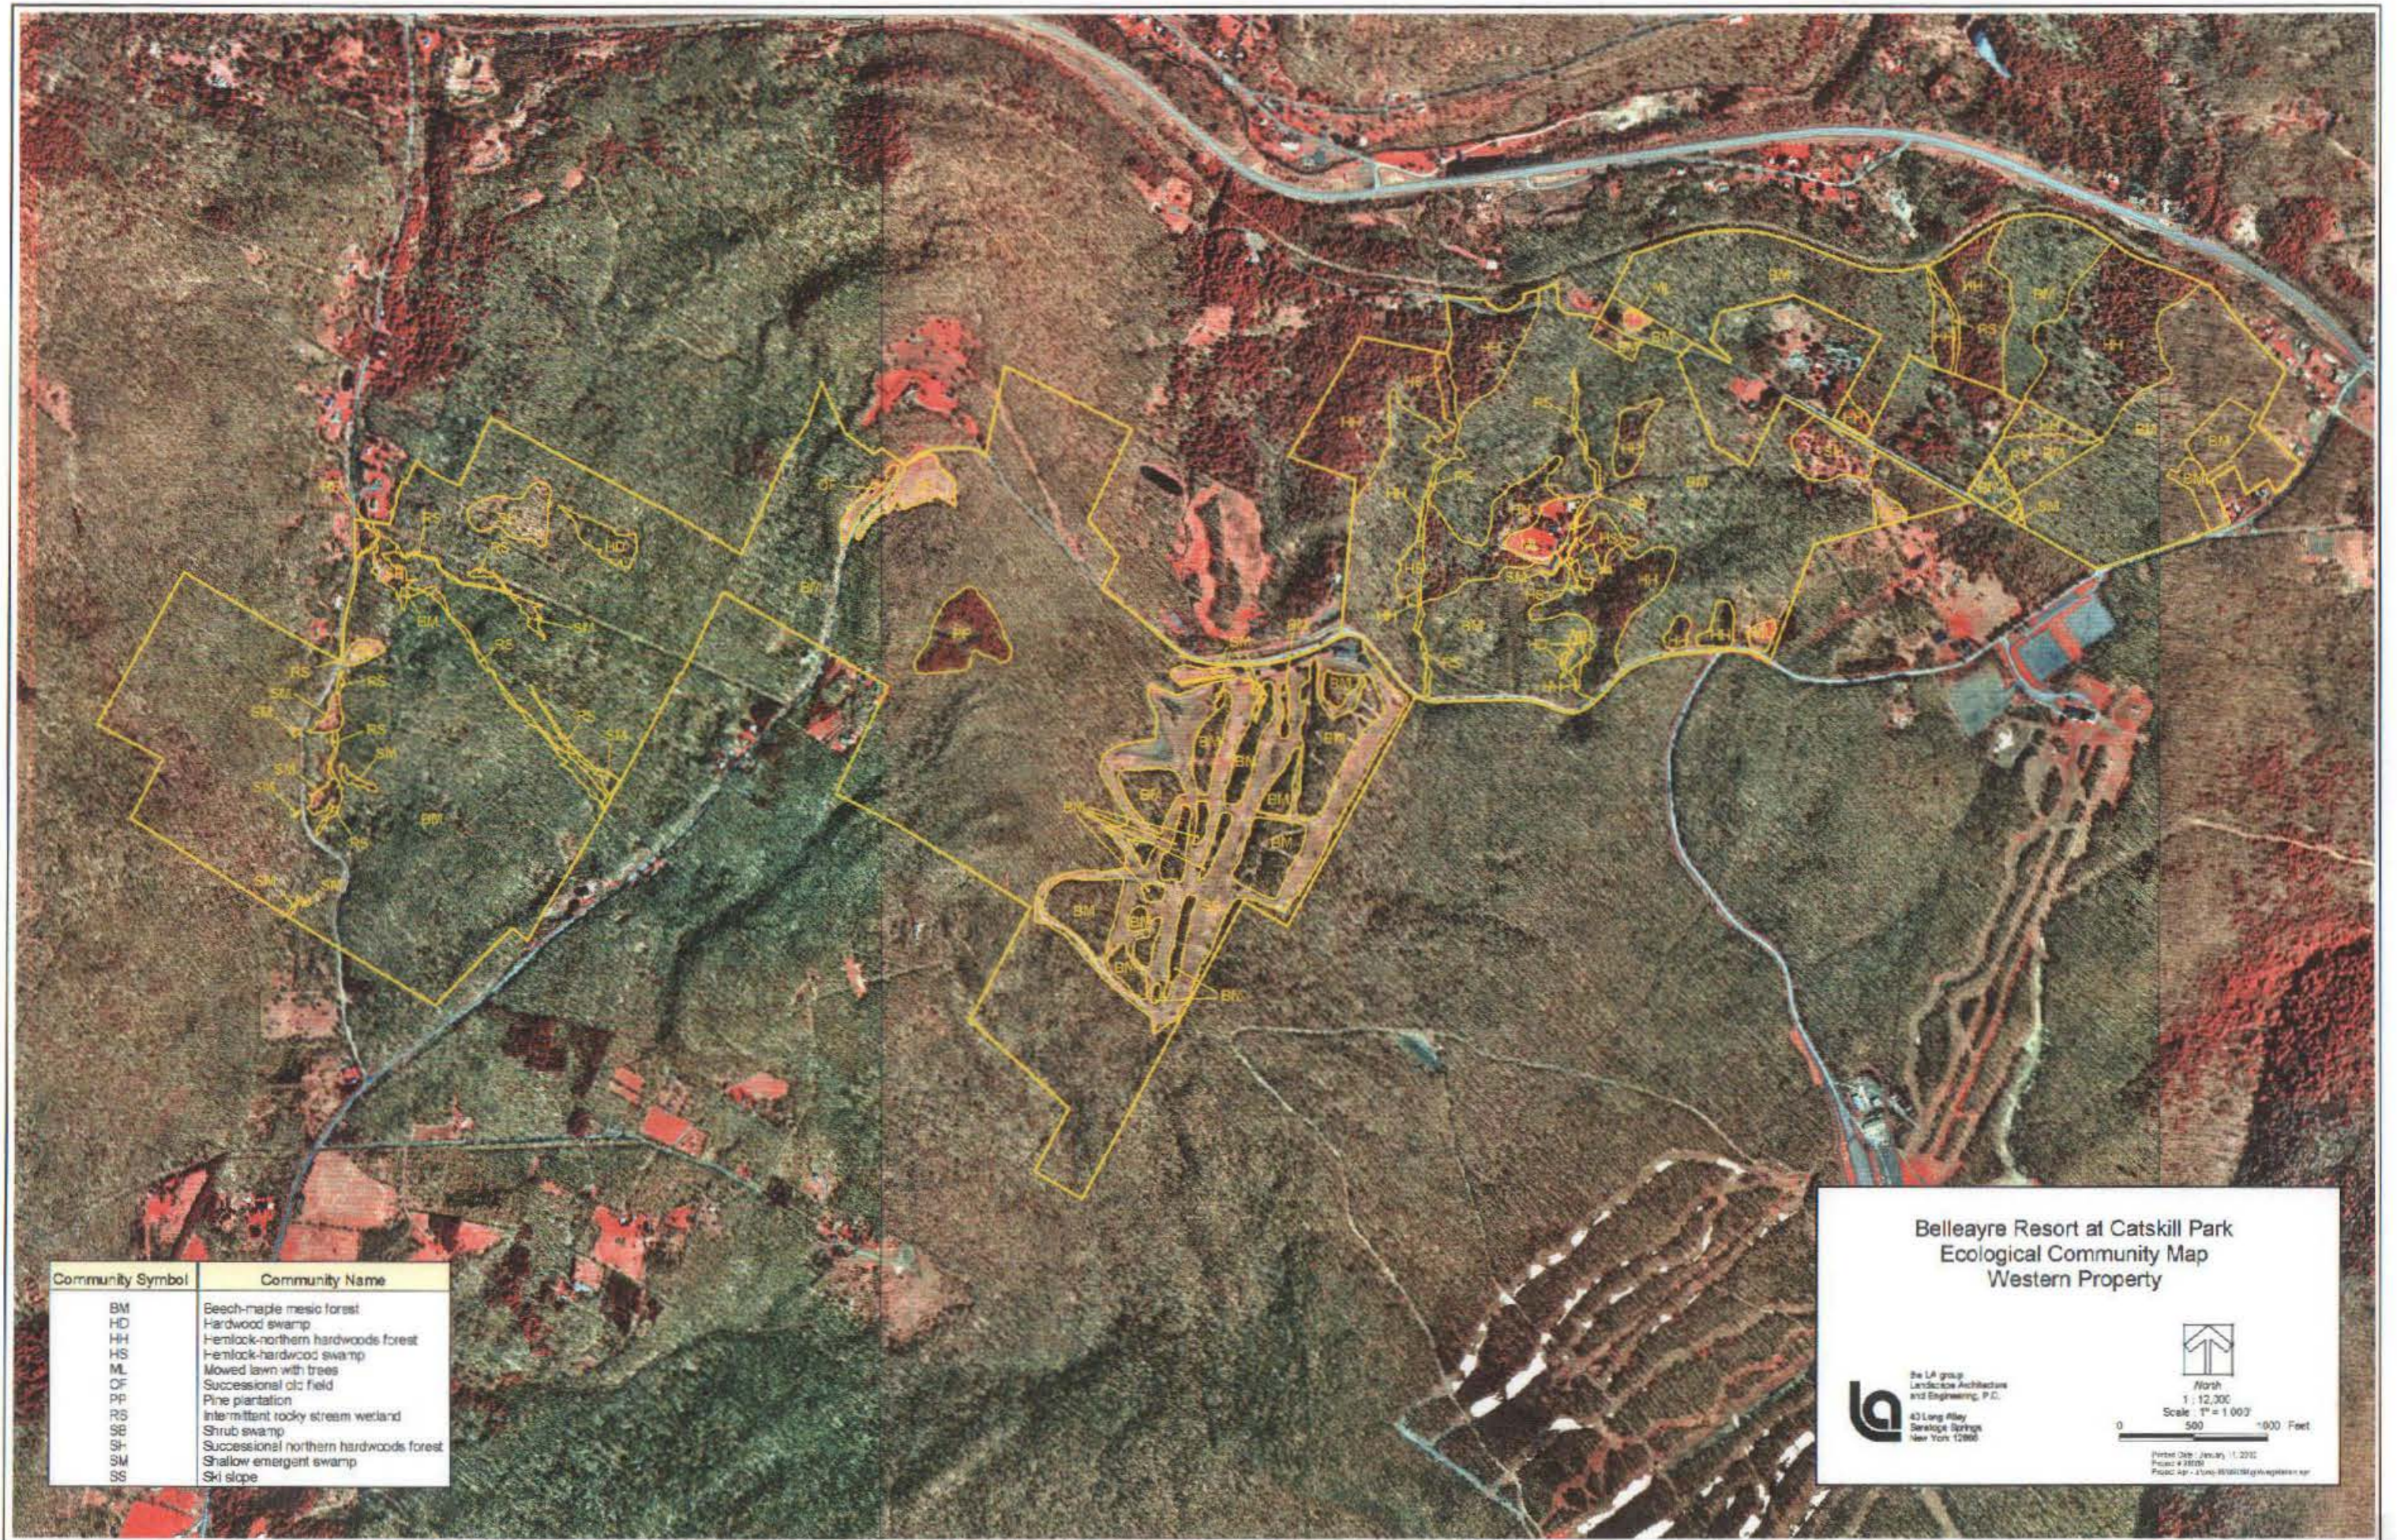


FIG. 2

90% Rainfall in New York State

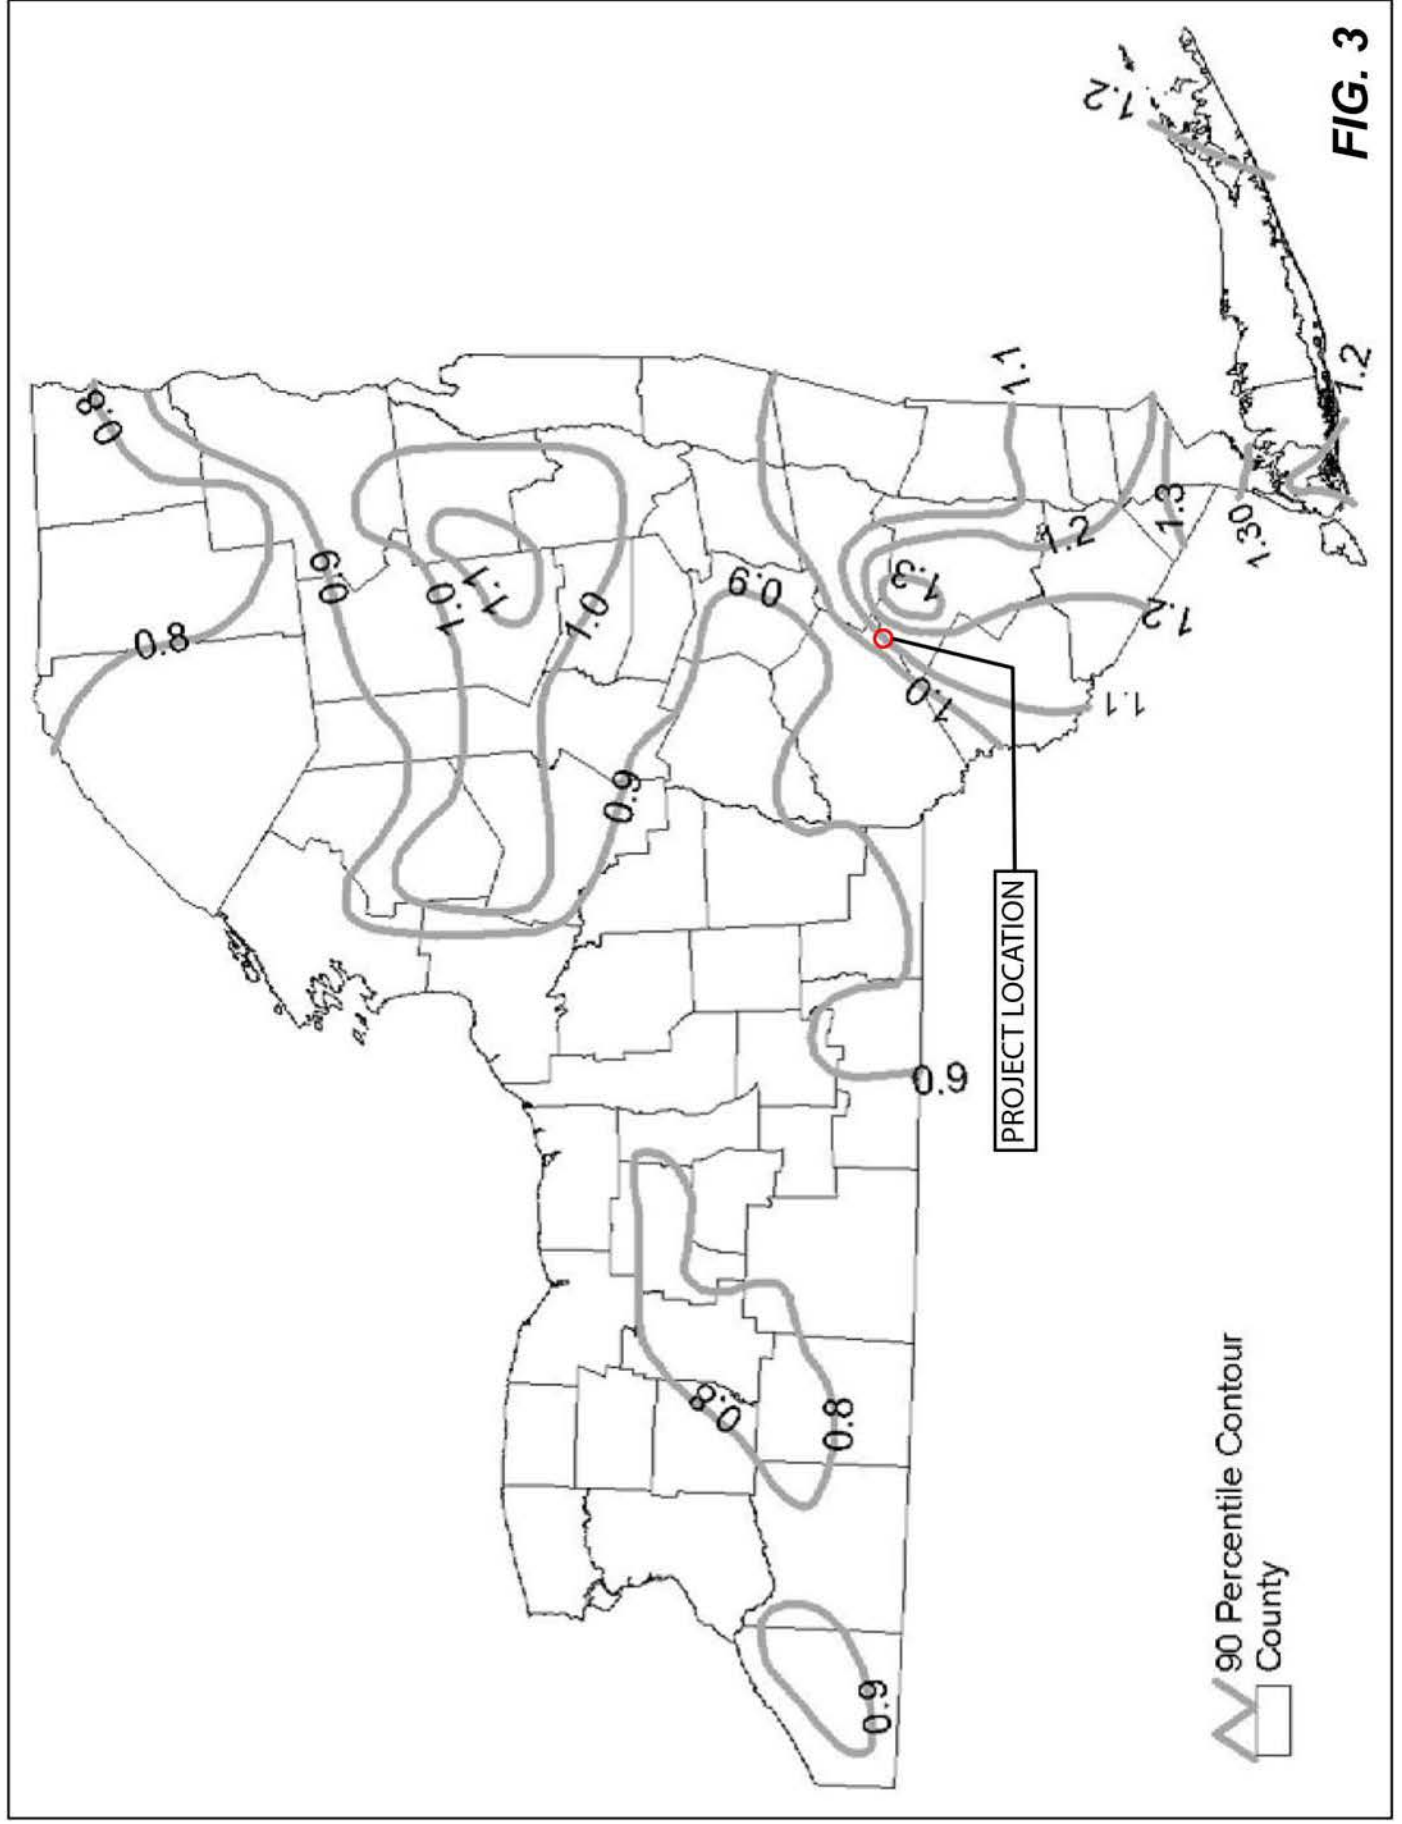

APPENDIX B

AIP Exhibit F - 'Stormwater Quantity and Quality Protocols'

‘AIP APPENDIX F’

**CROSSROADS SETTLEMENT DISCUSSIONS
BELLEAYRE RESORT AT CATSKILL PARK
WILDACRES AND HIGHMOUNT
STORMWATER QUANTITY AND QUALITY PROTOCOLS**

The following provides the proposed methodologies to be employed and assumptions that will be used for advancing stormwater management design¹ for Wildacres resort and the alternative development plan for the lands that were formerly Highmount Estates.

A. Model Used

The Stormwater Model that will be used is the; HydroCAD Stormwater Modeling System, Version 7.1 or higher, by Applied Microcomputer Systems. The SCS TR-20 method will be utilized.

B. Storms Analyzed

The intensity of rainfall varies considerably during a storm as well as over geographic regions. To represent various regions of the United States, SCS developed four rainfall distributions (I, IA, II, and III) from available National Weather Service duration-frequency data. Type II is the type of storm that SCS has mapped for the Crossroads assemblage. Type II represents the most intense, short duration rainfall of the four different distributions.

The storms analyzed are those specified in the August 2003 New York State Stormwater Management Design Manual (the Manual). Those storms are:

1. The Water Quality volume, the 90% rainfall event totaling 1.3 inches as per Figure 4.1 of the Manual.
2. The Channel Protection Volume, 1-Year, Type II Design Storm having a 24-hour rainfall total of 3.5 inches as per Figure 4.4 of the Manual.
3. The Overbank Flood Control Volume, 10-Year, Type II Design Storm having a 24-hour rainfall total of 6.0 inches, as per Figure 4.5 of the Manual.
4. The Extreme Storm, 100-Year, Type II Design Storm having a 24-hour rainfall total of 8.0 inches as per Figure 4.6 of the Manual.

¹ This document, and all future stormwater design for the proposed project, will meet or exceed NYSDEC SPDES General Permit 02-01 requirements, the NYSDEC Design Guidelines, and the New York Standards and Specifications for Erosion and Sediment Control. As a result, general comments contained in Charles D. Silver’s documents “Technical Comments on the Camarda Park Proposal to the Town of Carmel, NY” dated July 1, 2005 and SEQRA Comments of the New York City Watershed Inspector General to the Town of Patterson Planning Board” dated September 25, 2006 will be met.

5. The 25-Year Design Storm having a 24-hour rainfall total of 6.5 inches. The inclusion of this storm is a local and DEP requirement and will be required as the project moves through the respective reviews.

C. Identification of Design Points

A revised pre-development model will be created for use in predicting stormwater runoff at the proposed Design Points. Revised Design Points have been identified at points of interest where flows can be easily determined, locations that are down gradient of proposed development, and as close as possible to the areas of proposed development. Revised Design Points were identified during fall of 2006 field investigations and inspected again in the spring of 2007.

Design Point	Structure Type	Location
1	Drop inlet with 24" Smooth Steel Pipe	± 380' upgradient from mountain stream in village
2	Drop inlet with 24" Smooth Steel Pipe	± 720' upgradient (east) from Design Point 1
3	Drop inlet with 24" Smooth Steel Pipe	± 1920' upgradient (east) from Design Point 2
4	Drop inlet with 24" Smooth Steel Pipe	± 1040' upgradient (east) from Design Point 3
5	Drop inlet with 24" Smooth Steel Pipe	± 1100' upgradient (southeast) from Design Point 4
6	Drop inlet with 24" Smooth Steel Pipe	± 420' upgradient (southeast) from Design Point 5
7	4' x 3' Stone Culvert	± 70' downgradient (north) from Gunnison Road
8	(2) 18" Smooth Steel Pipes	± 190' downgradient (north) from Gunnison Road
9	2' x 3' Stone Culvert	± 890' downgradient (north) from Gunnison Road
10	5' x 8' Stone Culvert	± 1405' downgradient (north) of Gunnison Road
11	2' x 3' Stone Culvert	± 2105' downgradient (north) of Gunnison Road
12	CB w/ 24" CMP	At Intersection of Van Loan Road & Rte. 49A
13	12" Smooth Steel Pipe	Along Rte. 49A (below Highmount)
14	12" Smooth Steel Pipe	Along Rte. 49A (below Highmount)
15	12" Smooth Steel Pipe	Along Rte. 49A (below Highmount)

D. Pre-Development Subcatchment Mapping

Once the Design Points are chosen, individual subcatchments are derived from field observation and mapped data. The individual subcatchments include;

1. Areas of cover type taken from air photos and field observation, and vegetation community type mapping derived from field observation.
2. Soils types compiled from on-site high intensity soils mapping.
3. Time of concentration flow paths based on existing conditions and mapping. These will begin with a sheet flow segment, transitioning to shallow concentrated flow and channel flow where these conditions exist. Channel conditions were determined by field observation, and the position and orientation of channels was established using GPS data.

E. Proposed Flow Paths

The flow paths within each subcatchment have been field verified to include existing culvert sizes and pitches, the geometry, cover type and slope of existing swales or ditches and the condition of cover types for sheet flow and shallow concentrated flow components. Reach segments will be included to link individual subcatchments together to create a path to the individual design points. Reaches will be described in a similar fashion as the time of concentration segments. A separate reach will be described for every significant change in cover type, slope or geometry.

These factors will combine to create a pre-development HydroCAD Model that will accurately predict the existing hydrology.

F. Proposed Methodology

The proposed stormwater management plan for the sites will be developed in accordance with the guidelines established in the Manual and the Rules and Regulations for the Protection from Contamination, Degradation, and Pollution of the New York City Water Supply and its sources, 10 NYCRR §128-3.9. The primary design goal is to meet the water quality objectives as discussed in the Manual. In order to achieve the primary goal of meeting water quality objectives, while at the same time mitigating potential impacts associated with increased stormwater runoff, the design of the stormwater management system will follow the guidelines presented in the Manual and 10 NYCRR §128-3.9.

The proposed ponds will be located in close proximity to the golf course and other proposed facilities and in locations that provide the best opportunity for treatment and flow attenuation. Subcatchments will be created around areas that contribute to the individual basins or proposed points such as catch basins or culverts. The subcatchments will be linked by reaches, which will be modeled, including pipes, culverts, swales and any facilities that will transmit runoff. The proposed flows associated with the five design storms will be treated and attenuated at or below the pre-development rates at each design point.

G. Construction phasing

This project is being administered under an individual industrial permit for construction stormwater discharges. The permit will be issued following a detailed evaluation by NYSDEC. Specific discharge points will be identified for water quality monitoring. An annual report will be prepared to report on any necessary maintenance or repairs.

The individual stormwater permit process incorporates a control program for both construction and operational phases of the project. During construction, temporary basins will be sized for the 10-year event and clean water will be diverted or protected during construction. A rigorous phasing and subphasing program is being implemented that incorporates rapid revegetation. Enhanced stormwater controls, including reinforced silt fence, extensive use of rolled erosion control products, temporary tarps to cover soil, wood cellulose bonded fiber matrix products

(Eco Aegis, Eco Fibre, Soil Guard), along with an independent work force to repair temporary stormwater facilities will be implemented. These types of construction phase measures are conceptually presented in materials prepared by Charles Silver (see Footnote 1 on page 1).

The stormwater modeling is making use of extensive site-specific soils data and regional information on runoff quality and quantity.

The following goals will be met by the construction phasing and erosion control/sediment control program:

1. Land disturbance will be divided into small compartments that can be rapidly constructed and stabilized.
2. Where possible, water flowing from areas up-slope of construction will be diverted away or around exposed construction areas to limit erosion and pollutant loading into relatively clean water.
3. Construction will be sequenced to maximize immediate permanent stabilization and utilize effective temporary stabilization where and when necessary.
4. The extent of areas of unstabilized soils are reflected in the phasing plans attached as an exhibit to the Agreement in Principle. Unstabilized areas will always be protected with enhanced erosion control measures in place. Construction phasing will attempt to disturb only 15 to 18 acres per phase.
5. The erosion control program will dictate the construction sequencing.

The construction phasing and erosion control plans will protect local surface water resources and the New York City drinking water supply, while at the same time allowing for the construction of the project to occur in a logical and controlled manner in a timeframe that does not make the construction of the project economically unfeasible.

The golf course at Wildacres is proposed to be built in a two-year period. A substantial amount of sod is proposed to be used. If enough sod is available and the timing is correct, 9 holes are proposed to be opened in the second year of development.

Central to the understanding of the overall process is the hierarchy of project phases, subphases or stages, and subcatchments.

- a. Phases – Phases represent various components of the Wild Acres project.
- b. Subphases or Stages – All subphases will have balanced cuts and fills. Some subphases will include the “transition areas” that tie together some contiguous golf holes (i.e., tee/green complexes, tee complexes, green complexes). It is important that these areas be graded at the same time in order to accurately create the golf course the way it was designed by the golf course architect.

- c. Subcatchments – Each subphase includes subcatchments (which relate to the HydroCAD model). The subcatchments form the basis for designing the permanent and temporary, construction phase retention basins.

The phasing below describes a sequence for typical golf course construction. Simultaneously, work will continue at the hotel site.

Temporary sediment basins and other sediment controls will be installed in accordance with the construction details, stabilized and functional prior to mass earthwork.

d. General Construction Phases

- (1) Construction stakeout and golf course centerline stakeout for entire phase.
- (2) Centerline clearing for Subphase 1.
- (3) Construction access and perimeter control for Subphase 1.
- (4) Temporary basins rough grade and stabilized in Subphase 1.
- (5) Tree harvest without grubbing in Subphase 1.
- (6) Stump grub, fine grade stormwater basins and stormwater swales, stabilizing swales with rock or geotextile in Subphase 1.
- (7) Rough and final grade Subphase 1.
- (8) Install permanent irrigation lines in Subphase 1.
- (9) 9A. Stabilize Subphase 1 with temporary measures as specified, and
- (10) 9B. Perform Steps 2, 3 and 4 in the Subphase 2.
- (11) Upon completion of temporary stabilization of Subphase 1, repeat Steps 5-8 in Subphase 2.
- (12) After permanent irrigation lines are installed in Subphase 2 immediately topsoil, install irrigation heads and install permanent stabilization (sod/seed) in Subphase 2.
- (13) Continue topsoiling and permanently stabilize into Subphase 1 which was previously temporarily stabilized.
- (14) Perform Steps 2 and 3 in the Subphase 3.
- (15) When a portion of Subphase 1 requires topsoiling and final stabilization, clear, but don't grub, a portion of Subphase 3.
- (16) After Subphase 1 is completely permanently stabilized, construct Subphase 3 through temporary stabilization (Steps 4 through 9A).
- (17) Continue construction through Subphases 4 then 5 and 6 using the same sequence described above for Subphases 1, 2 and 3.
- (18) Upon establishment of permanent cover, remove temporary drainage swales and basins. Convert appropriate temporary basins to be utilized during operations to their permanent condition (by Subphase).
- (19) Stabilize all remaining disturbed areas (by Subphase).
- (20) Remove perimeter erosion control after vegetation stabilization is established (by Subphase).

Whenever disturbed soil in an area in excess of 5 acres is to be left open for more than 7 days, temporary surface stabilization measures, including rapid mulching will be applied. In areas of disturbed soil less than 5 acres in size, the 14-day requirement would apply. If irrigation water is not yet available near the completion of any subphase, apply temporary stabilization measures such as high tack wood fiber bonded matrix (tackifier) and move to next Subphase. Minimal areas will be disturbed, and by phasing the project in this manner, the construction sequence can limit exposed soils yet progress in a logical fashion.

It is anticipated that construction work will occur six days a week and many activities will occur 10-12 hours daily especially during June and July in order to accomplish this segmented construction process within the construction season.

H. Sediment and Erosion Control Protocol

Central to the construction phasing and erosion control plan are a number of factors designed to mitigate potential impacts commonly associated with construction projects that involve large amounts of earthwork activities. These include:

1. Perimeter erosion control will be installed at the current work area prior to site disturbance.
2. All of the relatively small compartments of construction and soil disturbance will have temporary sediment basins designed to capture and hold all runoff from a storm with the volume and intensity that can be expected to occur from a 10-year, 24-hour, type II storm.
3. The runoff water captured in the temporary stormwater basins will be treated with Chitosan® flocculent to reduce stormwater turbidity prior to dewatering the stormwater basins when deemed necessary by the Erosion Control Superintendent. The Erosion Control Superintendent will notify the Independent Stormwater Monitor (Independent Monitor) that Chitosan® is being used. Use of Chitosan® will conform to the following requirements:

Water Treatment Chemical (WTC) Authorization (Draft SPDES Permit NY 027 0661)

The permittee is authorized to use Storm Klear Liqui-Floc (chitosan acetate) during construction periods only, for the treatment of stormwater which accumulates in any stormwater management pond, provided the following conditions are met.

Dosage – Runoff water collected in ponds shall be treated with chitosan based on the turbidity level and quantity of water being treated, at doses which result in a maximum concentration for the appropriate turbidity range, as follows:

<u>Pond Turbidity</u>	<u>Maximum Pond Concentration (mg/l)</u>
100-400	1.0
400-1400	1.1
1400-2400	1.2
2400-3400	1.3
3400-4400	1.4
4400-5000	1.5

Discharge – Stormwater treated with Storm Klear Liqui-Floc shall be discharged in accordance with the following requirements:

- No treated stormwater may be directly discharged to any surface water under any conditions.
- No treated stormwater may be discharged which exceeds a 50 NTU turbidity value, in any manner.
- Whenever possible, treated stormwater must be transferred from a stormwater management pond to an Irrigation Pond for future irrigation purposes.
- Stormwater which cannot be transferred to an Irrigation Pond, due to insufficient capacity or for any other reason, must be discharged to the ground (overland flow) at a location which is at least 300 feet from the nearest surface water, including intermittent streams, in an area which is fully vegetated at the disposal location and over the entire pathway to the surface water.
- Discharge of the treated stormwater to land must be performed in a manner which results in even and controlled distribution of the stormwater, and which will not result in scouring, channelization, or erosive velocities.

No other WTC may be used by the permittee without prior authorization, on a case-by-case basis, by the Department.

4. Temporary stabilization will be widely implemented during the construction process so that the amount of active construction and unstabilized soil never aggregates more than that presented in the construction phasing plans attached as an exhibit to the Agreement in Principle.
5. Erosion control measures and practices will be kept in place until the areas that they serve are permanently stabilized.

The following provides a description of how these plans will be implemented.

- a. There will be a dedicated erosion control team of 4 to 6 people plus supervisory personnel (Erosion Control Superintendent), whose primary role will be repairing, maintaining and upgrading erosion control devices such as silt fence, construction fence and wattles. These crews will be equipped with all the necessary equipment and supplies necessary to effectively maintain the erosion control devices. The site work contractor will install all

erosion controls and will also be responsible for maintaining the temporary sediment basins under the direction of the Erosion Control Superintendent.

- b. These crews will be directed by the Erosion Control Superintendent who will be a Certified Professional in Erosion and Sediment Control. The Independent Monitor will have the stop-work authority set forth in the Agreement in Principle.
- c. The Erosion Control Superintendent and the crew under their direction will not be employed by the site work contractor, but will be under independent contract to the developer and report directly to the developer's on-site representative.
- d. The site work contractor, as directed by the Erosion Control Superintendent will be responsible for constructing and structurally maintaining the construction phase sediment retention basins that will be constructed site-wide.
- e. The Erosion Control Superintendent will be the single point of contact for all issues related to on-site erosion and sediment control. This individual will be responsible for implementation of the construction pollution prevention plan, monitoring of the local watercourses during the construction process, and oversight on the progress of the construction project.

Given the complexity of the plan to construct the site it will be necessary to have a comprehensive process to share information on the construction process. A constant update of the construction process will be necessary. The contractors will have to closely monitor daily progress as it relates to all the construction tasks from site clearing to final grading. A common set of electronic plans will have to be maintained at a central location that is updated on a frequent basis in order to maintain accurate and up-to-date stormwater control reports.

Along with the administrative staff it can be anticipated that a significant amount of personnel time will have to be expended to carry out the monitoring requirements on the watercourses and of the stormwater control facilities including the retention basins along with the perimeter controls. Status reports on erosion control facilities as well as the water quality monitoring data will have to be compiled at a central location.

- f. All contractors and subcontractors are required to sign the SWPPP and adhere to its protocol. This ensures deliberate implementation of stormwater controls as the SWPPP is a contractual agreement.

Overall project phasing designed to control erosion by limiting the amount of construction at any given time.

The following are measures proposed to mitigate potential erosion.

- (1.) Construction will be phased over a multi-year time period so as to reduce the amount of disturbed soil at any given time. Work on subsequent Phases will not begin until the area in the previous Phase is stabilized. Likewise, work on a subsequent subphase or stage will not begin until the area in the previous stage is nearly all stabilized (last 5 acres being stabilized).
- (2.) Temporary sediment basins will be located throughout the proposed development. These basins will be sized to capture and hold the runoff from a 10-year storm of 6 inches in 24 hours falling on bare soil.
- (3.) Fairway drains will be installed during construction, and during construction these drains will consist of a perforated standpipe surrounded by a gravel/rock jacket all surrounded by perimeter silt fence. These fairway drains will be piped to temporary sediment basins that will be converted to operational phase basins. During final stabilization the silt fence and stone/gravel jacket will be removed, the standpipe cut flush with finished grade and a grate placed over the inlet to the drain pipe.
- (4.) Any areas of disturbed soils or soil stockpiles that will not be worked on for a period of fourteen (14) consecutive days will be temporarily stabilized by hydroseeding with ryegrass and mulch. Preferred mulch materials are Eco Aegis® and Soil Guard®.
- (5.) Sod will be used in many areas to provide more rapid stabilization. Approximately 50 acres of sod will be used for golf course construction.
- (6.) Erosion control products will be chosen based on their suitability for the different slopes. Temporary stabilization will be widely utilized during the construction process to limit exposed soils in accordance with the phasing plan.
- (7.) The permanent irrigation system will be used where and when necessary to supplement precipitation and promote rapid germination and rooting of seeded and sodded areas. If irrigation water is not yet available, apply temporary stabilization measures as specified and move to next stage.
- (8.) NYCDEP will continue to monitor surface water on and around the Crossroads assemblage during and after construction. Any decreases in water quality that can be attributed to the proposed project will result in changes in construction or operations of the project in order to immediately restore local water quality.
- (9.) All erosion control measures will be maintained in good working order; if repair is necessary, it will be initiated within 24 hours of report.
- (10.) Built up sediment will be removed from silt fence when it has reached one-third the height of the fence.

- (11.) Silt fence will be inspected for depth of sediment, tears, to see if the fabric is securely attached to the fence posts, and to see that the fence posts are firmly in ground.
- (12.) All temporary sediment basins will be inspected for stability and integrity once a week or after a storm event of 0.5 inch or more. Any structural failure in sediment basins or trenches that serve them will be repaired within 24 hours after detection.
- (13.) All temporary sediment basins or trenches shall be cleaned out when one foot of sediment or half the design depth of the trap has accumulated. All spoils shall be removed to a stabilized upland area.
- (14.) Seeded and planted areas will be inspected for bare spots, washouts, and healthy growth. If necessary, spot reseeding or sodding will be implemented.
- (15.) A maintenance inspection report will be made after each inspection. Reports will be compiled and maintained on-site.

I. Pollutant loading protocol

1. Sedimentation Basins

Temporary stormwater detention basins will be constructed throughout the area of construction and will be large enough to capture and hold all of the runoff from the 10-year design storm.

Where necessary as approved by the Independent Monitor, basins will be pumped out to the irrigation ponds. Where this is not feasible due to distance and/or topography, the method to empty these basins will be to discharge the water to a spreader pipe laid out in the undisturbed wooded areas below the basins. The spreader pipe will be a four to six inch perforated coil drain pipe with a filter fabric sock around the pipe. The filter fabric sock will reduce spray from the pipe and reduce the potential for undermining the pipe or creating erosion. The sock will also allow the system to act as a soaker hose. The wooded area will polish the stormwater to assure that effluent quality will meet the ambient conditions of the local watercourses. A plan has been developed that allows for the basin dewatering to occur at rates that are the same or less than runoff rates that occur under existing conditions. Dewatering the basins at these rates will prevent erosion in the forested areas below the level spreaders from which dewatering discharges will be made.

2. Water Quality

The project is located within the watershed of one of New York City's water supply reservoirs, the Pepacton Reservoir, therefore the impacts that may result from increased nutrient loading to this Reservoir will be evaluated. Two sources are considered to cumulatively contribute to the overall nutrient export that may be expected from the project development, golf course fertilization and stormwater runoff.

The goal of the project's stormwater management program is to manage runoff water quality to minimize nutrient or contaminant export or closely match pre-development stormwater quality. This will be accomplished by locating stormwater management facilities throughout the project site and by maintaining a low density of development.

The stormwater management system will be composed of appropriate practices for water quality maintenance such as ponds, filtering practices, infiltration practices, and channels. Open channels on slopes over 15% will be rock lined to better manage the velocity of the runoff by providing rough channels.

The proposed pond designs will provide for settling while at the same time minimizing standing water to avoid thermal impacts. The ponds tend to be narrow so that the water is shaded as much as possible. Each pond will have multiple outlets to allow for dispersion of the stormwater events accumulated runoff as well as allowing for infiltration of stormwater captured in the detention ponds. It is necessary to release the stormwater in order to avoid thermal loading associated with standing water and to avoid adverse impacts to local coldwater stream life.

3. Phosphorus Loading

To estimate phosphorus loading at Wildacres a direct calculation method was created using site-specific data collected by NYCDEP. The NYCDEP has operated a stream water quality gauging station on the Big Indian site since 2001. Data sets of stream flow and water quality data have been assembled and approved for use up through 2003. In August 2004, the last evaluation of phosphorus loading was complete.

To create the direct calculation, forest runoff characteristics from Big Indian in the undeveloped condition were utilized. To estimate the runoff quality for a developed site, NYCDEP 1997 (Guidance for Phosphorus Offset Pilot Program, March 1997) was consulted to obtain runoff values for developed areas.

The direct calculation found in the attached document "Total Phosphorus Loading Calculations and Comparisons," August 24, 2004 was determined to be the method with the greatest level of consensus among commenting parties.

This direct method calculation incorporates site specific and regional data. A comparison with the NYCDEP 1997 simple method was completed (see Table B, and pages 9 of 36, 13 of 36, 21 of 36, 25 of 36, 29 of 36, Table 3 and Figure 2).

4. DEP Pollutant Analysis

Pollutant loading analyses will also be performed in accordance with 10 NYCRR §128-3.9.

J. Post Construction Stormwater Controls

In general, stormwater control consisting of a series of road side swales, cross culverts, stormwater micropool extended detention basins and bioretention will be used to capture, convey and detain stormwater runoff from the developed portions of the project site. By creating positive drainage through site grading within each of the subcatchments, the proposed stormwater control systems are capable of reducing post-development runoff rates from a 1, 10, 25 and 100-year storm.

No existing surface waterbodies will be impounded. The ponds used to store irrigation water will be isolated dug ponds and not associated with any of the streams or brooks on the project site. Water levels in the ponds can be controlled by irrigation withdrawals and the amount of replenishment provided so that there is always reserve capacity in the ponds to accept runoff from storm events without the ponds discharging to surface water resources. Sufficient freeboard will be maintained in the irrigation ponds so that they can contain the runoff from the 100-year storm from the areas that drain to them.

The stormwater system for the proposed site will utilize on-site storage with outlet devices to regulate the stormwater discharge. The system is designed to discharge from the storage basins to the existing drainageways. The proposed peak runoff for the project is designed to not exceed the pre-development peak runoff conditions for the 1, 10, 25 and 100-year design storm event.

The majority of the stormwater will be directed through proposed detention basins which will control the release rate from the basins. The detention basins will also serve to capture stormwater contaminants and treat the water quality volume.

The objectives of the stormwater management plan will be to:

- Prevent increased runoff from developed land to reduce potential flooding and flood damage.
- Minimize the erosion potential from new construction.
- Increase water recharge.
- Enhance the quality of stormwater runoff to prevent water quality degradation and preserve water quality in receiving water bodies, including City water supply reservoirs.

These objectives will be accomplished through the implementation of the following:

1. Stormwater impacts associated with clearing and grading, along with the development of golf holes, roads and buildings will be mitigated. This will be achieved through the use of devices such as swales, roadside ditches, catch basins, pipes and micropool extended detention basins. The stormwater facilities will control the 25-year, Type II storm event while withstanding the discharge from a 100-year event.

2. The stormwater system for the proposed project will utilize on-site storage with outlet devices to regulate the stormwater discharge. The system will be designed to discharge from the storage basins to the existing drainageways. The proposed peak runoff for the project is designed to not exceed the pre-development peak runoff conditions for 1, 10, 25 and 100-year design event.
3. The stormwater management system for the project will be designed in accordance with the Manual and 10 NYCRR §128-3.9. This includes peak flow attenuation and water quality treatment through control of the water quality volume.
4. The majority of the stormwater will be directed through proposed ponds. These ponds will also serve to capture and treat water quality volume contaminants.
5. The drainage system will be designed so that it will not adversely affect downstream or adjacent properties.
6. A detailed site re-vegetation and stabilization plan will be developed that will re-establish vegetation quickly after final grade is achieved.
7. Implementation of the operational phase Stormwater Management Plan will result in no net increase in runoff volume to existing drainageways.
8. All operational phase stormwater ponds and bioretention will be maintained in accordance with Section 6.16 and 6.46 of the NYSDEC Stormwater Design Manual and the maintenance requirements included with the stormwater management design report. This includes such things as sediment removal, trash racks, and pond drains.

Materials removed as part of detention basin maintenance will be used on site. As part of golf course maintenance, the application of very thin layers of coarse topdressing to the golf course turf is typical. Much of the materials that will accumulate in the detention basins will be sand from road sanding. Therefore this material will be suitable for topdressing material on the golf course.

Two annual inspections will be conducted after completion of the project. They will take place in April and September of each year. Any necessary repairs will occur during the growing season. An annual report will be prepared to report on any maintenance or required repairs.

APPENDIX C

Supporting Calculations and Summary Tables

TABLE 1

The Belleayre Resort at Catskill Park
WQv and RRv Summary

Drainage Area 1a		(cf)
DEC WQv req'd at Design Point		2,466
Adjusted DEC WQv req'd *		1,773
Additional Area reductions?		NO
Adjusted DEC WQv req'd		1,773
Minimum RRv		488
<i>Runoff Reduction Volumes by GI Techniques</i>		
GI Practice		RRv (cf)
Rain Garden		
Green Roof		
Stormwater Planter (infiltration)		
Stormwater Planter (flow through)		
Cistern		
Permeable Pavement		
Infiltration Area		
Bioretention Areas		2,080
Dry Swales		
Vegetated Swale		
Total Runoff Reduction		2,080
Is RRv>WQv?	YES	
Is RRv>minimum RRv?	YES	
Total WQv remaining to be treated		0
WQv provided in standard practices		0
Total WQv provided		5,200

*After removal of areas not draining to an SMP

Drainage Area 4		(cf)
DEC WQv req'd at Design Point		46,517
Adjusted DEC WQv req'd *		45,081
Additional Area reductions?		NO
Adjusted DEC WQv req'd		45,081
Minimum RRv		13,103
<i>Runoff Reduction Volumes by GI Techniques</i>		
GI Practice		RRv (cf)
Rain Garden		
Green Roof		32,076
Stormwater Planter (infiltration)		
Stormwater Planter (flow through)		
Cistern		
Permeable Pavement		
Infiltration Area		
Bioretention Areas		0
Dry Swales		1,680
Vegetated Swale		
Total Runoff Reduction		33,756
Is RRv>WQv?	NO	
Is RRv>minimum RRv?	YES	
Total WQv remaining to be treated		11,324
WQv provided in standard practices		57,000
Total WQv provided		143,084

WQv and RRv Summary

Drainage Area 7		(cf)
DEC WQv req'd at Design Point		30,061
Adjusted DEC WQv req'd *		2,097
Additional Area reductions?		NO
Adjusted DEC WQv req'd		2,097
Minimum RRv		0
<i>Runoff Reduction Volumes by GI Techniques</i>		
GI Practice		RRv (cf)
Rain Garden		
Green Roof		
Stormwater Planter (infiltration)		
Stormwater Planter (flow through)		
Cistern		
Permeable Pavement		
Infiltration Area		
Bioretention Areas		
Dry Swales		3,200
Vegetated Swale		
Total Runoff Reduction		3,200
Is RRv>WQv?	YES	
Is RRv>minimum RRv?	YES	
Total WQv remaining to be treated		0
WQv provided in standard practices		0
Total WQv provided		16,000

Drainage Area 8		(cf)
DEC WQv req'd at Design Point		42,048
Adjusted DEC WQv req'd *		28,686
Additional Area reductions?		NO
Adjusted DEC WQv req'd		28,686
Minimum RRv		5,769
<i>Runoff Reduction Volumes by GI Techniques</i>		
GI Practice		RRv (cf)
Rain Garden		
Green Roof		
Stormwater Planter (infiltration)		
Stormwater Planter (flow through)		
Cistern		
Permeable Pavement		
Infiltration Area		
Bioretention Areas		4,200
Dry Swales		7,433
Vegetated Swale		
Total Runoff Reduction		11,633
Is RRv>WQv?	NO	
Is RRv>minimum RRv?	YES	
Total WQv remaining to be treated		17,053
WQv provided in standard practices		60,500
Total WQv provided		117,882

WQv and RRv Summary

Drainage Area 9		(cf)
DEC WQv req'd at Design Point		22,032
Adjusted DEC WQv req'd *		12,058
Additional Area reductions?		NO
Adjusted DEC WQv req'd		12,058
Minimum RRv		2,604
<i>Runoff Reduction Volumes by GI Techniques</i>		
GI Practice		RRv (cf)
Rain Garden		
Green Roof		
Stormwater Planter (infiltration)		
Stormwater Planter (flow through)		4,373
Cistern		
Permeable Pavement		
Infiltration Area		
Bioretention Areas		
Dry Swales		1,991
Vegetated Swale		
Total Runoff Reduction		6,364
Is RRv>WQv?		NO
Is RRv>minimum RRv?		YES
Total WQv remaining to be treated		5,694
WQv provided in standard practices		29,000
Total WQv provided		38,956

Drainage Area 11		(cf)
DEC WQv req'd at Design Point		62,775
Adjusted DEC WQv req'd *		51,403
Additional Area reductions?		NO
Adjusted DEC WQv req'd		51,403
Minimum RRv		12,566
<i>Runoff Reduction Volumes by GI Techniques</i>		
GI Practice		RRv (cf)
Rain Garden		
Green Roof		
Stormwater Planter (infiltration)		
Stormwater Planter (flow through)		
Cistern (Irrigation Pond)		38,449
Permeable Pavement		
Infiltration Area		
Bioretention Areas		7,200
Dry Swales		5,923
Vegetated Swale		
Total Runoff Reduction		51,571
Is RRv>WQv?		YES
Is RRv>minimum RRv?		YES
Total WQv remaining to be treated		-168
WQv provided in standard practices		126,551 *
Total WQv provided		212,614

*Cistern RRv subtracted from the the total WQv provided in the Irrigation Pond

WQv and RRv Summary

Drainage Area 16		(cf)
DEC WQv req'd at Design Point		6,607
Adjusted DEC WQv req'd *		2,088
Additional Area reductions?		NO
Adjusted DEC WQv req'd		2,088
Minimum RRv		0
<i>Runoff Reduction Volumes by GI Techniques</i>		
GI Practice		RRv (cf)
Rain Garden		
Green Roof		
Stormwater Planter (infiltration)		
Stormwater Planter (flow through)		
Cistern		
Permeable Pavement		
Infiltration Area		
Bioretention Areas		2,757
Dry Swales		
Vegetated Swale		
Total Runoff Reduction		2,757
Is RRv>WQv?	YES	
Is RRv>minimum RRv?	YES	
Total WQv remaining to be treated		0
WQv provided in standard practices		0
Total WQv provided		6,893

The Bellevue Resort at Catskill Park																								
<u>Water Quality Volume Calcs</u>																								
DESIGN POINT	DRAINAGE AREA (AG)	Storm Device	Contributing Subcatchments	total size (sf)	total size (ac)	total imp (sf)	total imp (ac)	I %	DEP	DEC	P	Rv	Min. Rv	Rec'd DEP WQV Acre Ft.	Rec'd DEP WQV Cu.Ft.	DEP-2.8" Rec'd DEP WQV Cu.Ft.	DEC-1.1" Rec'd DEC WQV Acre Ft.	Rec'd DEC WQV Cu.Ft.	Provided WQV Cu.Ft.	Apply Min. Rv Rec'd DEP WQV Cu.Ft.	Rec'd Min. Rv Rec'd DEC WQV Cu.Ft.	Min. RRv Cu.Ft.	*RRv Cu.Ft.	
5	9.41	None/Undisturbed	17	409,995	9.41	6,950	0.16																	
			Total	409,995	9.41																			
5A	13.04	None/Undisturbed	18	568,023	13.04	2,494	0.06																	
			Total	568,023	13.04																			
6	58.47	None/Undisturbed	19	2,546,954	58.47	8,277	0.19																	
			Total	2,546,954	58.47	8,277	0.19																	
6A	41.78	None/Undisturbed	20	1,819,937	41.78	80,499	1.85																	
			Total	1,819,937	41.78	80,499	1.85																	
7	130.68	SWALE S	218	96,418	2.21	0	0.00	0	2.8	1.1	0.050	0.03	0.03	1.125	0.01	442	4.200	840						
			Total	96,418	2.21	0	0.00	0	2.8	1.1	0.050	0.03	0.03	1.125	0.01	442	4.200	840						
		SWALE T	219	78,985	1.81	0	0.00	0	2.8	1.1	0.050	0.02	0.02	921	0.01	362	3.000	600						
			Total	78,985	1.81	0	0.00	0	2.8	1.1	0.050	0.02	0.02	921	0.01	362	3.000	600						
		SWALE U	220	282,188	6.48	0	0.00	0	2.8	1.1	0.050	0.08	0.08	3,292	0.03	1,293	8,800	1,760						
			Total	282,188	6.48	0	0.00	0	2.8	1.1	0.050	0.08	0.08	3,292	0.03	1,293	8,800	1,760						
		None/Undisturbed	2	18,468	0.42	4,400	0.10																	
			35	552,030	12.21	15,783	0.36																	
			200	3,326,419	76.41	14,331	0.33																	
			306	207,504	4.76	0	0.00																	
			307	122,324	2.81	0	0.00																	
			308	346,246	7.95	0	0.00																	
			309	316,725	7.27	13,610	0.31																	
			315	363,440	8.34	0	0.00																	
			Total	5,234,857	120.18	48,124	1.10																	
			Total	5,692,448	130.68	48,124	1.10	1	2.8	1.1	0.058	1.76	1.76	76,518	0.69	30,061								
		Remove Untreated Areas		457,591	10.50	0	0.00	0	2.8	1.1	0.050	0.12	0.12	5,339	0.05	2,097	16,000	3,200						

DESIGN POINT	DRAINAGE AREA (AQ)	Storm Device	Contributing Subcatchments	total size (sf)	total size (ac)	total imp (sf)	total imp (ac)	I %	DEP	DEC	P	Rv	Min. Rv	Reqd DEP WQV Acre Ft.	Reqd DEP WQV Cu.Ft.	DEC-1.1" Reqd DEC WQV Acre Ft.	Reqd DEC WQV Cu.Ft.	Provided WQV Cu.Ft.	Apply Min. Rv Reqd DEP WQV Cu.Ft.	Reqd Min. Rv Reqd DEC WQV Cu.Ft.	Min. RRv Cu.Ft.	RRv Cu.Ft.		
11	89.65		100a	50,494	1.16	0	0.00	0	2.8	1.1	0.050	0.01	0.01	589	231	0.01	231	2,680					536	
		SWALE A2	100b	20,138	0.46	0	0.00	0	2.8	1.1	0.050	0.01	0.01	235	92	0.00	92	1,019					204	
		SWALE A3	100c	33,000	0.76	0	0.00	0	2.8	1.1	0.050	0.01	0.01	385	151	0.00	151	1,938					388	
		SWALE A4	100d	23,704	0.54	0	0.00	0	2.8	1.1	0.050	0.01	0.01	277	109	0.00	109	1,364					273	
		SWALE A5	100e	64,786	1.49	0	0.00	0	2.8	1.1	0.050	0.02	0.02	766	297	0.01	297	3,030					606	
		SWALE F1	111	89,380	2.05	0	0.00	0	2.8	1.1	0.050	0.02	0.02	1,043	410	0.01	410	4,350					870	
		SWALE B	119	146,387	3.36	0	0.00	0	2.8	1.1	0.050	0.04	0.04	1,708	671	0.02	671	6,854					1,367	
		SWALE G	125	161,159	3.70	0	0.00	0	2.8	1.1	0.050	0.04	0.04	1,880	739	0.02	739	8,399					1,680	
		Bio B3	117	237,198	5.45	111,127	2.55	47	2.8	1.1	0.472	0.60	0.60	26,104	10,255	0.24	10,255	18,000					7,200	
		POND IP	61	15,005	0.34	15,005	0.34																	
			67	15,005	0.34	15,005	0.34																	
			70A	20,212	0.46	7,200	0.17																	
			70B	29,474	0.68	7,200	0.17																	
			101	38,707	0.89	7,596	0.17																	
			102	16,073	0.37	16,073	0.37																	
			103	115,694	2.66	53,467	1.23																	
			108	20,760	0.48	17,269	0.40																	
			109	8,280	0.19	6,175	0.14																	
			114	150,302	3.45	0	0.00																	
			115	460,843	10.56	54,674	1.26																	
			123	43,880	1.01	0	0.00																	
			126	74,991	1.72	0	0.00																	
			126A	8,000	0.18	0	0.00																	
			127	448,894	10.31	0	0.00																	
			128	6,878	0.16	6,878	0.16																	
			129	13,760	0.32	13,760	0.32																	
			130	39,147	0.90	9,220	0.21																	
			131	28,363	0.65	17,500	0.40																	
			131A	51,300	1.18	51,300	1.18																	
			132	12,145	0.28	1,650	0.04																	
			133	29,164	0.67	0	0.00																	
			134	6,878	0.16	6,878	0.16																	
			135	18,297	0.42	4,000	0.09																	
			136	45,262	1.04	45,262	1.04																	
			138	13,760	0.32	13,760	0.32																	
			Total	1,731,083	40	369,872	8	21	2.8	1.1	0.242	2.25	2.25	97,869	38,449	0.88	38,449	165,000					38,449	
		None/Undisturbed	12A	550,450	12.64	62,962	1.45																	
			12B	655,932	15.06	0	0.00																	
			28	141,352	3.24	0	0.00																	
			Total	1,347,734	30.94	62,962	1.45																	
		Entire Drainage Area	DP Totals	3,905,063	89.65	543,960	12.49	14	2.8	1.1	0.175	3.67	3.67	159,791	62,775	1.44	62,775	212,614						
		Remove Untreated Areas		2,557,329	58.71	480,996	11.04	19	2.8	1.1	0.219	3.00	3.00	130,845	51,403	1.18	51,403	12,566					3.31	51,571

The Bellevue Resort at Catskill Park
Water Quality Volume Calcs

DESIGN POINT	DRAINAGE AREA (AG)	Storm Device	Contributing Subcatchments	total size (sf)	total size (ac)	total imp (sf)	total imp (ac)	I %	DEP	P	DEC	Rv	Min. Rv	Reqt'd DEP WQV Acre Ft.	Reqt'd DEP WQV Cu.Ft.	DEC-1.1* Reqt'd DEC WQV Acre Ft.	Reqt'd DEC WQV Cu.Ft.	Provided WQV Cu.Ft.	Apply Min. Rv		Min. RRv Cu.Ft.	*RRv Cu.Ft.		
																			Reqt'd DEP WQV Cu.Ft.	Reqt'd DEC WQV Cu.Ft.				
12	5.40	None/Undisturbed	27 27A	68,054 141,739	1.56 3.25	25,722 23,417	0.59 0.54																	
			29	25,355	0.58	4,025	0.09																	
			DP Totals	235,148	5.40	53,164	1.22																	
16	18.37	Bio B1	104	455,573	10.46	0	0.00	0	2.8	1.1	0.050	0.12	0.050	5.315	2,088	0.05	2,088	6,883					2,757	
		None/Undisturbed	11	182,734	4.19	13,434	0.31																	
			11A	57,739	1.33	2,726	0.06																	
			11B	104,152	2.39	19,475	0.45																	
			Total	344,625	7.91	35,635	0.82																	
			DP Totals	800,198	18.37	35,635	0.82	4	2.8	1.1	0.050	0.39	0.15	16,819	6,607	0.05	6,607							
			Remove Untreated Areas	455,573	10.46	0	0.00	0	2.8	1.1	0.050	0.12	0.050	5,315	2,088	0.05	2,088	6,883			0	0.00		2,757

TABLE 3

The Belleayre Resort at Catskill Park

DEP WQv Summary

Drainage Area 1a

DEP WQv req'd	4,512	cf
Total WQv provided	5,200	cf
% of Impervious Area	9	%

Drainage Area 4

DEP WQv req'd	114,751	cf
Total WQv provided	143,084	cf
% of Impervious Area	16	%

Drainage Area 7

DEP WQv req'd	5,339	cf
Total WQv provided	16,000	cf
% of Impervious Area	1	%

Drainage Area 8

DEP WQv req'd	73,018	cf
Total WQv provided	117,882	cf
% of Impervious Area	5	%

Drainage Area 9

DEP WQv req'd	30,694	cf
Total WQv provided	38,956	cf
% of Impervious Area	8	%

Drainage Area 11

DEP WQv req'd	130,845	cf
Total WQv provided	212,614	cf
% of Impervious Area	14	%

Drainage Area 16

DEP WQv req'd	5,315	cf
Total WQv provided	6,893	cf
% of Impervious Area	4	%

Notes:

% impervious is calculated at the design point for each drainage area

TABLE 4

The Belleayre Resort at Catskill Park
Green Roof WQv Calculation

(From NYSDEC Stormwater Management Design Manual, Chapter 9)

$WQv < Vsm + Vdl + (Dp \times Agr)$

$Vsm = Agr \times Dsm \times n_{sm}$

$Vdl = Agr \times Ddl \times n_{dl}$

where:

Vsm=volume of the soil media (cubic feet)

Vdl=volume of the drainage layer (cubic feet)

Agr=green roof surface area (Square feet)

Dsm=depth of the soil media (feet)

Ddl=depth of drainage layer (Feet)

Dp=Depth of ponding above surface (feet)

n_{sm} =porosity of the soil media (~20%)

n_{dl} =porosity of the drainage layer (~25%)

WQv=Water Quality Volume (cubic feet)

Assumptions:

Roof System is Hydrotech Garden Roof, by American Hydrotech Inc.

System will be an 'intensive' system, with no impervious surfaces.

12" soil media - 40% porosity/voids according to manufacturer soil specifications

2" drainage layer - stone with 40% porosity/voids

very minimal

Assume soil media has 35% porosity as conservative measure, to match stated retention capacity.

stone has 40% porosity

Highmount Hotel and Spa: **306,000** SF of Green Roof Area (10,000 SF excluded as sky lights)

Vsm (cf) 48,960

Vdl (cf) 9,792

Vsm (cf)	Vdl (cf)	Agr (sf)	Dsm (ft)	Ddl (ft)	Dp (ft)	n_{sm} (%)	n_{dl} (%)	Wqv (cf)
48,960	9,792	306,000	1.00	0.08	0.025	0.16	0.40	66,402 provided in roof

Highmount Lodge: **52,000** SF of Roof Area

Vsm (cf) 8,320

Vdl (cf) 1,664

Vsm (cf)	Vdl (cf)	Agr (sf)	Dsm (ft)	Ddl (ft)	Dp (ft)	n_{sm} (%)	n_{dl} (%)	Wqv (cf)
8,320	1,664	52,000	1.00	0.08	0.025	0.16	0.40	11,284 provided in roof

GARDEN ROOF® ASSEMBLY RUNOFF CURVE NUMBER



THE BELLEAYRE RESORT - HOTEL ROOF CONSISTS OF:

GARDEN ROOF® -	269,724 SF
'BARE' ROOF -	29,969 SF
<hr/> TOTAL	<hr/> 299,693 SF

A THE GARDEN ROOF CAN HOLD **2.60** INCHES OF MOISTURE (SYSTEM TOTAL STORAGE - ANTECEDENT RAINFALL)
THE TOTAL MOISTURE STORAGE IS 58,347 CUBIC FEET (436,491 GALLONS).

B THE DESIGN 24-HR STORM IS **3.50** INCHES OF RAINFALL 2-YR
WHICH IS 87,410 CF (653,918 gallons)

THE GARDEN ROOF RUNOFF IS **0.90** INCHES (B - A)
C WHICH IS 20,323 CF (152,036 gallons)

'BARE' ROOF RUNOFF IS **3.27** INCHES BASED ON TR-55 EQUATION 2-2
D WHICH IS 8,158 CF (61,028 gallons)

THE TOTAL RUNOFF IS **28,481** CF (213,064 gallons) (C + D)
WHICH IS **1.14** INCHES

WHAT RUNOFF CURVE NUMBER YIELDS 1.14 INCHES OF RUNOFF FROM A 3.50 INCH STORM?

RUNOFF CURVE NUMBER = 72.3 (COMPOSITE GARDEN ROOF® AND 'BARE' AREAS)

TR-55 Worksheet 4: Graphical Peak Discharge Method



Project Belleayre Resort - Hotel

Location Catskill Park

Condition: **DEVELOPED 1-yr** (for Garden Roof[®] LEED calculation)

1. Data

Drainage area	299,693 sf	$A_m =$	0.010750	mi^2
Runoff Curve Number	72.3			
Time of Concentration	6 min	$T_c =$	0.10 hr	
Rainfall distribution	II	(I, IA, II, III)		

STORM INFO

2. Frequency, yr	1	
3. Rainfall, P (24 hr)	3.50	
Potential maximum ret., S, in	3.82	From equation 2-4
4. Initial abstraction, I_a , in	0.765	From equation 2-2
5. Compute I_a/P	0.219	
6. Unit peak discharge, q_u , csm/in	966	Use T_c and I_a/P with Exhibit 4-II
7. Runoff, Q, in	1.14	From equation 2-3
8. Pond & Swamp adjustment factor	1	Per table 4-2; $F_p = 1$ for 0% percent pond & swamp area
9. Peak discharge, Q_p, cfs	11.84	Where $Q_p = q_u A_m Q F_p$

GARDEN ROOF® ASSEMBLY RUNOFF CURVE NUMBER



THE BELLEAYRE RESORT - LODGE ROOF CONSISTS OF:

GARDEN ROOF® -	47,044 SF
'BARE' ROOF -	5,228 SF
<hr/> TOTAL	<hr/> 52,272 SF

A THE GARDEN ROOF CAN HOLD **2.60 INCHES OF MOISTURE** (SYSTEM TOTAL STORAGE - ANTECEDENT RAINFALL)
THE TOTAL MOISTURE STORAGE IS 10,177 CUBIC FEET (76,131 GALLONS).

B THE DESIGN 24-HR STORM IS **3.50 INCHES OF RAINFALL** 2-YR
WHICH IS 15,246 CF (114,055 gallons)

THE GARDEN ROOF RUNOFF IS **0.90 INCHES** (B - A)
C WHICH IS 3,545 CF (26,517 gallons)

'BARE' ROOF RUNOFF IS **3.27 INCHES BASED ON TR-55 EQUATION 2-2**
D WHICH IS 1,423 CF (10,646 gallons)

THE TOTAL RUNOFF IS **4,968 CF (37,164 gallons)** (C + D)
WHICH IS **1.14 INCHES**

WHAT RUNOFF CURVE NUMBER YIELDS 1.14 INCHES OF RUNOFF FROM A 3.50 INCH STORM?

RUNOFF CURVE NUMBER = 72.3 (COMPOSITE GARDEN ROOF® AND 'BARE' AREAS)

TR-55 Worksheet 4: Graphical Peak Discharge Method



Project Belleayre Resort - Lodge

Location Catskill Park

Condition: **DEVELOPED 1-yr** (for Garden Roof[®] LEED calculation)

1. Data

Drainage area	52,272 sf	$A_m =$	0.001875	mi ²
Runoff Curve Number	72.3			
Time of Concentration	6 min	$T_c =$	0.10	hr
Rainfall distribution	II			(I, IA, II, III)

STORM INFO

2. Frequency, yr	1	
3. Rainfall, P (24 hr)	3.50	
Potential maximum ret., S, in	3.82	From equation 2-4
4. Initial abstraction, I_a , in	0.765	From equation 2-2
5. Compute I_a/P	0.219	
6. Unit peak discharge, q_u , csm/in	966	Use T_c and I_a/P with Exhibit 4-II
7. Runoff, Q, in	1.14	From equation 2-3
8. Pond & Swamp adjustment factor	1	Per table 4-2; $F_p = 1$ for 0% percent pond & swamp area
9. Peak discharge, Q_p, cfs	2.07	Where $Q_p = q_u A_m Q F_p$

TABLE 5

The Belleayre Resort at Catskill Park

CPv Summary

Design Point	SMP	Req'd (cf)	Provided (cf)
1a	Bioret.-B9	3,305	5,232
4	AB - Gr. Roof		In Pond AC
	AD - Gr. Roof		In Pond AC
	Z - Dry Swale		In Pond AC
	AC - Pond	26,100	33,022
7	S - Dry Swale	2,573	4,200
	T - Dry Swale	2,478	3,000
	U - Dry Swale	2,182	8,800
8	B4 - Bioret.		In Pond L
	M - Dry Swale	4,549	9,663
	N - Dry Swale	1,459	2,621
	O - Dry Swale	7,362	9,800
	Q - Dry Swale	3,375	7,963
	W - Dry Swale	4,077	7,117
	K - Pond	14,220	14,780
	L - Pond	46,150	46,272
9	SP1 - Planter		In Pond H
	J - Dry Swale	5,056	5,628
	X - Dry Swale	2,962	4,328
	H - Pond	25,990	26,069
11	B3 - Bioret.		In Pond IP
	A1-A5 - Dry Sw.	5,181	10,031
	B. - Dry Swale	4,738	6,834
	F1. - Dry Swale	2,893	4,350
	G. - Dry Swale	3,477	8,399
	IP - Pond	165,000	166,713
16	B1-Bioret & 6p	11,909	13,575

TABLE 6

The Belleayre Resort at Catskill Park

Channel Protection Volume Calculations

Dry Swale S - DP7 - Wildacres

Step 1: Determine Ou

P = 2.8 in. (1-yr. storm)
Area = 2.21 acres
CN = 68
Ia = 0.941
Ia/P = 0.34
Tc = 0.115 Hrs.
Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
Qu = 740 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
Qo/Qi = 0.03

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64(Qo/Qi)^2 - 0.804(Qo/Qi)^3$
Vs/Vr = 0.641

Step 4: Determine Od

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
Qd = 0.5 in

Step 5: Determine Cpv

Area = 2.21 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.059 ac-ft
Cpv = 2573 ft³

Dry Swale T - DP7 - Wildacres

Step 1: Determine Ou

P = 2.8 in. (1-yr. storm)
Area = 1.81 acres
CN = 70
Ia = 0.857
Ia/P = 0.31
Tc = 0.03 Hrs.
Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
Qu = 950 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
Qo/Qi = 0.04

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64(Qo/Qi)^2 - 0.804(Qo/Qi)^3$
Vs/Vr = 0.627

Step 4: Determine Od

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
Qd = 0.6 in

Step 5: Determine Cpv

Area = 1.81 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.057 ac-ft
Cpv = 2478 ft³

Channel Protection Volume Calculations

Dry Swale U - DP7 - Wildacres

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 4.79 acres
 CN = 66
 Ia = 1.030
 Ia/P = 0.37
 Tc = 0.1 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 850 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.04

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.627

Step 4: Determine Qd

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.2 in

Step 5: Determine Cpv

Area = 4.79 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.050 ac-ft
 Cpv = 2182 ft³

Dry Swale M - DP8 - Wildacres

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 4.79 acres
 CN = 66
 Ia = 1.030
 Ia/P = 0.37
 Tc = 0.1 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 850 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.02

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.654

Step 4: Determine Qd

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.4 in

Step 5: Determine Cpv

Area = 4.79 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.104 ac-ft
 Cpv = 4549 ft³

Channel Protection Volume Calculations

Dry Swale N - DP8 - Wildacres

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 1.57 acres
 CN = 64
 Ia = 1.125
 Ia/P = 0.40
 Tc = 0.08 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 800 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.03

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.641

Step 4: Determine Od

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.4 in

Step 5: Determine Cpv

Area = 1.57 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.033 ac-ft
 Cpv = 1459 ft³

Dry Swale O - DP8 - Wildacres

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 4.43 acres
 CN = 73
 Ia = 0.740
 Ia/P = 0.26
 Tc = 0.07 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 975 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.02

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.654

Step 4: Determine Od

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.7 in

Step 5: Determine Cpv

Area = 4.43 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.169 ac-ft
 Cpv = 7362 ft³

Channel Protection Volume Calculations

Dry Swale Q - DP8 - Wildacres

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 3.63 acres
 CN = 66
 Ia = 1.030
 Ia/P = 0.37
 Tc = 0.11 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 810 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.03

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.641

Step 4: Determine Od

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.4 in

Step 5: Determine Cpv

Area = 3.63 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.077 ac-ft
 Cpv = 3375 ft³

Dry Swale W - DP8 - Wildacres

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 4.29 acres
 CN = 66
 Ia = 1.030
 Ia/P = 0.37
 Tc = 0.09 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 850 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.02

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.654

Step 4: Determine Od

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.4 in

Step 5: Determine Cpv

Area = 4.29 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.094 ac-ft
 Cpv = 4077 ft³

Channel Protection Volume Calculations

Detention Pond K - DP8 - Wildacres West

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 7.33 acres
 CN = 71
 Ia = 0.817
 Ia/P = 0.29
 Tc = 0.23 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 610 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.03

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.641

Step 4: Determine Od

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.6 in

Step 5: Determine Cpv

Area = 7.33 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.235 ac-ft
 Cpv = 10224 ft³

Dry Swale J - DP9 - Wildacres

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 1.77 acres
 CN = 83
 Ia = 0.410
 Ia/P = 0.15
 Tc = 0.04 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 975 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.02

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.654

Step 4: Determine Od

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 1.2 in

Step 5: Determine Cpv

Area = 1.77 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.116 ac-ft
 Cpv = 5056 ft³

Channel Protection Volume Calculations

Dry Swale X - DP9 - Wildacres

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 2.50 acres
 CN = 67
 Ia = 0.985
 Ia/P = 0.35
 Tc = 0.1 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 900 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.02

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.654

Step 4: Determine Qd

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.5 in

Step 5: Determine Cpv

Area = 2.50 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.068 ac-ft
 Cpv = 2962 ft³

Dry Swales A1-A5 - DP11 - Wildacres East

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 4.41 acres
 CN = 68
 Ia = 0.941
 Ia/P = 0.34
 Tc = 0.175 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 700 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.025

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.647

Step 4: Determine Qd

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.5 in

Step 5: Determine Cpv

Area = 4.41 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.119 ac-ft
 Cpv = 5181 ft³

Channel Protection Volume Calculations

Dry Swale B - DP11 - Wildacres East

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 3.36 acres
 CN = 69
 Ia = 0.899
 Ia/P = 0.32
 Tc = 0.21 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 700 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.025

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64(Qo/Qi)^2 - 0.804(Qo/Qi)^3$
 Vs/Vr = 0.647

Step 4: Determine Qd

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.6 in

Step 5: Determine Cpv

Area = 3.36 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.109 ac-ft
 Cpv = 4738 ft³

Dry Swale F1 - DP11 - Wildacres East

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 2.05 acres
 CN = 69
 Ia = 0.899
 Ia/P = 0.32
 Tc = 0.13 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 850 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.025

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64(Qo/Qi)^2 - 0.804(Qo/Qi)^3$
 Vs/Vr = 0.647

Step 4: Determine Qd

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.6 in

Step 5: Determine Cpv

Area = 2.05 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.066 ac-ft
 Cpv = 2893 ft³

Channel Protection Volume Calculations

Dry Swale G - DP11 - Wildacres East

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 3.70 acres
 CN = 66
 Ia = 1.030
 Ia/P = 0.37
 Tc = 0.15 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 700 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.025

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.647

Step 4: Determine Qd

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.4 in

Step 5: Determine Cpv

Area = 3.70 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.080 ac-ft
 Cpv = 3477 ft³

Detention Pond 6p - DP16 - Wildacres East

Step 1: Determine Qu

P = 2.8 in. (1-yr. storm)
 Area = 10.46 acres
 CN = 67
 Ia = 0.985
 Ia/P = 0.35
 Tc = 0.4 Hrs.
 Using Figure 4-II, TR-55 and Tc, determine Qu (csm/in)
 Qu = 450 csm/in

Step 2: Determine Qo/Qi

Using Figure B-1, DEC Manual Appendix B for T = 24 hrs. and Qu, determine Qo/Qi
 Qo/Qi = 0.04

Step 3: Determine Vs/Vr

$Vs/Vr = 0.682 - 1.43(Qo/Qi) + 1.64 (Qo/Qi)^2 - 0.804 (Qo/Qi)^3$
 Vs/Vr = 0.627

Step 4: Determine Qd

Using Figure 2.1, TR-55 or SCS TR-16 and P, determine Qd (in of runoff)
 Qd = 0.5 in

Step 5: Determine Cpv

Area = 10.46 acres
 $Cpv = Vs = (Vs/Vr) * Qd * A/12$

Cpv = 0.273 ac-ft
 Cpv = 11909 ft³

Reference: NYSDEC Stormwater Management Design Manual, August 2010

TABLE 7**Rate and Volume Summary**

The Belleayre Resort at Catskill Park

			WATERSHED AREA 748.48 ACRES					
DESIGN POINT #	Areas (Ac.)		DESIGN STORM					
			10 YEAR, 6.0"		25 YEAR, 6.5"		100 YEAR, 8.0"	
			VOLUME	PEAK	VOLUME	PEAK	VOLUME	PEAK
			af	cfs	af	cfs	af	cfs
1a	4.64	PRE	1.15	18.01	1.31	20.51	1.82	28.20
	4.64	POST	1.13	17.84	1.29	20.24	1.79	27.31
2	39.11	PRE	9.44	106.49	10.77	121.88	14.92	169.46
	31.94	POST	7.73	60.02	8.82	68.69	12.21	95.64
3	2.2	PRE	0.54	8.12	0.62	9.26	0.86	12.73
	0.71	POST	0.23	5.19	0.26	5.76	0.34	7.48
4	10.00	PRE	2.41	33.83	2.75	38.66	3.81	53.58
	22.18	POST	6.22	22.94	7.00	26.41	9.47	37.87
5	14.63	PRE	3.42	55.50	3.90	63.53	5.44	88.34
	9.41	POST	2.27	42.79	2.59	48.77	3.59	67.16
5a	12.2	PRE	2.85	40.90	3.26	46.88	4.53	65.36
	13.04	POST	3.04	26.09	3.49	29.99	4.85	42.11
6	58.77	PRE	14.19	169.07	16.19	193.45	22.42	268.75
	58.47	POST	13.67	118.71	15.63	136.44	21.75	191.48
6a	41.78	PRE	10.09	104.54	11.51	119.71	15.94	166.63
	41.78	POST	10.09	104.54	11.51	119.71	15.94	166.63
7	148.77	PRE	34.95	366.47	39.95	424.74	55.58	607.19
	130.68	POST	30.97	298.77	35.38	343.50	49.14	483.32
8	95.97	PRE	23.05	283.49	26.30	325.64	36.46	456.92
	110.69	POST	26.99	188.59	30.74	241.25	42.45	416.82
9	56.37	PRE	13.83	131.61	15.76	153.94	21.77	224.36
	45.92	POST	11.67	116.13	13.26	136.19	18.20	193.69
10	162.26	PRE	38.58	212.16	44.05	245.18	61.16	349.19
	157.34	POST	37.65	211.67	42.98	243.46	59.60	343.05
11	66.27	PRE	15.90	141.89	18.15	163.12	25.16	228.95
	89.65	POST	19.68	72.97	22.82	89.12	32.57	146.19
12	7.26	PRE	1.92	28.72	2.18	32.54	2.98	44.22
	5.40	POST	1.52	28.05	1.71	31.56	2.30	42.25
16	18.79	PRE	4.57	60.58	5.21	69.14	7.21	95.48
	18.37	POST	4.09	31.46	4.70	38.99	6.61	61.92
Pre-development Acreage			739.02					
Post-development Acreage			740.23					
*Difference			1.21					



*Area not included in pre-development model at top of highmount

APPENDIX D


HydroCAD Data – Existing Model – Entire Site

- 1. Existing Model Diagram, Area/Soil Listings and Subcatchment Summaries**
- 2. Existing Reach and Culvert Summaries – 1 & 10-yr Storm Events**
- 3. Existing Design Point Summaries - 1-yr Event**
- 4. Existing Design Point Totals – 10, 25 and 100-yr Storm Events**

**Model Diagram, Area and Soil Listings
and Subcatchment Summaries**

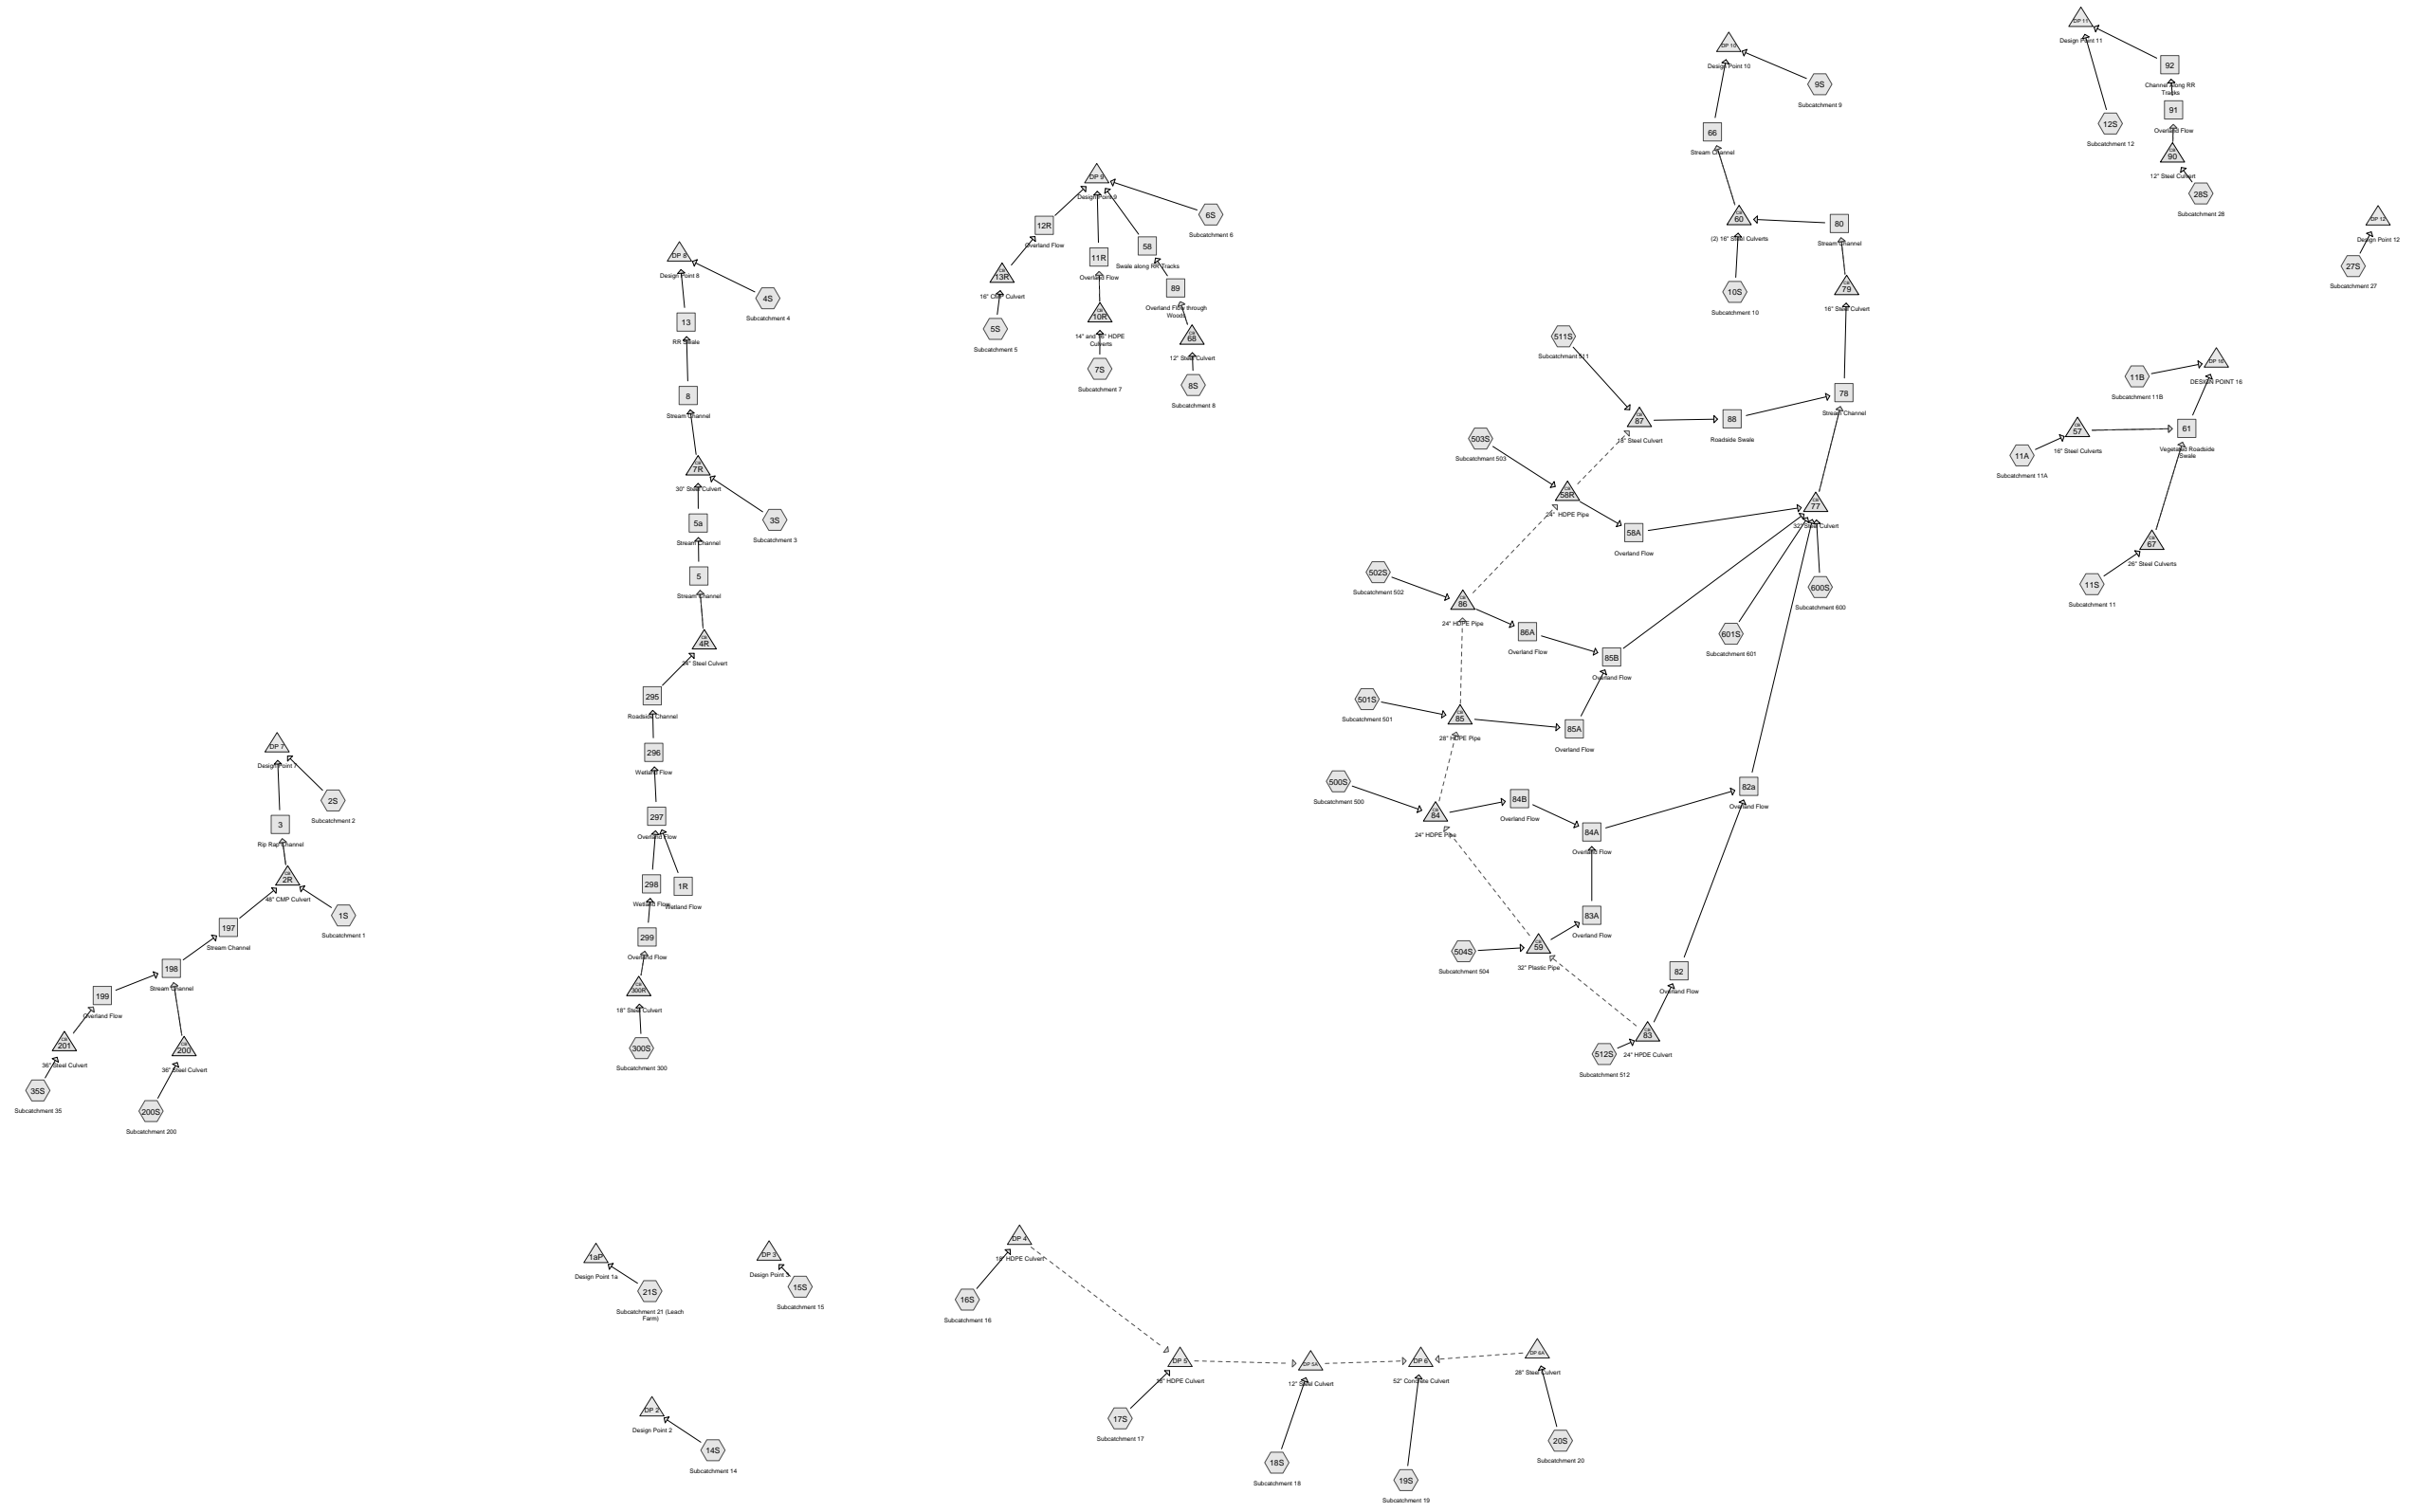

Reach



Drainage Diagram for 07074_existing
 Prepared by The LA Group P.C., Printed 3/16/2011
 HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.442	65	Brush, Good, HSG C (18S, 19S)
674.218	70	Woods, Good, HSG C (1S, 2S, 3S, 4S, 5S, 6S, 7S, 8S, 9S, 10S, 11A, 11B, 11S, 12S, 14S, 15S, 16S, 17S, 18S, 19S, 20S, 21S, 27S, 28S, 35S, 200S, 300S, 500S, 501S, 502S, 503S, 504S, 511S, 512S, 600S, 601S)
40.588	71	Meadow, non-grazed, HSG C (1S, 2S, 4S, 5S, 6S, 7S, 8S, 9S, 10S, 14S, 15S, 16S, 17S, 20S, 28S, 35S, 200S, 300S, 500S, 501S, 502S)
7.927	74	>75% Grass cover, Good, HSG C (3S, 6S, 12S, 21S, 27S, 504S)
0.586	87	Dirt roads, HSG C (14S)
3.908	89	Dirt Road (1S, 3S, 8S, 19S, 20S)
0.571	98	Dirt Road (6S)
0.110	98	Paved Drive (21S)
1.109	98	Paved Road (3S, 35S, 200S, 300S)
0.807	98	Paved parking & roofs (11A, 11B, 11S)
0.301	98	Paved parking, HSG C (9S)
0.739	98	Paved roads (12S, 14S)
2.001	98	Pavement (1S, 7S, 15S, 16S, 18S, 27S)
0.188	98	Pavment (8S)
0.783	98	Road (504S, 600S, 601S)
0.363	98	Road/Drive (10S)
2.041	98	Roadway (2S, 4S, 17S, 19S, 20S, 500S, 501S, 502S)
0.618	98	Roof (21S, 27S, 35S)
1.546	98	Roof Area (1S, 3S, 4S, 5S, 6S, 9S, 10S, 14S, 19S, 20S)
0.410	98	Roofs (12S)
739.256		TOTAL AREA

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Printed 3/16/2011

Page 2

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
724.062	HSG C	1S, 2S, 3S, 4S, 5S, 6S, 7S, 8S, 9S, 10S, 11A, 11B, 11S, 12S, 14S, 15S, 16S, 17S, 18S, 19S, 20S, 21S, 27S, 28S, 35S, 200S, 300S, 500S, 501S, 502S, 503S, 504S, 511S, 512S, 600S, 601S
0.000	HSG D	
15.194	Other	1S, 2S, 3S, 4S, 5S, 6S, 7S, 8S, 9S, 10S, 11A, 11B, 11S, 12S, 14S, 15S, 16S, 17S, 18S, 19S, 20S, 21S, 27S, 35S, 200S, 300S, 500S, 501S, 502S, 504S, 600S, 601S
739.256		TOTAL AREA

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Subcatchment 1	Runoff Area=2,611,846 sf 0.88% Impervious Runoff Depth=0.61" Flow Length=2,860' Tc=17.6 min CN=70 Runoff=36.91 cfs 3.028 af
Subcatchment 2S: Subcatchment 2	Runoff Area=18,469 sf 23.82% Impervious Runoff Depth=0.93" Flow Length=375' Tc=7.5 min CN=77 Runoff=0.66 cfs 0.033 af
Subcatchment 3S: Subcatchment 3	Runoff Area=2,671,441 sf 1.35% Impervious Runoff Depth=0.65" Flow Length=2,885' Tc=17.0 min CN=71 Runoff=42.27 cfs 3.312 af
Subcatchment 4S: Subcatchment 4	Runoff Area=796,495 sf 2.51% Impervious Runoff Depth=0.65" Flow Length=2,020' Tc=15.5 min CN=71 Runoff=13.33 cfs 0.988 af
Subcatchment 5S: Subcatchment 5	Runoff Area=91,345 sf 8.77% Impervious Runoff Depth=0.74" Flow Length=715' Tc=13.9 min CN=73 Runoff=1.92 cfs 0.129 af
Subcatchment 6S: Subcatchment 6	Runoff Area=1,024,096 sf 3.41% Impervious Runoff Depth=0.69" Flow Length=2,176' Tc=20.1 min CN=72 Runoff=15.90 cfs 1.355 af
Subcatchment 7S: Subcatchment 7	Runoff Area=876,427 sf 2.73% Impervious Runoff Depth=0.65" Flow Length=1,860' Tc=23.6 min CN=71 Runoff=11.18 cfs 1.087 af
Subcatchment 8S: Subcatchment 8	Runoff Area=463,566 sf 1.77% Impervious Runoff Depth=0.65" Flow Length=1,835' Tc=18.8 min CN=71 Runoff=6.89 cfs 0.575 af
Subcatchment 9S: Subcatchment 9	Runoff Area=1,465,881 sf 1.47% Impervious Runoff Depth=0.61" Flow Length=1,923' Slope=0.1100 '/' Tc=2.3 min CN=70 Runoff=39.51 cfs 1.700 af
Subcatchment 10S: Subcatchment 10	Runoff Area=1,643,388 sf 1.43% Impervious Runoff Depth=0.65" Flow Length=2,845' Tc=25.8 min CN=71 Runoff=19.76 cfs 2.038 af
Subcatchment 11A: Subcatchment 11A	Runoff Area=57,739 sf 4.72% Impervious Runoff Depth=0.65" Flow Length=480' Tc=15.3 min CN=71 Runoff=0.97 cfs 0.072 af
Subcatchment 11B: Subcatchment 11B	Runoff Area=577,903 sf 3.29% Impervious Runoff Depth=0.65" Flow Length=1,270' Tc=22.3 min CN=71 Runoff=7.68 cfs 0.717 af
Subcatchment 11S: Subcatchment 11	Runoff Area=182,734 sf 7.35% Impervious Runoff Depth=0.69" Flow Length=984' Tc=11.5 min CN=72 Runoff=3.90 cfs 0.242 af
Subcatchment 12S: Subcatchment 12	Runoff Area=2,326,061 sf 1.82% Impervious Runoff Depth=0.65" Flow Length=2,390' Tc=34.4 min CN=71 Runoff=22.78 cfs 2.884 af
Subcatchment 14S: Subcatchment 14	Runoff Area=1,703,544 sf 0.76% Impervious Runoff Depth=0.65" Flow Length=2,585' Tc=26.2 min CN=71 Runoff=20.26 cfs 2.112 af
Subcatchment 15S: Subcatchment 15	Runoff Area=95,640 sf 4.19% Impervious Runoff Depth=0.69" Flow Length=945' Tc=16.4 min CN=72 Runoff=1.69 cfs 0.127 af

Subcatchment 16S: Subcatchment 16	Runoff Area=435,730 sf 2.13% Impervious Runoff Depth=0.65" Flow Length=1,844' Tc=18.2 min CN=71 Runoff=6.61 cfs 0.540 af
Subcatchment 17S: Subcatchment 17	Runoff Area=637,108 sf 1.24% Impervious Runoff Depth=0.61" Flow Length=1,167' Tc=13.6 min CN=70 Runoff=10.49 cfs 0.739 af
Subcatchment 18S: Subcatchment 18	Runoff Area=531,432 sf 1.42% Impervious Runoff Depth=0.61" Flow Length=2,315' Tc=17.4 min CN=70 Runoff=7.57 cfs 0.616 af
Subcatchment 19S: Subcatchment 19	Runoff Area=2,560,021 sf 0.86% Impervious Runoff Depth=0.65" Flow Length=2,625' Tc=24.0 min CN=71 Runoff=32.30 cfs 3.174 af
Subcatchment 20S: Subcatchment 20	Runoff Area=1,819,937 sf 0.64% Impervious Runoff Depth=0.65" Flow Length=3,465' Tc=29.8 min CN=71 Runoff=19.76 cfs 2.257 af
Subcatchment 21S: Subcatchment 21	Runoff Area=202,100 sf 4.97% Impervious Runoff Depth=0.69" Flow Length=890' Tc=14.9 min CN=72 Runoff=3.77 cfs 0.267 af
Subcatchment 27S: Subcatchment 27	Runoff Area=316,441 sf 12.46% Impervious Runoff Depth=0.78" Flow Length=943' Tc=16.3 min CN=74 Runoff=6.57 cfs 0.475 af
Subcatchment 28S: Subcatchment 28	Runoff Area=560,792 sf 0.00% Impervious Runoff Depth=0.61" Flow Length=1,455' Tc=36.1 min CN=70 Runoff=4.82 cfs 0.650 af
Subcatchment 35S: Subcatchment 35	Runoff Area=532,041 sf 2.97% Impervious Runoff Depth=0.65" Flow Length=3,110' Tc=22.0 min CN=71 Runoff=7.13 cfs 0.660 af
Subcatchment 200S: Subcatchment 200	Runoff Area=3,328,419 sf 0.43% Impervious Runoff Depth=0.61" Flow Length=3,545' Tc=23.5 min CN=70 Runoff=38.77 cfs 3.859 af
Subcatchment 300S: Subcatchment 300	Runoff Area=712,598 sf 0.46% Impervious Runoff Depth=0.61" Flow Length=2,040' Tc=21.0 min CN=70 Runoff=8.97 cfs 0.826 af
Subcatchment 500S: Subcatchment 500	Runoff Area=1,350,926 sf 2.16% Impervious Runoff Depth=0.65" Flow Length=3,875' Tc=32.0 min CN=71 Runoff=13.91 cfs 1.675 af
Subcatchment 501S: Subcatchment 501	Runoff Area=186,481 sf 0.54% Impervious Runoff Depth=0.61" Flow Length=2,030' Tc=19.3 min CN=70 Runoff=2.48 cfs 0.216 af
Subcatchment 502S: Subcatchment 502	Runoff Area=189,050 sf 0.76% Impervious Runoff Depth=0.61" Flow Length=1,300' Tc=13.0 min CN=70 Runoff=3.20 cfs 0.219 af
Subcatchment 503S: Subcatchment 503	Runoff Area=130,680 sf 0.00% Impervious Runoff Depth=0.61" Flow Length=1,010' Tc=16.6 min CN=70 Runoff=1.92 cfs 0.152 af
Subcatchment 504S: Subcatchment 504	Runoff Area=1,320,521 sf 1.06% Impervious Runoff Depth=0.61" Flow Length=3,280' Tc=25.0 min CN=70 Runoff=14.76 cfs 1.531 af
Subcatchment 511S: Subcatchment 511	Runoff Area=87,120 sf 0.00% Impervious Runoff Depth=0.61" Flow Length=680' Tc=15.6 min CN=70 Runoff=1.33 cfs 0.101 af
Subcatchment 512S: Subcatchment 512	Runoff Area=56,628 sf 0.00% Impervious Runoff Depth=0.61" Flow Length=600' Tc=14.0 min CN=70 Runoff=0.92 cfs 0.066 af

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 5

Subcatchment 600S: Subcatchment 600 Runoff Area=369,868 sf 2.61% Impervious Runoff Depth=0.65"
Flow Length=1,610' Tc=19.3 min CN=71 Runoff=5.40 cfs 0.459 af

Subcatchment 601S: Subcatchment 601 Runoff Area=267,502 sf 3.92% Impervious Runoff Depth=0.65"
Flow Length=1,070' Tc=15.0 min CN=71 Runoff=4.56 cfs 0.332 af

Total Runoff Area = 739.256 ac Runoff Volume = 39.210 af Average Runoff Depth = 0.64"
98.43% Pervious = 727.669 ac 1.57% Impervious = 11.587 ac

Summary for Subcatchment 1S: Subcatchment 1

Runoff = 36.91 cfs @ 12.13 hrs, Volume= 3.028 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 7,405	98	Roof Area
* 15,551	98	Pavement
* 9,714	89	Dirt Road
75,794	71	Meadow, non-grazed, HSG C
2,503,382	70	Woods, Good, HSG C
2,611,846	70	Weighted Average
2,588,890		99.12% Pervious Area
22,956		0.88% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.4	55	0.0720	2.28		Sheet Flow, Sheet Flow over Pavement Smooth surfaces n= 0.011 P2= 4.00"
4.4	45	0.1600	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
10.6	1,315	0.1720	2.07		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
2.2	1,445	0.1868	11.00	70.92	Trap/Vee/Rect Channel Flow, Mountain Stream w/ Medium Boul Bot.W=4.00' D=1.50' Z= 0.2 '/' Top.W=4.60' n= 0.055
17.6	2,860	Total			

Summary for Subcatchment 2S: Subcatchment 2

Runoff = 0.66 cfs @ 12.00 hrs, Volume= 0.033 af, Depth= 0.93"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 4,400	98	Roadway
5,009	71	Meadow, non-grazed, HSG C
9,060	70	Woods, Good, HSG C
18,469	77	Weighted Average
14,069		76.18% Pervious Area
4,400		23.82% Impervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 7

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.7	90	0.2290	0.23		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
0.5	70	0.2550	2.52		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	215	0.0547	13.12	137.80	Trap/Vee/Rect Channel Flow, Vegetated Swale along RR Tracks Bot.W=2.00' D=3.00' Z= 0.5 '/' Top.W=5.00' n= 0.030
7.5	375	Total			

Summary for Subcatchment 3S: Subcatchment 3

Runoff = 42.27 cfs @ 12.12 hrs, Volume= 3.312 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 18,818	89	Dirt Road
* 24,002	98	Paved Road
* 11,979	98	Roof Area
73,006	74	>75% Grass cover, Good, HSG C
2,543,636	70	Woods, Good, HSG C
2,671,441	71	Weighted Average
2,635,460		98.65% Pervious Area
35,981		1.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.3	100	0.2270	0.23		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
4.0	307	0.0650	1.27		Shallow Concentrated Flow, SC Flow overland Woodland Kv= 5.0 fps
4.1	592	0.2300	2.40		Shallow Concentrated Flow, overland Woodland Kv= 5.0 fps
0.4	655	0.1959	28.46	3,073.23	Trap/Vee/Rect Channel Flow, Stream Channel Bot.W=25.00' D=4.00' Z= 0.5 '/' Top.W=29.00' n= 0.050 Mountain streams w/large boulders
0.1	50	0.0400	6.18	10.92	Pipe Channel, 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.025 Corrugated metal
1.1	1,181	0.1950	18.29	493.73	Trap/Vee/Rect Channel Flow, Bot.W=3.00' D=3.00' Z= 2.0 '/' Top.W=15.00' n= 0.050 Mountain streams w/large boulders
17.0	2,885	Total			

Summary for Subcatchment 4S: Subcatchment 4

Runoff = 13.33 cfs @ 12.10 hrs, Volume= 0.988 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 5,009	98	Roof Area
64,992	71	Meadow, non-grazed, HSG C
* 14,985	98	Roadway
711,509	70	Woods, Good, HSG C
796,495	71	Weighted Average
776,501		97.49% Pervious Area
19,994		2.51% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.5	100	0.3000	0.26		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
6.0	770	0.1860	2.16		Shallow Concentrated Flow, Sheet Flow through Woods Woodland Kv= 5.0 fps
0.4	200	0.0750	9.49	56.96	Trap/Vee/Rect Channel Flow, RR Swale w/Gravel and Leaves Bot.W=1.00' D=2.00' Z= 1.0 '/' Top.W=5.00' n= 0.040
0.8	250	0.0800	5.03	7.55	Trap/Vee/Rect Channel Flow, RR Swale w/ Gravel and Leaves Bot.W=1.00' D=1.00' Z= 0.5 '/' Top.W=2.00' n= 0.050
0.6	300	0.0650	8.00	48.03	Trap/Vee/Rect Channel Flow, RR Swale w/ Cobbles and Leaves Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.045
1.2	400	0.0600	5.69	14.23	Trap/Vee/Rect Channel Flow, RR Swale w/ Cobbles and Leaves Bot.W=2.00' D=1.00' Z= 0.5 '/' Top.W=3.00' n= 0.045
15.5	2,020	Total			

Summary for Subcatchment 5S: Subcatchment 5

Runoff = 1.92 cfs @ 12.07 hrs, Volume= 0.129 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
40,511	71	Meadow, non-grazed, HSG C
* 8,015	98	Roof Area
42,819	70	Woods, Good, HSG C
91,345	73	Weighted Average
83,330		91.23% Pervious Area
8,015		8.77% Impervious Area

07074_existing

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 9

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.1	100	0.1300	0.18		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
4.3	390	0.0920	1.52		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.5	225	0.0346	7.48	29.91	Trap/Vee/Rect Channel Flow, Flow in Vegated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
13.9	715	Total			

Summary for Subcatchment 6S: Subcatchment 6

Runoff = 15.90 cfs @ 12.15 hrs, Volume= 1.355 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 24,873	98	Dirt Road
* 10,062	98	Roof Area
70,635	71	Meadow, non-grazed, HSG C
777,256	70	Woods, Good, HSG C
141,270	74	>75% Grass cover, Good, HSG C
1,024,096	72	Weighted Average
989,161		96.59% Pervious Area
34,935		3.41% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.7	100	0.1100	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
8.7	1,016	0.1500	1.94		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
1.7	1,060	0.0750	10.48	83.81	Trap/Vee/Rect Channel Flow, RR Swale w/ Gravel and Leaves Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.040
20.1	2,176	Total			

Summary for Subcatchment 7S: Subcatchment 7

Runoff = 11.18 cfs @ 12.20 hrs, Volume= 1.087 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

07074_existing

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 10

Area (sf)	CN	Description
* 23,914	98	Pavement
18,513	71	Meadow, non-grazed, HSG C
834,000	70	Woods, Good, HSG C
876,427	71	Weighted Average
852,513		97.27% Pervious Area
23,914		2.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.4	100	0.1570	0.20		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
15.2	1,760	0.1490	1.93		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
23.6	1,860	Total			

Summary for Subcatchment 8S: Subcatchment 8

Runoff = 6.89 cfs @ 12.14 hrs, Volume= 0.575 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
27,225	71	Meadow, non-grazed, HSG C
* 3,006	89	Dirt Road
* 8,189	98	Pavement
425,146	70	Woods, Good, HSG C
463,566	71	Weighted Average
455,377		98.23% Pervious Area
8,189		1.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.4	100	0.1570	0.20		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
6.0	850	0.2200	2.35		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
1.1	135	0.0850	2.04		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
2.6	310	0.1540	1.96		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.7	440	0.0360	10.52	63.14	Trap/Vee/Rect Channel Flow, Flow through Vegetated Swale Bot.W=1.00' D=2.00' Z= 1.0 '/' Top.W=5.00' n= 0.025
18.8	1,835	Total			

Summary for Subcatchment 9S: Subcatchment 9

Runoff = 39.51 cfs @ 11.94 hrs, Volume= 1.700 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 8,494	98	Roof Area
57,978	71	Meadow, non-grazed, HSG C
1,386,297	70	Woods, Good, HSG C
13,112	98	Paved parking, HSG C
1,465,881	70	Weighted Average
1,444,275		98.53% Pervious Area
21,606		1.47% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.3	1,923	0.1100	13.81	662.89	Trap/Vee/Rect Channel Flow, Flow through Rock Channel Bot.W=20.00' D=2.00' Z= 2.0 '/' Top.W=28.00' n= 0.050 Mountain streams w/large boulders

Summary for Subcatchment 10S: Subcatchment 10

Runoff = 19.76 cfs @ 12.23 hrs, Volume= 2.038 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
1,134,433	70	Woods, Good, HSG C
485,520	71	Meadow, non-grazed, HSG C
* 7,623	98	Roof Area
* 15,812	98	Road/Drive
1,643,388	71	Weighted Average
1,619,953		98.57% Pervious Area
23,435		1.43% Impervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 12

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.1000	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
7.2	600	0.0780	1.40		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
2.7	455	0.1600	2.80		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
2.8	330	0.1570	1.98		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
1.6	685	0.0945	7.35	33.08	Trap/Vee/Rect Channel Flow, Stream Channel Bot.W=4.00' D=1.00' Z= 0.5 '/' Top.W=5.00' n= 0.050
0.0	30	0.0500	13.31	18.59	Pipe Channel, 16" Steel Culvert 16.0" Round Area= 1.4 sf Perim= 4.2' r= 0.33' n= 0.012 Steel, smooth
1.4	645	0.0483	7.65	91.77	Trap/Vee/Rect Channel Flow, Stream Channel Bot.W=5.00' D=2.00' Z= 0.5 '/' Top.W=7.00' n= 0.050
25.8	2,845	Total			

Summary for Subcatchment 11A: Subcatchment 11A

Runoff = 0.97 cfs @ 12.09 hrs, Volume= 0.072 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
55,013	70	Woods, Good, HSG C
2,726	98	Paved parking & roofs
57,739	71	Weighted Average
55,013		95.28% Pervious Area
2,726		4.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.0	100	0.0800	0.15		Sheet Flow, Sheet Flow through woods Woods: Light underbrush n= 0.400 P2= 4.00"
4.3	380	0.0875	1.48		Shallow Concentrated Flow, SC flow through Woods Woodland Kv= 5.0 fps
15.3	480	Total			

Summary for Subcatchment 11B: Subcatchment 11B

Runoff = 7.68 cfs @ 12.18 hrs, Volume= 0.717 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 13

Area (sf)	CN	Description
558,889	70	Woods, Good, HSG C
19,014	98	Paved parking & roofs
577,903	71	Weighted Average
558,889		96.71% Pervious Area
19,014		3.29% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.0	100	0.0800	0.15		Sheet Flow, Sheet Flow through woods Woods: Light underbrush n= 0.400 P2= 4.00"
4.0	460	0.0750	1.92		Shallow Concentrated Flow, Sheet Flow through Meadow Short Grass Pasture Kv= 7.0 fps
0.8	80	0.0625	1.75		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
6.3	560	0.0875	1.48		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.2	70	0.0500	7.39	16.25	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=2.00' D=1.00' Z= 0.2 '/' Top.W=2.40' n= 0.030 Earth, grassed & winding
22.3	1,270	Total			

Summary for Subcatchment 11S: Subcatchment 11

Runoff = 3.90 cfs @ 12.05 hrs, Volume= 0.242 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
169,300	70	Woods, Good, HSG C
13,434	98	Paved parking & roofs
182,734	72	Weighted Average
169,300		92.65% Pervious Area
13,434		7.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.2	25	0.0800	2.03		Sheet Flow, Sheet Flow off Roof Smooth surfaces n= 0.011 P2= 4.00"
4.4	75	0.0625	0.28		Sheet Flow, Sheet flow over meadow Grass: Short n= 0.150 P2= 4.00"
2.9	330	0.0750	1.92		Shallow Concentrated Flow, Sheet Flow through Meadow Short Grass Pasture Kv= 7.0 fps
3.4	300	0.0875	1.48		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.6	254	0.0500	7.39	16.25	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=2.00' D=1.00' Z= 0.2 '/' Top.W=2.40' n= 0.030
11.5	984	Total			

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 14

Summary for Subcatchment 12S: Subcatchment 12

Runoff = 22.78 cfs @ 12.34 hrs, Volume= 2.884 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
18,687	74	>75% Grass cover, Good, HSG C
2,265,120	70	Woods, Good, HSG C
* 17,860	98	Roofs
* 24,394	98	Paved roads
2,326,061	71	Weighted Average
2,283,807		98.18% Pervious Area
42,254		1.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.8	100	0.0850	0.15		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
23.6	2,290	0.1050	1.62		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
34.4	2,390	Total			

Summary for Subcatchment 14S: Subcatchment 14

Runoff = 20.26 cfs @ 12.23 hrs, Volume= 2.112 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
133,250	71	Meadow, non-grazed, HSG C
25,526	87	Dirt roads, HSG C
* 5,184	98	Roof Area
1,531,787	70	Woods, Good, HSG C
7,797	98	Paved roads
1,703,544	71	Weighted Average
1,690,563		99.24% Pervious Area
12,981		0.76% Impervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 15

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.7	100	0.1100	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
0.6	80	0.1000	2.21		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
15.2	2,165	0.2260	2.38		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.4	90	0.2350	3.39		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
0.3	150	0.0450	8.53	34.11	Trap/Vee/Rect Channel Flow, Roadside Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
26.2	2,585	Total			

Summary for Subcatchment 15S: Subcatchment 15

Runoff = 1.69 cfs @ 12.11 hrs, Volume= 0.127 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
35,962	71	Meadow, non-grazed, HSG C
55,670	70	Woods, Good, HSG C
* 4,008	98	Pavement
95,640	72	Weighted Average
91,632		95.81% Pervious Area
4,008		4.19% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.1000	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
5.3	640	0.1600	2.00		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.8	125	0.1500	2.71		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
0.2	80	0.0400	5.93	8.90	Trap/Vee/Rect Channel Flow, Roadside Vegetated Swale Bot.W=1.00' D=1.00' Z= 0.5 '/' Top.W=2.00' n= 0.030
16.4	945	Total			

Summary for Subcatchment 16S: Subcatchment 16

Runoff = 6.61 cfs @ 12.13 hrs, Volume= 0.540 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 16

Area (sf)	CN	Description
141,134	71	Meadow, non-grazed, HSG C
* 9,278	98	Pavement
285,318	70	Woods, Good, HSG C
435,730	71	Weighted Average
426,452		97.87% Pervious Area
9,278		2.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.1000	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
5.7	644	0.1406	1.87		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
1.4	200	0.1200	2.42		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
1.0	900	0.1029	15.11	90.64	Trap/Vee/Rect Channel Flow, Roadside Vegetated Swale Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.030
18.2	1,844	Total			

Summary for Subcatchment 17S: Subcatchment 17

Runoff = 10.49 cfs @ 12.08 hrs, Volume= 0.739 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 7,884	98	Roadway
8,494	71	Meadow, non-grazed, HSG C
620,730	70	Woods, Good, HSG C
637,108	70	Weighted Average
629,224		98.76% Pervious Area
7,884		1.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.6	100	0.2000	0.22		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
5.8	922	0.2800	2.65		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.2	145	0.1160	16.04	96.24	Trap/Vee/Rect Channel Flow, Roadside Vegetated Swale Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.030
13.6	1,167	Total			

Summary for Subcatchment 18S: Subcatchment 18

Runoff = 7.57 cfs @ 12.12 hrs, Volume= 0.616 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 7,536	98	Pavement
3,615	65	Brush, Good, HSG C
520,281	70	Woods, Good, HSG C
531,432	70	Weighted Average
523,896		98.58% Pervious Area
7,536		1.42% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.3	100	0.3280	0.27		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
10.5	1,895	0.3630	3.01		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.6	320	0.0500	8.99	35.95	Trap/Vee/Rect Channel Flow, Flow in Roadside Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
17.4	2,315	Total			

Summary for Subcatchment 19S: Subcatchment 19

Runoff = 32.30 cfs @ 12.20 hrs, Volume= 3.174 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 69,870	89	Dirt Road
* 1,176	98	Roof Area
* 20,735	98	Roadway
2,452,602	70	Woods, Good, HSG C
15,638	65	Brush, Good, HSG C
2,560,021	71	Weighted Average
2,538,110		99.14% Pervious Area
21,911		0.86% Impervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 18

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	100	0.0910	0.16		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
12.6	2,055	0.2960	2.72		Shallow Concentrated Flow, SC Flow through woods Woodland Kv= 5.0 fps
0.9	470	0.0500	8.99	35.95	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030 Earth, grassed & winding
24.0	2,625	Total			

Summary for Subcatchment 20S: Subcatchment 20

Runoff = 19.76 cfs @ 12.28 hrs, Volume= 2.257 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 68,825	89	Dirt Road
* 2,396	98	Roof Area
* 9,278	98	Roadway
1,637,943	70	Woods, Good, HSG C
101,495	71	Meadow, non-grazed, HSG C
1,819,937	71	Weighted Average
1,808,263		99.36% Pervious Area
11,674		0.64% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	100	0.0910	0.16		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
18.7	3,055	0.2960	2.72		Shallow Concentrated Flow, SC Flow through woods Woodland Kv= 5.0 fps
0.6	310	0.0466	8.68	34.71	Trap/Vee/Rect Channel Flow, Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030 Earth, grassed & winding
29.8	3,465	Total			

Summary for Subcatchment 21S: Subcatchment 21 (Leach Farm)

Runoff = 3.77 cfs @ 12.09 hrs, Volume= 0.267 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

07074_existing

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 19

Area (sf)	CN	Description
147,807	70	Woods, Good, HSG C
* 5,253	98	Roof
* 4,790	98	Paved Drive
44,250	74	>75% Grass cover, Good, HSG C
202,100	72	Weighted Average
192,057		95.03% Pervious Area
10,043		4.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.8	100	0.0840	0.15		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
3.7	460	0.1700	2.06		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
0.4	330	0.2300	14.23	21.34	Trap/Vee/Rect Channel Flow, Bot.W=1.00' D=1.00' Z= 0.5 '/' Top.W=2.00' n= 0.030 Earth, clean & winding
14.9	890	Total			

Summary for Subcatchment 27S: Subcatchment 27

Runoff = 6.57 cfs @ 12.10 hrs, Volume= 0.475 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 12,543	98	Roof
* 26,873	98	Pavement
54,050	74	>75% Grass cover, Good, HSG C
222,975	70	Woods, Good, HSG C
316,441	74	Weighted Average
277,025		87.54% Pervious Area
39,416		12.46% Impervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 20

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.4	100	0.0600	0.13		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
2.5	165	0.0500	1.12		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
0.1	50	0.0560	5.58	4.38	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.025 Corrugated metal
0.4	250	0.0500	10.53	63.18	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.030 Earth, grassed & winding
0.1	40	0.0560	5.58	4.38	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.025 Corrugated metal
0.1	70	0.0450	9.99	59.94	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.030 Earth, grassed & winding
0.3	80	0.0500	5.27	4.14	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.025 Corrugated metal
0.2	128	0.0560	11.14	66.87	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.030 Earth, grassed & winding
0.2	60	0.0560	5.58	4.38	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.025 Corrugated metal
16.3	943	Total			

Summary for Subcatchment 28S: Subcatchment 28

Runoff = 4.82 cfs @ 12.38 hrs, Volume= 0.650 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
33,932	71	Meadow, non-grazed, HSG C
526,860	70	Woods, Good, HSG C
560,792	70	Weighted Average
560,792		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.3	100	0.0500	0.13		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
15.4	1,205	0.0680	1.30		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
7.4	150	0.0130	0.34	0.51	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=1.00' D=1.00' Z= 0.5 '/' Top.W=2.00' n= 0.300

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 21

36.1 1,455 Total

Summary for Subcatchment 35S: Subcatchment 35

Runoff = 7.13 cfs @ 12.18 hrs, Volume= 0.660 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
122,752	71	Meadow, non-grazed, HSG C
* 6,708	98	Paved Road
393,477	70	Woods, Good, HSG C
* 9,104	98	Roof
532,041	71	Weighted Average
516,229		97.03% Pervious Area
15,812		2.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.9	120	0.1667	0.52		Sheet Flow, Sheet Flow through Ski Trail Range n= 0.130 P2= 4.00"
3.7	630	0.3170	2.82		Shallow Concentrated Flow, Sheet Flow through Woods Woodland Kv= 5.0 fps
1.3	270	0.2590	3.56		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
1.6	225	0.2220	2.36		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.5	115	0.3478	4.13		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
1.5	230	0.2790	2.64		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.2	50	0.3150	3.93		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
9.3	1,470	0.2799	2.65		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
22.0	3,110	Total			

Summary for Subcatchment 200S: Subcatchment 200

Runoff = 38.77 cfs @ 12.20 hrs, Volume= 3.859 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 22

Area (sf)	CN	Description
* 14,331	98	Paved Road
311,323	71	Meadow, non-grazed, HSG C
3,002,765	70	Woods, Good, HSG C
3,328,419	70	Weighted Average
3,314,088		99.57% Pervious Area
14,331		0.43% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.3	100	0.1667	0.50		Sheet Flow, Sheet Flow through Ski Trail Range n= 0.130 P2= 4.00"
3.7	630	0.3170	2.82		Shallow Concentrated Flow, Sheet Flow through Woods Woodland Kv= 5.0 fps
1.3	270	0.2590	3.56		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
1.6	225	0.2220	2.36		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.5	115	0.3478	4.13		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
1.4	215	0.2790	2.64		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	70	0.3150	3.93		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
11.1	1,760	0.2799	2.65		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	160	0.0500	8.99	35.95	Trap/Vee/Rect Channel Flow, Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
23.5	3,545	Total			

Summary for Subcatchment 300S: Subcatchment 300

Runoff = 8.97 cfs @ 12.17 hrs, Volume= 0.826 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 3,267	98	Paved Road
6,447	71	Meadow, non-grazed, HSG C
702,884	70	Woods, Good, HSG C
712,598	70	Weighted Average
709,331		99.54% Pervious Area
3,267		0.46% Impervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 23

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.1	120	0.2500	0.25		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
12.7	1,810	0.2257	2.38		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.2	110	0.0910	12.13	48.50	Trap/Vee/Rect Channel Flow, Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
21.0	2,040	Total			

Summary for Subcatchment 500S: Subcatchment 500

Runoff = 13.91 cfs @ 12.31 hrs, Volume= 1.675 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
9,017	71	Meadow, non-grazed, HSG C
* 29,185	98	Roadway
1,312,724	70	Woods, Good, HSG C
1,350,926	71	Weighted Average
1,321,741		97.84% Pervious Area
29,185		2.16% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2	100	0.3330	0.27		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
25.7	3,665	0.2266	2.38		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.1	110	0.1066	16.65	133.22	Trap/Vee/Rect Channel Flow, Roadside Swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.030
32.0	3,875	Total			

Summary for Subcatchment 501S: Subcatchment 501

Runoff = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
9,017	71	Meadow, non-grazed, HSG C
* 1,002	98	Roadway
176,462	70	Woods, Good, HSG C
186,481	70	Weighted Average
185,479		99.46% Pervious Area
1,002		0.54% Impervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 24

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2	100	0.3330	0.27		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
13.1	1,930	0.2410	2.45		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
19.3	2,030	Total			

Summary for Subcatchment 502S: Subcatchment 502

Runoff = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
9,017	71	Meadow, non-grazed, HSG C
* 1,437	98	Roadway
178,596	70	Woods, Good, HSG C
189,050	70	Weighted Average
187,613		99.24% Pervious Area
1,437		0.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2	100	0.3330	0.27		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
6.5	935	0.2266	2.38		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	265	0.1066	16.65	133.22	Trap/Vee/Rect Channel Flow, Roadside Swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.030
13.0	1,300	Total			

Summary for Subcatchment 503S: Subcatchment 503

Runoff = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
130,680	70	Woods, Good, HSG C
130,680		100.00% Pervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 25

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.1000	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
6.2	655	0.1250	1.77		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	255	0.1066	16.65	133.22	Trap/Vee/Rect Channel Flow, Roadside swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.030
16.6	1,010	Total			

Summary for Subcatchment 504S: Subcatchment 504

Runoff = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
1,292,556	70	Woods, Good, HSG C
* 13,939	98	Road
14,026	74	>75% Grass cover, Good, HSG C
1,320,521	70	Weighted Average
1,306,582		98.94% Pervious Area
13,939		1.06% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.4375	0.30		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
19.1	2,860	0.2500	2.50		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	320	0.1910	15.31	321.48	Trap/Vee/Rect Channel Flow, Mountain Stream Bot.W=4.00' D=3.00' Z= 1.0 '/' Top.W=10.00' n= 0.060
25.0	3,280	Total			

Summary for Subcatchment 511S: Subcatchment 511

Runoff = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
87,120	70	Woods, Good, HSG C
87,120		100.00% Pervious Area

07074_existing

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 26

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.1000	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
5.5	580	0.1250	1.77		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
15.6	680	Total			

Summary for Subcatchment 512S: Subcatchment 512

Runoff = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
56,628	70	Woods, Good, HSG C
56,628		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.1	100	0.3125	0.15		Sheet Flow, Sheet Flow through Woods Woods: Dense underbrush n= 0.800 P2= 4.00"
2.6	345	0.1900	2.18		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	155	0.1000	8.43	10.12	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=1.00' D=1.00' Z= 0.2 '/' Top.W=1.40' n= 0.030 Earth, grassed & winding
14.0	600	Total			

Summary for Subcatchment 600S: Subcatchment 600

Runoff = 5.40 cfs @ 12.14 hrs, Volume= 0.459 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 9,670	98	Road
360,198	70	Woods, Good, HSG C
369,868	71	Weighted Average
360,198		97.39% Pervious Area
9,670		2.61% Impervious Area

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 27

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.1	10	0.0500	1.40		Sheet Flow, Sheet Flow off Road Smooth surfaces n= 0.011 P2= 4.00"
7.2	90	0.1875	0.21		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
12.0	1,510	0.1764	2.10		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
19.3	1,610	Total			

Summary for Subcatchment 601S: Subcatchment 601

Runoff = 4.56 cfs @ 12.09 hrs, Volume= 0.332 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 10,498	98	Road
257,004	70	Woods, Good, HSG C
267,502	71	Weighted Average
257,004		96.08% Pervious Area
10,498		3.92% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.1	10	0.0500	1.40		Sheet Flow, Sheet Flow off Road Smooth surfaces n= 0.011 P2= 4.00"
7.2	90	0.1875	0.21		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
7.7	970	0.1764	2.10		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
15.0	1,070	Total			

**Reach and Culvert Summaries
1 & 10-yr Storm Events**

Summary for Reach 1R: Wetland Flow

Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.00 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 0.00 fps, Avg. Travel Time= 0.0 min

Peak Storage= 0 cf @ 0.00 hrs
Average Depth at Peak Storage= 0.00'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 802.14 cfs

100.00' x 1.00' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 50.0 ' / ' Top Width= 200.00'
Length= 408.0' Slope= 0.0931 ' / '
Inlet Invert= 2,208.00', Outlet Invert= 2,170.00'



Summary for Reach 3: Rip Rap Channel

Inflow Area = 148.584 ac, 0.82% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 57.49 cfs @ 12.37 hrs, Volume= 7.547 af
Outflow = 57.47 cfs @ 12.37 hrs, Volume= 7.547 af, Atten= 0%, Lag= 0.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 14.92 fps, Min. Travel Time= 0.1 min
Avg. Velocity = 5.49 fps, Avg. Travel Time= 0.2 min

Peak Storage= 196 cf @ 12.37 hrs
Average Depth at Peak Storage= 0.75'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 257.29 cfs

5.00' x 2.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 0.2 ' / ' Top Width= 5.80'
Length= 51.0' Slope= 0.5098 ' / '
Inlet Invert= 1,740.00', Outlet Invert= 1,714.00'



Summary for Reach 5: Stream Channel

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 7.73 cfs @ 12.51 hrs, Volume= 0.826 af
Outflow = 7.53 cfs @ 12.60 hrs, Volume= 0.826 af, Atten= 2%, Lag= 4.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.39 fps, Min. Travel Time= 2.7 min
Avg. Velocity = 2.00 fps, Avg. Travel Time= 7.2 min

Peak Storage= 1,223 cf @ 12.55 hrs
Average Depth at Peak Storage= 0.30'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 1,064.40 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 870.0' Slope= 0.1954 '/'
Inlet Invert= 2,060.00', Outlet Invert= 1,890.00'



Summary for Reach 5a: Stream Channel

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 7.53 cfs @ 12.60 hrs, Volume= 0.826 af
Outflow = 7.49 cfs @ 12.62 hrs, Volume= 0.826 af, Atten= 1%, Lag= 1.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.28 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 2.37 fps, Avg. Travel Time= 2.5 min

Peak Storage= 425 cf @ 12.61 hrs
Average Depth at Peak Storage= 0.42'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 290.71 cfs

2.00' x 2.50' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 12.00'
Length= 355.0' Slope= 0.2141 '/'
Inlet Invert= 1,890.00', Outlet Invert= 1,814.00'



Summary for Reach 8: Stream Channel

Inflow Area = 77.687 ac, 1.16% Impervious, Inflow Depth = 0.64" for 1-YEAR event
Inflow = 42.27 cfs @ 12.12 hrs, Volume= 4.139 af
Outflow = 42.04 cfs @ 12.13 hrs, Volume= 4.139 af, Atten= 1%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 10.36 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 3.71 fps, Avg. Travel Time= 1.1 min

Peak Storage= 999 cf @ 12.12 hrs
Average Depth at Peak Storage= 0.59'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 578.22 cfs

4.00' x 2.00' deep channel, n= 0.040
Side Slope Z-value= 5.0 '/' Top Width= 24.00'
Length= 245.0' Slope= 0.2571 '/'
Inlet Invert= 1,813.00', Outlet Invert= 1,750.00'




Summary for Reach 11R: Overland Flow

Inflow Area = 20.120 ac, 2.73% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 11.18 cfs @ 12.20 hrs, Volume= 1.087 af
Outflow = 8.14 cfs @ 12.59 hrs, Volume= 1.087 af, Atten= 27%, Lag= 23.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.38 fps, Min. Travel Time= 14.3 min
Avg. Velocity = 0.47 fps, Avg. Travel Time= 41.5 min

Peak Storage= 6,971 cf @ 12.35 hrs
Average Depth at Peak Storage= 0.08'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 620.77 cfs

75.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 15.0 '/' Top Width= 105.00'
Length= 1,180.0' Slope= 0.1695 '/'
Inlet Invert= 1,973.00', Outlet Invert= 1,773.00'

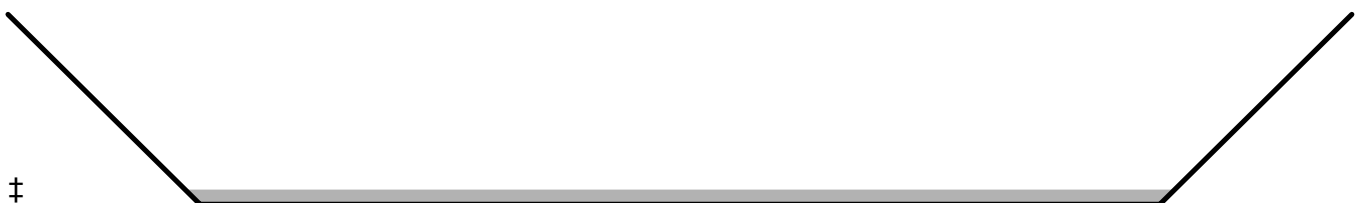

Summary for Reach 12R: Overland Flow

Inflow Area = 2.097 ac, 8.77% Impervious, Inflow Depth = 0.74" for 1-YEAR event
Inflow = 1.92 cfs @ 12.07 hrs, Volume= 0.129 af
Outflow = 1.08 cfs @ 12.49 hrs, Volume= 0.129 af, Atten= 43%, Lag= 25.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.93 fps, Min. Travel Time= 17.0 min
Avg. Velocity = 0.41 fps, Avg. Travel Time= 38.7 min

Peak Storage= 1,112 cf @ 12.21 hrs
Average Depth at Peak Storage= 0.04'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 305.91 cfs

30.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 15.0 '/' Top Width= 60.00'
Length= 950.0' Slope= 0.1968 '/'
Inlet Invert= 1,960.00', Outlet Invert= 1,773.00'



Summary for Reach 13: RR Swale

Inflow Area = 77.687 ac, 1.16% Impervious, Inflow Depth = 0.64" for 1-YEAR event
Inflow = 42.04 cfs @ 12.13 hrs, Volume= 4.139 af
Outflow = 41.52 cfs @ 12.16 hrs, Volume= 4.139 af, Atten= 1%, Lag= 1.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.70 fps, Min. Travel Time= 1.1 min
Avg. Velocity = 2.08 fps, Avg. Travel Time= 2.9 min

Peak Storage= 2,635 cf @ 12.14 hrs
Average Depth at Peak Storage= 0.94'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 529.21 cfs

4.00' x 3.00' deep channel, n= 0.040
Side Slope Z-value= 4.0 '/' Top Width= 28.00'
Length= 360.0' Slope= 0.0444 '/'
Inlet Invert= 1,750.00', Outlet Invert= 1,734.00'




Summary for Reach 58: Swale along RR Tracks

Inflow Area = 10.642 ac, 1.77% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 4.98 cfs @ 12.46 hrs, Volume= 0.575 af
Outflow = 4.57 cfs @ 12.64 hrs, Volume= 0.575 af, Atten= 8%, Lag= 10.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.03 fps, Min. Travel Time= 5.6 min
Avg. Velocity = 1.13 fps, Avg. Travel Time= 15.0 min

Peak Storage= 1,539 cf @ 12.54 hrs
Average Depth at Peak Storage= 0.50'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 127.78 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 ' Top Width= 12.00'
Length= 1,020.0' Slope= 0.0265 '
Inlet Invert= 1,800.00', Outlet Invert= 1,773.00'

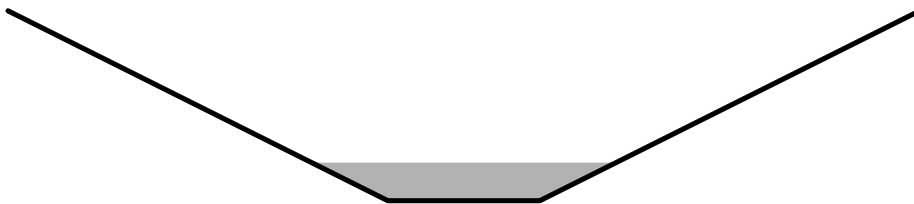

Summary for Reach 58A: Overland Flow

Inflow Area = 3.000 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af
Outflow = 0.46 cfs @ 13.75 hrs, Volume= 0.152 af, Atten= 76%, Lag= 98.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.11 fps, Min. Travel Time= 71.2 min
Avg. Velocity = 0.05 fps, Avg. Travel Time= 151.8 min

Peak Storage= 1,948 cf @ 12.56 hrs
Average Depth at Peak Storage= 0.04'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 151.22 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 478.0' Slope= 0.0711 '
Inlet Invert= 2,212.00', Outlet Invert= 2,178.00'



‡


Summary for Reach 61: Vegetated Roadside Swale

Inflow Area = 5.521 ac, 6.72% Impervious, Inflow Depth = 0.68" for 1-YEAR event
Inflow = 4.80 cfs @ 12.06 hrs, Volume= 0.313 af
Outflow = 4.51 cfs @ 12.13 hrs, Volume= 0.313 af, Atten= 6%, Lag= 4.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.75 fps, Min. Travel Time= 2.6 min
Avg. Velocity = 1.73 fps, Avg. Travel Time= 7.2 min

Peak Storage= 720 cf @ 12.09 hrs
Average Depth at Peak Storage= 0.71'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 67.71 cfs

1.00' x 3.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 '/' Top Width= 4.00'
Length= 751.0' Slope= 0.0613 '/'
Inlet Invert= 2,000.00', Outlet Invert= 1,954.00'



Summary for Reach 66: Stream Channel

Inflow Area = 128.608 ac, 1.59% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 29.07 cfs @ 12.26 hrs, Volume= 6.788 af
Outflow = 27.03 cfs @ 12.42 hrs, Volume= 6.788 af, Atten= 7%, Lag= 9.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.95 fps, Min. Travel Time= 5.3 min
Avg. Velocity = 1.43 fps, Avg. Travel Time= 22.0 min

Peak Storage= 8,566 cf @ 12.33 hrs
Average Depth at Peak Storage= 0.61'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 297.74 cfs

5.00' x 2.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 21.00'
Length= 1,884.0' Slope= 0.1152 '/'
Inlet Invert= 2,017.00', Outlet Invert= 1,800.00'



‡

Summary for Reach 78: Stream Channel

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 17.10 cfs @ 13.58 hrs, Volume= 4.750 af
Outflow = 17.07 cfs @ 13.64 hrs, Volume= 4.750 af, Atten= 0%, Lag= 3.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.67 fps, Min. Travel Time= 2.0 min
Avg. Velocity = 1.39 fps, Avg. Travel Time= 8.2 min

Peak Storage= 2,060 cf @ 13.61 hrs
Average Depth at Peak Storage= 0.40'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 213.41 cfs

6.00' x 1.50' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 18.00'
Length= 685.0' Slope= 0.1635 '/'
Inlet Invert= 2,170.00', Outlet Invert= 2,058.00'



Summary for Reach 80: Stream Channel

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 17.07 cfs @ 13.64 hrs, Volume= 4.750 af
Outflow = 16.98 cfs @ 13.74 hrs, Volume= 4.750 af, Atten= 1%, Lag= 6.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.70 fps, Min. Travel Time= 3.3 min
Avg. Velocity = 0.90 fps, Avg. Travel Time= 13.7 min

Peak Storage= 3,397 cf @ 13.68 hrs
Average Depth at Peak Storage= 0.56'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 209.43 cfs

6.00' x 2.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 22.00'
Length= 740.0' Slope= 0.0473 '/'
Inlet Invert= 2,055.00', Outlet Invert= 2,020.00'



Summary for Reach 82: Overland Flow

Inflow Area = 1.300 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af
Outflow = 0.09 cfs @ 16.94 hrs, Volume= 0.066 af, Atten= 90%, Lag= 291.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.07 fps, Min. Travel Time= 215.5 min
Avg. Velocity = 0.04 fps, Avg. Travel Time= 361.8 min

Peak Storage= 1,136 cf @ 13.35 hrs
Average Depth at Peak Storage= 0.01'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 53.31 cfs

100.00' x 0.50' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 200.00'
Length= 938.0' Slope= 0.1354 '/'
Inlet Invert= 2,347.00', Outlet Invert= 2,220.00'



Summary for Reach 82a: Overland Flow

Inflow Area = 62.628 ac, 1.58% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 19.39 cfs @ 12.98 hrs, Volume= 3.272 af
Outflow = 14.95 cfs @ 13.58 hrs, Volume= 3.272 af, Atten= 23%, Lag= 36.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.41 fps, Min. Travel Time= 19.3 min
Avg. Velocity = 0.08 fps, Avg. Travel Time= 96.5 min

Peak Storage= 17,297 cf @ 13.26 hrs
Average Depth at Peak Storage= 0.28'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 164.89 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 473.0' Slope= 0.0846 '/'
Inlet Invert= 2,220.00', Outlet Invert= 2,180.00'



Summary for Reach 83A: Overland Flow

Inflow Area = 30.315 ac, 1.06% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af
Outflow = 10.29 cfs @ 12.67 hrs, Volume= 1.531 af, Atten= 30%, Lag= 26.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.46 fps, Min. Travel Time= 16.1 min
Avg. Velocity = 0.13 fps, Avg. Travel Time= 57.9 min

Peak Storage= 9,967 cf @ 12.40 hrs
Average Depth at Peak Storage= 0.19'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 232.26 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 441.0' Slope= 0.1678 '/'
Inlet Invert= 2,326.00', Outlet Invert= 2,252.00'



Summary for Reach 84A: Overland Flow

Inflow Area = 61.328 ac, 1.61% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 21.55 cfs @ 12.68 hrs, Volume= 3.206 af
Outflow = 19.39 cfs @ 12.98 hrs, Volume= 3.206 af, Atten= 10%, Lag= 17.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.49 fps, Min. Travel Time= 9.3 min
Avg. Velocity = 0.13 fps, Avg. Travel Time= 35.6 min

Peak Storage= 10,876 cf @ 12.82 hrs
Average Depth at Peak Storage= 0.30'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 192.72 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 277.0' Slope= 0.1155 '/'
Inlet Invert= 2,252.00', Outlet Invert= 2,220.00'



Summary for Reach 84B: Overland Flow

Inflow Area = 31.013 ac, 2.16% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 13.91 cfs @ 12.31 hrs, Volume= 1.675 af
Outflow = 11.30 cfs @ 12.70 hrs, Volume= 1.675 af, Atten= 19%, Lag= 22.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.46 fps, Min. Travel Time= 13.3 min
Avg. Velocity = 0.13 fps, Avg. Travel Time= 46.4 min

Peak Storage= 9,002 cf @ 12.48 hrs
Average Depth at Peak Storage= 0.20'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 228.33 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 370.0' Slope= 0.1622 '/'
Inlet Invert= 2,312.00', Outlet Invert= 2,252.00'



Summary for Reach 85A: Overland Flow

Inflow Area = 4.281 ac, 0.54% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af
Outflow = 0.86 cfs @ 13.27 hrs, Volume= 0.216 af, Atten= 65%, Lag= 67.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.18 fps, Min. Travel Time= 46.5 min
Avg. Velocity = 0.08 fps, Avg. Travel Time= 107.2 min

Peak Storage= 2,406 cf @ 12.49 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 221.40 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 505.0' Slope= 0.1525 '/'
Inlet Invert= 2,292.00', Outlet Invert= 2,215.00'



Summary for Reach 85B: Overland Flow

Inflow Area = 8.621 ac, 0.65% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 1.84 cfs @ 12.44 hrs, Volume= 0.435 af
Outflow = 1.09 cfs @ 14.39 hrs, Volume= 0.435 af, Atten= 41%, Lag= 116.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.16 fps, Min. Travel Time= 47.3 min
Avg. Velocity = 0.06 fps, Avg. Travel Time= 116.5 min

Peak Storage= 3,091 cf @ 13.60 hrs
Average Depth at Peak Storage= 0.06'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 157.60 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' ' Top Width= 300.00'
Length= 453.0' Slope= 0.0773 ' '
Inlet Invert= 2,215.00', Outlet Invert= 2,180.00'



Summary for Reach 86A: Overland Flow

Inflow Area = 4.340 ac, 0.76% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af
Outflow = 1.84 cfs @ 12.44 hrs, Volume= 0.219 af, Atten= 42%, Lag= 22.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.22 fps, Min. Travel Time= 14.9 min
Avg. Velocity = 0.07 fps, Avg. Travel Time= 43.4 min

Peak Storage= 1,652 cf @ 12.19 hrs
Average Depth at Peak Storage= 0.08'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 190.45 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' ' Top Width= 300.00'
Length= 195.0' Slope= 0.1128 ' '
Inlet Invert= 2,237.00', Outlet Invert= 2,215.00'




Summary for Reach 88: Roadside Swale

Inflow Area = 2.000 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af
Outflow = 1.28 cfs @ 12.17 hrs, Volume= 0.101 af, Atten= 4%, Lag= 4.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.29 fps, Min. Travel Time= 2.4 min
Avg. Velocity = 1.09 fps, Avg. Travel Time= 7.2 min

Peak Storage= 185 cf @ 12.13 hrs
Average Depth at Peak Storage= 0.19'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 63.06 cfs

2.00' x 2.00' deep channel, n= 0.035
Side Slope Z-value= 0.5 '/' Top Width= 4.00'
Length= 472.0' Slope= 0.0678 '/'
Inlet Invert= 2,207.00', Outlet Invert= 2,175.00'

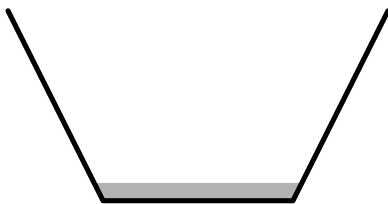


Summary for Reach 89: Overland Flow through Woods

Inflow Area = 10.642 ac, 1.77% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 6.89 cfs @ 12.14 hrs, Volume= 0.575 af
Outflow = 4.98 cfs @ 12.46 hrs, Volume= 0.575 af, Atten= 28%, Lag= 19.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.46 fps, Min. Travel Time= 12.0 min
Avg. Velocity = 0.59 fps, Avg. Travel Time= 29.6 min

Peak Storage= 3,592 cf @ 12.26 hrs
Average Depth at Peak Storage= 0.02'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 1,000.42 cfs

150.00' x 0.50' deep channel, n= 0.035 Earth, dense weeds
Side Slope Z-value= 100.0 '/' Top Width= 250.00'
Length= 1,051.0' Slope= 0.1884 '/'
Inlet Invert= 1,998.00', Outlet Invert= 1,800.00'

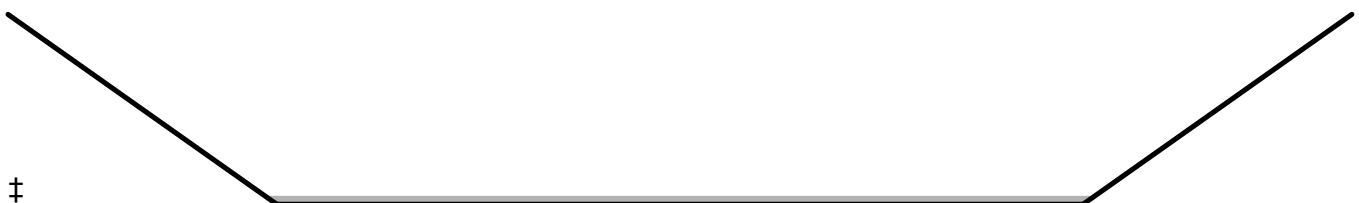

‡

Summary for Reach 91: Overland Flow

Inflow Area = 12.874 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 4.82 cfs @ 12.38 hrs, Volume= 0.650 af
Outflow = 4.77 cfs @ 12.46 hrs, Volume= 0.650 af, Atten= 1%, Lag= 5.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.06 fps, Min. Travel Time= 3.1 min
Avg. Velocity = 0.38 fps, Avg. Travel Time= 8.7 min

Peak Storage= 893 cf @ 12.41 hrs
Average Depth at Peak Storage= 0.20'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 79.94 cfs

20.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 10.0 '/' Top Width= 40.00'
Length= 198.0' Slope= 0.0303 '/'
Inlet Invert= 1,893.00', Outlet Invert= 1,887.00'




Summary for Reach 92: Channel Along RR Tracks

Inflow Area = 12.874 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 4.77 cfs @ 12.46 hrs, Volume= 0.650 af
Outflow = 4.56 cfs @ 12.64 hrs, Volume= 0.650 af, Atten= 4%, Lag= 10.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.55 fps, Min. Travel Time= 5.7 min
Avg. Velocity = 1.45 fps, Avg. Travel Time= 14.0 min

Peak Storage= 1,563 cf @ 12.54 hrs
Average Depth at Peak Storage= 0.44'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 243.54 cfs

2.00' x 3.00' deep channel, n= 0.035
Side Slope Z-value= 2.0 '/' Top Width= 14.00'
Length= 1,216.0' Slope= 0.0317 '/'
Inlet Invert= 1,887.00', Outlet Invert= 1,848.50'

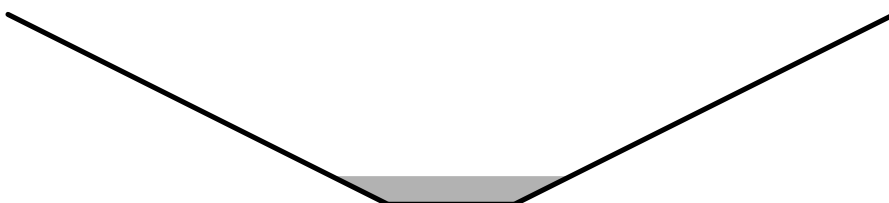

Summary for Reach 197: Stream Channel

Inflow Area = 88.624 ac, 0.78% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 44.68 cfs @ 12.28 hrs, Volume= 4.519 af
Outflow = 42.70 cfs @ 12.40 hrs, Volume= 4.519 af, Atten= 4%, Lag= 7.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.15 fps, Min. Travel Time= 4.1 min
Avg. Velocity = 2.35 fps, Avg. Travel Time= 10.6 min

Peak Storage= 10,437 cf @ 12.34 hrs
Average Depth at Peak Storage= 0.39'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 9,816.53 cfs

15.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 7.0 '/' Top Width= 99.00'
Length= 1,500.0' Slope= 0.1807 '/'
Inlet Invert= 2,015.00', Outlet Invert= 1,744.00'




Summary for Reach 198: Stream Channel

Inflow Area = 88.624 ac, 0.78% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 45.77 cfs @ 12.21 hrs, Volume= 4.519 af
Outflow = 44.68 cfs @ 12.28 hrs, Volume= 4.519 af, Atten= 2%, Lag= 4.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.04 fps, Min. Travel Time= 2.6 min
Avg. Velocity = 3.32 fps, Avg. Travel Time= 6.3 min

Peak Storage= 7,044 cf @ 12.24 hrs
Average Depth at Peak Storage= 0.78'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 4,399.92 cfs

4.00' x 6.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 4.0 '/' Top Width= 52.00'
Length= 1,262.0' Slope= 0.1688 '/'
Inlet Invert= 2,228.00', Outlet Invert= 2,015.00'

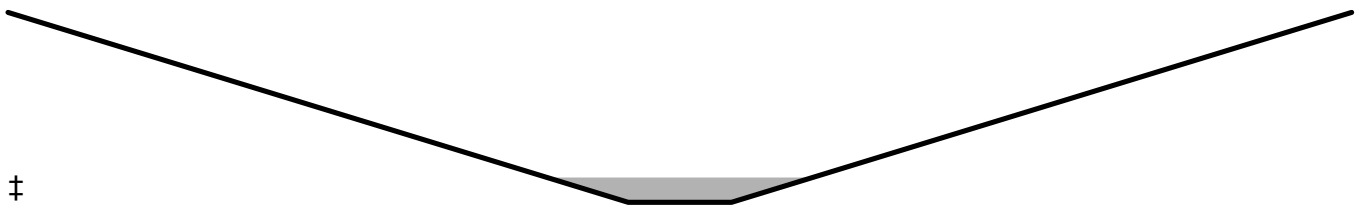

Summary for Reach 199: Overland Flow

Inflow Area = 12.214 ac, 2.97% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 7.13 cfs @ 12.18 hrs, Volume= 0.660 af
Outflow = 7.08 cfs @ 12.22 hrs, Volume= 0.660 af, Atten= 1%, Lag= 2.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.49 fps, Min. Travel Time= 1.7 min
Avg. Velocity = 0.87 fps, Avg. Travel Time= 4.8 min

Peak Storage= 710 cf @ 12.20 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 458.82 cfs

50.00' x 0.50' deep channel, n= 0.040 Earth, dense weeds
Side Slope Z-value= 100.0 '/' Top Width= 150.00'
Length= 250.0' Slope= 0.2640 '/'
Inlet Invert= 2,234.00', Outlet Invert= 2,168.00'




Summary for Reach 295: Roadside Channel

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 7.79 cfs @ 12.47 hrs, Volume= 0.826 af
Outflow = 7.73 cfs @ 12.51 hrs, Volume= 0.826 af, Atten= 1%, Lag= 2.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.60 fps, Min. Travel Time= 1.4 min
Avg. Velocity = 1.81 fps, Avg. Travel Time= 3.5 min

Peak Storage= 639 cf @ 12.49 hrs
Average Depth at Peak Storage= 0.62'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 163.61 cfs

1.50' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 11.50'
Length= 379.0' Slope= 0.0528 '/'
Inlet Invert= 2,085.00', Outlet Invert= 2,065.00'

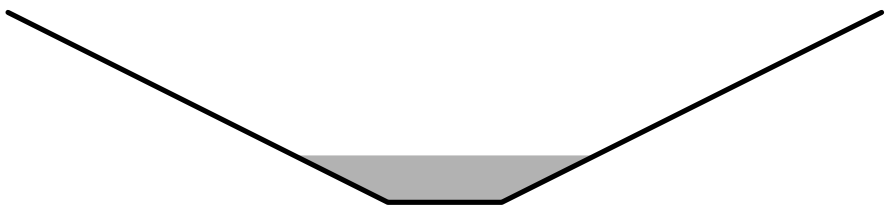

Summary for Reach 296: Wetland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 7.86 cfs @ 12.43 hrs, Volume= 0.826 af
Outflow = 7.79 cfs @ 12.47 hrs, Volume= 0.826 af, Atten= 1%, Lag= 2.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.74 fps, Min. Travel Time= 1.4 min
Avg. Velocity = 1.45 fps, Avg. Travel Time= 3.7 min

Peak Storage= 668 cf @ 12.45 hrs
Average Depth at Peak Storage= 0.57'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 122.08 cfs

2.00' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals
Side Slope Z-value= 3.0 '/' Top Width= 14.00'
Length= 320.0' Slope= 0.0375 '/'
Inlet Invert= 2,096.00', Outlet Invert= 2,084.00'



Summary for Reach 297: Overland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 7.98 cfs @ 12.37 hrs, Volume= 0.826 af
Outflow = 7.86 cfs @ 12.43 hrs, Volume= 0.826 af, Atten= 1%, Lag= 3.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.89 fps, Min. Travel Time= 2.1 min
Avg. Velocity = 0.96 fps, Avg. Travel Time= 6.3 min

Peak Storage= 1,000 cf @ 12.39 hrs
Average Depth at Peak Storage= 0.08'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 225.40 cfs

30.00' x 0.50' deep channel, n= 0.040 Winding stream, pools & shoals
Side Slope Z-value= 50.0 '/' Top Width= 80.00'
Length= 366.0' Slope= 0.2022 '/'
Inlet Invert= 2,170.00', Outlet Invert= 2,096.00'



‡

Summary for Reach 298: Wetland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 8.93 cfs @ 12.19 hrs, Volume= 0.826 af
Outflow = 7.98 cfs @ 12.37 hrs, Volume= 0.826 af, Atten= 11%, Lag= 10.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.09 fps, Min. Travel Time= 6.3 min
Avg. Velocity = 0.38 fps, Avg. Travel Time= 18.0 min

Peak Storage= 3,003 cf @ 12.26 hrs
Average Depth at Peak Storage= 0.07'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 802.14 cfs

100.00' x 1.00' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 50.0 '/' Top Width= 200.00'
Length= 408.0' Slope= 0.0931 '/'
Inlet Invert= 2,208.00', Outlet Invert= 2,170.00'



Summary for Reach 299: Overland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 8.97 cfs @ 12.17 hrs, Volume= 0.826 af
Outflow = 8.93 cfs @ 12.19 hrs, Volume= 0.826 af, Atten= 0%, Lag= 1.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.76 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 1.50 fps, Avg. Travel Time= 1.5 min

Peak Storage= 322 cf @ 12.18 hrs
Average Depth at Peak Storage= 0.14'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 134.95 cfs

10.00' x 0.50' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 50.0 '/' Top Width= 60.00'
Length= 135.0' Slope= 0.3481 '/'
Inlet Invert= 2,255.00', Outlet Invert= 2,208.00'



Summary for Reach 1R: Wetland Flow

Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.00 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 0.00 fps, Avg. Travel Time= 0.0 min

Peak Storage= 0 cf @ 0.00 hrs
Average Depth at Peak Storage= 0.00'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 802.14 cfs

100.00' x 1.00' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 50.0 ' / ' Top Width= 200.00'
Length= 408.0' Slope= 0.0931 ' / '
Inlet Invert= 2,208.00', Outlet Invert= 2,170.00'



Summary for Reach 3: Rip Rap Channel

Inflow Area = 148.584 ac, 0.82% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 366.11 cfs @ 12.21 hrs, Volume= 34.829 af
Outflow = 366.04 cfs @ 12.21 hrs, Volume= 34.829 af, Atten= 0%, Lag= 0.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 25.97 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 8.20 fps, Avg. Travel Time= 0.1 min

Peak Storage= 719 cf @ 12.21 hrs
Average Depth at Peak Storage= 2.57'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 257.29 cfs

5.00' x 2.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 0.2 ' / ' Top Width= 5.80'
Length= 51.0' Slope= 0.5098 ' / '
Inlet Invert= 1,740.00', Outlet Invert= 1,714.00'



Summary for Reach 5: Stream Channel

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 46.62 cfs @ 12.33 hrs, Volume= 3.824 af
Outflow = 46.19 cfs @ 12.38 hrs, Volume= 3.824 af, Atten= 1%, Lag= 2.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 9.56 fps, Min. Travel Time= 1.5 min
Avg. Velocity = 2.88 fps, Avg. Travel Time= 5.0 min

Peak Storage= 4,213 cf @ 12.35 hrs
Average Depth at Peak Storage= 0.85'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 1,064.40 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 870.0' Slope= 0.1954 '/'
Inlet Invert= 2,060.00', Outlet Invert= 1,890.00'




Summary for Reach 5a: Stream Channel

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 46.19 cfs @ 12.38 hrs, Volume= 3.824 af
Outflow = 46.00 cfs @ 12.39 hrs, Volume= 3.824 af, Atten= 0%, Lag= 1.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 10.37 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 3.36 fps, Avg. Travel Time= 1.8 min

Peak Storage= 1,581 cf @ 12.38 hrs
Average Depth at Peak Storage= 1.07'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 290.71 cfs

2.00' x 2.50' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 12.00'
Length= 355.0' Slope= 0.2141 '/'
Inlet Invert= 1,890.00', Outlet Invert= 1,814.00'

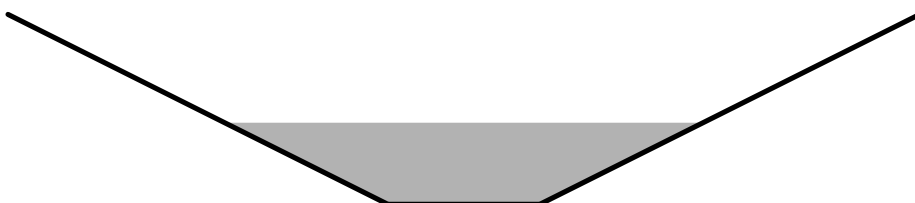

Summary for Reach 8: Stream Channel

Inflow Area = 77.687 ac, 1.16% Impervious, Inflow Depth = 2.88" for 10-YEAR event
Inflow = 222.80 cfs @ 12.10 hrs, Volume= 18.639 af
Outflow = 221.91 cfs @ 12.11 hrs, Volume= 18.639 af, Atten= 0%, Lag= 0.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 16.14 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 5.23 fps, Avg. Travel Time= 0.8 min

Peak Storage= 3,376 cf @ 12.10 hrs
Average Depth at Peak Storage= 1.31'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 578.22 cfs

4.00' x 2.00' deep channel, n= 0.040
Side Slope Z-value= 5.0 '/' Top Width= 24.00'
Length= 245.0' Slope= 0.2571 '/'
Inlet Invert= 1,813.00', Outlet Invert= 1,750.00'



Summary for Reach 11R: Overland Flow

Inflow Area = 20.120 ac, 2.73% Impervious, Inflow Depth = 2.90" for 10-YEAR event
Inflow = 58.43 cfs @ 12.17 hrs, Volume= 4.860 af
Outflow = 53.37 cfs @ 12.36 hrs, Volume= 4.860 af, Atten= 9%, Lag= 11.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.85 fps, Min. Travel Time= 6.9 min
Avg. Velocity = 0.66 fps, Avg. Travel Time= 29.6 min

Peak Storage= 22,106 cf @ 12.25 hrs
Average Depth at Peak Storage= 0.24'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 620.77 cfs

75.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 15.0 '/' Top Width= 105.00'
Length= 1,180.0' Slope= 0.1695 '/'
Inlet Invert= 1,973.00', Outlet Invert= 1,773.00'



Summary for Reach 12R: Overland Flow

Inflow Area = 2.097 ac, 8.77% Impervious, Inflow Depth = 3.09" for 10-YEAR event
Inflow = 8.69 cfs @ 12.06 hrs, Volume= 0.540 af
Outflow = 7.10 cfs @ 12.27 hrs, Volume= 0.540 af, Atten= 18%, Lag= 12.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.91 fps, Min. Travel Time= 8.3 min
Avg. Velocity = 0.50 fps, Avg. Travel Time= 31.7 min

Peak Storage= 3,552 cf @ 12.13 hrs
Average Depth at Peak Storage= 0.12'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 305.91 cfs

30.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 15.0 '/' Top Width= 60.00'
Length= 950.0' Slope= 0.1968 '/'
Inlet Invert= 1,960.00', Outlet Invert= 1,773.00'



Summary for Reach 13: RR Swale

Inflow Area = 77.687 ac, 1.16% Impervious, Inflow Depth = 2.88" for 10-YEAR event
Inflow = 221.91 cfs @ 12.11 hrs, Volume= 18.639 af
Outflow = 220.40 cfs @ 12.13 hrs, Volume= 18.639 af, Atten= 1%, Lag= 1.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.84 fps, Min. Travel Time= 0.7 min
Avg. Velocity = 2.89 fps, Avg. Travel Time= 2.1 min

Peak Storage= 9,029 cf @ 12.12 hrs
Average Depth at Peak Storage= 2.05'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 529.21 cfs

4.00' x 3.00' deep channel, n= 0.040
Side Slope Z-value= 4.0 '/' Top Width= 28.00'
Length= 360.0' Slope= 0.0444 '/'
Inlet Invert= 1,750.00', Outlet Invert= 1,734.00'




Summary for Reach 58: Swale along RR Tracks

Inflow Area = 10.642 ac, 1.77% Impervious, Inflow Depth = 2.90" for 10-YEAR event
Inflow = 32.28 cfs @ 12.27 hrs, Volume= 2.571 af
Outflow = 31.00 cfs @ 12.37 hrs, Volume= 2.571 af, Atten= 4%, Lag= 5.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.09 fps, Min. Travel Time= 3.3 min
Avg. Velocity = 1.56 fps, Avg. Travel Time= 10.9 min

Peak Storage= 6,219 cf @ 12.32 hrs
Average Depth at Peak Storage= 1.32'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 127.78 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 12.00'
Length= 1,020.0' Slope= 0.0265 '/'
Inlet Invert= 1,800.00', Outlet Invert= 1,773.00'

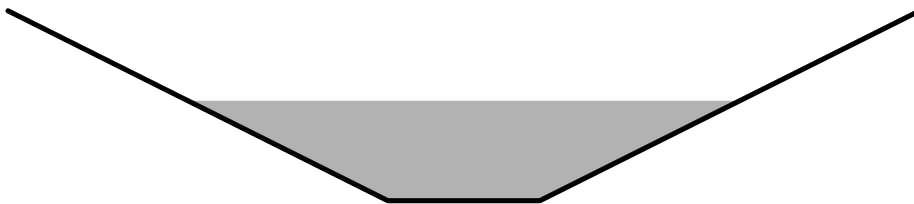

Summary for Reach 58A: Overland Flow

Inflow Area = 3.000 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 10.31 cfs @ 12.09 hrs, Volume= 0.701 af
Outflow = 4.96 cfs @ 12.78 hrs, Volume= 0.701 af, Atten= 52%, Lag= 41.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.27 fps, Min. Travel Time= 29.8 min
Avg. Velocity = 0.07 fps, Avg. Travel Time= 121.9 min

Peak Storage= 8,863 cf @ 12.28 hrs
Average Depth at Peak Storage= 0.16'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 151.22 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 478.0' Slope= 0.0711 '/'
Inlet Invert= 2,212.00', Outlet Invert= 2,178.00'



‡


Summary for Reach 61: Vegetated Roadside Swale

Inflow Area = 5.521 ac, 6.72% Impervious, Inflow Depth = 2.97" for 10-YEAR event
Inflow = 22.93 cfs @ 12.04 hrs, Volume= 1.367 af
Outflow = 22.39 cfs @ 12.09 hrs, Volume= 1.367 af, Atten= 2%, Lag= 3.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.98 fps, Min. Travel Time= 1.8 min
Avg. Velocity = 2.42 fps, Avg. Travel Time= 5.2 min

Peak Storage= 2,410 cf @ 12.06 hrs
Average Depth at Peak Storage= 1.72'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 67.71 cfs

1.00' x 3.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 '/' Top Width= 4.00'
Length= 751.0' Slope= 0.0613 '/'
Inlet Invert= 2,000.00', Outlet Invert= 1,954.00'



Summary for Reach 66: Stream Channel

Inflow Area = 128.608 ac, 1.59% Impervious, Inflow Depth = 2.87" for 10-YEAR event
Inflow = 161.62 cfs @ 12.20 hrs, Volume= 30.714 af
Outflow = 156.56 cfs @ 12.29 hrs, Volume= 30.714 af, Atten= 3%, Lag= 5.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 9.68 fps, Min. Travel Time= 3.2 min
Avg. Velocity = 1.86 fps, Avg. Travel Time= 16.9 min

Peak Storage= 30,535 cf @ 12.24 hrs
Average Depth at Peak Storage= 1.48'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 297.74 cfs

5.00' x 2.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 21.00'
Length= 1,884.0' Slope= 0.1152 '/'
Inlet Invert= 2,017.00', Outlet Invert= 1,800.00'



‡

Summary for Reach 78: Stream Channel

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 2.85" for 10-YEAR event
Inflow = 130.68 cfs @ 12.97 hrs, Volume= 21.601 af
Outflow = 130.41 cfs @ 13.01 hrs, Volume= 21.601 af, Atten= 0%, Lag= 1.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 10.37 fps, Min. Travel Time= 1.1 min
Avg. Velocity = 1.83 fps, Avg. Travel Time= 6.2 min

Peak Storage= 8,622 cf @ 12.99 hrs
Average Depth at Peak Storage= 1.18'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 213.41 cfs

6.00' x 1.50' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 18.00'
Length= 685.0' Slope= 0.1635 '/'
Inlet Invert= 2,170.00', Outlet Invert= 2,058.00'



Summary for Reach 80: Stream Channel

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 2.85" for 10-YEAR event
Inflow = 130.41 cfs @ 13.01 hrs, Volume= 21.601 af
Outflow = 130.05 cfs @ 13.06 hrs, Volume= 21.601 af, Atten= 0%, Lag= 3.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.59 fps, Min. Travel Time= 1.9 min
Avg. Velocity = 1.17 fps, Avg. Travel Time= 10.6 min

Peak Storage= 14,598 cf @ 13.03 hrs
Average Depth at Peak Storage= 1.59'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 209.43 cfs

6.00' x 2.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 22.00'
Length= 740.0' Slope= 0.0473 '/'
Inlet Invert= 2,055.00', Outlet Invert= 2,020.00'



Summary for Reach 82: Overland Flow

Inflow Area = 1.300 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 4.87 cfs @ 12.06 hrs, Volume= 0.304 af
Outflow = 1.08 cfs @ 13.77 hrs, Volume= 0.304 af, Atten= 78%, Lag= 102.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.19 fps, Min. Travel Time= 82.5 min
Avg. Velocity = 0.05 fps, Avg. Travel Time= 306.3 min

Peak Storage= 5,366 cf @ 12.39 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 53.31 cfs

100.00' x 0.50' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 200.00'
Length= 938.0' Slope= 0.1354 '/'
Inlet Invert= 2,347.00', Outlet Invert= 2,220.00'



Summary for Reach 82a: Overland Flow

Inflow Area = 62.628 ac, 1.58% Impervious, Inflow Depth = 2.68" for 10-YEAR event
Inflow = 101.52 cfs @ 12.67 hrs, Volume= 13.991 af
Outflow = 92.40 cfs @ 13.01 hrs, Volume= 13.991 af, Atten= 9%, Lag= 20.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.70 fps, Min. Travel Time= 11.2 min
Avg. Velocity = 0.10 fps, Avg. Travel Time= 75.6 min

Peak Storage= 62,178 cf @ 12.82 hrs
Average Depth at Peak Storage= 0.75'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 164.89 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 473.0' Slope= 0.0846 '/'
Inlet Invert= 2,220.00', Outlet Invert= 2,180.00'



Summary for Reach 83A: Overland Flow

Inflow Area = 30.315 ac, 1.06% Impervious, Inflow Depth = 2.48" for 10-YEAR event
Inflow = 46.42 cfs @ 12.19 hrs, Volume= 6.253 af
Outflow = 42.96 cfs @ 12.51 hrs, Volume= 6.253 af, Atten= 7%, Lag= 19.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.72 fps, Min. Travel Time= 10.2 min
Avg. Velocity = 0.18 fps, Avg. Travel Time= 41.7 min

Peak Storage= 26,373 cf @ 12.34 hrs
Average Depth at Peak Storage= 0.42'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 232.26 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 441.0' Slope= 0.1678 '/'
Inlet Invert= 2,326.00', Outlet Invert= 2,252.00'



Summary for Reach 84A: Overland Flow

Inflow Area = 61.328 ac, 1.61% Impervious, Inflow Depth = 2.68" for 10-YEAR event
Inflow = 104.13 cfs @ 12.49 hrs, Volume= 13.687 af
Outflow = 101.51 cfs @ 12.67 hrs, Volume= 13.687 af, Atten= 3%, Lag= 10.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.81 fps, Min. Travel Time= 5.7 min
Avg. Velocity = 0.18 fps, Avg. Travel Time= 25.6 min

Peak Storage= 34,815 cf @ 12.58 hrs
Average Depth at Peak Storage= 0.73'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 192.72 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 277.0' Slope= 0.1155 '/'
Inlet Invert= 2,252.00', Outlet Invert= 2,220.00'



Summary for Reach 84B: Overland Flow

Inflow Area = 31.013 ac, 2.16% Impervious, Inflow Depth = 2.88" for 10-YEAR event
Inflow = 64.69 cfs @ 12.23 hrs, Volume= 7.434 af
Outflow = 61.22 cfs @ 12.48 hrs, Volume= 7.434 af, Atten= 5%, Lag= 15.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.79 fps, Min. Travel Time= 7.8 min
Avg. Velocity = 0.19 fps, Avg. Travel Time= 33.0 min

Peak Storage= 28,726 cf @ 12.35 hrs
Average Depth at Peak Storage= 0.51'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 228.33 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 370.0' Slope= 0.1622 '/'
Inlet Invert= 2,312.00', Outlet Invert= 2,252.00'



Summary for Reach 85A: Overland Flow

Inflow Area = 4.281 ac, 0.54% Impervious, Inflow Depth = 4.95" for 10-YEAR event
Inflow = 40.92 cfs @ 12.21 hrs, Volume= 1.765 af
Outflow = 30.67 cfs @ 12.58 hrs, Volume= 1.765 af, Atten= 25%, Lag= 21.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.63 fps, Min. Travel Time= 13.4 min
Avg. Velocity = 0.10 fps, Avg. Travel Time= 80.5 min

Peak Storage= 24,784 cf @ 12.36 hrs
Average Depth at Peak Storage= 0.36'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 221.40 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 505.0' Slope= 0.1525 '/'
Inlet Invert= 2,292.00', Outlet Invert= 2,215.00'



Summary for Reach 85B: Overland Flow

Inflow Area = 8.621 ac, 0.65% Impervious, Inflow Depth = 4.05" for 10-YEAR event
Inflow = 36.47 cfs @ 12.55 hrs, Volume= 2.906 af
Outflow = 29.55 cfs @ 12.93 hrs, Volume= 2.906 af, Atten= 19%, Lag= 22.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.49 fps, Min. Travel Time= 15.4 min
Avg. Velocity = 0.09 fps, Avg. Travel Time= 87.5 min

Peak Storage= 27,375 cf @ 12.67 hrs
Average Depth at Peak Storage= 0.42'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 157.60 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 453.0' Slope= 0.0773 '/'
Inlet Invert= 2,215.00', Outlet Invert= 2,180.00'



Summary for Reach 86A: Overland Flow

Inflow Area = 4.340 ac, 0.76% Impervious, Inflow Depth = 3.16" for 10-YEAR event
Inflow = 19.66 cfs @ 12.19 hrs, Volume= 1.142 af
Outflow = 17.29 cfs @ 12.35 hrs, Volume= 1.142 af, Atten= 12%, Lag= 9.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.47 fps, Min. Travel Time= 6.9 min
Avg. Velocity = 0.10 fps, Avg. Travel Time= 31.1 min

Peak Storage= 7,157 cf @ 12.24 hrs
Average Depth at Peak Storage= 0.29'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 190.45 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 '/' Top Width= 300.00'
Length= 195.0' Slope= 0.1128 '/'
Inlet Invert= 2,237.00', Outlet Invert= 2,215.00'




Summary for Reach 88: Roadside Swale

Inflow Area = 2.000 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 7.10 cfs @ 12.08 hrs, Volume= 0.468 af
Outflow = 7.00 cfs @ 12.12 hrs, Volume= 0.468 af, Atten= 1%, Lag= 2.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.79 fps, Min. Travel Time= 1.4 min
Avg. Velocity = 1.65 fps, Avg. Travel Time= 4.8 min

Peak Storage= 573 cf @ 12.10 hrs
Average Depth at Peak Storage= 0.54'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 63.06 cfs

2.00' x 2.00' deep channel, n= 0.035
Side Slope Z-value= 0.5 '/' Top Width= 4.00'
Length= 472.0' Slope= 0.0678 '/'
Inlet Invert= 2,207.00', Outlet Invert= 2,175.00'

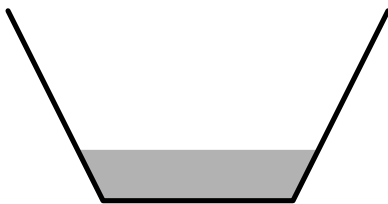

Summary for Reach 89: Overland Flow through Woods

Inflow Area = 10.642 ac, 1.77% Impervious, Inflow Depth = 2.90" for 10-YEAR event
Inflow = 35.36 cfs @ 12.12 hrs, Volume= 2.571 af
Outflow = 32.28 cfs @ 12.27 hrs, Volume= 2.571 af, Atten= 9%, Lag= 9.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.01 fps, Min. Travel Time= 5.8 min
Avg. Velocity = 0.78 fps, Avg. Travel Time= 22.3 min

Peak Storage= 11,327 cf @ 12.18 hrs
Average Depth at Peak Storage= 0.07'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 1,000.42 cfs

150.00' x 0.50' deep channel, n= 0.035 Earth, dense weeds
Side Slope Z-value= 100.0 '/' Top Width= 250.00'
Length= 1,051.0' Slope= 0.1884 '/'
Inlet Invert= 1,998.00', Outlet Invert= 1,800.00'



‡

Summary for Reach 91: Overland Flow

Inflow Area = 12.874 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 27.27 cfs @ 12.32 hrs, Volume= 3.010 af
Outflow = 27.18 cfs @ 12.37 hrs, Volume= 3.010 af, Atten= 0%, Lag= 2.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.91 fps, Min. Travel Time= 1.7 min
Avg. Velocity = 0.57 fps, Avg. Travel Time= 5.8 min

Peak Storage= 2,811 cf @ 12.34 hrs
Average Depth at Peak Storage= 0.56'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 79.94 cfs

20.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 10.0 '/' Top Width= 40.00'
Length= 198.0' Slope= 0.0303 '/'
Inlet Invert= 1,893.00', Outlet Invert= 1,887.00'




Summary for Reach 92: Channel Along RR Tracks

Inflow Area = 12.874 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 27.18 cfs @ 12.37 hrs, Volume= 3.010 af
Outflow = 26.72 cfs @ 12.48 hrs, Volume= 3.010 af, Atten= 2%, Lag= 6.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.78 fps, Min. Travel Time= 3.5 min
Avg. Velocity = 2.05 fps, Avg. Travel Time= 9.9 min

Peak Storage= 5,627 cf @ 12.42 hrs
Average Depth at Peak Storage= 1.10'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 243.54 cfs

2.00' x 3.00' deep channel, n= 0.035
Side Slope Z-value= 2.0 '/' Top Width= 14.00'
Length= 1,216.0' Slope= 0.0317 '/'
Inlet Invert= 1,887.00', Outlet Invert= 1,848.50'

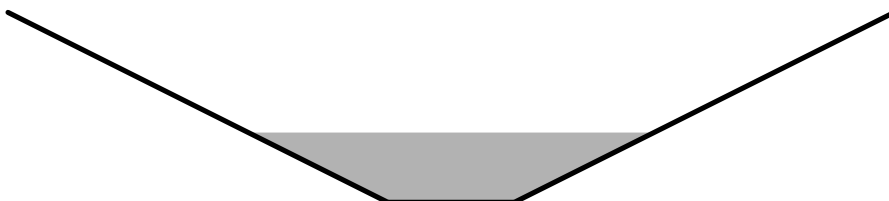

Summary for Reach 197: Stream Channel

Inflow Area = 88.624 ac, 0.78% Impervious, Inflow Depth = 2.82" for 10-YEAR event
Inflow = 249.32 cfs @ 12.22 hrs, Volume= 20.813 af
Outflow = 244.79 cfs @ 12.29 hrs, Volume= 20.813 af, Atten= 2%, Lag= 4.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 10.67 fps, Min. Travel Time= 2.3 min
Avg. Velocity = 3.39 fps, Avg. Travel Time= 7.4 min

Peak Storage= 34,527 cf @ 12.25 hrs
Average Depth at Peak Storage= 1.03'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 9,816.53 cfs

15.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 7.0 '/' Top Width= 99.00'
Length= 1,500.0' Slope= 0.1807 '/'
Inlet Invert= 2,015.00', Outlet Invert= 1,744.00'




Summary for Reach 198: Stream Channel

Inflow Area = 88.624 ac, 0.78% Impervious, Inflow Depth = 2.82" for 10-YEAR event
Inflow = 251.53 cfs @ 12.17 hrs, Volume= 20.813 af
Outflow = 249.32 cfs @ 12.22 hrs, Volume= 20.813 af, Atten= 1%, Lag= 2.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 12.66 fps, Min. Travel Time= 1.7 min
Avg. Velocity = 4.63 fps, Avg. Travel Time= 4.5 min

Peak Storage= 24,858 cf @ 12.19 hrs
Average Depth at Peak Storage= 1.77'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 4,399.92 cfs

4.00' x 6.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 4.0 '/' Top Width= 52.00'
Length= 1,262.0' Slope= 0.1688 '/'
Inlet Invert= 2,228.00', Outlet Invert= 2,015.00'

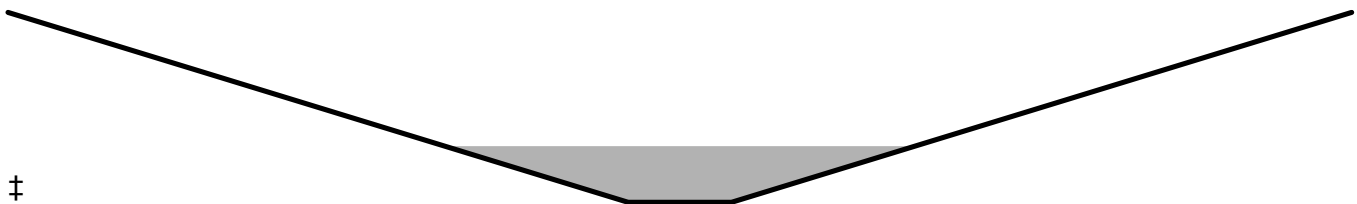

Summary for Reach 199: Overland Flow

Inflow Area = 12.214 ac, 2.97% Impervious, Inflow Depth = 2.90" for 10-YEAR event
Inflow = 37.07 cfs @ 12.15 hrs, Volume= 2.950 af
Outflow = 36.79 cfs @ 12.18 hrs, Volume= 2.950 af, Atten= 1%, Lag= 1.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.38 fps, Min. Travel Time= 1.0 min
Avg. Velocity = 1.28 fps, Avg. Travel Time= 3.2 min

Peak Storage= 2,108 cf @ 12.16 hrs
Average Depth at Peak Storage= 0.13'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 458.82 cfs

50.00' x 0.50' deep channel, n= 0.040 Earth, dense weeds
Side Slope Z-value= 100.0 '/' Top Width= 150.00'
Length= 250.0' Slope= 0.2640 '/'
Inlet Invert= 2,234.00', Outlet Invert= 2,168.00'




Summary for Reach 295: Roadside Channel

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 46.94 cfs @ 12.31 hrs, Volume= 3.824 af
Outflow = 46.62 cfs @ 12.33 hrs, Volume= 3.824 af, Atten= 1%, Lag= 1.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.34 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 2.51 fps, Avg. Travel Time= 2.5 min

Peak Storage= 2,415 cf @ 12.32 hrs
Average Depth at Peak Storage= 1.45'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 163.61 cfs

1.50' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 11.50'
Length= 379.0' Slope= 0.0528 '/'
Inlet Invert= 2,085.00', Outlet Invert= 2,065.00'

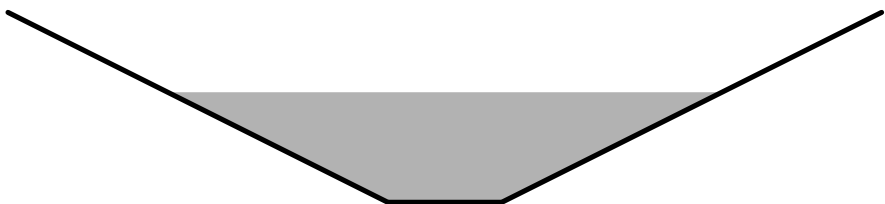

Summary for Reach 296: Wetland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 47.28 cfs @ 12.28 hrs, Volume= 3.824 af
Outflow = 46.94 cfs @ 12.31 hrs, Volume= 3.824 af, Atten= 1%, Lag= 1.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.99 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 2.02 fps, Avg. Travel Time= 2.6 min

Peak Storage= 2,517 cf @ 12.29 hrs
Average Depth at Peak Storage= 1.32'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 122.08 cfs

2.00' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals
Side Slope Z-value= 3.0 '/' Top Width= 14.00'
Length= 320.0' Slope= 0.0375 '/'
Inlet Invert= 2,096.00', Outlet Invert= 2,084.00'



Summary for Reach 297: Overland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 47.66 cfs @ 12.24 hrs, Volume= 3.824 af
Outflow = 47.28 cfs @ 12.28 hrs, Volume= 3.824 af, Atten= 1%, Lag= 2.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.21 fps, Min. Travel Time= 1.2 min
Avg. Velocity = 1.43 fps, Avg. Travel Time= 4.3 min

Peak Storage= 3,330 cf @ 12.26 hrs
Average Depth at Peak Storage= 0.22'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 225.40 cfs

30.00' x 0.50' deep channel, n= 0.040 Winding stream, pools & shoals
Side Slope Z-value= 50.0 '/' Top Width= 80.00'
Length= 366.0' Slope= 0.2022 '/'
Inlet Invert= 2,170.00', Outlet Invert= 2,096.00'



‡

Summary for Reach 298: Wetland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 49.11 cfs @ 12.15 hrs, Volume= 3.824 af
Outflow = 47.66 cfs @ 12.24 hrs, Volume= 3.824 af, Atten= 3%, Lag= 5.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.12 fps, Min. Travel Time= 3.2 min
Avg. Velocity = 0.55 fps, Avg. Travel Time= 12.3 min

Peak Storage= 9,199 cf @ 12.19 hrs
Average Depth at Peak Storage= 0.20'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 802.14 cfs

100.00' x 1.00' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 50.0 ' / ' Top Width= 200.00'
Length= 408.0' Slope= 0.0931 ' / '
Inlet Invert= 2,208.00', Outlet Invert= 2,170.00'



Summary for Reach 299: Overland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 49.29 cfs @ 12.14 hrs, Volume= 3.824 af
Outflow = 49.11 cfs @ 12.15 hrs, Volume= 3.824 af, Atten= 0%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.95 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 2.15 fps, Avg. Travel Time= 1.0 min

Peak Storage= 1,118 cf @ 12.15 hrs
Average Depth at Peak Storage= 0.32'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 134.95 cfs

10.00' x 0.50' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 50.0 ' / ' Top Width= 60.00'
Length= 135.0' Slope= 0.3481 ' / '
Inlet Invert= 2,255.00', Outlet Invert= 2,208.00'



07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 1

Summary for Pond 2R: 48" CMP Culvert

Inflow Area = 148.584 ac, 0.82% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 57.49 cfs @ 12.37 hrs, Volume= 7.547 af
 Outflow = 57.49 cfs @ 12.37 hrs, Volume= 7.547 af, Atten= 0%, Lag= 0.0 min
 Primary = 57.49 cfs @ 12.37 hrs, Volume= 7.547 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,744.93' @ 12.37 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,742.00'	48.0" Round Culvert L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 1,742.00' / 1,740.00' S= 0.0667 '/' Cc= 0.900 n= 0.025
#2	Secondary	1,746.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=57.33 cfs @ 12.37 hrs HW=1,744.92' (Free Discharge)
 ↑1=Culvert (Inlet Controls 57.33 cfs @ 5.82 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,742.00' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 4R: 24" Steel Culvert

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 7.73 cfs @ 12.51 hrs, Volume= 0.826 af
 Outflow = 7.73 cfs @ 12.51 hrs, Volume= 0.826 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.73 cfs @ 12.51 hrs, Volume= 0.826 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,066.24' @ 12.51 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,065.00'	24.0" Round Culvert L= 50.0' Ke= 0.500 Inlet / Outlet Invert= 2,065.00' / 2,060.00' S= 0.1000 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,067.50'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=7.71 cfs @ 12.51 hrs HW=2,066.24' (Free Discharge)
 ↑1=Culvert (Inlet Controls 7.71 cfs @ 3.78 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,065.00' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 7R: 30" Steel Culvert

Inflow Area = 77.687 ac, 1.16% Impervious, Inflow Depth = 0.64" for 1-YEAR event
 Inflow = 42.27 cfs @ 12.12 hrs, Volume= 4.139 af
 Outflow = 42.27 cfs @ 12.12 hrs, Volume= 4.139 af, Atten= 0%, Lag= 0.0 min
 Primary = 42.27 cfs @ 12.12 hrs, Volume= 4.139 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,816.17' @ 12.12 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,812.50'	30.0" Round Culvert L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 1,812.50' / 1,812.00' S= 0.0167 '/' Cc= 0.900 n= 0.012
#2	Primary	1,816.00'	30.0' long x 30.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=42.09 cfs @ 12.12 hrs HW=1,816.16' (Free Discharge)

- ↑1=Culvert (Inlet Controls 36.73 cfs @ 7.48 fps)
- ↑2=Broad-Crested Rectangular Weir (Weir Controls 5.37 cfs @ 1.09 fps)

Summary for Pond 10R: 14" and 16" HDPE Culverts

Inflow Area = 20.120 ac, 2.73% Impervious, Inflow Depth = 0.65" for 1-YEAR event
 Inflow = 11.18 cfs @ 12.20 hrs, Volume= 1.087 af
 Outflow = 11.18 cfs @ 12.20 hrs, Volume= 1.087 af, Atten= 0%, Lag= 0.0 min
 Primary = 11.01 cfs @ 12.20 hrs, Volume= 1.086 af
 Secondary = 0.17 cfs @ 12.20 hrs, Volume= 0.001 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,977.01' @ 12.20 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,975.00'	14.0" Round 14" Culvert L= 50.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,975.00' / 1,974.50' S= 0.0100 '/' Cc= 0.900 n= 0.011
#2	Primary	1,975.00'	16.0" Round 16" Culvert L= 50.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,975.00' / 1,974.50' S= 0.0100 '/' Cc= 0.900 n= 0.011
#3	Secondary	1,977.00'	50.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=11.00 cfs @ 12.20 hrs HW=1,977.01' (Free Discharge)

- ↑1=14" Culvert (Inlet Controls 4.85 cfs @ 4.54 fps)
- ↑2=16" Culvert (Inlet Controls 6.15 cfs @ 4.40 fps)

Secondary OutFlow Max=0.09 cfs @ 12.20 hrs HW=1,977.01' (Free Discharge)

- ↑3=Broad-Crested Rectangular Weir (Weir Controls 0.09 cfs @ 0.24 fps)

Summary for Pond 13R: 16" CMP Culvert

Inflow Area = 2.097 ac, 8.77% Impervious, Inflow Depth = 0.74" for 1-YEAR event
 Inflow = 1.92 cfs @ 12.07 hrs, Volume= 0.129 af
 Outflow = 1.92 cfs @ 12.07 hrs, Volume= 0.129 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.92 cfs @ 12.07 hrs, Volume= 0.129 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,968.66' @ 12.07 hrs
 Flood Elev= 1,969.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,968.00'	16.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 1,968.00' / 1,965.00' S= 0.0750 '/' Cc= 0.900 n= 0.025

Primary OutFlow Max=1.90 cfs @ 12.07 hrs HW=1,968.66' (Free Discharge)
 ↳1=Culvert (Inlet Controls 1.90 cfs @ 2.76 fps)

Summary for Pond 57: 16" Steel Culverts

Inflow Area = 1.326 ac, 4.72% Impervious, Inflow Depth = 0.65" for 1-YEAR event
 Inflow = 0.97 cfs @ 12.09 hrs, Volume= 0.072 af
 Outflow = 0.97 cfs @ 12.09 hrs, Volume= 0.072 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.97 cfs @ 12.09 hrs, Volume= 0.072 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,004.52' @ 12.09 hrs
 Flood Elev= 2,008.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,004.00'	16.0" Round 16" Smooth Steel Culvert (old) L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,004.00' / 2,000.00' S= 0.0667 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,006.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.97 cfs @ 12.09 hrs HW=2,004.52' (Free Discharge)
 ↳1=16" Smooth Steel Culvert (old) (Inlet Controls 0.97 cfs @ 1.93 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,004.00' (Free Discharge)
 ↳2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 4

Summary for Pond 58R: 24" HDPE Pipe

Inflow Area = 3.000 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af
 Outflow = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,215.65' @ 12.11 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,215.00'	24.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,215.00' / 2,212.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,218.50'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=1.90 cfs @ 12.11 hrs HW=2,215.65' (Free Discharge)

↑**1=Culvert** (Inlet Controls 1.90 cfs @ 2.16 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,215.00' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond 59: 32" Plastic Pipe

Inflow Area = 30.315 ac, 1.06% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af
 Outflow = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af, Atten= 0%, Lag= 0.0 min
 Primary = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,328.82' @ 12.22 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,327.00'	32.0" Round 32" Plastic Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,327.00' / 2,324.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,331.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=14.71 cfs @ 12.22 hrs HW=2,328.82' (Free Discharge)
 ↳1=32" Plastic Culvert (Inlet Controls 14.71 cfs @ 3.62 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,327.00' (Free Discharge)
 ↳2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 60: (2) 16" Steel Culverts

Inflow Area = 128.608 ac, 1.59% Impervious, Inflow Depth = 0.63" for 1-YEAR event
 Inflow = 29.07 cfs @ 12.26 hrs, Volume= 6.788 af
 Outflow = 29.07 cfs @ 12.26 hrs, Volume= 6.788 af, Atten= 0%, Lag= 0.0 min
 Primary = 26.98 cfs @ 12.26 hrs, Volume= 6.771 af
 Secondary = 2.09 cfs @ 12.26 hrs, Volume= 0.017 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,022.69' @ 12.26 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,018.00'	16.0" Round Culvert X 2.00 L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 2,018.00' / 2,017.00' S= 0.0500 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,022.50'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=26.96 cfs @ 12.26 hrs HW=2,022.69' (Free Discharge)
 ↳1=Culvert (Inlet Controls 26.96 cfs @ 9.65 fps)

Secondary OutFlow Max=2.01 cfs @ 12.26 hrs HW=2,022.69' (Free Discharge)
 ↳2=Broad-Crested Rectangular Weir (Weir Controls 2.01 cfs @ 1.08 fps)

Summary for Pond 67: 26" Steel Culverts

Inflow Area = 4.195 ac, 7.35% Impervious, Inflow Depth = 0.69" for 1-YEAR event
 Inflow = 3.90 cfs @ 12.05 hrs, Volume= 0.242 af
 Outflow = 3.90 cfs @ 12.05 hrs, Volume= 0.242 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.90 cfs @ 12.05 hrs, Volume= 0.242 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,003.93' @ 12.05 hrs
 Flood Elev= 2,008.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,003.00'	26.0" Round 26" Smooth Steel Culvert (old) L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,003.00' / 2,000.00' S= 0.0500 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,006.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 6

Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31
3.30 3.31 3.32

Primary OutFlow Max=3.85 cfs @ 12.05 hrs HW=2,003.92' (Free Discharge)

↑1=26" Smooth Steel Culvert (old) (Inlet Controls 3.85 cfs @ 2.58 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,003.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 68: 12" Steel Culvert

Inflow Area = 10.642 ac, 1.77% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 6.89 cfs @ 12.14 hrs, Volume= 0.575 af
Outflow = 6.89 cfs @ 12.14 hrs, Volume= 0.575 af, Atten= 0%, Lag= 0.0 min
Primary = 3.26 cfs @ 12.14 hrs, Volume= 0.480 af
Secondary = 3.62 cfs @ 12.14 hrs, Volume= 0.095 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,001.24' @ 12.14 hrs

Flood Elev= 2,001.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,000.00'	12.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,000.00' / 1,999.00' S= 0.0250 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,000.50'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=3.25 cfs @ 12.14 hrs HW=2,001.24' (Free Discharge)

↑1=Culvert (Inlet Controls 3.25 cfs @ 4.14 fps)

Secondary OutFlow Max=3.59 cfs @ 12.14 hrs HW=2,001.24' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 3.59 cfs @ 2.43 fps)

Summary for Pond 77: 32" Steel Culvert

Inflow Area = 88.881 ac, 1.70% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 16.97 cfs @ 13.58 hrs, Volume= 4.649 af
Outflow = 16.97 cfs @ 13.58 hrs, Volume= 4.649 af, Atten= 0%, Lag= 0.0 min
Primary = 16.97 cfs @ 13.58 hrs, Volume= 4.649 af
Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,181.72' @ 13.58 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,180.00'	32.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,180.00' / 2,179.00' S= 0.0250 '/' Cc= 0.900 n= 0.012

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 7

#2 Secondary 2,183.00' **10.0' long x 10.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60
 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=16.96 cfs @ 13.58 hrs HW=2,181.72' (Free Discharge)

↑**1=Culvert** (Inlet Controls 16.96 cfs @ 4.46 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,180.00' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond 79: 16" Steel Culvert

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 0.63" for 1-YEAR event
 Inflow = 17.07 cfs @ 13.64 hrs, Volume= 4.750 af
 Outflow = 17.07 cfs @ 13.64 hrs, Volume= 4.750 af, Atten= 0%, Lag= 0.0 min
 Primary = 9.67 cfs @ 13.64 hrs, Volume= 4.197 af
 Secondary = 7.39 cfs @ 13.64 hrs, Volume= 0.553 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,058.74' @ 13.64 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,056.00'	16.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 2,056.00' / 2,055.00' S= 0.0500 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,057.50'	2.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=9.67 cfs @ 13.64 hrs HW=2,058.74' (Free Discharge)

↑**1=Culvert** (Inlet Controls 9.67 cfs @ 6.93 fps)

Secondary OutFlow Max=7.39 cfs @ 13.64 hrs HW=2,058.74' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 7.39 cfs @ 2.99 fps)

Summary for Pond 83: 24" HPDE Culvert

Inflow Area = 1.300 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af
 Outflow = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,360.44' @ 12.08 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,360.00'	24.0" Round 24" Plastic Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,360.00' / 2,357.00' S= 0.0500 '/' Cc= 0.900 n= 0.011
#2	Secondary	2,364.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 8

Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00
	2.50	3.00	3.50							
Coef. (English)	2.54	2.61	2.61	2.60	2.66	2.70	2.77	2.89	2.88	
	2.85	3.07	3.20	3.32						

Primary OutFlow Max=0.91 cfs @ 12.08 hrs HW=2,360.44' (Free Discharge)

↑1=24" Plastic Culvert (Inlet Controls 0.91 cfs @ 1.78 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,360.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 84: 24" HDPE Pipe

Inflow Area = 31.013 ac, 2.16% Impervious, Inflow Depth = 0.65" for 1-YEAR event
 Inflow = 13.91 cfs @ 12.31 hrs, Volume= 1.675 af
 Outflow = 13.91 cfs @ 12.31 hrs, Volume= 1.675 af, Atten= 0%, Lag= 0.0 min
 Primary = 13.91 cfs @ 12.31 hrs, Volume= 1.675 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,316.66' @ 12.31 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,315.00'	36.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,315.00' / 2,312.00' S= 0.0500 '/' Cc= 0.900 n= 0.011
#2	Secondary	2,320.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=13.89 cfs @ 12.31 hrs HW=2,316.66' (Free Discharge)

↑1=Culvert (Inlet Controls 13.89 cfs @ 3.46 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,315.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 85: 28" HDPE Pipe

Inflow Area = 4.281 ac, 0.54% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af
 Outflow = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,295.69' @ 12.15 hrs

07074_existing

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 9

Device	Routing	Invert	Outlet Devices
#1	Primary	2,295.00'	30.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,295.00' / 2,292.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,300.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=2.48 cfs @ 12.15 hrs HW=2,295.69' (Free Discharge)

↑1=Culvert (Inlet Controls 2.48 cfs @ 2.24 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,295.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 86: 24" HDPE Pipe

Inflow Area = 4.340 ac, 0.76% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af
 Outflow = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,240.86' @ 12.07 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,240.00'	24.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,240.00' / 2,237.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,245.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=3.17 cfs @ 12.07 hrs HW=2,240.85' (Free Discharge)

↑1=Culvert (Inlet Controls 3.17 cfs @ 2.48 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,240.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 87: 18" Steel Culvert

Inflow Area = 2.000 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af
 Outflow = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 10

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,208.59' @ 12.10 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,208.00'	18.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,208.00' / 2,207.00' S= 0.0167 '/' Cc= 0.900 n= 0.012

Primary OutFlow Max=1.32 cfs @ 12.10 hrs HW=2,208.59' (Free Discharge)↑**1=Culvert** (Inlet Controls 1.32 cfs @ 2.06 fps)**Summary for Pond 90: 12" Steel Culvert**

Inflow Area = 12.874 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 4.82 cfs @ 12.38 hrs, Volume= 0.650 af
 Outflow = 4.82 cfs @ 12.38 hrs, Volume= 0.650 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.82 cfs @ 12.38 hrs, Volume= 0.650 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,892.12' @ 12.38 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,890.00'	12.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 1,890.00' / 1,889.50' S= 0.0250 '/' Cc= 0.900 n= 0.012
#2	Secondary	1,895.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=4.81 cfs @ 12.38 hrs HW=1,892.12' (Free Discharge)↑**1=Culvert** (Inlet Controls 4.81 cfs @ 6.12 fps)**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=1,890.00' (Free Discharge)↑**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)**Summary for Pond 200: 36" Steel Culvert**

Inflow Area = 76.410 ac, 0.43% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 38.77 cfs @ 12.20 hrs, Volume= 3.859 af
 Outflow = 38.77 cfs @ 12.20 hrs, Volume= 3.859 af, Atten= 0%, Lag= 0.0 min
 Primary = 33.94 cfs @ 12.20 hrs, Volume= 3.783 af
 Secondary = 4.83 cfs @ 12.20 hrs, Volume= 0.076 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,236.50' @ 12.20 hrs

Flood Elev= 2,248.00'

07074_existing

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 11

Device	Routing	Invert	Outlet Devices
#1	Primary	2,234.00'	36.0" Round Culvert L= 50.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,234.00' / 2,228.00' S= 0.1200 '/ Cc= 0.900 n= 0.025 Corrugated metal
#2	Secondary	2,236.00'	5.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=33.87 cfs @ 12.20 hrs HW=2,236.50' (Free Discharge)↑**1=Culvert** (Inlet Controls 33.87 cfs @ 5.38 fps)**Secondary OutFlow** Max=4.76 cfs @ 12.20 hrs HW=2,236.50' (Free Discharge)↑**2=Broad-Crested Rectangular Weir** (Weir Controls 4.76 cfs @ 1.91 fps)**Summary for Pond 201: 36" Steel Culvert**

Inflow Area = 12.214 ac, 2.97% Impervious, Inflow Depth = 0.65" for 1-YEAR event
 Inflow = 7.13 cfs @ 12.18 hrs, Volume= 0.660 af
 Outflow = 7.13 cfs @ 12.18 hrs, Volume= 0.660 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.13 cfs @ 12.18 hrs, Volume= 0.660 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,235.01' @ 12.18 hrs

Flood Elev= 2,248.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,234.00'	36.0" Round Culvert L= 30.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,234.00' / 2,233.00' S= 0.0333 '/ Cc= 0.900 n= 0.025 Corrugated metal
#2	Secondary	2,236.00'	5.0' long x 30.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=7.11 cfs @ 12.18 hrs HW=2,235.01' (Free Discharge)↑**1=Culvert** (Barrel Controls 7.11 cfs @ 5.08 fps)**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=2,234.00' (Free Discharge)↑**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)**Summary for Pond 300R: 18" Steel Culvert**

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 8.97 cfs @ 12.17 hrs, Volume= 0.826 af
 Outflow = 8.97 cfs @ 12.17 hrs, Volume= 0.826 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.40 cfs @ 12.17 hrs, Volume= 0.821 af
 Secondary = 0.57 cfs @ 12.17 hrs, Volume= 0.005 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 3/16/2011

Page 12

Peak Elev= 2,260.72' @ 12.17 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,259.00'	18.0" Round 18" Steel Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,259.00' / 2,256.00' S= 0.0750 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,260.50'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=8.38 cfs @ 12.17 hrs HW=2,260.72' (Free Discharge)

↑1=18" Steel Culvert (Inlet Controls 8.38 cfs @ 4.74 fps)

Secondary OutFlow Max=0.55 cfs @ 12.17 hrs HW=2,260.72' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 0.55 cfs @ 1.26 fps)

Summary for Pond 2R: 48" CMP Culvert

Inflow Area = 148.584 ac, 0.82% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 366.11 cfs @ 12.21 hrs, Volume= 34.829 af
 Outflow = 366.11 cfs @ 12.21 hrs, Volume= 34.829 af, Atten= 0%, Lag= 0.0 min
 Primary = 149.11 cfs @ 12.21 hrs, Volume= 27.203 af
 Secondary = 217.00 cfs @ 12.21 hrs, Volume= 7.626 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,750.07' @ 12.21 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,742.00'	48.0" Round Culvert L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 1,742.00' / 1,740.00' S= 0.0667 '/' Cc= 0.900 n= 0.025
#2	Secondary	1,746.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=149.08 cfs @ 12.21 hrs HW=1,750.07' (Free Discharge)
 ↑1=Culvert (Inlet Controls 149.08 cfs @ 11.86 fps)

Secondary OutFlow Max=216.81 cfs @ 12.21 hrs HW=1,750.07' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Weir Controls 216.81 cfs @ 5.33 fps)

Summary for Pond 4R: 24" Steel Culvert

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 46.62 cfs @ 12.33 hrs, Volume= 3.824 af
 Outflow = 46.62 cfs @ 12.33 hrs, Volume= 3.824 af, Atten= 0%, Lag= 0.0 min
 Primary = 28.22 cfs @ 12.33 hrs, Volume= 3.424 af
 Secondary = 18.40 cfs @ 12.33 hrs, Volume= 0.401 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,069.48' @ 12.33 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,065.00'	24.0" Round Culvert L= 50.0' Ke= 0.500 Inlet / Outlet Invert= 2,065.00' / 2,060.00' S= 0.1000 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,067.50'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=28.21 cfs @ 12.33 hrs HW=2,069.48' (Free Discharge)
 ↑1=Culvert (Inlet Controls 28.21 cfs @ 8.98 fps)

Secondary OutFlow Max=18.37 cfs @ 12.33 hrs HW=2,069.48' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Weir Controls 18.37 cfs @ 4.64 fps)

Summary for Pond 7R: 30" Steel Culvert

Inflow Area = 77.687 ac, 1.16% Impervious, Inflow Depth = 2.88" for 10-YEAR event
 Inflow = 222.80 cfs @ 12.10 hrs, Volume= 18.639 af
 Outflow = 222.80 cfs @ 12.10 hrs, Volume= 18.639 af, Atten= 0%, Lag= 0.0 min
 Primary = 222.80 cfs @ 12.10 hrs, Volume= 18.639 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,817.71' @ 12.10 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,812.50'	30.0" Round Culvert L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 1,812.50' / 1,812.00' S= 0.0167 '/' Cc= 0.900 n= 0.012
#2	Primary	1,816.00'	30.0' long x 30.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=221.46 cfs @ 12.10 hrs HW=1,817.70' (Free Discharge)

↑1=Culvert (Inlet Controls 46.96 cfs @ 9.57 fps)

↓2=Broad-Crested Rectangular Weir (Weir Controls 174.50 cfs @ 3.43 fps)

Summary for Pond 10R: 14" and 16" HDPE Culverts

Inflow Area = 20.120 ac, 2.73% Impervious, Inflow Depth = 2.90" for 10-YEAR event
 Inflow = 58.43 cfs @ 12.17 hrs, Volume= 4.860 af
 Outflow = 58.43 cfs @ 12.17 hrs, Volume= 4.860 af, Atten= 0%, Lag= 0.0 min
 Primary = 12.76 cfs @ 12.17 hrs, Volume= 3.359 af
 Secondary = 45.67 cfs @ 12.17 hrs, Volume= 1.501 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,977.49' @ 12.17 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,975.00'	14.0" Round 14" Culvert L= 50.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,975.00' / 1,974.50' S= 0.0100 '/' Cc= 0.900 n= 0.011
#2	Primary	1,975.00'	16.0" Round 16" Culvert L= 50.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,975.00' / 1,974.50' S= 0.0100 '/' Cc= 0.900 n= 0.011
#3	Secondary	1,977.00'	50.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=12.76 cfs @ 12.17 hrs HW=1,977.48' (Free Discharge)

↑1=14" Culvert (Inlet Controls 5.60 cfs @ 5.24 fps)

↓2=16" Culvert (Inlet Controls 7.16 cfs @ 5.12 fps)

Secondary OutFlow Max=45.49 cfs @ 12.17 hrs HW=1,977.48' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Weir Controls 45.49 cfs @ 1.88 fps)

Summary for Pond 13R: 16" CMP Culvert

Inflow Area = 2.097 ac, 8.77% Impervious, Inflow Depth = 3.09" for 10-YEAR event
 Inflow = 8.69 cfs @ 12.06 hrs, Volume= 0.540 af
 Outflow = 8.69 cfs @ 12.06 hrs, Volume= 0.540 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.69 cfs @ 12.06 hrs, Volume= 0.540 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,970.34' @ 12.06 hrs
 Flood Elev= 1,969.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,968.00'	16.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 1,968.00' / 1,965.00' S= 0.0750 '/' Cc= 0.900 n= 0.025

Primary OutFlow Max=8.68 cfs @ 12.06 hrs HW=1,970.33' (Free Discharge)
 ↳1=Culvert (Inlet Controls 8.68 cfs @ 6.22 fps)

Summary for Pond 57: 16" Steel Culverts

Inflow Area = 1.326 ac, 4.72% Impervious, Inflow Depth = 2.90" for 10-YEAR event
 Inflow = 4.91 cfs @ 12.08 hrs, Volume= 0.320 af
 Outflow = 4.91 cfs @ 12.08 hrs, Volume= 0.320 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.91 cfs @ 12.08 hrs, Volume= 0.320 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,005.52' @ 12.08 hrs
 Flood Elev= 2,008.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,004.00'	16.0" Round 16" Smooth Steel Culvert (old) L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,004.00' / 2,000.00' S= 0.0667 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,006.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=4.87 cfs @ 12.08 hrs HW=2,005.51' (Free Discharge)
 ↳1=16" Smooth Steel Culvert (old) (Inlet Controls 4.87 cfs @ 3.49 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,004.00' (Free Discharge)
 ↳2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

07074_existing

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 16

Summary for Pond 58R: 24" HDPE Pipe

Inflow Area = 3.000 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 10.31 cfs @ 12.09 hrs, Volume= 0.701 af
 Outflow = 10.31 cfs @ 12.09 hrs, Volume= 0.701 af, Atten= 0%, Lag= 0.0 min
 Primary = 10.31 cfs @ 12.09 hrs, Volume= 0.701 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,216.74' @ 12.09 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,215.00'	24.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,215.00' / 2,212.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,218.50'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=10.29 cfs @ 12.09 hrs HW=2,216.74' (Free Discharge)
 ↑1=Culvert (Inlet Controls 10.29 cfs @ 3.55 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,215.00' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 59: 32" Plastic Pipe

Inflow Area = 30.315 ac, 1.06% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 82.05 cfs @ 12.19 hrs, Volume= 7.087 af
 Outflow = 82.05 cfs @ 12.19 hrs, Volume= 7.087 af, Atten= 0%, Lag= 0.0 min
 Primary = 46.42 cfs @ 12.19 hrs, Volume= 6.253 af
 Secondary = 35.63 cfs @ 12.19 hrs, Volume= 0.834 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,333.11' @ 12.19 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,327.00'	32.0" Round 32" Plastic Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,327.00' / 2,324.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,331.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=46.38 cfs @ 12.19 hrs HW=2,333.11' (Free Discharge)

↑1=32" Plastic Culvert (Inlet Controls 46.38 cfs @ 8.30 fps)

Secondary OutFlow Max=35.39 cfs @ 12.19 hrs HW=2,333.11' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 35.39 cfs @ 4.20 fps)

Summary for Pond 60: (2) 16" Steel Culverts

Inflow Area = 128.608 ac, 1.59% Impervious, Inflow Depth = 2.87" for 10-YEAR event
 Inflow = 161.62 cfs @ 12.20 hrs, Volume= 30.714 af
 Outflow = 161.62 cfs @ 12.20 hrs, Volume= 30.714 af, Atten= 0%, Lag= 0.0 min
 Primary = 34.75 cfs @ 12.20 hrs, Volume= 18.423 af
 Secondary = 126.86 cfs @ 12.20 hrs, Volume= 12.292 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,025.35' @ 12.20 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,018.00'	16.0" Round Culvert X 2.00 L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 2,018.00' / 2,017.00' S= 0.0500 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,022.50'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=34.73 cfs @ 12.20 hrs HW=2,025.34' (Free Discharge)

↑1=Culvert (Inlet Controls 34.73 cfs @ 12.44 fps)

Secondary OutFlow Max=126.31 cfs @ 12.20 hrs HW=2,025.34' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 126.31 cfs @ 4.45 fps)

Summary for Pond 67: 26" Steel Culverts

Inflow Area = 4.195 ac, 7.35% Impervious, Inflow Depth = 2.99" for 10-YEAR event
 Inflow = 18.29 cfs @ 12.03 hrs, Volume= 1.046 af
 Outflow = 18.29 cfs @ 12.03 hrs, Volume= 1.046 af, Atten= 0%, Lag= 0.0 min
 Primary = 18.29 cfs @ 12.03 hrs, Volume= 1.046 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,005.79' @ 12.03 hrs
 Flood Elev= 2,008.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,003.00'	26.0" Round 26" Smooth Steel Culvert (old) L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,003.00' / 2,000.00' S= 0.0500 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,006.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 3/16/2011

Page 18

Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31
3.30 3.31 3.32

Primary OutFlow Max=18.18 cfs @ 12.03 hrs HW=2,005.77' (Free Discharge)

↑1=26" Smooth Steel Culvert (old) (Inlet Controls 18.18 cfs @ 4.93 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,003.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 68: 12" Steel Culvert

Inflow Area = 10.642 ac, 1.77% Impervious, Inflow Depth = 2.90" for 10-YEAR event
Inflow = 35.36 cfs @ 12.12 hrs, Volume= 2.571 af
Outflow = 35.36 cfs @ 12.12 hrs, Volume= 2.571 af, Atten= 0%, Lag= 0.0 min
Primary = 6.20 cfs @ 12.12 hrs, Volume= 1.449 af
Secondary = 29.17 cfs @ 12.12 hrs, Volume= 1.121 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,003.19' @ 12.12 hrs

Flood Elev= 2,001.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,000.00'	12.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,000.00' / 1,999.00' S= 0.0250 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,000.50'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=6.19 cfs @ 12.12 hrs HW=2,003.18' (Free Discharge)

↑1=Culvert (Inlet Controls 6.19 cfs @ 7.88 fps)

Secondary OutFlow Max=29.09 cfs @ 12.12 hrs HW=2,003.18' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 29.09 cfs @ 5.43 fps)

Summary for Pond 77: 32" Steel Culvert

Inflow Area = 88.881 ac, 1.70% Impervious, Inflow Depth = 2.85" for 10-YEAR event
Inflow = 130.01 cfs @ 12.97 hrs, Volume= 21.133 af
Outflow = 130.01 cfs @ 12.97 hrs, Volume= 21.133 af, Atten= 0%, Lag= 0.0 min
Primary = 51.92 cfs @ 12.97 hrs, Volume= 16.640 af
Secondary = 78.09 cfs @ 12.97 hrs, Volume= 4.493 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,185.06' @ 12.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,180.00'	32.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,180.00' / 2,179.00' S= 0.0250 '/' Cc= 0.900 n= 0.012

07074_existing

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 19

#2 Secondary 2,183.00' **10.0' long x 10.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60
 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=51.90 cfs @ 12.97 hrs HW=2,185.06' (Free Discharge)

↑**1=Culvert** (Inlet Controls 51.90 cfs @ 9.29 fps)

Secondary OutFlow Max=77.95 cfs @ 12.97 hrs HW=2,185.06' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 77.95 cfs @ 3.79 fps)

Summary for Pond 79: 16" Steel Culvert

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 2.85" for 10-YEAR event
 Inflow = 130.41 cfs @ 13.01 hrs, Volume= 21.601 af
 Outflow = 130.41 cfs @ 13.01 hrs, Volume= 21.601 af, Atten= 0%, Lag= 0.0 min
 Primary = 19.54 cfs @ 13.01 hrs, Volume= 9.968 af
 Secondary = 110.87 cfs @ 13.01 hrs, Volume= 11.633 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,065.11' @ 13.01 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,056.00'	16.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 2,056.00' / 2,055.00' S= 0.0500 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,057.50'	2.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=19.53 cfs @ 13.01 hrs HW=2,065.11' (Free Discharge)

↑**1=Culvert** (Inlet Controls 19.53 cfs @ 13.99 fps)

Secondary OutFlow Max=110.74 cfs @ 13.01 hrs HW=2,065.11' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 110.74 cfs @ 7.28 fps)

Summary for Pond 83: 24" HPDE Culvert

Inflow Area = 1.300 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 4.87 cfs @ 12.06 hrs, Volume= 0.304 af
 Outflow = 4.87 cfs @ 12.06 hrs, Volume= 0.304 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.87 cfs @ 12.06 hrs, Volume= 0.304 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,361.08' @ 12.06 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,360.00'	24.0" Round 24" Plastic Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,360.00' / 2,357.00' S= 0.0500 '/' Cc= 0.900 n= 0.011
#2	Secondary	2,364.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 3/16/2011

Page 20

Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00
	2.50	3.00	3.50							
Coef. (English)	2.54	2.61	2.61	2.60	2.66	2.70	2.77	2.89	2.88	
	2.85	3.07	3.20	3.32						

Primary OutFlow Max=4.85 cfs @ 12.06 hrs HW=2,361.08' (Free Discharge)

↑1=24" Plastic Culvert (Inlet Controls 4.85 cfs @ 2.80 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,360.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 84: 24" HDPE Pipe

Inflow Area = 31.013 ac, 2.16% Impervious, Inflow Depth = 3.22" for 10-YEAR event
 Inflow = 106.20 cfs @ 12.23 hrs, Volume= 8.325 af
 Outflow = 106.20 cfs @ 12.23 hrs, Volume= 8.325 af, Atten= 0%, Lag= 0.0 min
 Primary = 64.69 cfs @ 12.23 hrs, Volume= 7.434 af
 Secondary = 41.51 cfs @ 12.23 hrs, Volume= 0.891 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,322.30' @ 12.23 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,315.00'	36.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,315.00' / 2,312.00' S= 0.0500 '/' Cc= 0.900 n= 0.011
#2	Secondary	2,320.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=64.65 cfs @ 12.23 hrs HW=2,322.29' (Free Discharge)

↑1=Culvert (Inlet Controls 64.65 cfs @ 9.15 fps)

Secondary OutFlow Max=41.22 cfs @ 12.23 hrs HW=2,322.29' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 41.22 cfs @ 4.50 fps)

Summary for Pond 85: 28" HDPE Pipe

Inflow Area = 4.281 ac, 0.54% Impervious, Inflow Depth = 5.30" for 10-YEAR event
 Inflow = 52.58 cfs @ 12.21 hrs, Volume= 1.892 af
 Outflow = 52.58 cfs @ 12.21 hrs, Volume= 1.892 af, Atten= 0%, Lag= 0.0 min
 Primary = 40.92 cfs @ 12.21 hrs, Volume= 1.765 af
 Secondary = 11.65 cfs @ 12.21 hrs, Volume= 0.127 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,301.06' @ 12.21 hrs

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 3/16/2011

Page 21

Device	Routing	Invert	Outlet Devices
#1	Primary	2,295.00'	30.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,295.00' / 2,292.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,300.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=40.89 cfs @ 12.21 hrs HW=2,301.05' (Free Discharge)

↑1=Culvert (Inlet Controls 40.89 cfs @ 8.33 fps)

Secondary OutFlow Max=11.52 cfs @ 12.21 hrs HW=2,301.05' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 11.52 cfs @ 2.74 fps)

Summary for Pond 86: 24" HDPE Pipe

Inflow Area = 4.340 ac, 0.76% Impervious, Inflow Depth = 3.16" for 10-YEAR event
 Inflow = 19.66 cfs @ 12.19 hrs, Volume= 1.142 af
 Outflow = 19.66 cfs @ 12.19 hrs, Volume= 1.142 af, Atten= 0%, Lag= 0.0 min
 Primary = 19.66 cfs @ 12.19 hrs, Volume= 1.142 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Peak Elev= 2,243.71' @ 12.19 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,240.00'	24.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,240.00' / 2,237.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,245.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=19.41 cfs @ 12.19 hrs HW=2,243.64' (Free Discharge)

↑1=Culvert (Inlet Controls 19.41 cfs @ 6.18 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,240.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 87: 18" Steel Culvert

Inflow Area = 2.000 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 7.10 cfs @ 12.08 hrs, Volume= 0.468 af
 Outflow = 7.10 cfs @ 12.08 hrs, Volume= 0.468 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.10 cfs @ 12.08 hrs, Volume= 0.468 af

07074_existing

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 22

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,209.87' @ 12.08 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,208.00'	18.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,208.00' / 2,207.00' S= 0.0167 '/' Cc= 0.900 n= 0.012

Primary OutFlow Max=7.05 cfs @ 12.08 hrs HW=2,209.85' (Free Discharge)↑**1=Culvert** (Inlet Controls 7.05 cfs @ 3.99 fps)**Summary for Pond 90: 12" Steel Culvert**

Inflow Area = 12.874 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 27.27 cfs @ 12.32 hrs, Volume= 3.010 af
 Outflow = 27.27 cfs @ 12.32 hrs, Volume= 3.010 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.69 cfs @ 12.32 hrs, Volume= 2.252 af
 Secondary = 18.58 cfs @ 12.32 hrs, Volume= 0.758 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,895.78' @ 12.32 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,890.00'	12.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 1,890.00' / 1,889.50' S= 0.0250 '/' Cc= 0.900 n= 0.012
#2	Secondary	1,895.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=8.69 cfs @ 12.32 hrs HW=1,895.78' (Free Discharge)↑**1=Culvert** (Inlet Controls 8.69 cfs @ 11.06 fps)**Secondary OutFlow** Max=18.54 cfs @ 12.32 hrs HW=1,895.78' (Free Discharge)↑**2=Broad-Crested Rectangular Weir** (Weir Controls 18.54 cfs @ 2.38 fps)**Summary for Pond 200: 36" Steel Culvert**

Inflow Area = 76.410 ac, 0.43% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 214.79 cfs @ 12.17 hrs, Volume= 17.862 af
 Outflow = 214.79 cfs @ 12.17 hrs, Volume= 17.862 af, Atten= 0%, Lag= 0.0 min
 Primary = 78.08 cfs @ 12.17 hrs, Volume= 13.324 af
 Secondary = 136.71 cfs @ 12.17 hrs, Volume= 4.538 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,240.76' @ 12.17 hrs

Flood Elev= 2,248.00'

07074_existing

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA Group P.C.

Printed 3/16/2011

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 23

Device	Routing	Invert	Outlet Devices
#1	Primary	2,234.00'	36.0" Round Culvert L= 50.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,234.00' / 2,228.00' S= 0.1200 '/ Cc= 0.900 n= 0.025 Corrugated metal
#2	Secondary	2,236.00'	5.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=77.98 cfs @ 12.17 hrs HW=2,240.75' (Free Discharge)↑**1=Culvert** (Inlet Controls 77.98 cfs @ 11.03 fps)**Secondary OutFlow** Max=136.11 cfs @ 12.17 hrs HW=2,240.75' (Free Discharge)↑**2=Broad-Crested Rectangular Weir** (Weir Controls 136.11 cfs @ 5.73 fps)**Summary for Pond 201: 36" Steel Culvert**

Inflow Area = 12.214 ac, 2.97% Impervious, Inflow Depth = 2.90" for 10-YEAR event
 Inflow = 37.07 cfs @ 12.15 hrs, Volume= 2.950 af
 Outflow = 37.07 cfs @ 12.15 hrs, Volume= 2.950 af, Atten= 0%, Lag= 0.0 min
 Primary = 32.24 cfs @ 12.15 hrs, Volume= 2.877 af
 Secondary = 4.83 cfs @ 12.15 hrs, Volume= 0.074 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,236.50' @ 12.15 hrs

Flood Elev= 2,248.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,234.00'	36.0" Round Culvert L= 30.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,234.00' / 2,233.00' S= 0.0333 '/ Cc= 0.900 n= 0.025 Corrugated metal
#2	Secondary	2,236.00'	5.0' long x 30.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=32.20 cfs @ 12.15 hrs HW=2,236.50' (Free Discharge)↑**1=Culvert** (Barrel Controls 32.20 cfs @ 6.93 fps)**Secondary OutFlow** Max=4.78 cfs @ 12.15 hrs HW=2,236.50' (Free Discharge)↑**2=Broad-Crested Rectangular Weir** (Weir Controls 4.78 cfs @ 1.91 fps)**Summary for Pond 300R: 18" Steel Culvert**

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 49.29 cfs @ 12.14 hrs, Volume= 3.824 af
 Outflow = 49.29 cfs @ 12.14 hrs, Volume= 3.824 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.29 cfs @ 12.14 hrs, Volume= 2.851 af
 Secondary = 33.01 cfs @ 12.14 hrs, Volume= 0.973 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 3/16/2011

Page 24

Peak Elev= 2,263.41' @ 12.14 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,259.00'	18.0" Round 18" Steel Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,259.00' / 2,256.00' S= 0.0750 '/' Cc= 0.900 n= 0.012
#2	Secondary	2,260.50'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=16.26 cfs @ 12.14 hrs HW=2,263.40' (Free Discharge)

↑1=18" Steel Culvert (Inlet Controls 16.26 cfs @ 9.20 fps)

Secondary OutFlow Max=32.84 cfs @ 12.14 hrs HW=2,263.40' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 32.84 cfs @ 5.65 fps)

Design Point Summary

1-yr Storm Event

Design Point Totals

10, 25 & 100-yr Storm Events

Summary for Pond 1aP: Design Point 1a

Inflow Area = 4.640 ac, 4.97% Impervious, Inflow Depth = 0.69" for 1-YEAR event
Inflow = 3.77 cfs @ 12.09 hrs, Volume= 0.267 af
Primary = 3.77 cfs @ 12.09 hrs, Volume= 0.267 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 10: Design Point 10

Inflow Area = 162.260 ac, 1.57% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 39.56 cfs @ 11.94 hrs, Volume= 8.487 af
Primary = 39.56 cfs @ 11.94 hrs, Volume= 8.487 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 11: Design Point 11

Inflow Area = 66.273 ac, 1.46% Impervious, Inflow Depth = 0.64" for 1-YEAR event
Inflow = 24.41 cfs @ 12.40 hrs, Volume= 3.534 af
Primary = 24.41 cfs @ 12.40 hrs, Volume= 3.534 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 12: Design Point 12

Inflow Area = 7.264 ac, 12.46% Impervious, Inflow Depth = 0.78" for 1-YEAR event
Inflow = 6.57 cfs @ 12.10 hrs, Volume= 0.475 af
Primary = 6.57 cfs @ 12.10 hrs, Volume= 0.475 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 16: DESIGN POINT 16

Inflow Area = 18.787 ac, 4.30% Impervious, Inflow Depth = 0.66" for 1-YEAR event
Inflow = 11.97 cfs @ 12.16 hrs, Volume= 1.030 af
Primary = 11.97 cfs @ 12.16 hrs, Volume= 1.030 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 2: Design Point 2

Inflow Area = 39.108 ac, 0.76% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 20.26 cfs @ 12.23 hrs, Volume= 2.112 af
Primary = 20.26 cfs @ 12.23 hrs, Volume= 2.112 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 3: Design Point 3

Inflow Area = 2.196 ac, 4.19% Impervious, Inflow Depth = 0.69" for 1-YEAR event
Inflow = 1.69 cfs @ 12.11 hrs, Volume= 0.127 af
Primary = 1.69 cfs @ 12.11 hrs, Volume= 0.127 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 4: 18" HDPE Culvert

Inflow Area = 10.003 ac, 2.13% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 6.61 cfs @ 12.13 hrs, Volume= 0.540 af
Primary = 6.61 cfs @ 12.13 hrs, Volume= 0.540 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 5: 18" HDPE Culvert

Inflow Area = 14.626 ac, 1.24% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 10.49 cfs @ 12.08 hrs, Volume= 0.739 af
Primary = 10.49 cfs @ 12.08 hrs, Volume= 0.739 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 5A: 12" Steel Culvert

Inflow Area = 12.200 ac, 1.42% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 7.57 cfs @ 12.12 hrs, Volume= 0.616 af
Primary = 7.57 cfs @ 12.12 hrs, Volume= 0.616 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 6: 52" Concrete Culvert

Inflow Area = 58.770 ac, 0.86% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 32.30 cfs @ 12.20 hrs, Volume= 3.174 af
Primary = 32.30 cfs @ 12.20 hrs, Volume= 3.174 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 6A: 28" Steel Culvert

Inflow Area = 41.780 ac, 0.64% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 19.76 cfs @ 12.28 hrs, Volume= 2.257 af
Primary = 19.76 cfs @ 12.28 hrs, Volume= 2.257 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 7: Design Point 7

Inflow Area = 149.008 ac, 0.89% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 57.56 cfs @ 12.37 hrs, Volume= 7.580 af
Primary = 57.56 cfs @ 12.37 hrs, Volume= 7.580 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 8: Design Point 8

Inflow Area = 95.972 ac, 1.42% Impervious, Inflow Depth = 0.64" for 1-YEAR event
Inflow = 53.51 cfs @ 12.14 hrs, Volume= 5.126 af
Primary = 53.51 cfs @ 12.14 hrs, Volume= 5.126 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 9: Design Point 9

Inflow Area = 56.369 ac, 3.06% Impervious, Inflow Depth = 0.67" for 1-YEAR event
Inflow = 18.01 cfs @ 12.58 hrs, Volume= 3.146 af
Primary = 18.01 cfs @ 12.58 hrs, Volume= 3.146 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 3/16/2011

Page 1

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond 1aP: Design Point 1a	Inflow=18.01 cfs 1.157 af Primary=18.01 cfs 1.157 af
Pond DP 10: Design Point 10	Inflow=212.16 cfs 38.581 af Primary=212.16 cfs 38.581 af
Pond DP 11: Design Point 11	Inflow=141.89 cfs 15.909 af Primary=141.89 cfs 15.909 af
Pond DP 12: Design Point 12	Inflow=28.72 cfs 1.928 af Primary=28.72 cfs 1.928 af
Pond DP 16: DESIGN POINT 16	Inflow=60.58 cfs 4.571 af Primary=60.58 cfs 4.571 af
Pond DP 2: Design Point 2	Inflow=106.49 cfs 9.447 af Primary=106.49 cfs 9.447 af
Pond DP 3: Design Point 3	Inflow=8.12 cfs 0.548 af Primary=8.12 cfs 0.548 af
Pond DP 4: 18" HDPE Culvert	Inflow=33.83 cfs 2.416 af Primary=33.83 cfs 2.416 af
Pond DP 5: 18" HDPE Culvert	Inflow=55.50 cfs 3.419 af Primary=55.50 cfs 3.419 af
Pond DP 5A: 12" Steel Culvert	Inflow=40.90 cfs 2.852 af Primary=40.90 cfs 2.852 af
Pond DP 6: 52" Concrete Culvert	Inflow=169.07 cfs 14.197 af Primary=169.07 cfs 14.197 af
Pond DP 6A: 28" Steel Culvert	Inflow=104.54 cfs 10.092 af Primary=104.54 cfs 10.092 af
Pond DP 7: Design Point 7	Inflow=366.47 cfs 34.952 af Primary=366.47 cfs 34.952 af
Pond DP 8: Design Point 8	Inflow=283.49 cfs 23.056 af Primary=283.49 cfs 23.056 af
Pond DP 9: Design Point 9	Inflow=131.61 cfs 13.835 af Primary=131.61 cfs 13.835 af

07074_existing

Prepared by The LA Group P.C.

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 25-YEAR Rainfall=6.50"

Printed 3/16/2011

Page 2

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond 1aP: Design Point 1a	Inflow=20.51 cfs 1.317 af Primary=20.51 cfs 1.317 af
Pond DP 10: Design Point 10	Inflow=245.18 cfs 44.057 af Primary=245.18 cfs 44.057 af
Pond DP 11: Design Point 11	Inflow=163.12 cfs 18.155 af Primary=163.12 cfs 18.155 af
Pond DP 12: Design Point 12	Inflow=32.54 cfs 2.185 af Primary=32.54 cfs 2.185 af
Pond DP 16: DESIGN POINT 16	Inflow=69.14 cfs 5.212 af Primary=69.14 cfs 5.212 af
Pond DP 2: Design Point 2	Inflow=121.88 cfs 10.776 af Primary=121.88 cfs 10.776 af
Pond DP 3: Design Point 3	Inflow=9.26 cfs 0.623 af Primary=9.26 cfs 0.623 af
Pond DP 4: 18" HDPE Culvert	Inflow=38.66 cfs 2.756 af Primary=38.66 cfs 2.756 af
Pond DP 5: 18" HDPE Culvert	Inflow=63.53 cfs 3.909 af Primary=63.53 cfs 3.909 af
Pond DP 5A: 12" Steel Culvert	Inflow=46.88 cfs 3.261 af Primary=46.88 cfs 3.261 af
Pond DP 6: 52" Concrete Culvert	Inflow=193.45 cfs 16.194 af Primary=193.45 cfs 16.194 af
Pond DP 6A: 28" Steel Culvert	Inflow=119.71 cfs 11.512 af Primary=119.71 cfs 11.512 af
Pond DP 7: Design Point 7	Inflow=424.74 cfs 39.950 af Primary=424.74 cfs 39.950 af
Pond DP 8: Design Point 8	Inflow=325.64 cfs 26.309 af Primary=325.64 cfs 26.309 af
Pond DP 9: Design Point 9	Inflow=153.94 cfs 15.764 af Primary=153.94 cfs 15.764 af

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method




Pond 1aP: Design Point 1a	Inflow=28.20 cfs 1.815 af Primary=28.20 cfs 1.815 af
Pond DP 10: Design Point 10	Inflow=349.19 cfs 61.163 af Primary=349.19 cfs 61.163 af
Pond DP 11: Design Point 11	Inflow=228.95 cfs 25.167 af Primary=228.95 cfs 25.167 af
Pond DP 12: Design Point 12	Inflow=44.22 cfs 2.982 af Primary=44.22 cfs 2.982 af
Pond DP 16: DESIGN POINT 16	Inflow=95.48 cfs 7.210 af Primary=95.48 cfs 7.210 af
Pond DP 2: Design Point 2	Inflow=169.46 cfs 14.924 af Primary=169.46 cfs 14.924 af
Pond DP 3: Design Point 3	Inflow=12.73 cfs 0.859 af Primary=12.73 cfs 0.859 af
Pond DP 4: 18" HDPE Culvert	Inflow=53.58 cfs 3.817 af Primary=53.58 cfs 3.817 af
Pond DP 5: 18" HDPE Culvert	Inflow=88.34 cfs 5.441 af Primary=88.34 cfs 5.441 af
Pond DP 5A: 12" Steel Culvert	Inflow=65.36 cfs 4.539 af Primary=65.36 cfs 4.539 af
Pond DP 6: 52" Concrete Culvert	Inflow=268.75 cfs 22.427 af Primary=268.75 cfs 22.427 af
Pond DP 6A: 28" Steel Culvert	Inflow=166.63 cfs 15.943 af Primary=166.63 cfs 15.943 af
Pond DP 7: Design Point 7	Inflow=607.19 cfs 55.580 af Primary=607.19 cfs 55.580 af
Pond DP 8: Design Point 8	Inflow=456.92 cfs 36.466 af Primary=456.92 cfs 36.466 af
Pond DP 9: Design Point 9	Inflow=224.36 cfs 21.777 af Primary=224.36 cfs 21.777 af

APPENDIX E

HydroCAD Data – Proposed Model – Highmount

- 1. Proposed Model Diagram, Area/Soil Listings and Subcatchment Summaries**
- 2. Proposed Reach and Culvert Summaries – 1 & 10-yr Storm Events**
- 3. Proposed Pond Summaries – 1, 10 & 100-yr Storm Events**
- 4. Proposed Design Point Summaries - 1-yr Event**
- 5. Proposed Design Point Totals – 10, 25 and 100-yr Storm Events**

**Model Diagram, Area and Soil Listings
and Subcatchment Summaries**

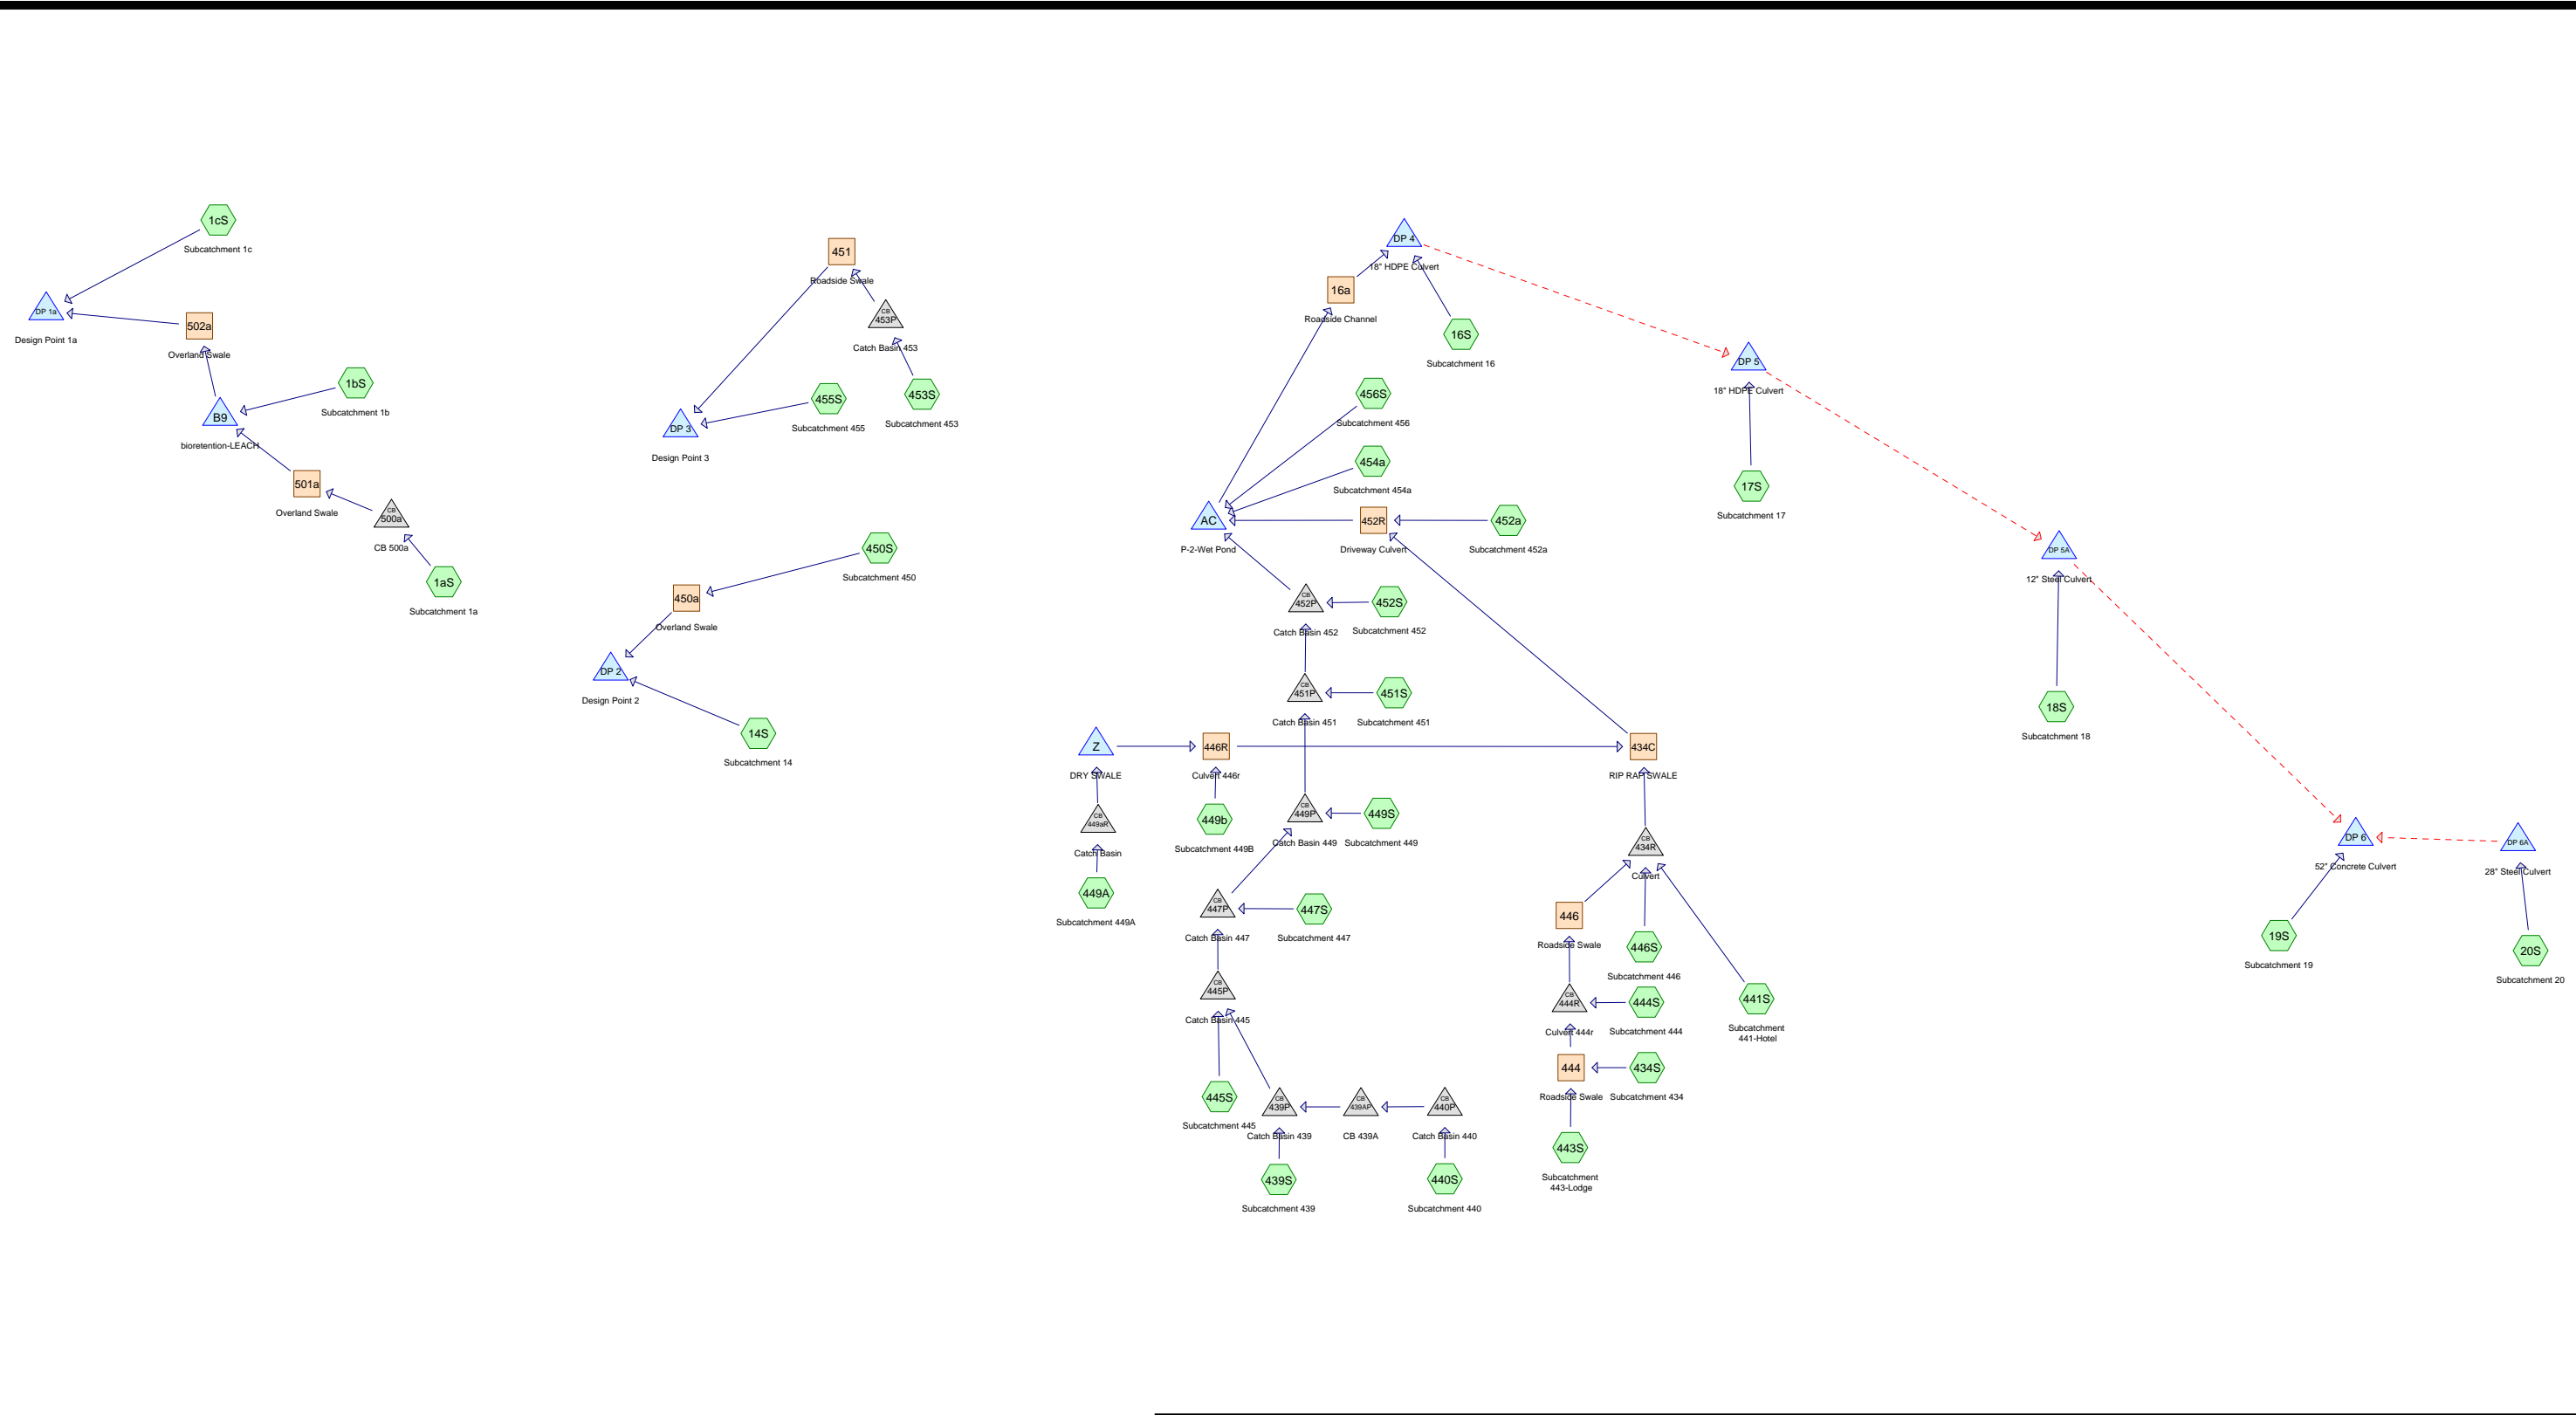

Drainage Diagram for 07074_Pro-Highmount
 Prepared by The LA group, Printed 2/27/2012
 HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Printed 2/27/2012

Page 1

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
115.837	70	Woods, Good, HSG C (1cS, 14S, 16S, 17S, 18S, 19S, 20S, 450S)
41.436	71	Meadow, non-grazed, HSG C (14S, 16S, 17S, 18S, 19S, 20S)
1.200	72	Green Roof (443S)
7.256	72	green roof (441S)
9.936	74	>75% Grass cover, Good, HSG C (1aS, 1bS, 1cS, 434S, 439S, 440S, 444S, 445S, 446S, 447S, 449A, 449b, 450S, 452a, 452S, 453S, 455S, 456S)
1.580	89	Dirt Road (20S)
0.230	98	Paved (1aS)
0.036	98	Paved parking (1bS)
1.050	98	Paved parking & roofs (439S, 447S, 449A, 449S)
0.080	98	Paved parking, HSG C (19S)
0.668	98	Paved roads (14S)
0.598	98	Paved roads w/curbs & sewers (445S, 451S, 453S, 455S)
0.284	98	Paved roads w/curbs & sewers, HSG C (452S)
0.255	98	Pavement (16S, 18S)
0.373	98	Roadway (17S, 20S)
0.463	98	Roof (1bS, 454a)
0.213	98	Roof Area (14S, 19S, 20S)
0.294	98	Roofs (449A)
0.040	98	Roofs, HSG C (440S)
0.071	98	Water Surface (1bS)
0.247	98	Water Surface, 0% imp, HSG C (456S)
0.025	98	Water Surface, HSG C (14S)

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Printed 2/27/2012

Page 2

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
167.886	HSG C	1aS, 1bS, 1cS, 14S, 16S, 17S, 18S, 19S, 20S, 434S, 439S, 440S, 444S, 445S, 446S, 447S, 449A, 449b, 450S, 452a, 452S, 453S, 455S, 456S
0.000	HSG D	
14.286	Other	1aS, 1bS, 14S, 16S, 17S, 18S, 19S, 20S, 439S, 441S, 443S, 445S, 447S, 449A, 449S, 451S, 453S, 454a, 455S

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 1

Summary for Subcatchment 1aS: Subcatchment 1a

Runoff = 1.33 cfs @ 11.91 hrs, Volume= 0.054 af, Depth= 1.64"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
0	70	Woods, Good, HSG C
* 0	98	Roof
* 10,000	98	Paved
7,305	74	>75% Grass cover, Good, HSG C
17,305	88	Weighted Average
7,305		42.21% Pervious Area
10,000		57.79% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0500	2.22		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.3	76	0.0500	4.54		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.1	176	Total			

Summary for Subcatchment 1bS: Subcatchment 1b

Runoff = 1.74 cfs @ 11.96 hrs, Volume= 0.078 af, Depth= 1.22"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
1,580	98	Paved parking
21,744	74	>75% Grass cover, Good, HSG C
3,090	98	Water Surface
* 7,080	98	Roof
0	70	Woods, Good, HSG C
33,494	82	Weighted Average
21,744		64.92% Pervious Area
11,750		35.08% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 2

Summary for Subcatchment 1cS: Subcatchment 1c

Runoff = 2.37 cfs @ 12.09 hrs, Volume= 0.175 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
135,640	70	Woods, Good, HSG C
15,700	74	>75% Grass cover, Good, HSG C
151,340	70	Weighted Average
151,340		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.8	100	0.0840	0.15		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
3.7	460	0.1700	2.06		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
0.4	330	0.2300	14.23	21.34	Trap/Vee/Rect Channel Flow, Bot.W=1.00' D=1.00' Z= 0.5 '/ Top.W=2.00' n= 0.030 Earth, clean & winding
14.9	890	Total			

Summary for Subcatchment 14S: Subcatchment 14

Runoff = 10.91 cfs @ 12.45 hrs, Volume= 1.606 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
405,108	71	Meadow, non-grazed, HSG C
* 2,091	98	Roof Area
858,175	70	Woods, Good, HSG C
29,098	98	Paved roads
1,089	98	Water Surface, HSG C
1,295,561	71	Weighted Average
1,263,283		97.51% Pervious Area
32,278		2.49% Impervious Area

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 3

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.7	100	0.1100	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
0.6	80	0.1000	2.21		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
30.4	2,165	0.2260	1.19		Shallow Concentrated Flow, SC Flow through Woods Forest w/Heavy Litter Kv= 2.5 fps
1.2	90	0.2350	1.21		Shallow Concentrated Flow, SC Flow through Grass Forest w/Heavy Litter Kv= 2.5 fps
0.3	150	0.0450	8.53	34.11	Trap/Vee/Rect Channel Flow, Roadside Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
42.2	2,585	Total			

Summary for Subcatchment 16S: Subcatchment 16

Runoff = 4.88 cfs @ 11.94 hrs, Volume= 0.209 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 8,620	98	Pavement
100,893	70	Woods, Good, HSG C
48,662	71	Meadow, non-grazed, HSG C
158,175	72	Weighted Average
149,555		94.55% Pervious Area
8,620		5.45% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.5	421	0.0230	4.64	37.13	Trap/Vee/Rect Channel Flow, Roadside Vegetated Swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.050 Earth, cobble bottom, clean sides
1.3	740	0.1000	9.68	77.42	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.050 Earth, cobble bottom, clean sides
2.8	1,161	Total			

Summary for Subcatchment 17S: Subcatchment 17

Runoff = 8.83 cfs @ 12.03 hrs, Volume= 0.508 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 4

Area (sf)	CN	Description
* 6,950	98	Roadway
81,862	71	Meadow, non-grazed, HSG C
321,183	70	Woods, Good, HSG C
409,995	71	Weighted Average
403,045		98.30% Pervious Area
6,950		1.70% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.5	100	0.2000	0.48		Sheet Flow, Sheet Flow through Woods Grass: Short n= 0.150 P2= 4.00"
5.2	440	0.3200	1.41		Shallow Concentrated Flow, SC Flow through Woods Forest w/Heavy Litter Kv= 2.5 fps
0.7	540	0.1160	13.69	54.76	Trap/Vee/Rect Channel Flow, Roadside Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
9.4	1,080	Total			

Summary for Subcatchment 18S: Subcatchment 18

Runoff = 4.58 cfs @ 12.43 hrs, Volume= 0.659 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 2,494	98	Pavement
183,388	71	Meadow, non-grazed, HSG C
382,141	70	Woods, Good, HSG C
568,023	70	Weighted Average
565,529		99.56% Pervious Area
2,494		0.44% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	100	0.0900	0.16		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
11.7	651	0.1380	0.93		Shallow Concentrated Flow, SCF Forest w/Heavy Litter Kv= 2.5 fps
2.8	102	0.0600	0.61		Shallow Concentrated Flow, SCF2 Forest w/Heavy Litter Kv= 2.5 fps
14.2	997	0.2190	1.17		Shallow Concentrated Flow, SCF3 Forest w/Heavy Litter Kv= 2.5 fps
0.1	51	0.0590	9.76	39.05	Trap/Vee/Rect Channel Flow, Flow in Roadside Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
39.3	1,901	Total			

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 5

Summary for Subcatchment 19S: Subcatchment 19

Runoff = 20.84 cfs @ 12.41 hrs, Volume= 2.953 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 4,792	98	Roof Area
3,485	98	Paved parking, HSG C
1,554,221	70	Woods, Good, HSG C
984,456	71	Meadow, non-grazed, HSG C
2,546,954	70	Weighted Average
2,538,677		99.68% Pervious Area
8,277		0.32% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	100	0.0910	0.16		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
26.9	2,633	0.2960	1.63		Shallow Concentrated Flow, SC Flow through woods Kv= 3.0 fps
1.1	300	0.0130	4.58	18.33	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030 Earth, grassed & winding
38.5	3,033	Total			

Summary for Subcatchment 20S: Subcatchment 20

Runoff = 19.76 cfs @ 12.28 hrs, Volume= 2.257 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 68,825	89	Dirt Road
* 2,396	98	Roof Area
* 9,278	98	Roadway
1,637,943	70	Woods, Good, HSG C
101,495	71	Meadow, non-grazed, HSG C
1,819,937	71	Weighted Average
1,808,263		99.36% Pervious Area
11,674		0.64% Impervious Area

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 6

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	100	0.0910	0.16		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
18.7	3,055	0.2960	2.72		Shallow Concentrated Flow, SC Flow through woods Woodland Kv= 5.0 fps
0.6	310	0.0466	8.68	34.71	Trap/Vee/Rect Channel Flow, Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030 Earth, grassed & winding
29.8	3,465	Total			

Summary for Subcatchment 434S: Subcatchment 434

Runoff = 0.59 cfs @ 11.98 hrs, Volume= 0.029 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
19,166	74	>75% Grass cover, Good, HSG C
19,166		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, sheet flow Grass: Short n= 0.150 P2= 4.00"
0.1	27	0.2240	7.10		Shallow Concentrated Flow, shallow concentrated flow Grassed Waterway Kv= 15.0 fps
0.5	287	0.0450	9.08	54.49	Trap/Vee/Rect Channel Flow, roadside ditch Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.033
6.2	414	Total			

Summary for Subcatchment 439S: Subcatchment 439

Runoff = 3.04 cfs @ 11.98 hrs, Volume= 0.144 af, Depth= 1.04"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
13,896	98	Paved parking & roofs
58,414	74	>75% Grass cover, Good, HSG C
72,310	79	Weighted Average
58,414		80.78% Pervious Area
13,896		19.22% Impervious Area

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 7

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	100	0.1200	0.39		Sheet Flow, sheet flow Grass: Short n= 0.150 P2= 4.00"
0.6	84	0.1300	2.52		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.4	322	0.0340	3.74		Shallow Concentrated Flow, Paved Kv= 20.3 fps
6.3	506	Total			

Summary for Subcatchment 440S: Subcatchment 440

Runoff = 1.06 cfs @ 12.00 hrs, Volume= 0.054 af, Depth= 0.83"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
1,742	98	Roofs, HSG C
32,234	74	>75% Grass cover, Good, HSG C
33,976	75	Weighted Average
32,234		94.87% Pervious Area
1,742		5.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.6	100	0.1000	0.36		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
3.0	235	0.0340	1.29		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
7.6	335	Total			

Summary for Subcatchment 441S: Subcatchment 441-Hotel

Runoff = 7.50 cfs @ 12.02 hrs, Volume= 0.418 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 316,069	72	green roof
316,069		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.0					Direct Entry,

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 8

Summary for Subcatchment 443S: Subcatchment 443-Lodge

Runoff = 1.24 cfs @ 12.02 hrs, Volume= 0.069 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 52,272	72	Green Roof
52,272		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.0					Direct Entry, Highmount Lodge

Summary for Subcatchment 444S: Subcatchment 444

Runoff = 1.01 cfs @ 11.94 hrs, Volume= 0.042 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
28,241	74	>75% Grass cover, Good, HSG C
28,241		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.1	66	0.3030	0.52		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.5	300	0.0600	10.49	62.92	Trap/Vee/Rect Channel Flow, TRM SWALE Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.033 Earth, grassed & winding
2.6	366	Total			

Summary for Subcatchment 445S: Subcatchment 445

Runoff = 0.90 cfs @ 11.96 hrs, Volume= 0.041 af, Depth= 1.72"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
7,680	98	Paved roads w/curbs & sewers
4,825	74	>75% Grass cover, Good, HSG C
12,505	89	Weighted Average
4,825		38.58% Pervious Area
7,680		61.42% Impervious Area

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 9

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.6	100	0.1800	0.46		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.0	350	0.0800	5.74		Shallow Concentrated Flow, Paved Kv= 20.3 fps
4.6	450	Total			

Summary for Subcatchment 446S: Subcatchment 446

Runoff = 1.73 cfs @ 11.98 hrs, Volume= 0.084 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
55,919	74	>75% Grass cover, Good, HSG C
55,919		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	88	0.0680	0.30		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.4	730	0.0400	8.56	51.38	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.033 Earth, grassed & winding
6.2	818	Total			

Summary for Subcatchment 447S: Subcatchment 447

Runoff = 1.10 cfs @ 11.92 hrs, Volume= 0.050 af, Depth= 2.25"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
10,130	98	Paved parking & roofs
1,562	74	>75% Grass cover, Good, HSG C
11,692	95	Weighted Average
1,562		13.36% Pervious Area
10,130		86.64% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	100	0.0300	1.81		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
1.1	244	0.0328	3.68		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.0	344	Total			

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 10

Summary for Subcatchment 449A: Subcatchment 449A

Runoff = 3.18 cfs @ 11.95 hrs, Volume= 0.143 af, Depth= 1.64"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
13,350	98	Paved parking & roofs
19,520	74	>75% Grass cover, Good, HSG C
* 12,800	98	Roofs
45,670	88	Weighted Average
19,520		42.74% Pervious Area
26,150		57.26% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	30	0.5000	0.54		Sheet Flow, GRASS Grass: Short n= 0.150 P2= 4.00"
1.3	300	0.0350	3.80		Shallow Concentrated Flow, ROAD Paved Kv= 20.3 fps
0.8	250	0.0050	5.09	16.00	Pipe Channel, culvert 24.0" Round Area= 3.1 sf Perim= 6.3' r= 0.50' n= 0.013 Corrugated PE, smooth interior
1.1	213	0.0050	3.28	26.23	Trap/Vee/Rect Channel Flow, trm swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.033 Earth, grassed & winding
0.2	50	0.0050	5.09	16.00	Pipe Channel, into cb 24.0" Round Area= 3.1 sf Perim= 6.3' r= 0.50' n= 0.013 Corrugated PE, smooth interior
4.3	843	Total			

Summary for Subcatchment 449b: Subcatchment 449B

Runoff = 0.82 cfs @ 11.92 hrs, Volume= 0.033 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
22,066	74	>75% Grass cover, Good, HSG C
22,066		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	455	0.0200	7.01	14.01	Channel Flow, Area= 2.0 sf Perim= 2.0' r= 1.00' n= 0.030 Earth, grassed & winding

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 11

Summary for Subcatchment 449S: Subcatchment 449

Runoff = 0.83 cfs @ 11.92 hrs, Volume= 0.041 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
8,350	98	Paved parking & roofs
8,350		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0400	2.03		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
1.3	245	0.0240	3.14		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.1	345	Total			

Summary for Subcatchment 450S: Subcatchment 450

Runoff = 3.04 cfs @ 11.93 hrs, Volume= 0.127 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
40,190	74	>75% Grass cover, Good, HSG C
55,675	70	Woods, Good, HSG C
95,865	72	Weighted Average
95,865		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	740	0.0600	7.50	59.97	Trap/Vee/Rect Channel Flow, conveyance swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.050 swale with checkdams

Summary for Subcatchment 451S: Subcatchment 451

Runoff = 0.81 cfs @ 11.91 hrs, Volume= 0.040 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
8,072	98	Paved roads w/curbs & sewers
8,072		100.00% Impervious Area

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 12

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	100	0.0300	1.81		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.8	234	0.0600	4.97		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.7	334	Total			

Summary for Subcatchment 452a: Subcatchment 452a

Runoff = 0.08 cfs @ 11.91 hrs, Volume= 0.003 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
2,110	74	>75% Grass cover, Good, HSG C
2,110		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.3	188	0.0600	9.10	18.20	Channel Flow, Area= 2.0 sf Perim= 2.0' r= 1.00' n= 0.040 Earth, cobble bottom, clean sides

Summary for Subcatchment 452S: Subcatchment 452

Runoff = 1.43 cfs @ 11.91 hrs, Volume= 0.062 af, Depth= 2.06"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
12,360	98	Paved roads w/curbs & sewers, HSG C
3,381	74	>75% Grass cover, Good, HSG C
15,741	93	Weighted Average
3,381		21.48% Pervious Area
12,360		78.52% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0700	2.54		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.7	234	0.0726	5.47		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.4	334	Total			

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 13

Summary for Subcatchment 453S: Subcatchment 453

Runoff = 0.94 cfs @ 11.94 hrs, Volume= 0.041 af, Depth= 1.72"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
8,020	98	Paved roads w/curbs & sewers
4,462	74	>75% Grass cover, Good, HSG C
12,482	89	Weighted Average
4,462		35.75% Pervious Area
8,020		64.25% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.2	43	0.1160	0.32		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.4	57	0.0700	2.27		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.8	217	0.0500	4.54		Shallow Concentrated Flow, Paved Kv= 20.3 fps
3.4	317	Total			

Summary for Subcatchment 454a: Subcatchment 454a

Runoff = 1.21 cfs @ 11.96 hrs, Volume= 0.064 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 13,080	98	Roof
13,080		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 455S: Subcatchment 455

Runoff = 0.84 cfs @ 11.91 hrs, Volume= 0.033 af, Depth= 0.93"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 14

Area (sf)	CN	Description
2,272	98	Paved roads w/curbs & sewers
16,118	74	>75% Grass cover, Good, HSG C
18,390	77	Weighted Average
16,118		87.65% Pervious Area
2,272		12.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	346	0.0400	8.74	69.95	Trap/Vee/Rect Channel Flow, roadside swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.035 Earth, dense weeds

Summary for Subcatchment 456S: Subcatchment 456

Runoff = 3.82 cfs @ 11.94 hrs, Volume= 0.162 af, Depth= 0.93"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
79,875	74	>75% Grass cover, Good, HSG C
10,775	98	Water Surface, 0% imp, HSG C
90,650	77	Weighted Average
90,650		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.2	100	0.2500	0.52		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"

**Reach and Culvert Summaries
1 & 10-yr Storm Events**

Summary for Reach 16a: Roadside Channel

Inflow Area = 18.547 ac, 12.56% Impervious, Inflow Depth > 0.95" for 1-YEAR event
Inflow = 1.09 cfs @ 14.75 hrs, Volume= 1.470 af
Outflow = 1.09 cfs @ 14.88 hrs, Volume= 1.470 af, Atten= 0%, Lag= 7.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.70 fps, Min. Travel Time= 4.8 min
Avg. Velocity = 1.12 fps, Avg. Travel Time= 11.5 min

Peak Storage= 310 cf @ 14.80 hrs
Average Depth at Peak Storage= 0.18'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 75.38 cfs

2.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 770.0' Slope= 0.0948 '/'
Inlet Invert= 2,443.00', Outlet Invert= 2,370.00'



Summary for Reach 434C: RIP RAP SWALE

Inflow Area = 12.383 ac, 4.85% Impervious, Inflow Depth = 0.79" for 1-YEAR event
Inflow = 10.80 cfs @ 12.02 hrs, Volume= 0.819 af
Outflow = 10.65 cfs @ 12.04 hrs, Volume= 0.819 af, Atten= 1%, Lag= 1.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.87 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 1.22 fps, Avg. Travel Time= 2.6 min

Peak Storage= 416 cf @ 12.02 hrs
Average Depth at Peak Storage= 0.79'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 61.85 cfs

2.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 188.0' Slope= 0.0638 '/'
Inlet Invert= 2,500.00', Outlet Invert= 2,488.00'



07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 2

Summary for Reach 444: Roadside Swale

Inflow Area = 1.640 ac, 0.00% Impervious, Inflow Depth = 0.72" for 1-YEAR event
Inflow = 1.79 cfs @ 12.01 hrs, Volume= 0.098 af
Outflow = 1.74 cfs @ 12.05 hrs, Volume= 0.098 af, Atten= 3%, Lag= 2.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.71 fps, Min. Travel Time= 1.4 min
Avg. Velocity = 1.09 fps, Avg. Travel Time= 4.8 min

Peak Storage= 150 cf @ 12.02 hrs
Average Depth at Peak Storage= 0.21'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 95.47 cfs

2.00' x 2.00' deep channel, n= 0.033 Earth, grassed & winding
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 317.0' Slope= 0.0662 '/'
Inlet Invert= 2,548.00', Outlet Invert= 2,527.00'



Summary for Reach 446: Roadside Swale

Inflow Area = 2.288 ac, 0.00% Impervious, Inflow Depth = 0.74" for 1-YEAR event
Inflow = 2.09 cfs @ 12.00 hrs, Volume= 0.140 af
Outflow = 1.96 cfs @ 12.11 hrs, Volume= 0.140 af, Atten= 7%, Lag= 6.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.15 fps, Min. Travel Time= 3.8 min
Avg. Velocity = 0.98 fps, Avg. Travel Time= 12.2 min

Peak Storage= 447 cf @ 12.05 hrs
Average Depth at Peak Storage= 0.27'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 70.49 cfs

2.00' x 2.00' deep channel, n= 0.033 Earth, grassed & winding
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 720.0' Slope= 0.0361 '/'
Inlet Invert= 2,526.00', Outlet Invert= 2,500.00'



07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 3


Summary for Reach 446R: Culvert 446r

Inflow Area = 1.555 ac, 38.61% Impervious, Inflow Depth = 1.36" for 1-YEAR event
Inflow = 0.92 cfs @ 11.92 hrs, Volume= 0.176 af
Outflow = 0.92 cfs @ 11.93 hrs, Volume= 0.176 af, Atten= 1%, Lag= 0.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.93 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 1.63 fps, Avg. Travel Time= 0.4 min

Peak Storage= 9 cf @ 11.92 hrs
Average Depth at Peak Storage= 0.28'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 11.74 cfs

18.0" Round Pipe
n= 0.013 Corrugated PE, smooth interior
Length= 40.0' Slope= 0.0125 '/'
Inlet Invert= 2,498.50', Outlet Invert= 2,498.00'



Summary for Reach 450a: Overland Swale

Inflow Area = 2.201 ac, 0.00% Impervious, Inflow Depth = 0.69" for 1-YEAR event
Inflow = 3.04 cfs @ 11.93 hrs, Volume= 0.127 af
Outflow = 2.29 cfs @ 12.06 hrs, Volume= 0.127 af, Atten= 25%, Lag= 8.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.25 fps, Min. Travel Time= 5.5 min
Avg. Velocity = 0.61 fps, Avg. Travel Time= 20.3 min

Peak Storage= 756 cf @ 11.97 hrs
Average Depth at Peak Storage= 0.46'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 26.44 cfs

2.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 0.5 '/' Top Width= 4.00'
Length= 740.0' Slope= 0.0243 '/'
Inlet Invert= 2,452.00', Outlet Invert= 2,434.00'



07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 4

Summary for Reach 451: Roadside Swale

Inflow Area = 0.287 ac, 64.25% Impervious, Inflow Depth = 1.72" for 1-YEAR event
Inflow = 0.94 cfs @ 11.94 hrs, Volume= 0.041 af
Outflow = 0.92 cfs @ 11.95 hrs, Volume= 0.041 af, Atten= 2%, Lag= 0.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.69 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 0.78 fps, Avg. Travel Time= 1.1 min

Peak Storage= 17 cf @ 11.94 hrs
Average Depth at Peak Storage= 0.16'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 81.60 cfs

2.00' x 2.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 50.0' Slope= 0.0400 '/'
Inlet Invert= 2,450.00', Outlet Invert= 2,448.00'




Summary for Reach 452R: Driveway Culvert

Inflow Area = 12.431 ac, 4.83% Impervious, Inflow Depth = 0.79" for 1-YEAR event
Inflow = 10.66 cfs @ 12.04 hrs, Volume= 0.822 af
Outflow = 8.73 cfs @ 12.03 hrs, Volume= 0.822 af, Atten= 18%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 12.62 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 4.05 fps, Avg. Travel Time= 1.2 min

Peak Storage= 236 cf @ 12.00 hrs
Average Depth at Peak Storage= 1.00'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 8.73 cfs

12.0" Round Pipe
n= 0.013 Corrugated PE, smooth interior
Length= 300.0' Slope= 0.0600 '/'
Inlet Invert= 2,488.00', Outlet Invert= 2,470.00'



Summary for Reach 501a: Overland Swale

Inflow Area = 0.397 ac, 57.79% Impervious, Inflow Depth = 1.64" for 1-YEAR event
Inflow = 1.33 cfs @ 11.91 hrs, Volume= 0.054 af
Outflow = 1.28 cfs @ 11.92 hrs, Volume= 0.054 af, Atten= 4%, Lag= 0.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.98 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 0.88 fps, Avg. Travel Time= 1.7 min

Peak Storage= 30 cf @ 11.91 hrs
Average Depth at Peak Storage= 0.16'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 25.98 cfs

2.00' x 1.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 0.5 '/' Top Width= 3.00'
Length= 90.0' Slope= 0.0889 '/'
Inlet Invert= 2,436.00', Outlet Invert= 2,428.00'




Summary for Reach 502a: Overland Swale

Inflow Area = 1.166 ac, 42.82% Impervious, Inflow Depth > 0.43" for 1-YEAR event
Inflow = 0.03 cfs @ 21.53 hrs, Volume= 0.041 af
Outflow = 0.03 cfs @ 21.66 hrs, Volume= 0.041 af, Atten= 0%, Lag= 7.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.33 fps, Min. Travel Time= 4.3 min
Avg. Velocity = 1.36 fps, Avg. Travel Time= 7.3 min

Peak Storage= 8 cf @ 21.59 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 18.45 cfs

2.00' x 1.00' deep Parabolic Channel, n= 0.030 Earth, clean & winding
Length= 600.0' Slope= 0.2258 '/'
Inlet Invert= 2,418.00', Outlet Invert= 2,282.50'

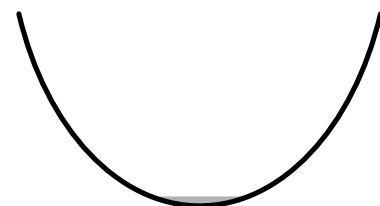

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 1

Summary for Pond 434R: Culvert

Inflow Area = 10.828 ac, 0.00% Impervious, Inflow Depth = 0.71" for 1-YEAR event
 Inflow = 10.45 cfs @ 12.02 hrs, Volume= 0.642 af
 Outflow = 10.45 cfs @ 12.02 hrs, Volume= 0.642 af, Atten= 0%, Lag= 0.0 min
 Primary = 10.45 cfs @ 12.02 hrs, Volume= 0.642 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,496.32' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,495.00'	36.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,495.00' / 2,494.50' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,498.00'	20.0' long x 30.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=10.32 cfs @ 12.02 hrs HW=2,496.31' (Free Discharge)

↑1=Culvert (Barrel Controls 10.32 cfs @ 5.11 fps)
 ↓2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 439AP: CB 439A

Inflow Area = 0.780 ac, 5.13% Impervious, Inflow Depth = 0.83" for 1-YEAR event
 Inflow = 1.06 cfs @ 12.00 hrs, Volume= 0.054 af
 Outflow = 1.06 cfs @ 12.00 hrs, Volume= 0.054 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.06 cfs @ 12.00 hrs, Volume= 0.054 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,576.42' @ 12.00 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,576.00'	24.0" Round Culvert L= 265.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,576.00' / 2,559.00' S= 0.0642 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=1.06 cfs @ 12.00 hrs HW=2,576.42' (Free Discharge)

↑1=Culvert (Inlet Controls 1.06 cfs @ 2.21 fps)

Summary for Pond 439P: Catch Basin 439

Inflow Area = 2.440 ac, 14.71% Impervious, Inflow Depth = 0.98" for 1-YEAR event
 Inflow = 4.08 cfs @ 11.99 hrs, Volume= 0.199 af
 Outflow = 4.08 cfs @ 11.99 hrs, Volume= 0.199 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.08 cfs @ 11.99 hrs, Volume= 0.199 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,559.75' @ 11.99 hrs

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 2

Device	Routing	Invert	Outlet Devices
#1	Primary	2,559.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,559.00' / 2,527.00' S= 0.0914 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,564.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.01 cfs @ 11.99 hrs HW=2,559.74' (Free Discharge)

↑1=Culvert (Inlet Controls 4.01 cfs @ 2.94 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 440P: Catch Basin 440

Inflow Area = 0.780 ac, 5.13% Impervious, Inflow Depth = 0.83" for 1-YEAR event
 Inflow = 1.06 cfs @ 12.00 hrs, Volume= 0.054 af
 Outflow = 1.06 cfs @ 12.00 hrs, Volume= 0.054 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.06 cfs @ 12.00 hrs, Volume= 0.054 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,585.42' @ 12.00 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,585.00'	24.0" Round Culvert L= 180.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,585.00' / 2,576.00' S= 0.0500 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,589.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.06 cfs @ 12.00 hrs HW=2,585.42' (Free Discharge)

↑1=Culvert (Inlet Controls 1.06 cfs @ 2.21 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 444R: Culvert 444r

Inflow Area = 2.288 ac, 0.00% Impervious, Inflow Depth = 0.74" for 1-YEAR event
 Inflow = 2.09 cfs @ 12.00 hrs, Volume= 0.140 af
 Outflow = 2.09 cfs @ 12.00 hrs, Volume= 0.140 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.09 cfs @ 12.00 hrs, Volume= 0.140 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,527.66' @ 12.00 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,527.00'	18.0" Round Culvert L= 80.0' Ke= 0.500 Inlet / Outlet Invert= 2,527.00' / 2,526.00' S= 0.0125 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=2.09 cfs @ 12.00 hrs HW=2,527.66' (Free Discharge)

↑1=Culvert (Inlet Controls 2.09 cfs @ 2.77 fps)

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 3

Summary for Pond 445P: Catch Basin 445

Inflow Area = 2.727 ac, 19.63% Impervious, Inflow Depth = 1.05" for 1-YEAR event
 Inflow = 4.91 cfs @ 11.98 hrs, Volume= 0.240 af
 Outflow = 4.91 cfs @ 11.98 hrs, Volume= 0.240 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.91 cfs @ 11.98 hrs, Volume= 0.240 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,527.83' @ 11.98 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,527.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,527.00' / 2,520.00' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,534.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.84 cfs @ 11.98 hrs HW=2,527.82' (Free Discharge)

1=Culvert (Inlet Controls 4.84 cfs @ 3.08 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 447P: Catch Basin 447

Inflow Area = 2.995 ac, 25.63% Impervious, Inflow Depth = 1.16" for 1-YEAR event
 Inflow = 5.68 cfs @ 11.97 hrs, Volume= 0.290 af
 Outflow = 5.68 cfs @ 11.97 hrs, Volume= 0.290 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.68 cfs @ 11.97 hrs, Volume= 0.290 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,516.89' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,516.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,516.00' / 2,509.00' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,523.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=5.63 cfs @ 11.97 hrs HW=2,516.89' (Free Discharge)

1=Culvert (Inlet Controls 5.63 cfs @ 3.21 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 449P: Catch Basin 449

Inflow Area = 3.187 ac, 30.11% Impervious, Inflow Depth = 1.25" for 1-YEAR event
 Inflow = 6.33 cfs @ 11.96 hrs, Volume= 0.331 af
 Outflow = 6.33 cfs @ 11.96 hrs, Volume= 0.331 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.33 cfs @ 11.96 hrs, Volume= 0.331 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

07074_Pro-Highmount

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 4

Peak Elev= 2,507.95' @ 11.96 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,507.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,507.00' / 2,492.00' S= 0.0429 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,513.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=6.24 cfs @ 11.96 hrs HW=2,507.94' (Free Discharge)

1=Culvert (Inlet Controls 6.24 cfs @ 3.30 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 451P: Catch Basin 451

Inflow Area = 3.372 ac, 33.95% Impervious, Inflow Depth = 1.32" for 1-YEAR event
 Inflow = 6.99 cfs @ 11.95 hrs, Volume= 0.371 af
 Outflow = 6.99 cfs @ 11.95 hrs, Volume= 0.371 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.99 cfs @ 11.95 hrs, Volume= 0.371 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,489.00' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,488.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,488.00' / 2,468.00' S= 0.0571 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,496.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=6.89 cfs @ 11.95 hrs HW=2,488.99' (Free Discharge)

1=Culvert (Inlet Controls 6.89 cfs @ 3.39 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 452P: Catch Basin 452

Inflow Area = 3.734 ac, 38.26% Impervious, Inflow Depth = 1.39" for 1-YEAR event
 Inflow = 8.22 cfs @ 11.94 hrs, Volume= 0.433 af
 Outflow = 8.22 cfs @ 11.94 hrs, Volume= 0.433 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.22 cfs @ 11.94 hrs, Volume= 0.433 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,467.03' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,466.00'	42.0" Round Culvert L= 110.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,466.00' / 2,462.00' S= 0.0364 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,472.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=8.20 cfs @ 11.94 hrs HW=2,467.03' (Free Discharge)

1=Culvert (Inlet Controls 8.20 cfs @ 3.46 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 453P: Catch Basin 453

Inflow Area = 0.287 ac, 64.25% Impervious, Inflow Depth = 1.72" for 1-YEAR event
 Inflow = 0.94 cfs @ 11.94 hrs, Volume= 0.041 af
 Outflow = 0.94 cfs @ 11.94 hrs, Volume= 0.041 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.94 cfs @ 11.94 hrs, Volume= 0.041 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,452.43' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,456.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Primary	2,452.00'	18.0" Round Culvert L= 150.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,452.00' / 2,450.00' S= 0.0133 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=0.94 cfs @ 11.94 hrs HW=2,452.43' (Free Discharge)

1=Orifice/Grate (Controls 0.00 cfs)

2=Culvert (Inlet Controls 0.94 cfs @ 2.23 fps)

Summary for Pond 500a: CB 500a

Inflow Area = 0.397 ac, 57.79% Impervious, Inflow Depth = 1.64" for 1-YEAR event
 Inflow = 1.33 cfs @ 11.91 hrs, Volume= 0.054 af
 Outflow = 1.33 cfs @ 11.91 hrs, Volume= 0.054 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.33 cfs @ 11.91 hrs, Volume= 0.054 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,441.36' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,440.75'	12.0" Round Culvert L= 95.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,440.75' / 2,436.00' S= 0.0500 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,446.00'	12.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.33 cfs @ 11.91 hrs HW=2,441.36' (Free Discharge)

1=Culvert (Inlet Controls 1.33 cfs @ 2.66 fps)

2=Orifice/Grate (Controls 0.00 cfs)

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 2/27/2012

Page 1

Summary for Reach 16a: Roadside Channel

Inflow Area = 18.547 ac, 12.56% Impervious, Inflow Depth > 3.44" for 10-YEAR event
Inflow = 9.60 cfs @ 14.49 hrs, Volume= 5.318 af
Outflow = 9.59 cfs @ 14.52 hrs, Volume= 5.318 af, Atten= 0%, Lag= 1.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.42 fps, Min. Travel Time= 2.4 min
Avg. Velocity = 1.44 fps, Avg. Travel Time= 8.9 min

Peak Storage= 1,362 cf @ 14.48 hrs
Average Depth at Peak Storage= 0.66'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 75.38 cfs

2.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 770.0' Slope= 0.0948 '/'
Inlet Invert= 2,443.00', Outlet Invert= 2,370.00'



Summary for Reach 434C: RIP RAP SWALE

Inflow Area = 12.383 ac, 4.85% Impervious, Inflow Depth = 3.18" for 10-YEAR event
Inflow = 51.72 cfs @ 12.00 hrs, Volume= 3.277 af
Outflow = 51.12 cfs @ 12.01 hrs, Volume= 3.277 af, Atten= 1%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.38 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 1.53 fps, Avg. Travel Time= 2.0 min

Peak Storage= 1,314 cf @ 12.01 hrs
Average Depth at Peak Storage= 1.83'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 61.85 cfs

2.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 188.0' Slope= 0.0638 '/'
Inlet Invert= 2,500.00', Outlet Invert= 2,488.00'



07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 2/27/2012

Page 2

Summary for Reach 444: Roadside Swale

Inflow Area = 1.640 ac, 0.00% Impervious, Inflow Depth = 3.04" for 10-YEAR event
Inflow = 8.05 cfs @ 12.00 hrs, Volume= 0.416 af
Outflow = 7.86 cfs @ 12.02 hrs, Volume= 0.416 af, Atten= 2%, Lag= 1.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.06 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 1.59 fps, Avg. Travel Time= 3.3 min

Peak Storage= 417 cf @ 12.01 hrs
Average Depth at Peak Storage= 0.52'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 95.47 cfs

2.00' x 2.00' deep channel, n= 0.033 Earth, grassed & winding
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 317.0' Slope= 0.0662 '/'
Inlet Invert= 2,548.00', Outlet Invert= 2,527.00'



Summary for Reach 446: Roadside Swale

Inflow Area = 2.288 ac, 0.00% Impervious, Inflow Depth = 3.08" for 10-YEAR event
Inflow = 10.15 cfs @ 11.98 hrs, Volume= 0.588 af
Outflow = 9.77 cfs @ 12.04 hrs, Volume= 0.588 af, Atten= 4%, Lag= 4.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.21 fps, Min. Travel Time= 2.3 min
Avg. Velocity = 1.40 fps, Avg. Travel Time= 8.6 min

Peak Storage= 1,361 cf @ 12.00 hrs
Average Depth at Peak Storage= 0.70'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 70.49 cfs

2.00' x 2.00' deep channel, n= 0.033 Earth, grassed & winding
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 720.0' Slope= 0.0361 '/'
Inlet Invert= 2,526.00', Outlet Invert= 2,500.00'



07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 2/27/2012

Page 3


Summary for Reach 446R: Culvert 446r

Inflow Area = 1.555 ac, 38.61% Impervious, Inflow Depth = 4.16" for 10-YEAR event
Inflow = 3.51 cfs @ 11.91 hrs, Volume= 0.539 af
Outflow = 3.47 cfs @ 11.91 hrs, Volume= 0.539 af, Atten= 1%, Lag= 0.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.80 fps, Min. Travel Time= 0.1 min
Avg. Velocity = 2.02 fps, Avg. Travel Time= 0.3 min

Peak Storage= 24 cf @ 11.91 hrs
Average Depth at Peak Storage= 0.56'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 11.74 cfs

18.0" Round Pipe
n= 0.013 Corrugated PE, smooth interior
Length= 40.0' Slope= 0.0125 '/'
Inlet Invert= 2,498.50', Outlet Invert= 2,498.00'




Summary for Reach 450a: Overland Swale

Inflow Area = 2.201 ac, 0.00% Impervious, Inflow Depth = 2.99" for 10-YEAR event
Inflow = 13.37 cfs @ 11.92 hrs, Volume= 0.549 af
Outflow = 11.62 cfs @ 12.01 hrs, Volume= 0.549 af, Atten= 13%, Lag= 5.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.58 fps, Min. Travel Time= 3.4 min
Avg. Velocity = 0.87 fps, Avg. Travel Time= 14.1 min

Peak Storage= 2,411 cf @ 11.95 hrs
Average Depth at Peak Storage= 1.24'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 26.44 cfs

2.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 0.5 '/' Top Width= 4.00'
Length= 740.0' Slope= 0.0243 '/'
Inlet Invert= 2,452.00', Outlet Invert= 2,434.00'

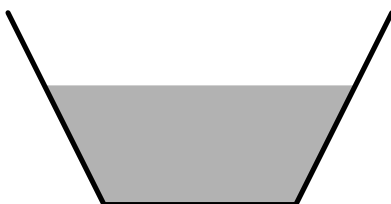

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 2/27/2012

Page 4

Summary for Reach 451: Roadside Swale

Inflow Area = 0.287 ac, 64.25% Impervious, Inflow Depth = 4.74" for 10-YEAR event
Inflow = 2.42 cfs @ 11.94 hrs, Volume= 0.113 af
Outflow = 2.39 cfs @ 11.94 hrs, Volume= 0.113 af, Atten= 1%, Lag= 0.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.73 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 0.88 fps, Avg. Travel Time= 0.9 min

Peak Storage= 32 cf @ 11.94 hrs
Average Depth at Peak Storage= 0.28'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 81.60 cfs

2.00' x 2.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 1.0 '/' Top Width= 6.00'
Length= 50.0' Slope= 0.0400 '/'
Inlet Invert= 2,450.00', Outlet Invert= 2,448.00'




Summary for Reach 452R: Driveway Culvert

Inflow Area = 12.431 ac, 4.83% Impervious, Inflow Depth = 3.18" for 10-YEAR event
Inflow = 51.16 cfs @ 12.01 hrs, Volume= 3.290 af
Outflow = 8.73 cfs @ 11.79 hrs, Volume= 3.290 af, Atten= 83%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 12.67 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 4.97 fps, Avg. Travel Time= 1.0 min

Peak Storage= 236 cf @ 11.76 hrs
Average Depth at Peak Storage= 1.00'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 8.73 cfs

12.0" Round Pipe
n= 0.013 Corrugated PE, smooth interior
Length= 300.0' Slope= 0.0600 '/'
Inlet Invert= 2,488.00', Outlet Invert= 2,470.00'



Summary for Reach 501a: Overland Swale

Inflow Area = 0.397 ac, 57.79% Impervious, Inflow Depth = 4.63" for 10-YEAR event
Inflow = 3.52 cfs @ 11.91 hrs, Volume= 0.153 af
Outflow = 3.42 cfs @ 11.91 hrs, Volume= 0.153 af, Atten= 3%, Lag= 0.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.61 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 1.17 fps, Avg. Travel Time= 1.3 min

Peak Storage= 56 cf @ 11.91 hrs
Average Depth at Peak Storage= 0.29'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 25.98 cfs

2.00' x 1.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 0.5 '/' Top Width= 3.00'
Length= 90.0' Slope= 0.0889 '/'
Inlet Invert= 2,436.00', Outlet Invert= 2,428.00'




Summary for Reach 502a: Overland Swale

Inflow Area = 1.166 ac, 42.82% Impervious, Inflow Depth > 3.27" for 10-YEAR event
Inflow = 5.41 cfs @ 12.01 hrs, Volume= 0.318 af
Outflow = 5.35 cfs @ 12.04 hrs, Volume= 0.318 af, Atten= 1%, Lag= 1.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 10.08 fps, Min. Travel Time= 1.0 min
Avg. Velocity = 1.69 fps, Avg. Travel Time= 5.9 min

Peak Storage= 320 cf @ 12.02 hrs
Average Depth at Peak Storage= 0.54'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 18.45 cfs

2.00' x 1.00' deep Parabolic Channel, n= 0.030 Earth, clean & winding
Length= 600.0' Slope= 0.2258 '/'
Inlet Invert= 2,418.00', Outlet Invert= 2,282.50'

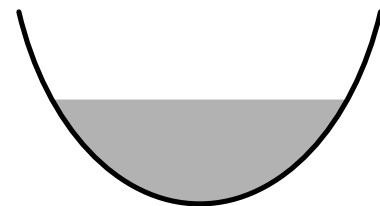

07074_Pro-Highmount

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 1

Summary for Pond 434R: Culvert

Inflow Area = 10.828 ac, 0.00% Impervious, Inflow Depth = 3.04" for 10-YEAR event
Inflow = 50.46 cfs @ 12.01 hrs, Volume= 2.739 af
Outflow = 50.46 cfs @ 12.01 hrs, Volume= 2.739 af, Atten= 0%, Lag= 0.0 min
Primary = 50.46 cfs @ 12.01 hrs, Volume= 2.739 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Peak Elev= 2,498.27' @ 12.01 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,495.00'	36.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,495.00' / 2,494.50' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,498.00'	20.0' long x 30.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=50.04 cfs @ 12.01 hrs HW=2,498.27' (Free Discharge)

- ↑1=Culvert (Barrel Controls 42.66 cfs @ 6.90 fps)
- ↑2=Broad-Crested Rectangular Weir (Weir Controls 7.38 cfs @ 1.39 fps)

Summary for Pond 439AP: CB 439A

Inflow Area = 0.780 ac, 5.13% Impervious, Inflow Depth = 3.28" for 10-YEAR event
Inflow = 4.27 cfs @ 11.99 hrs, Volume= 0.213 af
Outflow = 4.27 cfs @ 11.99 hrs, Volume= 0.213 af, Atten= 0%, Lag= 0.0 min
Primary = 4.27 cfs @ 11.99 hrs, Volume= 0.213 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Peak Elev= 2,576.88' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,576.00'	24.0" Round Culvert L= 265.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,576.00' / 2,559.00' S= 0.0642 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=4.21 cfs @ 11.99 hrs HW=2,576.88' (Free Discharge)

- ↑1=Culvert (Inlet Controls 4.21 cfs @ 3.19 fps)

Summary for Pond 439P: Catch Basin 439

Inflow Area = 2.440 ac, 14.71% Impervious, Inflow Depth = 3.55" for 10-YEAR event
Inflow = 14.72 cfs @ 11.98 hrs, Volume= 0.722 af
Outflow = 14.72 cfs @ 11.98 hrs, Volume= 0.722 af, Atten= 0%, Lag= 0.0 min
Primary = 14.72 cfs @ 11.98 hrs, Volume= 0.722 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Peak Elev= 2,560.50' @ 11.98 hrs

07074_Pro-Highmount

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 2

Device	Routing	Invert	Outlet Devices
#1	Primary	2,559.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,559.00' / 2,527.00' S= 0.0914 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,564.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=14.54 cfs @ 11.98 hrs HW=2,560.49' (Free Discharge)

↑1=Culvert (Inlet Controls 14.54 cfs @ 4.15 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 440P: Catch Basin 440

Inflow Area = 0.780 ac, 5.13% Impervious, Inflow Depth = 3.28" for 10-YEAR event
 Inflow = 4.27 cfs @ 11.99 hrs, Volume= 0.213 af
 Outflow = 4.27 cfs @ 11.99 hrs, Volume= 0.213 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.27 cfs @ 11.99 hrs, Volume= 0.213 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,585.88' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,585.00'	24.0" Round Culvert L= 180.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,585.00' / 2,576.00' S= 0.0500 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,589.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.21 cfs @ 11.99 hrs HW=2,585.88' (Free Discharge)

↑1=Culvert (Inlet Controls 4.21 cfs @ 3.19 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 444R: Culvert 444r

Inflow Area = 2.288 ac, 0.00% Impervious, Inflow Depth = 3.08" for 10-YEAR event
 Inflow = 10.15 cfs @ 11.98 hrs, Volume= 0.588 af
 Outflow = 10.15 cfs @ 11.98 hrs, Volume= 0.588 af, Atten= 0%, Lag= 0.0 min
 Primary = 10.15 cfs @ 11.98 hrs, Volume= 0.588 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,529.17' @ 11.98 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,527.00'	18.0" Round Culvert L= 80.0' Ke= 0.500 Inlet / Outlet Invert= 2,527.00' / 2,526.00' S= 0.0125 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=10.10 cfs @ 11.98 hrs HW=2,529.16' (Free Discharge)

↑1=Culvert (Inlet Controls 10.10 cfs @ 5.72 fps)

07074_Pro-Highmount

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 3

Summary for Pond 445P: Catch Basin 445

Inflow Area = 2.727 ac, 19.63% Impervious, Inflow Depth = 3.68" for 10-YEAR event
 Inflow = 16.94 cfs @ 11.97 hrs, Volume= 0.836 af
 Outflow = 16.94 cfs @ 11.97 hrs, Volume= 0.836 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.94 cfs @ 11.97 hrs, Volume= 0.836 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,528.62' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,527.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,527.00' / 2,520.00' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,534.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=16.81 cfs @ 11.97 hrs HW=2,528.62' (Free Discharge)

1=Culvert (Inlet Controls 16.81 cfs @ 4.33 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 447P: Catch Basin 447

Inflow Area = 2.995 ac, 25.63% Impervious, Inflow Depth = 3.83" for 10-YEAR event
 Inflow = 18.72 cfs @ 11.97 hrs, Volume= 0.957 af
 Outflow = 18.72 cfs @ 11.97 hrs, Volume= 0.957 af, Atten= 0%, Lag= 0.0 min
 Primary = 18.72 cfs @ 11.97 hrs, Volume= 0.957 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,517.72' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,516.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,516.00' / 2,509.00' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,523.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=18.56 cfs @ 11.97 hrs HW=2,517.71' (Free Discharge)

1=Culvert (Inlet Controls 18.56 cfs @ 4.45 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 449P: Catch Basin 449

Inflow Area = 3.187 ac, 30.11% Impervious, Inflow Depth = 3.95" for 10-YEAR event
 Inflow = 20.14 cfs @ 11.96 hrs, Volume= 1.049 af
 Outflow = 20.14 cfs @ 11.96 hrs, Volume= 1.049 af, Atten= 0%, Lag= 0.0 min
 Primary = 20.14 cfs @ 11.96 hrs, Volume= 1.049 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 2/27/2012

Page 4

Peak Elev= 2,508.80' @ 11.96 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,507.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,507.00' / 2,492.00' S= 0.0429 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,513.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=19.87 cfs @ 11.96 hrs HW=2,508.78' (Free Discharge)

1=Culvert (Inlet Controls 19.87 cfs @ 4.54 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 451P: Catch Basin 451

Inflow Area = 3.372 ac, 33.95% Impervious, Inflow Depth = 4.05" for 10-YEAR event
 Inflow = 21.50 cfs @ 11.95 hrs, Volume= 1.138 af
 Outflow = 21.50 cfs @ 11.95 hrs, Volume= 1.138 af, Atten= 0%, Lag= 0.0 min
 Primary = 21.50 cfs @ 11.95 hrs, Volume= 1.138 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,489.87' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,488.00'	36.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,488.00' / 2,468.00' S= 0.0571 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,496.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=21.21 cfs @ 11.95 hrs HW=2,489.85' (Free Discharge)

1=Culvert (Inlet Controls 21.21 cfs @ 4.63 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 452P: Catch Basin 452

Inflow Area = 3.734 ac, 38.26% Impervious, Inflow Depth = 4.16" for 10-YEAR event
 Inflow = 24.26 cfs @ 11.94 hrs, Volume= 1.294 af
 Outflow = 24.26 cfs @ 11.94 hrs, Volume= 1.294 af, Atten= 0%, Lag= 0.0 min
 Primary = 24.26 cfs @ 11.94 hrs, Volume= 1.294 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,467.87' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,466.00'	42.0" Round Culvert L= 110.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,466.00' / 2,462.00' S= 0.0364 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,472.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=24.09 cfs @ 11.94 hrs HW=2,467.86' (Free Discharge)

1=Culvert (Inlet Controls 24.09 cfs @ 4.64 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 453P: Catch Basin 453

Inflow Area = 0.287 ac, 64.25% Impervious, Inflow Depth = 4.74" for 10-YEAR event
 Inflow = 2.42 cfs @ 11.94 hrs, Volume= 0.113 af
 Outflow = 2.42 cfs @ 11.94 hrs, Volume= 0.113 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.42 cfs @ 11.94 hrs, Volume= 0.113 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,452.72' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,456.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Primary	2,452.00'	18.0" Round Culvert L= 150.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,452.00' / 2,450.00' S= 0.0133 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=2.40 cfs @ 11.94 hrs HW=2,452.72' (Free Discharge)

1=Orifice/Grate (Controls 0.00 cfs)

2=Culvert (Inlet Controls 2.40 cfs @ 2.88 fps)

Summary for Pond 500a: CB 500a

Inflow Area = 0.397 ac, 57.79% Impervious, Inflow Depth = 4.63" for 10-YEAR event
 Inflow = 3.52 cfs @ 11.91 hrs, Volume= 0.153 af
 Outflow = 3.52 cfs @ 11.91 hrs, Volume= 0.153 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.52 cfs @ 11.91 hrs, Volume= 0.153 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,442.11' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,440.75'	12.0" Round Culvert L= 95.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,440.75' / 2,436.00' S= 0.0500 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,446.00'	12.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=3.48 cfs @ 11.91 hrs HW=2,442.10' (Free Discharge)

1=Culvert (Inlet Controls 3.48 cfs @ 4.43 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Pond Summaries
1, 10 & 100-yr Storm Events

Summary for Pond AC: P-2-Wet Pond

Inflow Area = 18.547 ac, 12.56% Impervious, Inflow Depth = 0.96" for 1-YEAR event
 Inflow = 20.11 cfs @ 11.97 hrs, Volume= 1.482 af
 Outflow = 1.09 cfs @ 14.75 hrs, Volume= 1.470 af, Atten= 95%, Lag= 166.8 min
 Primary = 1.09 cfs @ 14.75 hrs, Volume= 1.470 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 2,455.00' Surf.Area= 21,032 sf Storage= 57,564 cf
 Peak Elev= 2,456.12' @ 14.75 hrs Surf.Area= 37,459 sf Storage= 90,585 cf (33,022 cf above start)

Plug-Flow detention time= 2,033.0 min calculated for 0.148 af (10% of inflow)
 Center-of-Mass det. time= 527.9 min (1,397.8 - 870.0)

Volume	Invert	Avail.Storage	Storage Description		
#1	2,448.00'	190,566 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
2,448.00	2,220	247.0	0	0	2,220
2,450.00	2,450	550.0	4,668	4,668	21,454
2,452.00	9,960	590.0	11,567	16,235	25,257
2,454.00	14,058	650.0	23,901	40,135	31,306
2,455.00	21,032	724.0	17,428	57,564	39,427
2,456.00	37,023	950.0	28,653	86,217	69,544
2,458.00	44,800	1,000.0	81,700	167,916	77,544
2,458.50	45,800	1,004.0	22,650	190,566	78,356

Device	Routing	Invert	Outlet Devices
#1	Primary	2,453.00'	24.0" Round Culvert L= 120.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,453.00' / 2,450.00' S= 0.0250 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	2,455.00'	6.0" Vert. Orifice/Grate C= 0.600
#3	Device 1	2,456.00'	18.0" W x 12.0" H Vert. Orifice/Grate C= 0.600
#4	Primary	2,457.50'	40.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=1.07 cfs @ 14.75 hrs HW=2,456.12' (Free Discharge)

- 1=Culvert (Passes 1.07 cfs of 22.01 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.88 cfs @ 4.48 fps)
- 3=Orifice/Grate (Orifice Controls 0.19 cfs @ 1.10 fps)
- 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 2

Summary for Pond B9: bioretention-LEACH

Inflow Area = 1.166 ac, 42.82% Impervious, Inflow Depth = 1.37" for 1-YEAR event
 Inflow = 2.86 cfs @ 11.94 hrs, Volume= 0.133 af
 Outflow = 0.03 cfs @ 21.53 hrs, Volume= 0.041 af, Atten= 99%, Lag= 575.5 min
 Primary = 0.03 cfs @ 21.53 hrs, Volume= 0.041 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,423.51' @ 21.53 hrs Surf.Area= 10,590 sf Storage= 5,232 cf

Plug-Flow detention time= 1,898.3 min calculated for 0.041 af (31% of inflow)
 Center-of-Mass det. time= 1,767.8 min (2,596.6 - 828.8)

Volume	Invert	Avail.Storage	Storage Description
#1	2,418.00'	1,366 cf	stone underdrain (Prismatic) Listed below (Recalc) 3,414 cf Overall x 40.0% Voids
#2	2,419.00'	2,048 cf	filter media (Prismatic) Listed below (Recalc) 13,656 cf Overall x 15.0% Voids
#3	2,423.00'	8,215 cf	surface storage (Prismatic) Listed below (Recalc)
		11,629 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,418.00	3,414	0	0
2,419.00	3,414	3,414	3,414

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,419.00	3,414	0	0
2,423.00	3,414	13,656	13,656

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,423.00	3,414	0	0
2,424.00	4,100	3,757	3,757
2,425.00	4,815	4,458	8,215

Device	Routing	Invert	Outlet Devices
#1	Primary	2,418.50'	24.0" Round Culvert L= 66.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,418.50' / 2,418.00' S= 0.0076 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,423.00'	1.000 in/hr Exfiltration over Surface area above 2,423.00' Excluded Surface area = 10,242 sf
#3	Device 1	2,423.50'	12.0" Horiz. Orifice/Grate X 2.00 C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.02 cfs @ 21.53 hrs HW=2,423.51' (Free Discharge)

- 1=Culvert (Passes 0.02 cfs of 30.28 cfs potential flow)
- 2=Exfiltration (Exfiltration Controls 0.01 cfs)
- 3=Orifice/Grate (Weir Controls 0.01 cfs @ 0.27 fps)

Summary for Pond Z: DRY SWALE

Inflow Area = 1.048 ac, 57.26% Impervious, Inflow Depth = 1.64" for 1-YEAR event
 Inflow = 3.18 cfs @ 11.95 hrs, Volume= 0.143 af
 Outflow = 0.16 cfs @ 12.97 hrs, Volume= 0.143 af, Atten= 95%, Lag= 61.4 min
 Primary = 0.16 cfs @ 12.97 hrs, Volume= 0.143 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,504.66' @ 12.97 hrs Surf.Area= 6,920 sf Storage= 3,166 cf

Plug-Flow detention time= 237.4 min calculated for 0.143 af (100% of inflow)
 Center-of-Mass det. time= 237.0 min (1,053.0 - 816.0)

Volume	Invert	Avail.Storage	Storage Description
#1	2,500.50'	800 cf	stone underdrain (Prismatic) Listed below (Recalc) 2,000 cf Overall x 40.0% Voids
#2	2,501.50'	750 cf	filter media (Prismatic) Listed below (Recalc) 5,000 cf Overall x 15.0% Voids
#3	2,504.00'	11,950 cf	surface storage (Prismatic) Listed below (Recalc)
		13,500 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,500.50	2,000	0	0
2,501.50	2,000	2,000	2,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,501.50	2,000	0	0
2,504.00	2,000	5,000	5,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,504.00	2,000	0	0
2,506.00	4,800	6,800	6,800
2,507.00	5,500	5,150	11,950

Device	Routing	Invert	Outlet Devices
#1	Device 2	2,500.50'	1.000 in/hr Exfiltration over Surface area above 1,863.00' Excluded Surface area = 0 sf
#2	Primary	2,500.50'	8.0" Round Culvert L= 235.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,500.50' / 2,495.00' S= 0.0234 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#3	Primary	2,506.00'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 1-YEAR Rainfall=2.80"

Printed 2/27/2012

Page 4

Primary OutFlow Max=0.16 cfs @ 12.97 hrs HW=2,504.66' (Free Discharge)

2=Culvert (Passes 0.16 cfs of 2.80 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.16 cfs)

3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond AC: P-2-Wet Pond

Inflow Area = 18.547 ac, 12.56% Impervious, Inflow Depth = 3.45" for 10-YEAR event
 Inflow = 49.53 cfs @ 11.94 hrs, Volume= 5.331 af
 Outflow = 9.60 cfs @ 14.49 hrs, Volume= 5.318 af, Atten= 81%, Lag= 152.9 min
 Primary = 9.60 cfs @ 14.49 hrs, Volume= 5.318 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 2,455.00' Surf.Area= 21,032 sf Storage= 57,564 cf
 Peak Elev= 2,457.54' @ 14.49 hrs Surf.Area= 42,928 sf Storage= 147,541 cf (89,977 cf above start)

Plug-Flow detention time= 511.1 min calculated for 3.997 af (75% of inflow)
 Center-of-Mass det. time= 277.9 min (1,140.7 - 862.8)

Volume	Invert	Avail.Storage	Storage Description		
#1	2,448.00'	190,566 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
2,448.00	2,220	247.0	0	0	2,220
2,450.00	2,450	550.0	4,668	4,668	21,454
2,452.00	9,960	590.0	11,567	16,235	25,257
2,454.00	14,058	650.0	23,901	40,135	31,306
2,455.00	21,032	724.0	17,428	57,564	39,427
2,456.00	37,023	950.0	28,653	86,217	69,544
2,458.00	44,800	1,000.0	81,700	167,916	77,544
2,458.50	45,800	1,004.0	22,650	190,566	78,356

Device	Routing	Invert	Outlet Devices
#1	Primary	2,453.00'	24.0" Round Culvert L= 120.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,453.00' / 2,450.00' S= 0.0250 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	2,455.00'	6.0" Vert. Orifice/Grate C= 0.600
#3	Device 1	2,456.00'	18.0" W x 12.0" H Vert. Orifice/Grate C= 0.600
#4	Primary	2,457.50'	40.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=9.42 cfs @ 14.49 hrs HW=2,457.54' (Free Discharge)

- 1=Culvert (Passes 8.70 cfs of 28.44 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 1.43 cfs @ 7.28 fps)
- 3=Orifice/Grate (Orifice Controls 7.27 cfs @ 4.85 fps)
- 4=Broad-Crested Rectangular Weir (Weir Controls 0.72 cfs @ 0.51 fps)

Summary for Pond B9: bioretention-LEACH

Inflow Area = 1.166 ac, 42.82% Impervious, Inflow Depth = 4.20" for 10-YEAR event
 Inflow = 8.43 cfs @ 11.94 hrs, Volume= 0.409 af
 Outflow = 5.41 cfs @ 12.01 hrs, Volume= 0.318 af, Atten= 36%, Lag= 4.3 min
 Primary = 5.41 cfs @ 12.01 hrs, Volume= 0.318 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,424.01' @ 12.01 hrs Surf.Area= 10,934 sf Storage= 7,206 cf

Plug-Flow detention time= 361.1 min calculated for 0.318 af (78% of inflow)
 Center-of-Mass det. time= 276.6 min (1,074.0 - 797.4)

Volume	Invert	Avail.Storage	Storage Description
#1	2,418.00'	1,366 cf	stone underdrain (Prismatic) Listed below (Recalc) 3,414 cf Overall x 40.0% Voids
#2	2,419.00'	2,048 cf	filter media (Prismatic) Listed below (Recalc) 13,656 cf Overall x 15.0% Voids
#3	2,423.00'	8,215 cf	surface storage (Prismatic) Listed below (Recalc)
		11,629 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,418.00	3,414	0	0
2,419.00	3,414	3,414	3,414

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,419.00	3,414	0	0
2,423.00	3,414	13,656	13,656

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,423.00	3,414	0	0
2,424.00	4,100	3,757	3,757
2,425.00	4,815	4,458	8,215

Device	Routing	Invert	Outlet Devices
#1	Primary	2,418.50'	24.0" Round Culvert L= 66.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,418.50' / 2,418.00' S= 0.0076 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,423.00'	1.000 in/hr Exfiltration over Surface area above 2,423.00' Excluded Surface area = 10,242 sf
#3	Device 1	2,423.50'	12.0" Horiz. Orifice/Grate X 2.00 C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=5.38 cfs @ 12.01 hrs HW=2,424.00' (Free Discharge)

- 1=Culvert (Passes 5.38 cfs of 32.10 cfs potential flow)
- 2=Exfiltration (Exfiltration Controls 0.02 cfs)
- 3=Orifice/Grate (Orifice Controls 5.37 cfs @ 3.42 fps)

Summary for Pond Z: DRY SWALE

Inflow Area = 1.048 ac, 57.26% Impervious, Inflow Depth = 4.63" for 10-YEAR event
 Inflow = 8.45 cfs @ 11.95 hrs, Volume= 0.404 af
 Outflow = 1.20 cfs @ 12.14 hrs, Volume= 0.404 af, Atten= 86%, Lag= 11.3 min
 Primary = 1.20 cfs @ 12.14 hrs, Volume= 0.404 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,506.11' @ 12.14 hrs Surf.Area= 8,876 sf Storage= 8,877 cf

Plug-Flow detention time= 404.6 min calculated for 0.404 af (100% of inflow)
 Center-of-Mass det. time= 404.7 min (1,191.4 - 786.7)

Volume	Invert	Avail.Storage	Storage Description
#1	2,500.50'	800 cf	stone underdrain (Prismatic) Listed below (Recalc) 2,000 cf Overall x 40.0% Voids
#2	2,501.50'	750 cf	filter media (Prismatic) Listed below (Recalc) 5,000 cf Overall x 15.0% Voids
#3	2,504.00'	11,950 cf	surface storage (Prismatic) Listed below (Recalc)
		13,500 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,500.50	2,000	0	0
2,501.50	2,000	2,000	2,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,501.50	2,000	0	0
2,504.00	2,000	5,000	5,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,504.00	2,000	0	0
2,506.00	4,800	6,800	6,800
2,507.00	5,500	5,150	11,950

Device	Routing	Invert	Outlet Devices
#1	Device 2	2,500.50'	1.000 in/hr Exfiltration over Surface area above 1,863.00' Excluded Surface area = 0 sf
#2	Primary	2,500.50'	8.0" Round Culvert L= 235.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,500.50' / 2,495.00' S= 0.0234 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#3	Primary	2,506.00'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 2/27/2012

Page 8

Primary OutFlow Max=1.17 cfs @ 12.14 hrs HW=2,506.11' (Free Discharge)

2=Culvert (Passes 0.21 cfs of 3.02 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.21 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 0.96 cfs @ 0.89 fps)

Summary for Pond AC: P-2-Wet Pond

Inflow Area = 18.547 ac, 12.56% Impervious, Inflow Depth = 5.22" for 100-YEAR event
 Inflow = 67.59 cfs @ 11.94 hrs, Volume= 8.067 af
 Outflow = 15.65 cfs @ 12.27 hrs, Volume= 8.054 af, Atten= 77%, Lag= 19.9 min
 Primary = 15.65 cfs @ 12.27 hrs, Volume= 8.054 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 2,455.00' Surf.Area= 21,032 sf Storage= 57,564 cf
 Peak Elev= 2,457.65' @ 12.27 hrs Surf.Area= 43,396 sf Storage= 152,597 cf (95,034 cf above start)

Plug-Flow detention time= 370.8 min calculated for 6.732 af (83% of inflow)
 Center-of-Mass det. time= 220.4 min (1,088.9 - 868.5)

Volume	Invert	Avail.Storage	Storage Description		
#1	2,448.00'	190,566 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
2,448.00	2,220	247.0	0	0	2,220
2,450.00	2,450	550.0	4,668	4,668	21,454
2,452.00	9,960	590.0	11,567	16,235	25,257
2,454.00	14,058	650.0	23,901	40,135	31,306
2,455.00	21,032	724.0	17,428	57,564	39,427
2,456.00	37,023	950.0	28,653	86,217	69,544
2,458.00	44,800	1,000.0	81,700	167,916	77,544
2,458.50	45,800	1,004.0	22,650	190,566	78,356

Device	Routing	Invert	Outlet Devices
#1	Primary	2,453.00'	24.0" Round Culvert L= 120.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,453.00' / 2,450.00' S= 0.0250 1/ S= 0.0250 1/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	2,455.00'	6.0" Vert. Orifice/Grate C= 0.600
#3	Device 1	2,456.00'	18.0" W x 12.0" H Vert. Orifice/Grate C= 0.600
#4	Primary	2,457.50'	40.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=15.57 cfs @ 12.27 hrs HW=2,457.65' (Free Discharge)

- 1=Culvert (Passes 9.16 cfs of 28.91 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 1.47 cfs @ 7.46 fps)
- 3=Orifice/Grate (Orifice Controls 7.69 cfs @ 5.13 fps)
- 4=Broad-Crested Rectangular Weir (Weir Controls 6.41 cfs @ 1.05 fps)

Summary for Pond B9: bioretention-LEACH

Inflow Area = 1.166 ac, 42.82% Impervious, Inflow Depth = 6.10" for 100-YEAR event
 Inflow = 11.95 cfs @ 11.94 hrs, Volume= 0.593 af
 Outflow = 7.36 cfs @ 12.01 hrs, Volume= 0.502 af, Atten= 38%, Lag= 4.5 min
 Primary = 7.36 cfs @ 12.01 hrs, Volume= 0.502 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,424.44' @ 12.01 hrs Surf.Area= 11,243 sf Storage= 9,046 cf

Plug-Flow detention time= 256.4 min calculated for 0.502 af (85% of inflow)
 Center-of-Mass det. time= 187.3 min (974.4 - 787.1)

Volume	Invert	Avail.Storage	Storage Description
#1	2,418.00'	1,366 cf	stone underdrain (Prismatic) Listed below (Recalc) 3,414 cf Overall x 40.0% Voids
#2	2,419.00'	2,048 cf	filter media (Prismatic) Listed below (Recalc) 13,656 cf Overall x 15.0% Voids
#3	2,423.00'	8,215 cf	surface storage (Prismatic) Listed below (Recalc)
		11,629 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,418.00	3,414	0	0
2,419.00	3,414	3,414	3,414

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,419.00	3,414	0	0
2,423.00	3,414	13,656	13,656

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,423.00	3,414	0	0
2,424.00	4,100	3,757	3,757
2,425.00	4,815	4,458	8,215

Device	Routing	Invert	Outlet Devices
#1	Primary	2,418.50'	24.0" Round Culvert L= 66.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,418.50' / 2,418.00' S= 0.0076 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,423.00'	1.000 in/hr Exfiltration over Surface area above 2,423.00' Excluded Surface area = 10,242 sf
#3	Device 1	2,423.50'	12.0" Horiz. Orifice/Grate X 2.00 C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=7.33 cfs @ 12.01 hrs HW=2,424.43' (Free Discharge)

- 1=Culvert (Passes 7.33 cfs of 33.60 cfs potential flow)
- 2=Exfiltration (Exfiltration Controls 0.02 cfs)
- 3=Orifice/Grate (Orifice Controls 7.30 cfs @ 4.65 fps)

Summary for Pond Z: DRY SWALE

Inflow Area = 1.048 ac, 57.26% Impervious, Inflow Depth = 6.57" for 100-YEAR event
 Inflow = 11.72 cfs @ 11.95 hrs, Volume= 0.574 af
 Outflow = 7.66 cfs @ 12.01 hrs, Volume= 0.574 af, Atten= 35%, Lag= 4.0 min
 Primary = 7.66 cfs @ 12.01 hrs, Volume= 0.574 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,506.42' @ 12.01 hrs Surf.Area= 9,095 sf Storage= 10,436 cf

Plug-Flow detention time= 326.2 min calculated for 0.574 af (100% of inflow)
 Center-of-Mass det. time= 326.5 min (1,103.6 - 777.2)

Volume	Invert	Avail.Storage	Storage Description
#1	2,500.50'	800 cf	stone underdrain (Prismatic) Listed below (Recalc) 2,000 cf Overall x 40.0% Voids
#2	2,501.50'	750 cf	filter media (Prismatic) Listed below (Recalc) 5,000 cf Overall x 15.0% Voids
#3	2,504.00'	11,950 cf	surface storage (Prismatic) Listed below (Recalc)
		13,500 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,500.50	2,000	0	0
2,501.50	2,000	2,000	2,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,501.50	2,000	0	0
2,504.00	2,000	5,000	5,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,504.00	2,000	0	0
2,506.00	4,800	6,800	6,800
2,507.00	5,500	5,150	11,950

Device	Routing	Invert	Outlet Devices
#1	Device 2	2,500.50'	1.000 in/hr Exfiltration over Surface area above 1,863.00' Excluded Surface area = 0 sf
#2	Primary	2,500.50'	8.0" Round Culvert L= 235.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,500.50' / 2,495.00' S= 0.0234 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#3	Primary	2,506.00'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 100-YEAR Rainfall=8.00"

Printed 2/27/2012

Page 12

Primary OutFlow Max=7.42 cfs @ 12.01 hrs HW=2,506.41' (Free Discharge)

2=Culvert (Passes 0.21 cfs of 3.06 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.21 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 7.21 cfs @ 1.75 fps)

Design Point Summary

1-yr Storm Event

Design Point Totals

10, 25 & 100-yr Storm Events

Summary for Pond DP 1a: Design Point 1a

Inflow Area = 4.640 ac, 10.76% Impervious, Inflow Depth > 0.56" for 1-YEAR event
Inflow = 2.37 cfs @ 12.09 hrs, Volume= 0.217 af
Primary = 2.37 cfs @ 12.09 hrs, Volume= 0.217 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 2: Design Point 2

Inflow Area = 31.943 ac, 2.32% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 11.32 cfs @ 12.44 hrs, Volume= 1.733 af
Primary = 11.32 cfs @ 12.44 hrs, Volume= 1.733 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 3: Design Point 3

Inflow Area = 0.709 ac, 33.34% Impervious, Inflow Depth = 1.25" for 1-YEAR event
Inflow = 1.67 cfs @ 11.92 hrs, Volume= 0.074 af
Primary = 1.67 cfs @ 11.92 hrs, Volume= 0.074 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 4: 18" HDPE Culvert

Inflow Area = 22.178 ac, 11.39% Impervious, Inflow Depth > 0.91" for 1-YEAR event
Inflow = 5.01 cfs @ 11.94 hrs, Volume= 1.679 af
Primary = 5.01 cfs @ 11.94 hrs, Volume= 1.679 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 5: 18" HDPE Culvert

Inflow Area = 9.412 ac, 1.70% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 8.83 cfs @ 12.03 hrs, Volume= 0.508 af
Primary = 8.83 cfs @ 12.03 hrs, Volume= 0.508 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 5A: 12" Steel Culvert

Inflow Area = 13.040 ac, 0.44% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 4.58 cfs @ 12.43 hrs, Volume= 0.659 af
Primary = 4.58 cfs @ 12.43 hrs, Volume= 0.659 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 6: 52" Concrete Culvert

Inflow Area = 58.470 ac, 0.32% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 20.84 cfs @ 12.41 hrs, Volume= 2.953 af
Primary = 20.84 cfs @ 12.41 hrs, Volume= 2.953 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 6A: 28" Steel Culvert

Inflow Area = 41.780 ac, 0.64% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 19.76 cfs @ 12.28 hrs, Volume= 2.257 af
Primary = 19.76 cfs @ 12.28 hrs, Volume= 2.257 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 2/27/2012

Page 1

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 1a: Design Point 1a

Inflow=17.84 cfs 1.130 af
Primary=17.84 cfs 1.130 af

Pond DP 2: Design Point 2

Inflow=60.02 cfs 7.734 af
Primary=60.02 cfs 7.734 af

Pond DP 3: Design Point 3

Inflow=5.19 cfs 0.235 af
Primary=5.19 cfs 0.235 af

Pond DP 4: 18" HDPE Culvert

Inflow=22.94 cfs 6.224 af
Primary=22.94 cfs 6.224 af

Pond DP 5: 18" HDPE Culvert

Inflow=42.79 cfs 2.274 af
Primary=42.79 cfs 2.274 af

Pond DP 5A: 12" Steel Culvert

Inflow=26.09 cfs 3.048 af
Primary=26.09 cfs 3.048 af

Pond DP 6: 52" Concrete Culvert

Inflow=118.71 cfs 13.668 af
Primary=118.71 cfs 13.668 af

Pond DP 6A: 28" Steel Culvert

Inflow=104.54 cfs 10.092 af
Primary=104.54 cfs 10.092 af

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 25-YEAR Rainfall=6.50"

Printed 2/27/2012

Page 2

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 1a: Design Point 1aInflow=20.24 cfs 1.292 af
Primary=20.24 cfs 1.292 af**Pond DP 2: Design Point 2**Inflow=68.69 cfs 8.820 af
Primary=68.69 cfs 8.820 af**Pond DP 3: Design Point 3**Inflow=5.76 cfs 0.263 af
Primary=5.76 cfs 0.263 af**Pond DP 4: 18" HDPE Culvert**Inflow=26.41 cfs 7.019 af
Primary=26.41 cfs 7.019 af**Pond DP 5: 18" HDPE Culvert**Inflow=48.77 cfs 2.594 af
Primary=48.77 cfs 2.594 af**Pond DP 5A: 12" Steel Culvert**Inflow=29.99 cfs 3.485 af
Primary=29.99 cfs 3.485 af**Pond DP 6: 52" Concrete Culvert**Inflow=136.44 cfs 15.627 af
Primary=136.44 cfs 15.627 af**Pond DP 6A: 28" Steel Culvert**Inflow=119.71 cfs 11.512 af
Primary=119.71 cfs 11.512 af

07074_Pro-Highmount

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 100-YEAR Rainfall=8.00"

Printed 2/27/2012

Page 3

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 1a: Design Point 1a

Inflow=27.31 cfs 1.794 af
Primary=27.31 cfs 1.794 af

Pond DP 2: Design Point 2

Inflow=95.64 cfs 12.211 af
Primary=95.64 cfs 12.211 af

Pond DP 3: Design Point 3

Inflow=7.48 cfs 0.345 af
Primary=7.48 cfs 0.345 af

Pond DP 4: 18" HDPE Culvert

Inflow=37.87 cfs 9.474 af
Primary=37.87 cfs 9.474 af

Pond DP 5: 18" HDPE Culvert

Inflow=67.16 cfs 3.592 af
Primary=67.16 cfs 3.592 af

Pond DP 5A: 12" Steel Culvert

Inflow=42.11 cfs 4.851 af
Primary=42.11 cfs 4.851 af

Pond DP 6: 52" Concrete Culvert

Inflow=191.48 cfs 21.752 af
Primary=191.48 cfs 21.752 af

Pond DP 6A: 28" Steel Culvert




Inflow=166.63 cfs 15.943 af
Primary=166.63 cfs 15.943 af

APPENDIX F

HydroCAD Data – Proposed Model – Wildacres West

- 1. Proposed Model Diagram, Area/Soil Listings and Subcatchment Summaries**
- 2. Proposed Reach and Culvert Summaries – 1 & 10-yr Storm Events**
- 3. Proposed Pond Summaries – 1, 10 & 100-yr Storm Events**
- 4. Proposed Design Point Summaries - 1-yr Event**
- 5. Proposed Design Point Totals – 10, 25 and 100-yr Storm Events**

**Model Diagram, Area and Soil Listings
and Subcatchment Summaries**

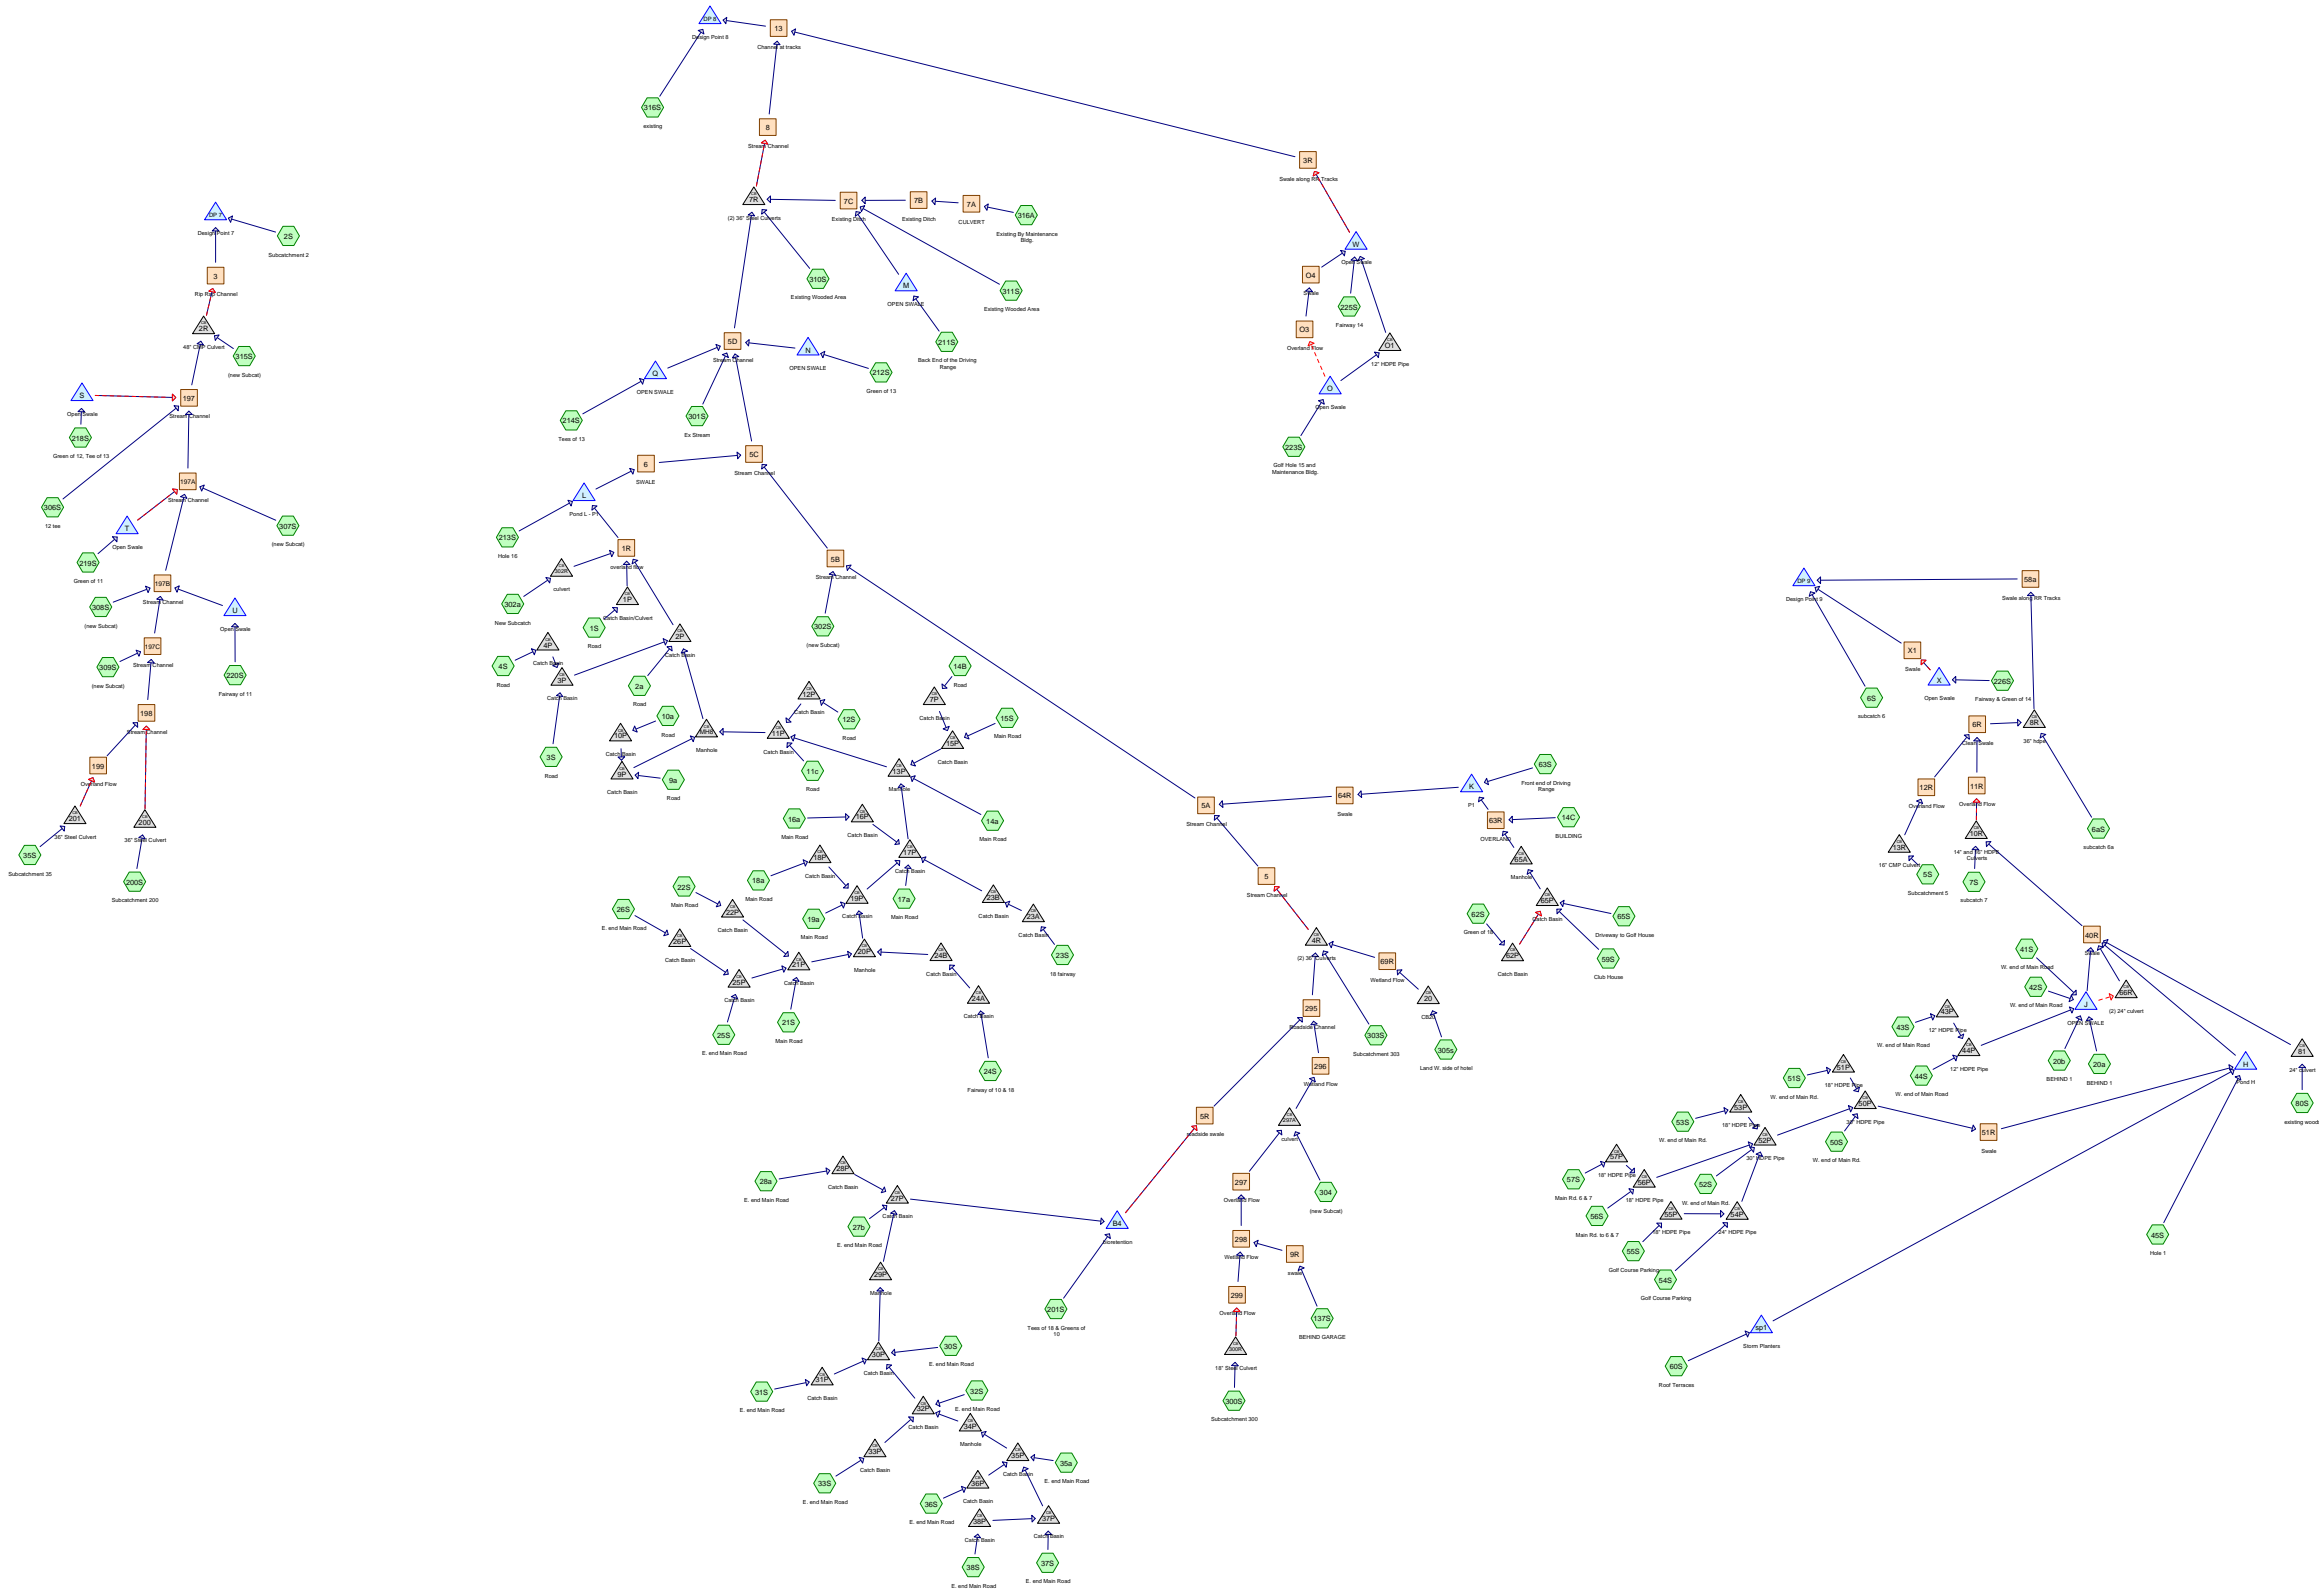

Drainage Diagram for 07074_Pro-WildacresWest
 Prepared by The LA group, Printed 2/27/2012
 HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
38.893	61	>75% Grass cover, Good, HSG B (6aS, 23S, 24S, 45S, 51S, 53S, 60S, 62S, 63S, 80S, 201S, 211S, 212S, 213S, 214S, 218S, 219S, 220S, 223S, 225S, 226S, 303S, 305s, 307S, 309S, 316S)
0.462	68	Porous Pavement (52S, 53S, 80S, 301S, 310S, 311S, 316S)
163.770	70	Woods, Good, HSG C (2S, 5S, 6aS, 6S, 7S, 20b, 24S, 35S, 45S, 63S, 80S, 137S, 200S, 201S, 220S, 223S, 300S, 301S, 302a, 302S, 304, 306S, 307S, 308S, 309S, 310S, 311S, 315S, 316A, 316S)
15.346	71	Meadow, non-grazed, HSG C (2S, 5S, 6aS, 35S, 200S, 300S, 302S, 316A)
48.567	74	>75% Grass cover, Good, HSG C (1S, 2a, 3S, 6aS, 6S, 7S, 9a, 10a, 11c, 12S, 14a, 14B, 14C, 15S, 16a, 17a, 18a, 19a, 20a, 20b, 21S, 22S, 23S, 24S, 25S, 26S, 27b, 28a, 30S, 31S, 32S, 33S, 35a, 36S, 37S, 38S, 43S, 44S, 45S, 51S, 52S, 53S, 54S, 55S, 56S, 57S, 62S, 63S, 65S, 80S, 137S, 201S, 211S, 212S, 213S, 214S, 218S, 219S, 220S, 223S, 225S, 226S, 301S, 303S, 304, 305s, 306S, 307S, 308S, 309S, 310S, 311S, 315S, 316S)
4.641	74	Pasture/grassland/range, Good, HSG C (302a)
5.969	98	Paved (2a, 3S, 4S, 6aS, 6S, 9a, 10a, 11c, 12S, 14a, 15S, 16a, 17a, 18a, 19a, 21S, 22S, 25S, 26S, 27b, 28a, 30S, 31S, 32S, 33S, 35a, 36S, 37S, 38S, 41S, 42S, 43S, 44S, 50S, 51S, 52S, 53S, 54S, 55S, 56S, 57S, 65S, 309S, 310S, 311S, 316S)
0.249	98	Paved (Porous) (307S)
0.027	98	Paved (porous) (302S)
0.558	98	Paved Road (35S, 200S, 300S)
0.067	98	Paved parking (316A)
0.223	98	Paved parking & roofs (7S)
1.166	98	Paved parking, HSG C (5S, 14B, 14C, 20a, 63S, 223S)
3.309	98	Porous Pavement (23S, 24S, 45S, 54S, 55S, 56S, 62S, 65S, 201S, 211S, 212S, 213S, 214S, 218S, 219S, 223S, 225S, 226S, 303S, 304, 305s, 306S, 309S)
0.164	98	Porous Paving (6aS)
0.101	98	Roadway (2S)
2.655	98	Roof (1S, 6aS, 6S, 18a, 35S, 59S, 60S, 223S)
0.031	98	Roof Area (5S)
0.100	98	Roofs (11c)
0.007	98	Roofs, HSG C (63S)
0.667	98	Water Surface, 0% imp, HSG C (63S, 213S)
0.179	98	Water Surface, HSG C (220S)
0.389	98	porous paving (220S)

07074_Pro-WildacresWest

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Printed 2/27/2012

Page 3

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
38.893	HSG B	6aS, 23S, 24S, 45S, 51S, 53S, 60S, 62S, 63S, 80S, 201S, 211S, 212S, 213S, 214S, 218S, 219S, 220S, 223S, 225S, 226S, 303S, 305s, 307S, 309S, 316S
234.343	HSG C	1S, 2a, 2S, 3S, 5S, 6aS, 6S, 7S, 9a, 10a, 11c, 12S, 14a, 14B, 14C, 15S, 16a, 17a, 18a, 19a, 20a, 20b, 21S, 22S, 23S, 24S, 25S, 26S, 27b, 28a, 30S, 31S, 32S, 33S, 35a, 35S, 36S, 37S, 38S, 43S, 44S, 45S, 51S, 52S, 53S, 54S, 55S, 56S, 57S, 62S, 63S, 65S, 80S, 137S, 200S, 201S, 211S, 212S, 213S, 214S, 218S, 219S, 220S, 223S, 225S, 226S, 300S, 301S, 302a, 302S, 303S, 304, 305s, 306S, 307S, 308S, 309S, 310S, 311S, 315S, 316A, 316S
0.000	HSG D	
14.302	Other	1S, 2a, 2S, 3S, 4S, 5S, 6aS, 6S, 7S, 9a, 10a, 11c, 12S, 14a, 15S, 16a, 17a, 18a, 19a, 21S, 22S, 23S, 24S, 25S, 26S, 27b, 28a, 30S, 31S, 32S, 33S, 35a, 35S, 36S, 37S, 38S, 41S, 42S, 43S, 44S, 45S, 50S, 51S, 52S, 53S, 54S, 55S, 56S, 57S, 59S, 60S, 62S, 65S, 80S, 200S, 201S, 211S, 212S, 213S, 214S, 218S, 219S, 220S, 223S, 225S, 226S, 300S, 301S, 302S, 303S, 304, 305s, 306S, 307S, 309S, 310S, 311S, 316A, 316S

Summary for Subcatchment 1S: Road

Runoff = 3.14 cfs @ 12.01 hrs, Volume= 0.170 af, Depth= 1.64"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 30,818	98	Roof
23,162	74	>75% Grass cover, Good, HSG C
53,980	88	Weighted Average
23,162		42.91% Pervious Area
30,818		57.09% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.8	100	0.0200	0.19		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.8	130	0.0350	2.81		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
9.6	230	Total			

Summary for Subcatchment 2a: Road

Runoff = 1.25 cfs @ 11.92 hrs, Volume= 0.056 af, Depth= 2.06"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 10,932	98	Paved
3,222	74	>75% Grass cover, Good, HSG C
14,154	93	Weighted Average
3,222		22.76% Pervious Area
10,932		77.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	100	0.0200	1.54		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.9	219	0.0380	3.96		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.0	319	Total			

Summary for Subcatchment 2S: Subcatchment 2

Runoff = 0.65 cfs @ 12.00 hrs, Volume= 0.033 af, Depth= 0.93"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 4,400	98	Roadway
5,009	71	Meadow, non-grazed, HSG C
9,060	70	Woods, Good, HSG C
18,469	77	Weighted Average
14,069		76.18% Pervious Area
4,400		23.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.7	90	0.2290	0.23		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
0.8	70	0.2550	1.51		Shallow Concentrated Flow, SC Flow through Woods Kv= 3.0 fps
0.3	215	0.0547	13.12	137.80	Trap/Vee/Rect Channel Flow, Vegetated Swale along RR Tracks Bot.W=2.00' D=3.00' Z= 0.5 '/' Top.W=5.00' n= 0.030
7.8	375	Total			

Summary for Subcatchment 3S: Road

Runoff = 0.58 cfs @ 11.91 hrs, Volume= 0.024 af, Depth= 1.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 4,120	98	Paved
3,743	74	>75% Grass cover, Good, HSG C
7,863	87	Weighted Average
3,743		47.60% Pervious Area
4,120		52.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1100	3.04		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.4	172	0.1100	6.73		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.9	272	Total			

Summary for Subcatchment 4S: Road

Runoff = 0.46 cfs @ 11.91 hrs, Volume= 0.022 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 4,505	98	Paved
4,505		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0500	2.22		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.7	174	0.0460	4.35		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	274	Total			

Summary for Subcatchment 5S: Subcatchment 5

Runoff = 1.93 cfs @ 12.07 hrs, Volume= 0.130 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
39,399	71	Meadow, non-grazed, HSG C
* 1,338	98	Roof Area
45,785	70	Woods, Good, HSG C
5,498	98	Paved parking, HSG C
92,020	73	Weighted Average
85,184		92.57% Pervious Area
6,836		7.43% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.1	100	0.1300	0.18		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
4.3	390	0.0920	1.52		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.5	225	0.0346	7.48	29.91	Trap/Vee/Rect Channel Flow, Flow in Vegated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/ Top.W=3.00' n= 0.030
13.9	715	Total			

Summary for Subcatchment 6aS: subcatch 6a

Runoff = 8.62 cfs @ 12.13 hrs, Volume= 0.703 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

	Area (sf)	CN	Description
*	7,130	98	Porous Paving
*	2,840	98	Roof
	334,295	70	Woods, Good, HSG C
	27,046	74	>75% Grass cover, Good, HSG C
*	18,735	98	Paved
	9,300	61	>75% Grass cover, Good, HSG B
	131,702	71	Meadow, non-grazed, HSG C
	531,048	72	Weighted Average
	502,343		94.59% Pervious Area
	28,705		5.41% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.4	100	0.1200	0.18		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
9.2	915	0.1100	1.66		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.2	240	0.0950	18.86	150.91	Trap/Vee/Rect Channel Flow, swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.025 Earth, clean & winding
18.8	1,255	Total			

Summary for Subcatchment 6S: subcatch 6

Runoff = 6.25 cfs @ 12.14 hrs, Volume= 0.516 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

	Area (sf)	CN	Description
*	7,240	98	Roof
	293,063	70	Woods, Good, HSG C
	78,387	74	>75% Grass cover, Good, HSG C
*	10,890	98	Paved
	389,580	72	Weighted Average
	371,450		95.35% Pervious Area
	18,130		4.65% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 5

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.7	100	0.1100	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
7.7	1,015	0.1950	2.21		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
1.7	1,060	0.0750	10.48	83.81	Trap/Vee/Rect Channel Flow, RR Swale w/ Gravel and Leaves Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.040 Earth, cobble bottom, clean sides
19.1	2,175	Total			

Summary for Subcatchment 7S: subcatch 7

Runoff = 1.54 cfs @ 11.94 hrs, Volume= 0.065 af, Depth= 1.22"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
9,700	98	Paved parking & roofs
5,730	70	Woods, Good, HSG C
12,143	74	>75% Grass cover, Good, HSG C
27,573	82	Weighted Average
17,873		64.82% Pervious Area
9,700		35.18% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	20	0.3000	0.41		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
2.1	225	0.1250	1.77		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
2.9	245	Total			

Summary for Subcatchment 9a: Road

Runoff = 0.30 cfs @ 11.91 hrs, Volume= 0.012 af, Depth= 1.89"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,405	98	Paved
1,022	74	>75% Grass cover, Good, HSG C
3,427	91	Weighted Average
1,022		29.82% Pervious Area
2,405		70.18% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 6

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0790	2.66		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.4	138	0.0790	5.71		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.0	238	Total			

Summary for Subcatchment 10a: Road

Runoff = 0.39 cfs @ 11.91 hrs, Volume= 0.018 af, Depth= 2.46"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 3,650	98	Paved
200	74	>75% Grass cover, Good, HSG C
3,850	97	Weighted Average
200		5.19% Pervious Area
3,650		94.81% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0940	2.86		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.5	171	0.0940	6.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.1	271	Total			

Summary for Subcatchment 11c: Road

Runoff = 1.40 cfs @ 11.90 hrs, Volume= 0.058 af, Depth= 1.89"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 7,010	98	Paved
4,732	74	>75% Grass cover, Good, HSG C
* 4,335	98	Roofs
16,077	91	Weighted Average
4,732		29.43% Pervious Area
11,345		70.57% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 7

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0920	2.83		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.1	31	0.0920	6.16		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.7	131	Total			

Summary for Subcatchment 12S: Road

Runoff = 0.29 cfs @ 11.90 hrs, Volume= 0.013 af, Depth= 2.25"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,610	98	Paved
330	74	>75% Grass cover, Good, HSG C
2,940	95	Weighted Average
330		11.22% Pervious Area
2,610		88.78% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0810	2.69		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.1	49	0.0810	5.78		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.7	149	Total			

Summary for Subcatchment 14a: Main Road

Runoff = 0.54 cfs @ 11.94 hrs, Volume= 0.023 af, Depth= 1.64"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 4,265	98	Paved
3,075	74	>75% Grass cover, Good, HSG C
7,340	88	Weighted Average
3,075		41.89% Pervious Area
4,265		58.11% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	100	0.0280	1.76		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
2.0	411	0.0280	3.40		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.9	511	Total			

Summary for Subcatchment 14B: Road

Runoff = 0.92 cfs @ 11.94 hrs, Volume= 0.041 af, Depth= 1.89"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
8,075	98	Paved parking, HSG C
3,326	74	>75% Grass cover, Good, HSG C
11,401	91	Weighted Average
3,326		29.17% Pervious Area
8,075		70.83% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	100	0.0200	1.54		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
2.3	426	0.0240	3.14		Shallow Concentrated Flow, Paved Kv= 20.3 fps
3.4	526	Total			

Summary for Subcatchment 14C: BUILDING

Runoff = 1.89 cfs @ 11.98 hrs, Volume= 0.095 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
19,361	98	Paved parking, HSG C
5,890	74	>75% Grass cover, Good, HSG C
25,251	92	Weighted Average
5,890		23.33% Pervious Area
19,361		76.67% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 9

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.0400	0.25		Sheet Flow, sheet flow Grass: Short n= 0.150 P2= 4.00"
0.2	27	0.0375	2.90		Shallow Concentrated Flow, shallow concentrated flow Grassed Waterway Kv= 15.0 fps
6.8	127	Total			

Summary for Subcatchment 15S: Main Road

Runoff = 1.16 cfs @ 11.93 hrs, Volume= 0.050 af, Depth= 1.72"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 9,480	98	Paved
5,664	74	>75% Grass cover, Good, HSG C
15,144	89	Weighted Average
5,664		37.40% Pervious Area
9,480		62.60% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	100	0.0290	1.78		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
1.9	394	0.0290	3.46		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.8	494	Total			

Summary for Subcatchment 16a: Main Road

Runoff = 0.74 cfs @ 11.91 hrs, Volume= 0.034 af, Depth= 2.46"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 6,864	98	Paved
453	74	>75% Grass cover, Good, HSG C
7,317	97	Weighted Average
453		6.19% Pervious Area
6,864		93.81% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 10

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0750	2.61		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.6	206	0.0750	5.56		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.2	306	Total			

Summary for Subcatchment 17a: Main Road

Runoff = 0.37 cfs @ 11.91 hrs, Volume= 0.016 af, Depth= 1.89"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 3,040	98	Paved
1,330	74	>75% Grass cover, Good, HSG C
4,370	91	Weighted Average
1,330		30.43% Pervious Area
3,040		69.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0790	2.66		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.6	192	0.0790	5.71		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.2	292	Total			

Summary for Subcatchment 18a: Main Road

Runoff = 2.99 cfs @ 11.91 hrs, Volume= 0.137 af, Depth= 2.36"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 13,586	98	Paved
2,952	74	>75% Grass cover, Good, HSG C
* 13,800	98	Roof
30,338	96	Weighted Average
2,952		9.73% Pervious Area
27,386		90.27% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 11

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	56	0.0360	1.73		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.9	220	0.0450	4.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.4	276	Total			

Summary for Subcatchment 19a: Main Road

Runoff = 0.35 cfs @ 11.91 hrs, Volume= 0.015 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,920	98	Paved
1,054	74	>75% Grass cover, Good, HSG C
3,974	92	Weighted Average
1,054		26.52% Pervious Area
2,920		73.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0400	2.03		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.6	139	0.0400	4.06		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.4	239	Total			

Summary for Subcatchment 20a: BEHIND 1

Runoff = 1.10 cfs @ 11.91 hrs, Volume= 0.044 af, Depth= 0.83"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
26,663	74	>75% Grass cover, Good, HSG C
910	98	Paved parking, HSG C
27,573	75	Weighted Average
26,663		96.70% Pervious Area
910		3.30% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.0	395	0.0380	6.65	79.79	Channel Flow, Area= 12.0 sf Perim= 21.0' r= 0.57' n= 0.030 Earth, grassed & winding

Summary for Subcatchment 20b: BEHIND 1

Runoff = 0.83 cfs @ 11.97 hrs, Volume= 0.039 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
23,963	74	>75% Grass cover, Good, HSG C
3,610	70	Woods, Good, HSG C
27,573	73	Weighted Average
27,573		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.8	100	0.1600	0.44		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.4	136	0.0500	1.57		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
5.2	236	Total			

Summary for Subcatchment 21S: Main Road

Runoff = 0.39 cfs @ 11.91 hrs, Volume= 0.016 af, Depth= 1.89"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 3,330	98	Paved
1,244	74	>75% Grass cover, Good, HSG C
4,574	91	Weighted Average
1,244		27.20% Pervious Area
3,330		72.80% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0610	2.40		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.6	169	0.0610	5.01		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.3	269	Total			

Summary for Subcatchment 22S: Main Road

Runoff = 1.58 cfs @ 11.91 hrs, Volume= 0.067 af, Depth= 1.89"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 13

	Area (sf)	CN	Description
*	13,274	98	Paved
	5,332	74	>75% Grass cover, Good, HSG C
	18,606	91	Weighted Average
	5,332		28.66% Pervious Area
	13,274		71.34% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0630	2.43		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.7	161	0.0311	3.58		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.4	261	Total			

Summary for Subcatchment 23S: 18 fairway

Runoff = 0.43 cfs @ 12.00 hrs, Volume= 0.026 af, Depth= 0.42"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

	Area (sf)	CN	Description
	1,549	74	>75% Grass cover, Good, HSG C
*	3,090	98	Porous Pavement
	27,280	61	>75% Grass cover, Good, HSG B
	31,919	65	Weighted Average
	28,829		90.32% Pervious Area
	3,090		9.68% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.5	100	0.0640	0.30		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.7	73	0.0640	1.77		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.6	114	0.0100	3.17	7.92	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.00' Z= 0.5 '/' Top.W=3.00' n= 0.033 Earth, grassed & winding
6.8	287	Total			

Summary for Subcatchment 24S: Fairway of 10 & 18

Runoff = 2.48 cfs @ 11.99 hrs, Volume= 0.141 af, Depth= 0.42"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 14

Area (sf)	CN	Description
23,070	74	>75% Grass cover, Good, HSG C
6,012	70	Woods, Good, HSG C
* 8,530	98	Porous Pavement
138,653	61	>75% Grass cover, Good, HSG B
176,265	65	Weighted Average
167,735		95.16% Pervious Area
8,530		4.84% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0	100	0.0800	0.33		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.9	152	0.0054	2.69	13.44	Trap/Vee/Rect Channel Flow, Bot.W=4.00' D=1.00' Z= 1.0 ' /' Top.W=6.00' n= 0.033 Earth, grassed & winding

5.9 252 Total

Summary for Subcatchment 25S: E. end Main Road

Runoff = 0.33 cfs @ 11.91 hrs, Volume= 0.014 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,740	98	Paved
1,011	74	>75% Grass cover, Good, HSG C
3,751	92	Weighted Average
1,011		26.95% Pervious Area
2,740		73.05% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0700	2.54		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.4	127	0.0700	5.37		Shallow Concentrated Flow, Paved Kv= 20.3 fps

1.1 227 Total

Summary for Subcatchment 26S: E. end Main Road

Runoff = 0.32 cfs @ 11.91 hrs, Volume= 0.014 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 15

Area (sf)	CN	Description
* 2,740	98	Paved
905	74	>75% Grass cover, Good, HSG C
3,645	92	Weighted Average
905		24.83% Pervious Area
2,740		75.17% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0700	2.54		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.4	126	0.0700	5.37		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.1	226	Total			

Summary for Subcatchment 27b: E. end Main Road

Runoff = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,930	98	Paved
1,046	74	>75% Grass cover, Good, HSG C
3,976	92	Weighted Average
1,046		26.31% Pervious Area
2,930		73.69% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1250	3.20		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.3	140	0.1250	7.18		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.8	240	Total			

Summary for Subcatchment 28a: E. end Main Road

Runoff = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 3,090	98	Paved
970	74	>75% Grass cover, Good, HSG C
4,060	92	Weighted Average
970		23.89% Pervious Area
3,090		76.11% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1170	3.12		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.4	156	0.1170	6.94		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.9	256	Total			

Summary for Subcatchment 30S: E. end Main Road

Runoff = 0.24 cfs @ 11.90 hrs, Volume= 0.010 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,010	98	Paved
709	74	>75% Grass cover, Good, HSG C
2,719	92	Weighted Average
709		26.08% Pervious Area
2,010		73.92% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1290	3.24		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.1	63	0.1290	7.29		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.6	163	Total			

Summary for Subcatchment 31S: E. end Main Road

Runoff = 0.26 cfs @ 11.90 hrs, Volume= 0.011 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,160	98	Paved
749	74	>75% Grass cover, Good, HSG C
2,909	92	Weighted Average
749		25.75% Pervious Area
2,160		74.25% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 17

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1190	3.14		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.2	77	0.1190	7.00		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.7	177	Total			

Summary for Subcatchment 32S: E. end Main Road

Runoff = 0.32 cfs @ 11.91 hrs, Volume= 0.014 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,640	98	Paved
941	74	>75% Grass cover, Good, HSG C
3,581	92	Weighted Average
941		26.28% Pervious Area
2,640		73.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1270	3.22		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.3	112	0.1270	7.23		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.8	212	Total			

Summary for Subcatchment 33S: E. end Main Road

Runoff = 0.34 cfs @ 11.91 hrs, Volume= 0.014 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,780	98	Paved
956	74	>75% Grass cover, Good, HSG C
3,736	92	Weighted Average
956		25.59% Pervious Area
2,780		74.41% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 18

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1170	3.12		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.3	130	0.1170	6.94		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.8	230	Total			

Summary for Subcatchment 35a: E. end Main Road

Runoff = 0.29 cfs @ 11.90 hrs, Volume= 0.012 af, Depth= 1.89"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,400	98	Paved
908	74	>75% Grass cover, Good, HSG C
3,308	91	Weighted Average
908		27.45% Pervious Area
2,400		72.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1220	3.17		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.2	96	0.1220	7.09		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.7	196	Total			

Summary for Subcatchment 35S: Subcatchment 35

Runoff = 7.26 cfs @ 12.17 hrs, Volume= 0.660 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 6,708	98	Paved Road
393,477	70	Woods, Good, HSG C
122,752	71	Meadow, non-grazed, HSG C
* 9,104	98	Roof
532,041	71	Weighted Average
516,229		97.03% Pervious Area
15,812		2.97% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 19

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.3	100	0.1667	0.50		Sheet Flow, Sheet Flow through Ski Trail Range n= 0.130 P2= 4.00"
3.7	630	0.3170	2.82		Shallow Concentrated Flow, Sheet Flow through Woods Woodland Kv= 5.0 fps
1.3	270	0.2590	3.56		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
1.6	225	0.2220	2.36		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.5	115	0.3478	4.13		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
1.5	230	0.2790	2.64		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.2	50	0.3150	3.93		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
9.3	1,470	0.2799	2.65		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
21.4	3,090	Total			

Summary for Subcatchment 36S: E. end Main Road

Runoff = 0.29 cfs @ 11.90 hrs, Volume= 0.012 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,400	98	Paved
804	74	>75% Grass cover, Good, HSG C
3,204	92	Weighted Average
804		25.09% Pervious Area
2,400		74.91% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1210	3.16		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.2	98	0.1210	7.06		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.7	198	Total			

Summary for Subcatchment 37S: E. end Main Road

Runoff = 0.38 cfs @ 11.91 hrs, Volume= 0.016 af, Depth= 1.89"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 20

Area (sf)	CN	Description
* 3,200	98	Paved
1,247	74	>75% Grass cover, Good, HSG C
4,447	91	Weighted Average
1,247		28.04% Pervious Area
3,200		71.96% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0620	2.42		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.5	143	0.0620	5.05		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.2	243	Total			

Summary for Subcatchment 38S: E. end Main Road

Runoff = 0.32 cfs @ 11.91 hrs, Volume= 0.013 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 2,730	98	Paved
839	74	>75% Grass cover, Good, HSG C
3,569	92	Weighted Average
839		23.51% Pervious Area
2,730		76.49% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0720	2.57		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.3	107	0.0720	5.45		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.9	207	Total			

Summary for Subcatchment 41S: W. end of Main Road

Runoff = 0.77 cfs @ 11.91 hrs, Volume= 0.038 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 7,632	98	Paved
7,632		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0467	2.16		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.9	190	0.0320	3.63		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.7	290	Total			

Summary for Subcatchment 42S: W. end of Main Road

Runoff = 0.71 cfs @ 11.91 hrs, Volume= 0.034 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 7,012	98	Paved
7,012		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0467	2.16		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.9	183	0.0300	3.52		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.7	283	Total			

Summary for Subcatchment 43S: W. end of Main Road

Runoff = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af, Depth= 2.06"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 3,000	98	Paved
858	74	>75% Grass cover, Good, HSG C
3,858	93	Weighted Average
858		22.24% Pervious Area
3,000		77.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1200	3.15		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.4	144	0.1110	6.76		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.9	244	Total			

Summary for Subcatchment 44S: W. end of Main Road

Runoff = 0.35 cfs @ 11.90 hrs, Volume= 0.015 af, Depth= 2.16"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 3,000	98	Paved
652	74	>75% Grass cover, Good, HSG C
3,652	94	Weighted Average
652		17.85% Pervious Area
3,000		82.15% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1200	3.15		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.3	139	0.1150	6.88		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.8	239	Total			

Summary for Subcatchment 45S: Hole 1

Runoff = 7.17 cfs @ 12.02 hrs, Volume= 0.426 af, Depth= 0.53"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
29,365	70	Woods, Good, HSG C
168,858	74	>75% Grass cover, Good, HSG C
* 16,666	98	Porous Pavement
208,438	61	>75% Grass cover, Good, HSG B
423,327	68	Weighted Average
406,661		96.06% Pervious Area
16,666		3.94% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.1	100	0.0500	0.27		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.2	208	0.1830	2.99		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.4	888	0.0690	10.54	55.33	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
8.7	1,196	Total			

Summary for Subcatchment 50S: W. end of Main Rd.

Runoff = 0.41 cfs @ 11.91 hrs, Volume= 0.019 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 3,930	98	Paved
3,930		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.1140	3.09		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.5	193	0.1140	6.85		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.0	293	Total			

Summary for Subcatchment 51S: W. end of Main Rd.

Runoff = 0.63 cfs @ 11.96 hrs, Volume= 0.028 af, Depth= 0.83"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 3,600	98	Paved
8,603	74	>75% Grass cover, Good, HSG C
5,464	61	>75% Grass cover, Good, HSG B
17,667	75	Weighted Average
14,067		79.62% Pervious Area
3,600		20.38% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.6	86	0.1400	0.40		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.1	14	0.1140	2.08		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.6	261	0.1150	6.88		Shallow Concentrated Flow, Paved Kv= 20.3 fps
4.3	361	Total			

Summary for Subcatchment 52S: W. end of Main Rd.

Runoff = 0.41 cfs @ 11.93 hrs, Volume= 0.017 af, Depth= 0.93"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
7,193	74	>75% Grass cover, Good, HSG C
* 1,536	98	Paved
* 816	68	Porous Pavement
9,545	77	Weighted Average
8,009		83.91% Pervious Area
1,536		16.09% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	40	0.4000	0.52		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.5	60	0.0500	2.00		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.6	220	0.0820	5.81		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.4	320	Total			

Summary for Subcatchment 53S: W. end of Main Rd.

Runoff = 0.66 cfs @ 11.95 hrs, Volume= 0.029 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
6,647	74	>75% Grass cover, Good, HSG C
* 3,490	98	Paved
* 4,753	68	Porous Pavement
4,360	61	>75% Grass cover, Good, HSG B
19,250	74	Weighted Average
15,760		81.87% Pervious Area
3,490		18.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.5	40	0.0750	0.27		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.4	60	0.0670	2.25		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.8	236	0.0660	5.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
3.7	336	Total			

Summary for Subcatchment 54S: Golf Course Parking

Runoff = 4.19 cfs @ 12.00 hrs, Volume= 0.213 af, Depth= 1.16"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

	Area (sf)	CN	Description
*	17,600	98	Paved
	67,503	74	>75% Grass cover, Good, HSG C
*	10,730	98	Porous Pavement
	95,833	81	Weighted Average
	67,503		70.44% Pervious Area
	28,330		29.56% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	27	0.0760	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.3	33	0.0450	1.70		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
2.7	40	0.0625	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
2.7	434	0.1470	2.68		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.7	188	0.0430	4.21		Shallow Concentrated Flow, Paved Kv= 20.3 fps
8.2	722	Total			

Summary for Subcatchment 55S: Golf Course Parking

Runoff = 1.38 cfs @ 11.91 hrs, Volume= 0.060 af, Depth= 2.06"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

	Area (sf)	CN	Description
	3,030	74	>75% Grass cover, Good, HSG C
*	11,425	98	Paved
*	815	98	Porous Pavement
	15,270	93	Weighted Average
	3,030		19.84% Pervious Area
	12,240		80.16% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 26

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	100	0.0330	1.88		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.7	159	0.0390	4.01		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.6	259	Total			

Summary for Subcatchment 56S: Main Rd. to 6 & 7

Runoff = 0.93 cfs @ 11.92 hrs, Volume= 0.038 af, Depth= 1.10"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
13,240	74	>75% Grass cover, Good, HSG C
* 3,160	98	Paved
* 1,620	98	Porous Pavement
18,020	80	Weighted Average
13,240		73.47% Pervious Area
4,780		26.53% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	100	0.0170	1.44		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.5	145	0.0480	4.45		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.7	245	Total			

Summary for Subcatchment 57S: Main Rd. 6 & 7

Runoff = 0.45 cfs @ 11.92 hrs, Volume= 0.020 af, Depth= 2.16"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 4,049	98	Paved
831	74	>75% Grass cover, Good, HSG C
4,880	94	Weighted Average
831		17.03% Pervious Area
4,049		82.97% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 27

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	100	0.0160	1.41		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.7	137	0.0292	3.47		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.9	237	Total			

Summary for Subcatchment 59S: Club House

Runoff = 0.67 cfs @ 11.96 hrs, Volume= 0.035 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 7,222	98	Roof
7,222		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 60S: Roof Terraces

Runoff = 3.53 cfs @ 11.96 hrs, Volume= 0.170 af, Depth= 2.06"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 36,970	98	Roof
5,980	61	>75% Grass cover, Good, HSG B
42,950	93	Weighted Average
5,980		13.92% Pervious Area
36,970		86.08% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 62S: Green of 18

Runoff = 0.62 cfs @ 12.03 hrs, Volume= 0.043 af, Depth= 0.35"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 28

Area (sf)	CN	Description
2,744	74	>75% Grass cover, Good, HSG C
* 2,600	98	Porous Pavement
59,100	61	>75% Grass cover, Good, HSG B
64,444	63	Weighted Average
61,844		95.97% Pervious Area
2,600		4.03% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.0350	0.24		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.6	78	0.1030	2.25		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.5	255	0.0512	9.08	47.66	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
8.1	433	Total			

Summary for Subcatchment 63S: Front end of Driving Range

Runoff = 3.34 cfs @ 12.09 hrs, Volume= 0.249 af, Depth= 0.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
75,560	74	>75% Grass cover, Good, HSG C
16,416	70	Woods, Good, HSG C
15,620	98	Water Surface, 0% imp, HSG C
121,724	61	>75% Grass cover, Good, HSG B
642	98	Paved parking, HSG C
319	98	Roofs, HSG C
230,281	69	Weighted Average
229,320		99.58% Pervious Area
961		0.42% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.0	100	0.0250	0.21		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
5.7	496	0.0430	1.45		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.7	297	0.0330	7.29	38.26	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
14.4	893	Total			

Summary for Subcatchment 65S: Driveway to Golf House

Runoff = 1.40 cfs @ 11.92 hrs, Volume= 0.059 af, Depth= 1.80"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
5,721	74	>75% Grass cover, Good, HSG C
* 8,740	98	Paved
* 2,800	98	Porous Pavement
17,261	90	Weighted Average
5,721		33.14% Pervious Area
11,540		66.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	100	0.0350	1.92		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.7	199	0.0830	4.64		Shallow Concentrated Flow, Unpaved Kv= 16.1 fps
1.6	299	Total			

Summary for Subcatchment 80S: existing woods

Runoff = 3.20 cfs @ 11.97 hrs, Volume= 0.153 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
62,404	74	>75% Grass cover, Good, HSG C
46,340	70	Woods, Good, HSG C
* 3,190	68	Porous Pavement
11,666	61	>75% Grass cover, Good, HSG B
123,600	71	Weighted Average
123,600		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.8	100	0.1600	0.44		Sheet Flow, sheet Grass: Short n= 0.150 P2= 4.00"
0.3	90	0.1300	5.41		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
1.1	410	0.0350	6.38	76.58	Channel Flow, Area= 12.0 sf Perim= 21.0' r= 0.57' n= 0.030 Earth, grassed & winding
5.2	600	Total			

Summary for Subcatchment 137S: BEHIND GARAGE

Runoff = 0.73 cfs @ 12.01 hrs, Volume= 0.039 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
10,210	74	>75% Grass cover, Good, HSG C
21,275	70	Woods, Good, HSG C
31,485	71	Weighted Average
31,485		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	97	0.2500	0.24		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
1.0	280	0.0180	4.68	11.69	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.00' Z= 0.5 '/ Top.W=3.00' n= 0.030 Earth, grassed & winding
7.8	377	Total			

Summary for Subcatchment 200S: Subcatchment 200

Runoff = 38.77 cfs @ 12.20 hrs, Volume= 3.859 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
311,323	71	Meadow, non-grazed, HSG C
* 14,331	98	Paved Road
3,002,765	70	Woods, Good, HSG C
3,328,419	70	Weighted Average
3,314,088		99.57% Pervious Area
14,331		0.43% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 31

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.3	100	0.1667	0.50		Sheet Flow, Sheet Flow through Ski Trail Range n= 0.130 P2= 4.00"
3.7	630	0.3170	2.82		Shallow Concentrated Flow, Sheet Flow through Woods Woodland Kv= 5.0 fps
1.3	270	0.2590	3.56		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
1.6	225	0.2220	2.36		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.5	115	0.3478	4.13		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
1.4	215	0.2790	2.64		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	70	0.3150	3.93		Shallow Concentrated Flow, SC Flow through Ski Trail Short Grass Pasture Kv= 7.0 fps
11.1	1,760	0.2799	2.65		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	160	0.0500	8.99	35.95	Trap/Vee/Rect Channel Flow, Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
23.5	3,545	Total			

Summary for Subcatchment 201S: Tees of 18 & Greens of 10

Runoff = 4.03 cfs @ 11.97 hrs, Volume= 0.193 af, Depth= 0.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
64,007	74	>75% Grass cover, Good, HSG C
* 12,310	98	Porous Pavement
86,820	61	>75% Grass cover, Good, HSG B
15,640	70	Woods, Good, HSG C
178,777	69	Weighted Average
166,467		93.11% Pervious Area
12,310		6.89% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.8	100	0.1658	0.44		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.5	93	0.1658	2.85		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.3	232	0.0948	13.87	114.45	Trap/Vee/Rect Channel Flow, Bot.W=4.00' D=1.50' Z= 1.0 '/' Top.W=7.00' n= 0.033 Earth, grassed & winding
4.6	425	Total			

Summary for Subcatchment 211S: Back End of the Driving Range

Runoff = 3.31 cfs @ 11.99 hrs, Volume= 0.181 af, Depth= 0.45"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
61,458	74	>75% Grass cover, Good, HSG C
* 5,760	98	Porous Pavement
141,430	61	>75% Grass cover, Good, HSG B
208,648	66	Weighted Average
202,888		97.24% Pervious Area
5,760		2.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.6	100	0.1000	0.36		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.3	40	0.1000	2.21		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.9	765	0.1390	14.96	78.53	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
5.8	905	Total			

Summary for Subcatchment 212S: Green of 13

Runoff = 0.89 cfs @ 11.98 hrs, Volume= 0.050 af, Depth= 0.38"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
9,320	74	>75% Grass cover, Good, HSG C
* 1,810	98	Porous Pavement
57,180	61	>75% Grass cover, Good, HSG B
68,310	64	Weighted Average
66,500		97.35% Pervious Area
1,810		2.65% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.6	100	0.1000	0.36		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.3	119	0.0336	7.35	38.61	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
4.9	219	Total			

Summary for Subcatchment 213S: Hole 16

Runoff = 2.87 cfs @ 12.06 hrs, Volume= 0.196 af, Depth= 0.53"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
45,442	74	>75% Grass cover, Good, HSG C
* 8,230	98	Porous Pavement
127,890	61	>75% Grass cover, Good, HSG B
13,418	98	Water Surface, 0% imp, HSG C
194,980	68	Weighted Average
186,750		95.78% Pervious Area
8,230		4.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.8	100	0.0118	0.15		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.9	590	0.0576	10.81	89.21	Trap/Vee/Rect Channel Flow, Turf Reinforcement Mat Bot.W=4.00' D=1.50' Z= 1.0 '/' Top.W=7.00' n= 0.033 Earth, grassed & winding
11.7	690	Total			

Summary for Subcatchment 214S: Tees of 13

Runoff = 2.43 cfs @ 12.00 hrs, Volume= 0.137 af, Depth= 0.45"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
36,885	74	>75% Grass cover, Good, HSG C
* 9,000	98	Porous Pavement
112,185	61	>75% Grass cover, Good, HSG B
158,070	66	Weighted Average
149,070		94.31% Pervious Area
9,000		5.69% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 34

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.7	527	0.0700	11.92	98.35	Trap/Vee/Rect Channel Flow, TRM Swale Bot.W=4.00' D=1.50' Z= 1.0 '/' Top.W=7.00' n= 0.033 Earth, grassed & winding
0.0	20	0.0200	13.34	94.33	Pipe Channel, 36.0" Round Area= 7.1 sf Perim= 9.4' r= 0.75' n= 0.013 Corrugated PE, smooth interior
0.1	110	0.1500	17.45	143.97	Trap/Vee/Rect Channel Flow, TRM Swale Bot.W=4.00' D=1.50' Z= 1.0 '/' Top.W=7.00' n= 0.033 Earth, grassed & winding
6.4	757	Total			

Summary for Subcatchment 218S: Green of 12, Tee of 13

Runoff = 1.78 cfs @ 12.00 hrs, Volume= 0.097 af, Depth= 0.53"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
40,598	74	>75% Grass cover, Good, HSG C
* 4,120	98	Porous Pavement
51,700	61	>75% Grass cover, Good, HSG B
96,418	68	Weighted Average
92,298		95.73% Pervious Area
4,120		4.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0	100	0.0800	0.33		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.7	200	0.0800	1.98		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.2	167	0.1205	17.20	141.94	Trap/Vee/Rect Channel Flow, TRM Swale Bot.W=4.00' D=1.50' Z= 1.0 '/' Top.W=7.00' n= 0.030 Earth, grassed & winding
6.9	467	Total			

Summary for Subcatchment 219S: Green of 11

Runoff = 2.14 cfs @ 11.94 hrs, Volume= 0.092 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 35

Area (sf)	CN	Description
37,165	74	>75% Grass cover, Good, HSG C
* 6,050	98	Porous Pavement
35,770	61	>75% Grass cover, Good, HSG B
78,985	70	Weighted Average
72,935		92.34% Pervious Area
6,050		7.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	100	0.0130	1.29		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.4	108	0.0600	4.97		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.3	198	0.0550	10.57	87.18	Trap/Vee/Rect Channel Flow, Bot.W=4.00' D=1.50' Z= 1.0 '/' Top.W=7.00' n= 0.033 Earth, grassed & winding
2.0	406	Total			

Summary for Subcatchment 220S: Fairway of 11

Runoff = 4.49 cfs @ 12.06 hrs, Volume= 0.305 af, Depth= 0.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
76,630	74	>75% Grass cover, Good, HSG C
34,383	70	Woods, Good, HSG C
* 16,925	98	porous paving
146,470	61	>75% Grass cover, Good, HSG B
7,780	98	Water Surface, HSG C
282,188	69	Weighted Average
257,483		91.25% Pervious Area
24,705		8.75% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	100	0.1200	0.39		Sheet Flow, sheet flow Grass: Short n= 0.150 P2= 4.00"
7.7	627	0.0730	1.35		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
0.2	142	0.1270	15.73	82.57	Trap/Vee/Rect Channel Flow, TRM Swale Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.030 Earth, grassed & winding
12.2	869	Total			

Summary for Subcatchment 223S: Golf Hole 15 and Maintenance Bldg.

Runoff = 6.06 cfs @ 11.96 hrs, Volume= 0.272 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
16,393	70	Woods, Good, HSG C
84,076	74	>75% Grass cover, Good, HSG C
* 7,663	98	Roof
62,572	61	>75% Grass cover, Good, HSG B
* 5,950	98	Porous Pavement
16,303	98	Paved parking, HSG C
192,957	73	Weighted Average
163,041		84.50% Pervious Area
29,916		15.50% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.2	30	0.1000	2.30		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
2.2	70	0.3000	0.52		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.5	233	0.1460	2.67		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.2	68	0.0200	5.67	29.79	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/ Top.W=5.00' n= 0.033 Earth, grassed & winding
4.1	401	Total			

Summary for Subcatchment 225S: Fairway 14

Runoff = 3.05 cfs @ 11.98 hrs, Volume= 0.162 af, Depth= 0.45"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
55,496	74	>75% Grass cover, Good, HSG C
* 7,480	98	Porous Pavement
124,042	61	>75% Grass cover, Good, HSG B
187,018	66	Weighted Average
179,538		96.00% Pervious Area
7,480		4.00% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 37

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.6	100	0.1800	0.46		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.1	147	0.0950	2.16		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.5	284	0.0560	9.49	49.84	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
5.2	531	Total			

Summary for Subcatchment 226S: Fairway & Green of 14

Runoff = 1.91 cfs @ 11.99 hrs, Volume= 0.102 af, Depth= 0.49"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
28,724	74	>75% Grass cover, Good, HSG C
* 7,290	98	Porous Pavement
72,670	61	>75% Grass cover, Good, HSG B
108,684	67	Weighted Average
101,394		93.29% Pervious Area
7,290		6.71% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.9	100	0.3100	0.57		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.8	225	0.0840	2.03		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.6	100	0.0200	2.87		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.5	43	0.0470	1.52		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
5.8	468	Total			

Summary for Subcatchment 300S: Subcatchment 300

Runoff = 8.97 cfs @ 12.17 hrs, Volume= 0.826 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 38

Area (sf)	CN	Description
* 3,267	98	Paved Road
6,447	71	Meadow, non-grazed, HSG C
702,884	70	Woods, Good, HSG C
712,598	70	Weighted Average
709,331		99.54% Pervious Area
3,267		0.46% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.1	120	0.2500	0.25		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
12.7	1,810	0.2257	2.38		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.2	110	0.0910	12.13	48.50	Trap/Vee/Rect Channel Flow, Vegetated Swale Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030
21.0	2,040	Total			

Summary for Subcatchment 301S: Ex Stream

Runoff = 3.10 cfs @ 11.97 hrs, Volume= 0.147 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
65,722	70	Woods, Good, HSG C
43,672	74	>75% Grass cover, Good, HSG C
* 1,350	68	Porous Pavement
110,744	72	Weighted Average
110,744		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.4	100	0.2100	0.49		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.4	51	0.0988	2.20		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.0	118	0.1610	2.01		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
0.4	228	0.1140	10.19	50.95	Trap/Vee/Rect Channel Flow, Ex Stream Bot.W=4.00' D=1.00' Z= 1.0 '/' Top.W=6.00' n= 0.040 Mountain streams
5.2	497	Total			

Summary for Subcatchment 302a: New Subcatch

Runoff = 5.83 cfs @ 12.11 hrs, Volume= 0.441 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
202,172	74	Pasture/grassland/range, Good, HSG C
110,552	70	Woods, Good, HSG C
312,724	73	Weighted Average
312,724		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.9	92	0.1530	0.11		Sheet Flow, Woods: Dense underbrush n= 0.800 P2= 4.00"
1.4	130	0.0500	1.57		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.8	1,608	0.1100	14.64	76.84	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.030 Earth, grassed & winding
17.1	1,830	Total			

Summary for Subcatchment 302S: (new Subcat)

Runoff = 4.85 cfs @ 11.98 hrs, Volume= 0.239 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
46,647	71	Meadow, non-grazed, HSG C
158,360	70	Woods, Good, HSG C
* 1,180	98	Paved (porous)
206,187	70	Weighted Average
205,007		99.43% Pervious Area
1,180		0.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.8	100	0.1600	0.44		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.2	43	0.1860	3.02		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	871	0.0600	9.83	51.59	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
5.5	1,014	Total			

Summary for Subcatchment 303S: Subcatchment 303

Runoff = 3.02 cfs @ 11.99 hrs, Volume= 0.149 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 9,520	98	Porous Pavement
72,299	74	>75% Grass cover, Good, HSG C
23,715	61	>75% Grass cover, Good, HSG B
105,534	73	Weighted Average
96,014		90.98% Pervious Area
9,520		9.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	670	0.0850	12.87	67.55	Trap/Vee/Rect Channel Flow, TRM Swale Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.030 Earth, grassed & winding
4.9	358	0.0170	1.22	21.30	Trap/Vee/Rect Channel Flow, ex wetland flow Bot.W=10.00' D=0.50' Z= 50.0 '/' Top.W=60.00' n= 0.070 Sluggish weedy reaches w/pools
0.6	316	0.0450	9.45	132.34	Trap/Vee/Rect Channel Flow, ex wetland ditch Bot.W=5.00' D=2.00' Z= 1.0 '/' Top.W=9.00' n= 0.040 Earth, cobble bottom, clean sides
6.4	1,344	Total			

Summary for Subcatchment 304: (new Subcat)

Runoff = 6.49 cfs @ 11.97 hrs, Volume= 0.307 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 1,900	98	Porous Pavement
136,810	70	Woods, Good, HSG C
93,272	74	>75% Grass cover, Good, HSG C
231,982	72	Weighted Average
230,082		99.18% Pervious Area
1,900		0.82% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 41

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.7	52	0.3300	0.51		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.9	527	0.0500	9.57	57.44	Trap/Vee/Rect Channel Flow, swale Bot.W=2.00' D=2.00' Z= 0.5 '/' Top.W=4.00' n= 0.033 Earth, grassed & winding
1.7	280	0.0750	2.69	39.72	Trap/Vee/Rect Channel Flow, overland, wetland Bot.W=40.00' D=0.34' Z= 10.0 '/' Top.W=46.80' n= 0.070 Sluggish weedy reaches w/pools
0.9	190	0.2500	3.41	258.90	Trap/Vee/Rect Channel Flow, overland Bot.W=50.00' D=0.83' Z= 50.0 '/' Top.W=133.00' n= 0.150 Sheet flow over Short Grass
5.2	1,049	Total			

Summary for Subcatchment 305s: Land W. side of hotel

Runoff = 4.89 cfs @ 12.00 hrs, Volume= 0.254 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
145,260	74	>75% Grass cover, Good, HSG C
* 7,690	98	Porous Pavement
16,700	61	>75% Grass cover, Good, HSG B
169,650	74	Weighted Average
161,960		95.47% Pervious Area
7,690		4.53% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.0	100	0.3000	0.56		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
4.0	650	0.1500	2.71		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.9	215	0.0100	4.01	21.06	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
7.9	965	Total			

Summary for Subcatchment 306S: 12 tee

Runoff = 5.64 cfs @ 12.00 hrs, Volume= 0.292 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 42

Area (sf)	CN	Description
75,600	70	Woods, Good, HSG C
* 2,810	98	Porous Pavement
128,794	74	>75% Grass cover, Good, HSG C
207,204	73	Weighted Average
204,394		98.64% Pervious Area
2,810		1.36% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.3	100	0.0700	0.31		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.9	182	0.2200	3.28		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.0	550	0.0650	9.20	27.59	Trap/Vee/Rect Channel Flow, TRM Swale Bot.W=2.00' D=1.00' Z= 1.0 '/' Top.W=4.00' n= 0.030 Earth, grassed & winding
0.4	240	0.1600	11.19	72.20	Trap/Vee/Rect Channel Flow, Ex Wetlnd channel Bot.W=4.00' D=1.50' Z= 0.2 '/' Top.W=4.60' n= 0.050 Mountain streams w/large boulders
7.6	1,072	Total			

Summary for Subcatchment 307S: (new Subcat)

Runoff = 3.06 cfs @ 12.00 hrs, Volume= 0.162 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
13,050	61	>75% Grass cover, Good, HSG B
* 10,840	98	Paved (Porous)
24,084	74	>75% Grass cover, Good, HSG C
74,350	70	Woods, Good, HSG C
122,324	72	Weighted Average
111,484		91.14% Pervious Area
10,840		8.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.5	66	0.2000	0.20		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
1.1	130	0.0760	1.93		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.3	72	0.0350	4.77	14.31	Trap/Vee/Rect Channel Flow, Grassed Swale Bot.W=4.00' D=0.50' Z= 4.0 '/' Top.W=8.00' n= 0.030 Earth, grassed & winding
0.9	830	0.1100	14.87	111.53	Trap/Vee/Rect Channel Flow, TRM Swale Bot.W=2.00' D=1.50' Z= 2.0 '/' Top.W=8.00' n= 0.030 Earth, grassed & winding
7.8	1,098	Total			

Summary for Subcatchment 308S: (new Subcat)

Runoff = 6.49 cfs @ 12.04 hrs, Volume= 0.401 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
36,866	74	>75% Grass cover, Good, HSG C
309,380	70	Woods, Good, HSG C
346,246	70	Weighted Average
346,246		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.4	65	0.0920	0.32		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
3.4	35	0.1860	0.17		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
3.8	634	0.3120	2.79		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
10.6	734	Total			

Summary for Subcatchment 309S: (new Subcat)

Runoff = 6.81 cfs @ 12.07 hrs, Volume= 0.447 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
180,807	70	Woods, Good, HSG C
103,518	74	>75% Grass cover, Good, HSG C
* 13,610	98	Paved
* 7,390	98	Porous Pavement
11,400	61	>75% Grass cover, Good, HSG B
316,725	73	Weighted Average
295,725		93.37% Pervious Area
21,000		6.63% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.9	72	0.0278	0.20		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
4.2	28	0.0714	0.11		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
3.2	549	0.3320	2.88		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
13.3	649	Total			

Summary for Subcatchment 310S: Existing Wooded Area

Runoff = 4.59 cfs @ 11.96 hrs, Volume= 0.208 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
107,476	70	Woods, Good, HSG C
* 7,355	98	Paved
39,560	74	>75% Grass cover, Good, HSG C
* 2,820	68	Porous Pavement
157,211	72	Weighted Average
149,856		95.32% Pervious Area
7,355		4.68% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.4	40	0.2500	0.20		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
0.7	434	0.1240	10.89	32.66	Trap/Vee/Rect Channel Flow, ex. vegetated ditch Bot.W=2.00' D=1.00' Z= 1.0 '/ Top.W=4.00' n= 0.035 Earth, dense weeds
4.1	474	Total			

Summary for Subcatchment 311S: Existing Wooded Area

Runoff = 5.73 cfs @ 12.09 hrs, Volume= 0.411 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
103,137	74	>75% Grass cover, Good, HSG C
* 2,085	98	Paved
224,527	70	Woods, Good, HSG C
* 2,000	68	Porous Pavement
331,749	71	Weighted Average
329,664		99.37% Pervious Area
2,085		0.63% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 45

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.1	100	0.0500	0.27		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.1	12	0.1200	2.42		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
6.8	737	0.1300	1.80		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
1.7	930	0.1180	9.10	47.75	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.050 Earth, cobble bottom, clean sides
14.7	1,779	Total			

Summary for Subcatchment 315S: (new Subcat)

Runoff = 7.52 cfs @ 12.04 hrs, Volume= 0.451 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
315,930	70	Woods, Good, HSG C
47,510	74	>75% Grass cover, Good, HSG C
363,440	71	Weighted Average
363,440		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	100	0.2200	0.23		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
2.9	482	0.3150	2.81		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
10.3	582	Total			

Summary for Subcatchment 316A: Existing By Maintenance Bldg.

Runoff = 0.72 cfs @ 11.99 hrs, Volume= 0.035 af, Depth= 0.74"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
17,043	70	Woods, Good, HSG C
* 2,900	98	Paved parking
5,182	71	Meadow, non-grazed, HSG C
25,125	73	Weighted Average
22,225		88.46% Pervious Area
2,900		11.54% Impervious Area

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 46

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.8	100	0.4000	0.29		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
0.4	270	0.0800	11.83	29.57	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.00' Z= 0.5 '/' Top.W=3.00' n= 0.025 Earth, clean & winding
6.2	370	Total			

Summary for Subcatchment 316S: existing

Runoff = 9.59 cfs @ 12.00 hrs, Volume= 0.514 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1 Year Rainfall=2.80"

Area (sf)	CN	Description
* 5,340	98	Paved
380,785	70	Woods, Good, HSG C
33,106	74	>75% Grass cover, Good, HSG C
* 5,210	68	Porous Pavement
18,632	61	>75% Grass cover, Good, HSG B
443,073	70	Weighted Average
437,733		98.79% Pervious Area
5,340		1.21% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	77	0.3120	0.25		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
2.2	867	0.0280	6.71	35.25	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
7.4	944	Total			

**Reach and Culvert Summaries
1 & 10-yr Storm Events**

Summary for Reach 1R: overland flow

Inflow Area = 16.946 ac, 22.50% Impervious, Inflow Depth = 1.00" for 1 Year event
Inflow = 19.48 cfs @ 11.93 hrs, Volume= 1.407 af
Outflow = 19.44 cfs @ 11.94 hrs, Volume= 1.407 af, Atten= 0%, Lag= 0.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.05 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 1.95 fps, Avg. Travel Time= 0.6 min

Peak Storage= 182 cf @ 11.93 hrs
Average Depth at Peak Storage= 0.72'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 103.60 cfs

3.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 0.5 '/' Top Width= 5.00'
Length= 75.0' Slope= 0.1733 '/'
Inlet Invert= 1,963.00', Outlet Invert= 1,950.00'



Summary for Reach 3: Rip Rap Channel

Inflow Area = 130.257 ac, 1.76% Impervious, Inflow Depth = 0.62" for 1 Year event
Inflow = 50.83 cfs @ 12.39 hrs, Volume= 6.765 af
Outflow = 50.80 cfs @ 12.39 hrs, Volume= 6.765 af, Atten= 0%, Lag= 0.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 14.31 fps, Min. Travel Time= 0.1 min
Avg. Velocity = 2.77 fps, Avg. Travel Time= 0.3 min

Peak Storage= 181 cf @ 12.39 hrs
Average Depth at Peak Storage= 0.69'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 257.29 cfs

5.00' x 2.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 0.2 '/' Top Width= 5.80'
Length= 51.0' Slope= 0.5098 '/'
Inlet Invert= 1,740.00', Outlet Invert= 1,714.00'




Summary for Reach 3R: Swale along RR Tracks

Inflow Area = 8.723 ac, 9.84% Impervious, Inflow Depth = 0.60" for 1 Year event
Inflow = 0.22 cfs @ 24.05 hrs, Volume= 0.434 af
Outflow = 0.22 cfs @ 24.43 hrs, Volume= 0.434 af, Atten= 0%, Lag= 22.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.98 fps, Min. Travel Time= 17.7 min
Avg. Velocity = 0.78 fps, Avg. Travel Time= 22.2 min

Peak Storage= 231 cf @ 24.13 hrs
Average Depth at Peak Storage= 0.10'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 103.07 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 12.00'
Length= 1,045.0' Slope= 0.0172 '/'
Inlet Invert= 1,750.00', Outlet Invert= 1,732.00'

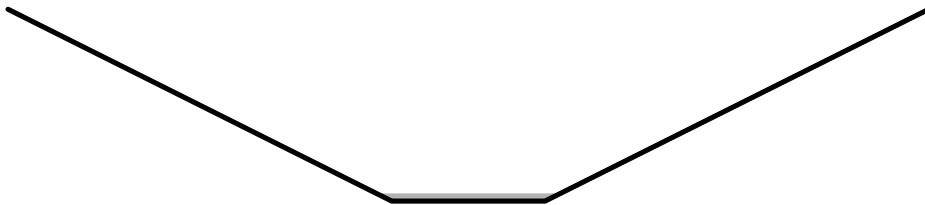

Summary for Reach 5: Stream Channel

Inflow Area = 33.644 ac, 4.16% Impervious, Inflow Depth = 0.66" for 1 Year event
Inflow = 10.59 cfs @ 12.52 hrs, Volume= 1.843 af
Outflow = 10.56 cfs @ 12.53 hrs, Volume= 1.843 af, Atten= 0%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.95 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 2.61 fps, Avg. Travel Time= 1.0 min

Peak Storage= 244 cf @ 12.52 hrs
Average Depth at Peak Storage= 0.33'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 1,318.86 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 160.0' Slope= 0.3000 '/'
Inlet Invert= 2,060.00', Outlet Invert= 2,012.00'



Summary for Reach 5A: Stream Channel

Inflow Area = 41.552 ac, 5.67% Impervious, Inflow Depth = 0.67" for 1 Year event
Inflow = 10.67 cfs @ 12.53 hrs, Volume= 2.326 af
Outflow = 10.63 cfs @ 12.55 hrs, Volume= 2.326 af, Atten= 0%, Lag= 1.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.32 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 1.84 fps, Avg. Travel Time= 3.1 min

Peak Storage= 574 cf @ 12.54 hrs
Average Depth at Peak Storage= 0.36'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 1,138.43 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 340.0' Slope= 0.2235 '/'
Inlet Invert= 2,012.00', Outlet Invert= 1,936.00'



Summary for Reach 5B: Stream Channel

Inflow Area = 46.285 ac, 5.15% Impervious, Inflow Depth = 0.66" for 1 Year event
Inflow = 11.12 cfs @ 12.55 hrs, Volume= 2.565 af
Outflow = 11.08 cfs @ 12.56 hrs, Volume= 2.565 af, Atten= 0%, Lag= 0.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Max. Velocity= 5.80 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 1.63 fps, Avg. Travel Time= 1.2 min

Peak Storage= 229 cf @ 12.56 hrs
Average Depth at Peak Storage= 0.40'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 983.02 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 120.0' Slope= 0.1667 '/'
Inlet Invert= 1,936.00', Outlet Invert= 1,916.00'



Summary for Reach 5C: Stream Channel

Inflow Area = 67.707 ac, 9.43% Impervious, Inflow Depth > 0.74" for 1 Year event
Inflow = 11.42 cfs @ 12.56 hrs, Volume= 4.165 af
Outflow = 11.38 cfs @ 12.59 hrs, Volume= 4.165 af, Atten= 0%, Lag= 1.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.68 fps, Min. Travel Time= 0.8 min
Avg. Velocity = 1.76 fps, Avg. Travel Time= 2.6 min

Peak Storage= 557 cf @ 12.57 hrs
Average Depth at Peak Storage= 0.42'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 937.61 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 277.0' Slope= 0.1516 '/'
Inlet Invert= 1,916.00', Outlet Invert= 1,874.00'



Summary for Reach 5D: Stream Channel

Inflow Area = 75.446 ac, 8.80% Impervious, Inflow Depth > 0.72" for 1 Year event
Inflow = 11.78 cfs @ 12.58 hrs, Volume= 4.499 af
Outflow = 11.75 cfs @ 12.60 hrs, Volume= 4.499 af, Atten= 0%, Lag= 1.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.27 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 2.53 fps, Avg. Travel Time= 2.0 min

Peak Storage= 427 cf @ 12.59 hrs
Average Depth at Peak Storage= 0.48'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 357.03 cfs

2.00' x 2.50' deep channel, n= 0.040
Side Slope Z-value= 2.0 '/' Top Width= 12.00'
Length= 300.0' Slope= 0.2067 '/'
Inlet Invert= 1,874.00', Outlet Invert= 1,812.00'



Summary for Reach 5R: roadside swale

Inflow Area = 4.919 ac, 18.04% Impervious, Inflow Depth = 0.65" for 1 Year event
Inflow = 0.23 cfs @ 14.81 hrs, Volume= 0.267 af
Outflow = 0.23 cfs @ 15.01 hrs, Volume= 0.267 af, Atten= 0%, Lag= 12.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.33 fps, Min. Travel Time= 7.6 min
Avg. Velocity = 1.00 fps, Avg. Travel Time= 10.1 min

Peak Storage= 103 cf @ 14.88 hrs
Average Depth at Peak Storage= 0.08'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 61.25 cfs

2.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/ Top Width= 6.00'
Length= 607.0' Slope= 0.0626 '/
Inlet Invert= 2,122.00', Outlet Invert= 2,084.00'



Summary for Reach 6: SWALE

Inflow Area = 21.422 ac, 18.68% Impervious, Inflow Depth > 0.90" for 1 Year event
Inflow = 0.83 cfs @ 15.93 hrs, Volume= 1.601 af
Outflow = 0.83 cfs @ 16.03 hrs, Volume= 1.601 af, Atten= 0%, Lag= 6.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.37 fps, Min. Travel Time= 3.6 min
Avg. Velocity = 0.75 fps, Avg. Travel Time= 6.6 min

Peak Storage= 182 cf @ 15.97 hrs
Average Depth at Peak Storage= 0.15'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 108.04 cfs

4.00' x 2.50' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/ Top Width= 9.00'
Length= 300.0' Slope= 0.0300 '/
Inlet Invert= 1,939.00', Outlet Invert= 1,930.00'



Summary for Reach 6R: Clean Swale

Inflow Area = 22.295 ac, 15.82% Impervious, Inflow Depth > 0.80" for 1 Year event
Inflow = 4.81 cfs @ 12.29 hrs, Volume= 1.494 af
Outflow = 4.76 cfs @ 12.32 hrs, Volume= 1.494 af, Atten= 1%, Lag= 1.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.68 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 1.36 fps, Avg. Travel Time= 3.0 min

Peak Storage= 251 cf @ 12.30 hrs
Average Depth at Peak Storage= 0.37'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 139.88 cfs

2.00' x 2.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 245.0' Slope= 0.0490 '/'
Inlet Invert= 1,842.00', Outlet Invert= 1,830.00'




Summary for Reach 7A: CULVERT

Inflow Area = 0.577 ac, 11.54% Impervious, Inflow Depth = 0.74" for 1 Year event
Inflow = 0.72 cfs @ 11.99 hrs, Volume= 0.035 af
Outflow = 0.71 cfs @ 12.00 hrs, Volume= 0.035 af, Atten= 2%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.33 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 1.51 fps, Avg. Travel Time= 1.3 min

Peak Storage= 19 cf @ 11.99 hrs
Average Depth at Peak Storage= 0.27'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 4.70 cfs

12.0" Round Pipe
n= 0.013 Corrugated PE, smooth interior
Length= 115.0' Slope= 0.0174 '/'
Inlet Invert= 1,900.00', Outlet Invert= 1,898.00'




Summary for Reach 7B: Existing Ditch

Inflow Area = 0.577 ac, 11.54% Impervious, Inflow Depth = 0.74" for 1 Year event
Inflow = 0.71 cfs @ 12.00 hrs, Volume= 0.035 af
Outflow = 0.69 cfs @ 12.02 hrs, Volume= 0.035 af, Atten= 3%, Lag= 1.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.94 fps, Min. Travel Time= 0.7 min
Avg. Velocity = 1.17 fps, Avg. Travel Time= 1.8 min

Peak Storage= 30 cf @ 12.01 hrs
Average Depth at Peak Storage= 0.11'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 172.60 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 7.00'
Length= 125.0' Slope= 0.1280 '/'
Inlet Invert= 1,896.00', Outlet Invert= 1,880.00'

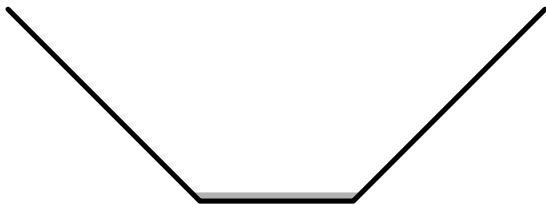


Summary for Reach 7C: Existing Ditch

Inflow Area = 12.983 ac, 1.90% Impervious, Inflow Depth = 0.57" for 1 Year event
Inflow = 6.28 cfs @ 12.08 hrs, Volume= 0.614 af
Outflow = 6.17 cfs @ 12.13 hrs, Volume= 0.614 af, Atten= 2%, Lag= 3.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.88 fps, Min. Travel Time= 1.8 min
Avg. Velocity = 1.20 fps, Avg. Travel Time= 7.3 min

Peak Storage= 670 cf @ 12.10 hrs
Average Depth at Peak Storage= 0.50'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 123.26 cfs

2.00' x 2.50' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 7.00'
Length= 530.0' Slope= 0.1020 '/'
Inlet Invert= 1,880.00', Outlet Invert= 1,825.94'

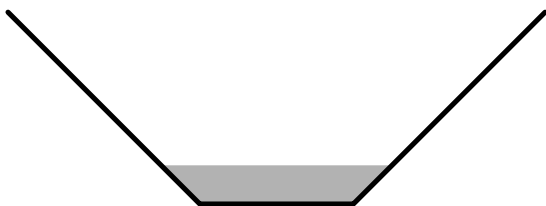

Summary for Reach 8: Stream Channel

Inflow Area = 92.038 ac, 7.66% Impervious, Inflow Depth > 0.69" for 1 Year event
Inflow = 16.80 cfs @ 12.04 hrs, Volume= 5.321 af
Outflow = 16.66 cfs @ 12.07 hrs, Volume= 5.321 af, Atten= 1%, Lag= 1.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Max. Velocity= 6.89 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 1.92 fps, Avg. Travel Time= 2.1 min

Peak Storage= 593 cf @ 12.05 hrs
Average Depth at Peak Storage= 0.40'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 473.46 cfs

4.00' x 2.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 5.0 '/ Top Width= 24.00'
Length= 245.0' Slope= 0.2694 '/
Inlet Invert= 1,816.00', Outlet Invert= 1,750.00'



Summary for Reach 9R: swale

Inflow Area = 0.723 ac, 0.00% Impervious, Inflow Depth = 0.65" for 1 Year event
Inflow = 0.73 cfs @ 12.01 hrs, Volume= 0.039 af
Outflow = 0.68 cfs @ 12.07 hrs, Volume= 0.039 af, Atten= 7%, Lag= 4.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.89 fps, Min. Travel Time= 2.5 min
Avg. Velocity = 0.53 fps, Avg. Travel Time= 8.8 min

Peak Storage= 102 cf @ 12.03 hrs
Average Depth at Peak Storage= 0.17'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 11.64 cfs

2.00' x 1.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 0.5 '/ Top Width= 3.00'
Length= 280.0' Slope= 0.0179 '/
Inlet Invert= 2,225.00', Outlet Invert= 2,220.00'



Summary for Reach 11R: Overland Flow

Inflow Area = 20.182 ac, 16.70% Impervious, Inflow Depth > 0.81" for 1 Year event
Inflow = 5.61 cfs @ 11.97 hrs, Volume= 1.365 af
Outflow = 3.33 cfs @ 12.29 hrs, Volume= 1.365 af, Atten= 41%, Lag= 18.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.98 fps, Min. Travel Time= 12.9 min
Avg. Velocity = 0.38 fps, Avg. Travel Time= 33.4 min

Peak Storage= 2,604 cf @ 12.07 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 626.02 cfs

75.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 15.0 '/' Top Width= 105.00'
Length= 760.0' Slope= 0.1724 '/'
Inlet Invert= 1,973.00', Outlet Invert= 1,842.00'



Summary for Reach 12R: Overland Flow

Inflow Area = 2.112 ac, 7.43% Impervious, Inflow Depth = 0.74" for 1 Year event
Inflow = 1.93 cfs @ 12.07 hrs, Volume= 0.130 af
Outflow = 1.48 cfs @ 12.31 hrs, Volume= 0.130 af, Atten= 23%, Lag= 13.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.07 fps, Min. Travel Time= 8.7 min
Avg. Velocity = 0.42 fps, Avg. Travel Time= 22.1 min

Peak Storage= 780 cf @ 12.16 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 315.94 cfs

30.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 15.0 '/' Top Width= 60.00'
Length= 562.0' Slope= 0.2100 '/'
Inlet Invert= 1,960.00', Outlet Invert= 1,842.00'



Summary for Reach 13: Channel at tracks

Inflow Area = 100.761 ac, 7.85% Impervious, Inflow Depth > 0.69" for 1 Year event
Inflow = 16.66 cfs @ 12.07 hrs, Volume= 5.755 af
Outflow = 16.52 cfs @ 12.12 hrs, Volume= 5.755 af, Atten= 1%, Lag= 3.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.76 fps, Min. Travel Time= 1.6 min
Avg. Velocity = 1.10 fps, Avg. Travel Time= 5.4 min

Peak Storage= 1,583 cf @ 12.09 hrs
Average Depth at Peak Storage= 0.66'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 423.37 cfs

4.00' x 3.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 4.0 '/ Top Width= 28.00'
Length= 360.0' Slope= 0.0444 '/
Inlet Invert= 1,750.00', Outlet Invert= 1,734.00'



Summary for Reach 40R: Swale

Inflow Area = 19.549 ac, 16.10% Impervious, Inflow Depth > 0.80" for 1 Year event
Inflow = 4.52 cfs @ 11.98 hrs, Volume= 1.301 af
Outflow = 4.40 cfs @ 11.99 hrs, Volume= 1.300 af, Atten= 3%, Lag= 0.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Max. Velocity= 3.40 fps, Min. Travel Time= 0.5 min
Avg. Velocity = 0.96 fps, Avg. Travel Time= 1.6 min

Peak Storage= 124 cf @ 11.98 hrs
Average Depth at Peak Storage= 0.40'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 106.53 cfs

2.50' x 2.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/ Top Width= 10.50'
Length= 95.0' Slope= 0.0411 '/
Inlet Invert= 1,983.90', Outlet Invert= 1,980.00'



Summary for Reach 51R: Swale

Inflow Area = 4.233 ac, 33.60% Impervious, Inflow Depth = 1.20" for 1 Year event
Inflow = 7.90 cfs @ 11.95 hrs, Volume= 0.425 af
Outflow = 7.58 cfs @ 12.00 hrs, Volume= 0.425 af, Atten= 4%, Lag= 3.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.57 fps, Min. Travel Time= 2.0 min
Avg. Velocity = 1.16 fps, Avg. Travel Time= 7.7 min

Peak Storage= 891 cf @ 11.97 hrs
Average Depth at Peak Storage= 0.48'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 162.52 cfs

2.00' x 2.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 3.0 '/' Top Width= 14.00'
Length= 535.0' Slope= 0.0374 '/'
Inlet Invert= 2,020.00', Outlet Invert= 2,000.00'




Summary for Reach 58a: Swale along RR Tracks

Inflow Area = 34.486 ac, 12.14% Impervious, Inflow Depth > 0.76" for 1 Year event
Inflow = 10.48 cfs @ 12.23 hrs, Volume= 2.197 af
Outflow = 10.37 cfs @ 12.30 hrs, Volume= 2.197 af, Atten= 1%, Lag= 3.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.87 fps, Min. Travel Time= 2.3 min
Avg. Velocity = 0.98 fps, Avg. Travel Time= 9.2 min

Peak Storage= 1,458 cf @ 12.26 hrs
Average Depth at Peak Storage= 0.76'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 130.53 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 12.00'
Length= 543.0' Slope= 0.0276 '/'
Inlet Invert= 1,788.00', Outlet Invert= 1,773.00'

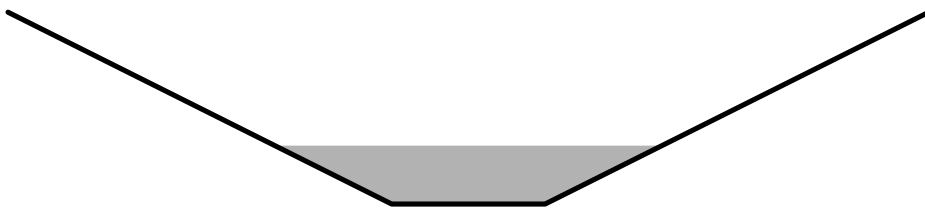

Summary for Reach 63R: OVERLAND

Inflow Area = 2.621 ac, 35.67% Impervious, Inflow Depth = 1.07" for 1 Year event
Inflow = 3.97 cfs @ 11.95 hrs, Volume= 0.234 af
Outflow = 3.91 cfs @ 11.97 hrs, Volume= 0.234 af, Atten= 1%, Lag= 1.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.49 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 0.92 fps, Avg. Travel Time= 2.3 min

Peak Storage= 143 cf @ 11.96 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 290.92 cfs

20.00' x 0.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 50.0 '/' Top Width= 70.00'
Length= 126.0' Slope= 0.3095 '/'
Inlet Invert= 2,079.00', Outlet Invert= 2,040.00'



Summary for Reach 64R: Swale

Inflow Area = 7.908 ac, 12.10% Impervious, Inflow Depth > 0.73" for 1 Year event
Inflow = 0.14 cfs @ 23.39 hrs, Volume= 0.483 af
Outflow = 0.14 cfs @ 23.58 hrs, Volume= 0.483 af, Atten= 0%, Lag= 11.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.54 fps, Min. Travel Time= 6.8 min
Avg. Velocity = 0.36 fps, Avg. Travel Time= 10.2 min

Peak Storage= 56 cf @ 23.46 hrs
Average Depth at Peak Storage= 0.11'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 31.81 cfs

2.00' x 2.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 222.0' Slope= 0.0045 '/'
Inlet Invert= 2,016.50', Outlet Invert= 2,015.50'



Summary for Reach 69R: Wetland Flow

Inflow Area = 3.895 ac, 4.53% Impervious, Inflow Depth = 0.78" for 1 Year event
Inflow = 4.89 cfs @ 12.00 hrs, Volume= 0.254 af
Outflow = 3.08 cfs @ 12.27 hrs, Volume= 0.254 af, Atten= 37%, Lag= 16.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.73 fps, Min. Travel Time= 11.1 min
Avg. Velocity = 0.21 fps, Avg. Travel Time= 38.3 min

Peak Storage= 2,067 cf @ 12.08 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 172.83 cfs

76.00' x 0.50' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 100.0 ' Top Width= 176.00'
Length= 487.0' Slope= 0.0657 '
Inlet Invert= 2,098.00', Outlet Invert= 2,066.00'



Summary for Reach 197: Stream Channel

Inflow Area = 121.913 ac, 1.88% Impervious, Inflow Depth = 0.62" for 1 Year event
Inflow = 49.67 cfs @ 12.36 hrs, Volume= 6.315 af
Outflow = 49.40 cfs @ 12.39 hrs, Volume= 6.315 af, Atten= 1%, Lag= 2.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.44 fps, Min. Travel Time= 1.3 min
Avg. Velocity = 2.56 fps, Avg. Travel Time= 3.9 min

Peak Storage= 3,984 cf @ 12.37 hrs
Average Depth at Peak Storage= 0.38'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 12,157.92 cfs

15.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 7.0 ' Top Width= 99.00'
Length= 599.0' Slope= 0.2771 '
Inlet Invert= 1,910.00', Outlet Invert= 1,744.00'




Summary for Reach 197A: Stream Channel

Inflow Area = 114.943 ac, 1.85% Impervious, Inflow Depth = 0.62" for 1 Year event
Inflow = 49.07 cfs @ 12.32 hrs, Volume= 5.925 af
Outflow = 48.75 cfs @ 12.36 hrs, Volume= 5.925 af, Atten= 1%, Lag= 2.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.55 fps, Min. Travel Time= 1.3 min
Avg. Velocity = 2.12 fps, Avg. Travel Time= 4.7 min

Peak Storage= 3,891 cf @ 12.33 hrs
Average Depth at Peak Storage= 0.87'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 3,907.44 cfs

4.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 52.00'
Length= 601.0' Slope= 0.1331 '/'
Inlet Invert= 1,990.00', Outlet Invert= 1,910.00'

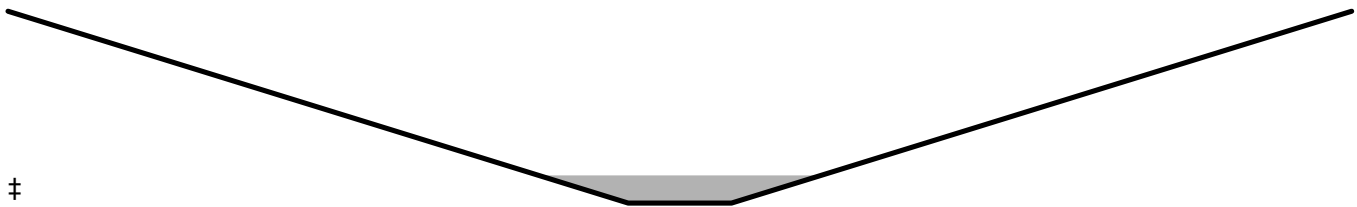


Summary for Reach 197B: Stream Channel

Inflow Area = 110.322 ac, 1.58% Impervious, Inflow Depth = 0.62" for 1 Year event
Inflow = 48.72 cfs @ 12.30 hrs, Volume= 5.672 af
Outflow = 48.51 cfs @ 12.32 hrs, Volume= 5.672 af, Atten= 0%, Lag= 1.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.78 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 1.86 fps, Avg. Travel Time= 2.3 min

Peak Storage= 1,810 cf @ 12.31 hrs
Average Depth at Peak Storage= 0.93'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 3,373.30 cfs

4.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 52.00'
Length= 252.0' Slope= 0.0992 '/'
Inlet Invert= 2,015.00', Outlet Invert= 1,990.00'

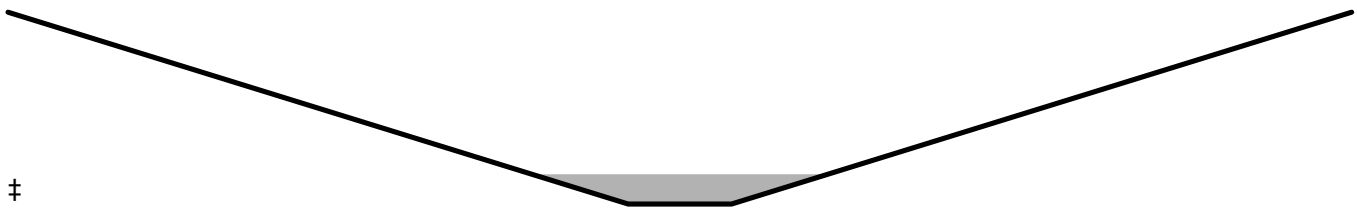


Summary for Reach 197C: Stream Channel

Inflow Area = 95.895 ac, 1.22% Impervious, Inflow Depth = 0.62" for 1 Year event
Inflow = 47.27 cfs @ 12.28 hrs, Volume= 4.965 af
Outflow = 46.99 cfs @ 12.30 hrs, Volume= 4.965 af, Atten= 1%, Lag= 1.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.85 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 3.27 fps, Avg. Travel Time= 2.2 min

Peak Storage= 2,557 cf @ 12.29 hrs
Average Depth at Peak Storage= 0.82'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 4,183.47 cfs

4.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/ Top Width= 52.00'
Length= 426.0' Slope= 0.1526 '/
Inlet Invert= 2,080.00', Outlet Invert= 2,015.00'

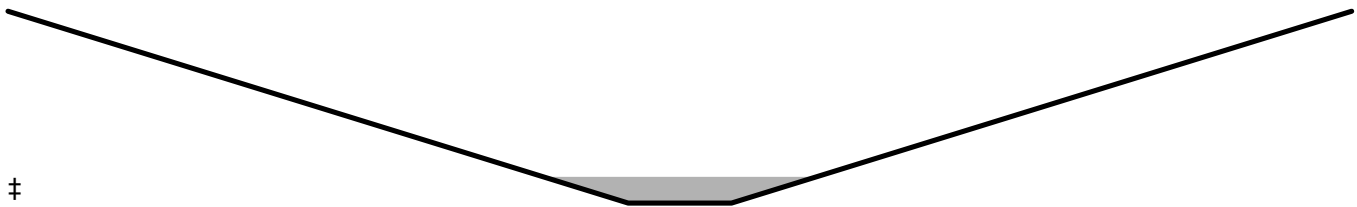


Summary for Reach 198: Stream Channel

Inflow Area = 88.624 ac, 0.78% Impervious, Inflow Depth = 0.61" for 1 Year event
Inflow = 45.94 cfs @ 12.20 hrs, Volume= 4.519 af
Outflow = 44.84 cfs @ 12.28 hrs, Volume= 4.519 af, Atten= 2%, Lag= 4.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.04 fps, Min. Travel Time= 2.6 min
Avg. Velocity = 3.32 fps, Avg. Travel Time= 6.3 min

Peak Storage= 7,062 cf @ 12.24 hrs
Average Depth at Peak Storage= 0.78'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 4,399.92 cfs

4.00' x 6.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 4.0 '/ Top Width= 52.00'
Length= 1,262.0' Slope= 0.1688 '/
Inlet Invert= 2,228.00', Outlet Invert= 2,015.00'

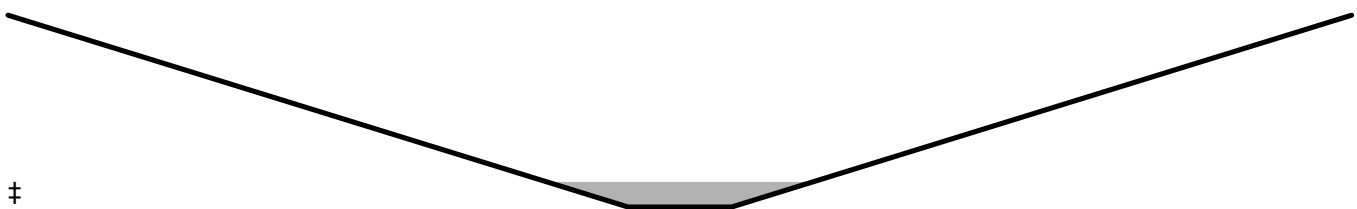

Summary for Reach 199: Overland Flow

Inflow Area = 12.214 ac, 2.97% Impervious, Inflow Depth = 0.65" for 1 Year event
Inflow = 7.26 cfs @ 12.17 hrs, Volume= 0.660 af
Outflow = 7.21 cfs @ 12.22 hrs, Volume= 0.660 af, Atten= 1%, Lag= 2.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.51 fps, Min. Travel Time= 1.7 min
Avg. Velocity = 0.87 fps, Avg. Travel Time= 4.8 min

Peak Storage= 719 cf @ 12.19 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 458.82 cfs

50.00' x 0.50' deep channel, n= 0.040 Earth, dense weeds
Side Slope Z-value= 100.0 ' Top Width= 150.00'
Length= 250.0' Slope= 0.2640 '
Inlet Invert= 2,234.00', Outlet Invert= 2,168.00'




Summary for Reach 295: Roadside Channel

Inflow Area = 27.327 ac, 3.68% Impervious, Inflow Depth = 0.63" for 1 Year event
Inflow = 8.91 cfs @ 12.50 hrs, Volume= 1.440 af
Outflow = 8.86 cfs @ 12.53 hrs, Volume= 1.440 af, Atten= 1%, Lag= 2.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.36 fps, Min. Travel Time= 1.1 min
Avg. Velocity = 1.58 fps, Avg. Travel Time= 2.9 min

Peak Storage= 571 cf @ 12.52 hrs
Average Depth at Peak Storage= 0.70'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 144.47 cfs

1.50' x 2.50' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 ' Top Width= 11.50'
Length= 280.0' Slope= 0.0643 '
Inlet Invert= 2,084.00', Outlet Invert= 2,066.00'

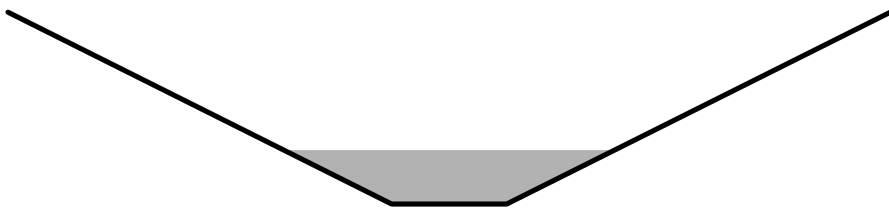

Summary for Reach 296: Wetland Flow

Inflow Area = 22.407 ac, 0.53% Impervious, Inflow Depth = 0.63" for 1 Year event
Inflow = 9.14 cfs @ 12.38 hrs, Volume= 1.172 af
Outflow = 8.72 cfs @ 12.50 hrs, Volume= 1.172 af, Atten= 5%, Lag= 7.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.69 fps, Min. Travel Time= 4.2 min
Avg. Velocity = 0.61 fps, Avg. Travel Time= 11.6 min

Peak Storage= 2,204 cf @ 12.43 hrs
Average Depth at Peak Storage= 0.35'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 251.85 cfs

12.00' x 2.00' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 8.0 '/ Top Width= 44.00'
Length= 427.0' Slope= 0.0328 '/
Inlet Invert= 2,098.00', Outlet Invert= 2,084.00'



Summary for Reach 297: Overland Flow

Inflow Area = 17.082 ac, 0.44% Impervious, Inflow Depth = 0.61" for 1 Year event
Inflow = 8.35 cfs @ 12.36 hrs, Volume= 0.865 af
Outflow = 8.30 cfs @ 12.38 hrs, Volume= 0.865 af, Atten= 1%, Lag= 1.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.97 fps, Min. Travel Time= 0.8 min
Avg. Velocity = 1.35 fps, Avg. Travel Time= 2.4 min

Peak Storage= 410 cf @ 12.37 hrs
Average Depth at Peak Storage= 0.06'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 358.18 cfs

30.00' x 0.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 50.0 '/ Top Width= 80.00'
Length= 195.0' Slope= 0.2872 '/
Inlet Invert= 2,170.00', Outlet Invert= 2,114.00'



Summary for Reach 298: Wetland Flow

Inflow Area = 17.082 ac, 0.44% Impervious, Inflow Depth = 0.61" for 1 Year event
Inflow = 9.29 cfs @ 12.18 hrs, Volume= 0.865 af
Outflow = 8.35 cfs @ 12.36 hrs, Volume= 0.865 af, Atten= 10%, Lag= 10.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.11 fps, Min. Travel Time= 6.1 min
Avg. Velocity = 0.38 fps, Avg. Travel Time= 17.8 min

Peak Storage= 3,090 cf @ 12.25 hrs
Average Depth at Peak Storage= 0.07'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 802.14 cfs

100.00' x 1.00' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 50.0 '/' Top Width= 200.00'
Length= 408.0' Slope= 0.0931 '/'
Inlet Invert= 2,208.00', Outlet Invert= 2,170.00'



Summary for Reach 299: Overland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1 Year event
Inflow = 8.97 cfs @ 12.17 hrs, Volume= 0.826 af
Outflow = 8.93 cfs @ 12.19 hrs, Volume= 0.826 af, Atten= 0%, Lag= 1.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.76 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 1.50 fps, Avg. Travel Time= 1.5 min

Peak Storage= 322 cf @ 12.18 hrs
Average Depth at Peak Storage= 0.14'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 134.95 cfs

10.00' x 0.50' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 50.0 '/' Top Width= 60.00'
Length= 135.0' Slope= 0.3481 '/'
Inlet Invert= 2,255.00', Outlet Invert= 2,208.00'



Summary for Reach O3: Overland Flow

Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.00 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 0.00 fps, Avg. Travel Time= 0.0 min

Peak Storage= 0 cf @ 0.00 hrs
Average Depth at Peak Storage= 0.00'
Bank-Full Depth= 0.25', Capacity at Bank-Full= 78.90 cfs

30.00' x 0.25' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 100.0 ' Top Width= 80.00'
Length= 178.0' Slope= 0.1404 '
Inlet Invert= 1,838.00', Outlet Invert= 1,813.00'



Summary for Reach O4: Swale

Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.00 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 0.00 fps, Avg. Travel Time= 0.0 min

Peak Storage= 0 cf @ 0.00 hrs
Average Depth at Peak Storage= 0.00'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 59.96 cfs

2.00' x 1.50' deep channel, n= 0.033 Earth, grassed & winding
Side Slope Z-value= 2.0 ' Top Width= 8.00'
Length= 286.0' Slope= 0.0385 '
Inlet Invert= 1,810.00', Outlet Invert= 1,799.00'



Summary for Reach X1: Swale

Inflow Area = 2.495 ac, 6.71% Impervious, Inflow Depth = 0.49" for 1 Year event
Inflow = 0.11 cfs @ 13.92 hrs, Volume= 0.102 af
Outflow = 0.11 cfs @ 13.99 hrs, Volume= 0.102 af, Atten= 0%, Lag= 4.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.34 fps, Min. Travel Time= 2.5 min
Avg. Velocity = 1.09 fps, Avg. Travel Time= 3.0 min

Peak Storage= 16 cf @ 13.95 hrs
Average Depth at Peak Storage= 0.04'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 153.60 cfs

2.00' x 2.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 200.0' Slope= 0.1050 '/'
Inlet Invert= 1,794.00', Outlet Invert= 1,773.00'



Summary for Pond 1P: Catch Basin/Culvert

Inflow Area = 1.239 ac, 57.09% Impervious, Inflow Depth = 1.64" for 1 Year event
 Inflow = 3.14 cfs @ 12.01 hrs, Volume= 0.170 af
 Outflow = 3.14 cfs @ 12.01 hrs, Volume= 0.170 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.14 cfs @ 12.01 hrs, Volume= 0.170 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,980.65' @ 12.01 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,980.00'	36.0" Round Culvert L= 200.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,980.00' / 1,964.00' S= 0.0800 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,002.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=3.09 cfs @ 12.01 hrs HW=1,980.65' (Free Discharge)

- 1=Culvert (Inlet Controls 3.09 cfs @ 2.74 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 2P: Catch Basin

Inflow Area = 8.528 ac, 36.42% Impervious, Inflow Depth = 1.12" for 1 Year event
 Inflow = 15.55 cfs @ 11.92 hrs, Volume= 0.797 af
 Outflow = 15.55 cfs @ 11.92 hrs, Volume= 0.797 af, Atten= 0%, Lag= 0.0 min
 Primary = 15.55 cfs @ 11.92 hrs, Volume= 0.797 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,997.68' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,996.00'	36.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,996.00' / 1,995.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,002.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=15.23 cfs @ 11.92 hrs HW=1,997.66' (Free Discharge)

- 1=Culvert (Barrel Controls 15.23 cfs @ 5.49 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 2R: 48" CMP Culvert

Inflow Area = 130.257 ac, 1.76% Impervious, Inflow Depth = 0.62" for 1 Year event
 Inflow = 50.83 cfs @ 12.39 hrs, Volume= 6.765 af
 Outflow = 50.83 cfs @ 12.39 hrs, Volume= 6.765 af, Atten= 0%, Lag= 0.0 min
 Primary = 50.83 cfs @ 12.39 hrs, Volume= 6.765 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,744.71' @ 12.39 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,742.00'	48.0" Round Culvert L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 1,742.00' / 1,740.00' S= 0.0667 '/ Cc= 0.900 n= 0.025
#2	Secondary	1,746.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=50.79 cfs @ 12.39 hrs HW=1,744.71' (Free Discharge)

↳1=**Culvert** (Inlet Controls 50.79 cfs @ 5.60 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,742.00' (Free Discharge)

↳2=**Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond 3P: Catch Basin

Inflow Area = 0.284 ac, 69.74% Impervious, Inflow Depth = 1.93" for 1 Year event
 Inflow = 1.04 cfs @ 11.91 hrs, Volume= 0.046 af
 Outflow = 1.04 cfs @ 11.91 hrs, Volume= 0.046 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.04 cfs @ 11.91 hrs, Volume= 0.046 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,009.65' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,009.19'	18.0" Round Culvert L= 304.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,009.19' / 1,997.21' S= 0.0394 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,014.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.04 cfs @ 11.91 hrs HW=2,009.64' (Free Discharge)

↳1=**Culvert** (Inlet Controls 1.04 cfs @ 2.29 fps)

↳2=**Orifice/Grate** (Controls 0.00 cfs)

Summary for Pond 4P: Catch Basin

Inflow Area = 0.103 ac, 100.00% Impervious, Inflow Depth = 2.57" for 1 Year event
 Inflow = 0.46 cfs @ 11.91 hrs, Volume= 0.022 af
 Outflow = 0.46 cfs @ 11.91 hrs, Volume= 0.022 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.46 cfs @ 11.91 hrs, Volume= 0.022 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,010.03' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,009.71'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,009.71' / 2,009.53' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

#2 Primary 2,014.00' **24.0" x 24.0" Horiz. Orifice/Grate** C= 0.600
 Limited to weir flow at low heads

Primary OutFlow Max=0.46 cfs @ 11.91 hrs HW=2,010.03' (Free Discharge)

↑1=Culvert (Barrel Controls 0.46 cfs @ 2.51 fps)
 ↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 4R: (2) 36" Culverts

Inflow Area = 33.644 ac, 4.16% Impervious, Inflow Depth = 0.66" for 1 Year event
 Inflow = 10.59 cfs @ 12.52 hrs, Volume= 1.843 af
 Outflow = 10.59 cfs @ 12.52 hrs, Volume= 1.843 af, Atten= 0%, Lag= 0.0 min
 Primary = 10.59 cfs @ 12.52 hrs, Volume= 1.843 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,064.86' @ 12.52 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,064.00'	36.0" Round Culvert X 2.00 L= 70.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,064.00' / 2,063.00' S= 0.0143 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Secondary	2,070.00'	50.0' long x 35.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=10.55 cfs @ 12.52 hrs HW=2,064.86' (Free Discharge)

↑1=Culvert (Inlet Controls 10.55 cfs @ 3.16 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,064.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 7P: Catch Basin

Inflow Area = 0.262 ac, 70.83% Impervious, Inflow Depth = 1.89" for 1 Year event
 Inflow = 0.92 cfs @ 11.94 hrs, Volume= 0.041 af
 Outflow = 0.92 cfs @ 11.94 hrs, Volume= 0.041 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.92 cfs @ 11.94 hrs, Volume= 0.041 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,065.95' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,065.43'	12.0" Round Culvert L= 11.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,065.43' / 2,065.25' S= 0.0164 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,070.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.92 cfs @ 11.94 hrs HW=2,065.95' (Free Discharge)

└1=Culvert (Barrel Controls 0.92 cfs @ 3.22 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 7R: (2) 36" Steel Culverts

Inflow Area = 92.038 ac, 7.66% Impervious, Inflow Depth > 0.69" for 1 Year event
 Inflow = 16.80 cfs @ 12.04 hrs, Volume= 5.321 af
 Outflow = 16.80 cfs @ 12.04 hrs, Volume= 5.321 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.80 cfs @ 12.04 hrs, Volume= 5.321 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,813.10' @ 12.04 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,812.00'	36.0" Round Culvert X 2.00 L= 30.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,812.00' / 1,811.00' S= 0.0333 '/ n= 0.012
#2	Secondary	1,816.00'	20.0' long x 20.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=16.70 cfs @ 12.04 hrs HW=1,813.10' (Free Discharge)

└1=Culvert (Inlet Controls 16.70 cfs @ 3.57 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,812.00' (Free Discharge)

└2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 8R: 36" hdpe

Inflow Area = 34.486 ac, 12.14% Impervious, Inflow Depth > 0.76" for 1 Year event
 Inflow = 10.48 cfs @ 12.23 hrs, Volume= 2.197 af
 Outflow = 10.48 cfs @ 12.23 hrs, Volume= 2.197 af, Atten= 0%, Lag= 0.0 min
 Primary = 10.48 cfs @ 12.23 hrs, Volume= 2.197 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,831.24' @ 12.23 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,830.00'	36.0" Round Culvert L= 245.0' Ke= 0.500 Inlet / Outlet Invert= 1,830.00' / 1,788.00' S= 0.1714 '/ n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=10.46 cfs @ 12.23 hrs HW=1,831.24' (Free Discharge)

└1=Culvert (Inlet Controls 10.46 cfs @ 3.79 fps)

Summary for Pond 9P: Catch Basin

Inflow Area = 0.167 ac, 83.21% Impervious, Inflow Depth = 2.19" for 1 Year event
 Inflow = 0.69 cfs @ 11.91 hrs, Volume= 0.030 af
 Outflow = 0.69 cfs @ 11.91 hrs, Volume= 0.030 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.69 cfs @ 11.91 hrs, Volume= 0.030 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,034.83' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,034.40'	24.0" Round Culvert L= 136.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,034.40' / 2,034.00' S= 0.0029 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,039.40'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.68 cfs @ 11.91 hrs HW=2,034.82' (Free Discharge)
 1=Culvert (Barrel Controls 0.68 cfs @ 2.10 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 10P: Catch Basin

Inflow Area = 0.088 ac, 94.81% Impervious, Inflow Depth = 2.46" for 1 Year event
 Inflow = 0.39 cfs @ 11.91 hrs, Volume= 0.018 af
 Outflow = 0.39 cfs @ 11.91 hrs, Volume= 0.018 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.39 cfs @ 11.91 hrs, Volume= 0.018 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,035.62' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,035.29'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,035.29' / 2,035.11' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,039.40'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.39 cfs @ 11.91 hrs HW=2,035.62' (Free Discharge)
 1=Culvert (Barrel Controls 0.39 cfs @ 2.53 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 10R: 14" and 16" HDPE Culverts

Inflow Area = 20.182 ac, 16.70% Impervious, Inflow Depth > 0.81" for 1 Year event
 Inflow = 5.61 cfs @ 11.97 hrs, Volume= 1.365 af
 Outflow = 5.61 cfs @ 11.97 hrs, Volume= 1.365 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.61 cfs @ 11.97 hrs, Volume= 1.365 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

Peak Elev= 1,976.00' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,975.00'	14.0" Round 14" Culvert L= 50.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,975.00' / 1,974.50' S= 0.0100 '/ Cc= 0.900 n= 0.011
#2	Primary	1,975.00'	16.0" Round 16" Culvert L= 50.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,975.00' / 1,974.50' S= 0.0100 '/ Cc= 0.900 n= 0.011
#3	Secondary	1,977.00'	50.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=5.58 cfs @ 11.97 hrs HW=1,975.99' (Free Discharge)

↑1=14" Culvert (Inlet Controls 2.59 cfs @ 2.68 fps)

↑2=16" Culvert (Inlet Controls 2.98 cfs @ 2.68 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,975.00' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 11P: Catch Basin

Inflow Area = 7.752 ac, 32.48% Impervious, Inflow Depth = 1.03" for 1 Year event
 Inflow = 12.60 cfs @ 11.92 hrs, Volume= 0.664 af
 Outflow = 12.60 cfs @ 11.92 hrs, Volume= 0.664 af, Atten= 0%, Lag= 0.0 min
 Primary = 12.60 cfs @ 11.92 hrs, Volume= 0.664 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,056.37' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,055.00'	36.0" Round Culvert L= 90.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,055.00' / 2,040.74' S= 0.1584 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,060.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=12.33 cfs @ 11.92 hrs HW=2,056.36' (Free Discharge)

↑1=Culvert (Inlet Controls 12.33 cfs @ 3.97 fps)

↑2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 12P: Catch Basin

Inflow Area = 0.067 ac, 88.78% Impervious, Inflow Depth = 2.25" for 1 Year event
 Inflow = 0.29 cfs @ 11.90 hrs, Volume= 0.013 af
 Outflow = 0.29 cfs @ 11.90 hrs, Volume= 0.013 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.29 cfs @ 11.90 hrs, Volume= 0.013 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,055.26' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,055.00'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,055.00' / 2,054.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,060.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.28 cfs @ 11.90 hrs HW=2,055.26' (Free Discharge)

↑1=Culvert (Inlet Controls 0.28 cfs @ 1.73 fps)

↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 13P: Manhole

Inflow Area = 7.315 ac, 30.04% Impervious, Inflow Depth = 0.97" for 1 Year event
 Inflow = 11.03 cfs @ 11.93 hrs, Volume= 0.594 af
 Outflow = 11.03 cfs @ 11.93 hrs, Volume= 0.594 af, Atten= 0%, Lag= 0.0 min
 Primary = 11.03 cfs @ 11.93 hrs, Volume= 0.594 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,065.16' @ 11.93 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,063.88'	36.0" Round Culvert L= 137.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,063.88' / 2,055.10' S= 0.0641 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,072.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=10.81 cfs @ 11.93 hrs HW=2,065.14' (Free Discharge)

↑1=Culvert (Inlet Controls 10.81 cfs @ 3.83 fps)

↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 13R: 16" CMP Culvert

Inflow Area = 2.112 ac, 7.43% Impervious, Inflow Depth = 0.74" for 1 Year event
 Inflow = 1.93 cfs @ 12.07 hrs, Volume= 0.130 af
 Outflow = 1.93 cfs @ 12.07 hrs, Volume= 0.130 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.93 cfs @ 12.07 hrs, Volume= 0.130 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,968.66' @ 12.07 hrs

Flood Elev= 1,969.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,968.00'	16.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 1,968.00' / 1,965.00' S= 0.0750 '/ Cc= 0.900 n= 0.025

Primary OutFlow Max=1.91 cfs @ 12.07 hrs HW=1,968.66' (Free Discharge)

↑1=Culvert (Inlet Controls 1.91 cfs @ 2.77 fps)

Summary for Pond 15P: Catch Basin

Inflow Area = 0.609 ac, 66.13% Impervious, Inflow Depth = 1.79" for 1 Year event
 Inflow = 2.08 cfs @ 11.94 hrs, Volume= 0.091 af
 Outflow = 2.08 cfs @ 11.94 hrs, Volume= 0.091 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.08 cfs @ 11.94 hrs, Volume= 0.091 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,066.34' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,065.43'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,065.43' / 2,065.25' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,070.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.05 cfs @ 11.94 hrs HW=2,066.33' (Free Discharge)

- 1=Culvert (Barrel Controls 2.05 cfs @ 3.65 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 16P: Catch Basin

Inflow Area = 0.168 ac, 93.81% Impervious, Inflow Depth = 2.46" for 1 Year event
 Inflow = 0.74 cfs @ 11.91 hrs, Volume= 0.034 af
 Outflow = 0.74 cfs @ 11.91 hrs, Volume= 0.034 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.74 cfs @ 11.91 hrs, Volume= 0.034 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,081.07' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,080.59'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,080.59' / 2,080.41' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,084.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.73 cfs @ 11.91 hrs HW=2,081.07' (Free Discharge)

- 1=Culvert (Barrel Controls 0.73 cfs @ 2.91 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 17P: Catch Basin

Inflow Area = 6.537 ac, 25.96% Impervious, Inflow Depth = 0.88" for 1 Year event
 Inflow = 8.49 cfs @ 11.92 hrs, Volume= 0.480 af
 Outflow = 8.49 cfs @ 11.92 hrs, Volume= 0.480 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.49 cfs @ 11.92 hrs, Volume= 0.480 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,080.61' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,079.50'	36.0" Round Culvert L= 213.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,079.50' / 2,067.47' S= 0.0565 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,084.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=8.30 cfs @ 11.92 hrs HW=2,080.59' (Free Discharge)

↑ **1=Culvert** (Inlet Controls 8.30 cfs @ 3.56 fps)

↳ **2=Orifice/Grate** (Controls 0.00 cfs)

Summary for Pond 18P: Catch Basin

Inflow Area = 0.696 ac, 90.27% Impervious, Inflow Depth = 2.36" for 1 Year event
 Inflow = 2.99 cfs @ 11.91 hrs, Volume= 0.137 af
 Outflow = 2.99 cfs @ 11.91 hrs, Volume= 0.137 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.99 cfs @ 11.91 hrs, Volume= 0.137 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,093.42' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,092.21'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,092.21' / 2,092.03' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,096.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.99 cfs @ 11.91 hrs HW=2,093.42' (Free Discharge)

↑ **1=Culvert** (Barrel Controls 2.99 cfs @ 3.99 fps)

↳ **2=Orifice/Grate** (Controls 0.00 cfs)

Summary for Pond 19P: Catch Basin

Inflow Area = 5.536 ac, 25.26% Impervious, Inflow Depth = 0.88" for 1 Year event
 Inflow = 7.20 cfs @ 11.92 hrs, Volume= 0.404 af
 Outflow = 7.20 cfs @ 11.92 hrs, Volume= 0.404 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.20 cfs @ 11.92 hrs, Volume= 0.404 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,092.01' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,091.00'	36.0" Round Culvert L= 250.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,091.00' / 2,077.47' S= 0.0541 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,096.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=7.04 cfs @ 11.92 hrs HW=2,092.00' (Free Discharge)

└1=Culvert (Inlet Controls 7.04 cfs @ 3.41 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 20: CB20

Inflow Area = 3.895 ac, 4.53% Impervious, Inflow Depth = 0.78" for 1 Year event
 Inflow = 4.89 cfs @ 12.00 hrs, Volume= 0.254 af
 Outflow = 4.89 cfs @ 12.00 hrs, Volume= 0.254 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.89 cfs @ 12.00 hrs, Volume= 0.254 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,105.09' @ 12.00 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,104.00'	18.0" Round Culvert L= 65.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,104.00' / 2,094.00' S= 0.1538 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,112.00'	75.0' long x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

Primary OutFlow Max=4.86 cfs @ 12.00 hrs HW=2,105.09' (Free Discharge)

└1=Culvert (Inlet Controls 4.86 cfs @ 3.55 fps)

└2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 20P: Manhole

Inflow Area = 4.748 ac, 14.80% Impervious, Inflow Depth = 0.64" for 1 Year event
 Inflow = 4.09 cfs @ 11.95 hrs, Volume= 0.252 af
 Outflow = 4.09 cfs @ 11.95 hrs, Volume= 0.252 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.09 cfs @ 11.95 hrs, Volume= 0.252 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,095.20' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,094.40'	30.0" Round Culvert L= 107.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,094.40' / 2,091.00' S= 0.0318 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=4.05 cfs @ 11.95 hrs HW=2,095.19' (Free Discharge)

└1=Culvert (Inlet Controls 4.05 cfs @ 3.03 fps)

Summary for Pond 21P: Catch Basin

Inflow Area = 0.702 ac, 72.23% Impervious, Inflow Depth = 1.91" for 1 Year event
 Inflow = 2.63 cfs @ 11.91 hrs, Volume= 0.112 af
 Outflow = 2.63 cfs @ 11.91 hrs, Volume= 0.112 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.63 cfs @ 11.91 hrs, Volume= 0.112 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,113.84' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,113.21'	30.0" Round Culvert L= 138.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,113.21' / 2,098.84' S= 0.1041 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,118.50'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.62 cfs @ 11.91 hrs HW=2,113.84' (Free Discharge)
 1=Culvert (Inlet Controls 2.62 cfs @ 2.70 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 22P: Catch Basin

Inflow Area = 0.427 ac, 71.34% Impervious, Inflow Depth = 1.89" for 1 Year event
 Inflow = 1.58 cfs @ 11.91 hrs, Volume= 0.067 af
 Outflow = 1.58 cfs @ 11.91 hrs, Volume= 0.067 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.58 cfs @ 11.91 hrs, Volume= 0.067 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,115.27' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,114.64'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,114.64' / 2,114.46' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,118.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.57 cfs @ 11.91 hrs HW=2,115.27' (Free Discharge)
 1=Culvert (Barrel Controls 1.57 cfs @ 3.28 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 23A: Catch Basin

Inflow Area = 0.733 ac, 9.68% Impervious, Inflow Depth = 0.42" for 1 Year event
 Inflow = 0.43 cfs @ 12.00 hrs, Volume= 0.026 af
 Outflow = 0.43 cfs @ 12.00 hrs, Volume= 0.026 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.43 cfs @ 12.00 hrs, Volume= 0.026 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,092.88' @ 12.01 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,092.59'	18.0" Round Culvert L= 198.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,092.59' / 2,083.20' S= 0.0474 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,097.50'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.42 cfs @ 12.00 hrs HW=2,092.87' (Free Discharge)

1=Culvert (Inlet Controls 0.42 cfs @ 1.81 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 23B: Catch Basin

Inflow Area = 0.733 ac, 9.68% Impervious, Inflow Depth = 0.42" for 1 Year event
 Inflow = 0.43 cfs @ 12.00 hrs, Volume= 0.026 af
 Outflow = 0.43 cfs @ 12.00 hrs, Volume= 0.026 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.43 cfs @ 12.00 hrs, Volume= 0.026 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,083.35' @ 12.00 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,083.07'	18.0" Round Culvert L= 51.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,083.07' / 2,079.50' S= 0.0700 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,096.50'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.41 cfs @ 12.00 hrs HW=2,083.35' (Free Discharge)

1=Culvert (Inlet Controls 0.41 cfs @ 1.80 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 24A: Catch Basin

Inflow Area = 4.046 ac, 4.84% Impervious, Inflow Depth = 0.42" for 1 Year event
 Inflow = 2.48 cfs @ 11.99 hrs, Volume= 0.141 af
 Outflow = 2.48 cfs @ 11.99 hrs, Volume= 0.141 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.48 cfs @ 11.99 hrs, Volume= 0.141 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,098.61' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,098.00'	30.0" Round Culvert L= 149.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,098.00' / 2,096.51' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,102.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.44 cfs @ 11.99 hrs HW=2,098.61' (Free Discharge)

1=Culvert (Inlet Controls 2.44 cfs @ 2.65 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 24B: Catch Basin

Inflow Area = 4.046 ac, 4.84% Impervious, Inflow Depth = 0.42" for 1 Year event
 Inflow = 2.48 cfs @ 11.99 hrs, Volume= 0.141 af
 Outflow = 2.48 cfs @ 11.99 hrs, Volume= 0.141 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.48 cfs @ 11.99 hrs, Volume= 0.141 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,095.63' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,095.00'	30.0" Round Culvert L= 49.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,095.00' / 2,094.51' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,100.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.44 cfs @ 11.99 hrs HW=2,095.62' (Free Discharge)
 1=Culvert (Barrel Controls 2.44 cfs @ 3.85 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 25P: Catch Basin

Inflow Area = 0.170 ac, 74.09% Impervious, Inflow Depth = 1.97" for 1 Year event
 Inflow = 0.66 cfs @ 11.91 hrs, Volume= 0.028 af
 Outflow = 0.66 cfs @ 11.91 hrs, Volume= 0.028 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.66 cfs @ 11.91 hrs, Volume= 0.028 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,123.20' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,122.88'	24.0" Round Culvert L= 270.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,122.88' / 2,113.50' S= 0.0347 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,135.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.64 cfs @ 11.91 hrs HW=2,123.20' (Free Discharge)
 1=Culvert (Inlet Controls 0.64 cfs @ 1.93 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 26P: Catch Basin

Inflow Area = 0.084 ac, 75.17% Impervious, Inflow Depth = 1.97" for 1 Year event
 Inflow = 0.32 cfs @ 11.91 hrs, Volume= 0.014 af
 Outflow = 0.32 cfs @ 11.91 hrs, Volume= 0.014 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.32 cfs @ 11.91 hrs, Volume= 0.014 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,131.35' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,131.05'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,131.05' / 2,130.87' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,135.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.32 cfs @ 11.91 hrs HW=2,131.35' (Free Discharge)

1=Culvert (Barrel Controls 0.32 cfs @ 2.42 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 27P: Catch Basin

Inflow Area = 0.815 ac, 74.18% Impervious, Inflow Depth = 1.95" for 1 Year event
 Inflow = 3.16 cfs @ 11.91 hrs, Volume= 0.133 af
 Outflow = 3.16 cfs @ 11.91 hrs, Volume= 0.133 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.16 cfs @ 11.91 hrs, Volume= 0.133 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,148.54' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,147.75'	21.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,147.75' / 2,145.50' S= 0.0450 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,152.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=3.10 cfs @ 11.91 hrs HW=2,148.53' (Free Discharge)

1=Culvert (Inlet Controls 3.10 cfs @ 3.00 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 28P: Catch Basin

Inflow Area = 0.093 ac, 76.11% Impervious, Inflow Depth = 1.97" for 1 Year event
 Inflow = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af
 Outflow = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,148.30' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,148.00'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,148.00' / 2,147.75' S= 0.0139 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,152.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.36 cfs @ 11.91 hrs HW=2,148.30' (Free Discharge)

↑1=Culvert (Barrel Controls 0.36 cfs @ 2.73 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 29P: Manhole

Inflow Area = 0.631 ac, 73.96% Impervious, Inflow Depth = 1.95" for 1 Year event
 Inflow = 2.44 cfs @ 11.91 hrs, Volume= 0.102 af
 Outflow = 2.44 cfs @ 11.91 hrs, Volume= 0.102 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.44 cfs @ 11.91 hrs, Volume= 0.102 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,162.68' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,162.00'	21.0" Round Culvert L= 125.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,162.00' / 2,147.75' S= 0.1140 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=2.39 cfs @ 11.91 hrs HW=2,162.68' (Free Discharge)

↑1=Culvert (Inlet Controls 2.39 cfs @ 2.80 fps)

Summary for Pond 30P: Catch Basin

Inflow Area = 0.631 ac, 73.96% Impervious, Inflow Depth = 1.95" for 1 Year event
 Inflow = 2.44 cfs @ 11.91 hrs, Volume= 0.102 af
 Outflow = 2.44 cfs @ 11.91 hrs, Volume= 0.102 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.44 cfs @ 11.91 hrs, Volume= 0.102 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,174.84' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,174.16'	21.0" Round Culvert L= 93.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,174.16' / 2,162.64' S= 0.1239 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,181.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.39 cfs @ 11.91 hrs HW=2,174.83' (Free Discharge)

↑1=Culvert (Inlet Controls 2.39 cfs @ 2.80 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 31P: Catch Basin

Inflow Area = 0.067 ac, 74.25% Impervious, Inflow Depth = 1.97" for 1 Year event
 Inflow = 0.26 cfs @ 11.90 hrs, Volume= 0.011 af
 Outflow = 0.26 cfs @ 11.90 hrs, Volume= 0.011 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.26 cfs @ 11.90 hrs, Volume= 0.011 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,177.45' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,177.18'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,177.18' / 2,177.00' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,181.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.25 cfs @ 11.90 hrs HW=2,177.45' (Free Discharge)

- 1=Culvert (Barrel Controls 0.25 cfs @ 2.30 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 32P: Catch Basin

Inflow Area = 0.501 ac, 73.93% Impervious, Inflow Depth = 1.94" for 1 Year event
 Inflow = 1.93 cfs @ 11.91 hrs, Volume= 0.081 af
 Outflow = 1.93 cfs @ 11.91 hrs, Volume= 0.081 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.93 cfs @ 11.91 hrs, Volume= 0.081 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,196.04' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,195.44'	21.0" Round Culvert L= 175.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,195.44' / 2,174.62' S= 0.1190 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,202.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.90 cfs @ 11.91 hrs HW=2,196.04' (Free Discharge)

- 1=Culvert (Inlet Controls 1.90 cfs @ 2.63 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 33P: Catch Basin

Inflow Area = 0.086 ac, 74.41% Impervious, Inflow Depth = 1.97" for 1 Year event
 Inflow = 0.34 cfs @ 11.91 hrs, Volume= 0.014 af
 Outflow = 0.34 cfs @ 11.91 hrs, Volume= 0.014 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.34 cfs @ 11.91 hrs, Volume= 0.014 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,198.28' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,198.00'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,198.00' / 2,197.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,202.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.33 cfs @ 11.91 hrs HW=2,198.28' (Free Discharge)

↑1=Culvert (Inlet Controls 0.33 cfs @ 1.81 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 34P: Manhole

Inflow Area = 0.334 ac, 73.86% Impervious, Inflow Depth = 1.93" for 1 Year event
 Inflow = 1.28 cfs @ 11.91 hrs, Volume= 0.054 af
 Outflow = 1.28 cfs @ 11.91 hrs, Volume= 0.054 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.28 cfs @ 11.91 hrs, Volume= 0.054 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,209.51' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,209.00'	18.0" Round Culvert L= 90.3' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,209.00' / 2,195.92' S= 0.1449 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=1.26 cfs @ 11.91 hrs HW=2,209.50' (Free Discharge)

↑1=Culvert (Inlet Controls 1.26 cfs @ 2.42 fps)

Summary for Pond 35P: Catch Basin

Inflow Area = 0.334 ac, 73.86% Impervious, Inflow Depth = 1.93" for 1 Year event
 Inflow = 1.28 cfs @ 11.91 hrs, Volume= 0.054 af
 Outflow = 1.28 cfs @ 11.91 hrs, Volume= 0.054 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.28 cfs @ 11.91 hrs, Volume= 0.054 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,225.51' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,225.00'	18.0" Round Culvert L= 121.4' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,225.00' / 2,209.50' S= 0.1277 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,229.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.26 cfs @ 11.91 hrs HW=2,225.50' (Free Discharge)

↑1=Culvert (Inlet Controls 1.26 cfs @ 2.41 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 36P: Catch Basin

Inflow Area = 0.074 ac, 74.91% Impervious, Inflow Depth = 1.97" for 1 Year event
 Inflow = 0.29 cfs @ 11.90 hrs, Volume= 0.012 af
 Outflow = 0.29 cfs @ 11.90 hrs, Volume= 0.012 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.29 cfs @ 11.90 hrs, Volume= 0.012 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,225.76' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,225.50'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,225.50' / 2,225.14' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,229.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.28 cfs @ 11.90 hrs HW=2,225.76' (Free Discharge)

- 1=Culvert (Inlet Controls 0.28 cfs @ 1.73 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 37P: Catch Basin

Inflow Area = 0.184 ac, 73.98% Impervious, Inflow Depth = 1.92" for 1 Year event
 Inflow = 0.70 cfs @ 11.91 hrs, Volume= 0.030 af
 Outflow = 0.70 cfs @ 11.91 hrs, Volume= 0.030 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.70 cfs @ 11.91 hrs, Volume= 0.030 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,248.87' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,248.50'	18.0" Round Culvert L= 200.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,248.50' / 2,225.10' S= 0.1170 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,253.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.69 cfs @ 11.91 hrs HW=2,248.87' (Free Discharge)

- 1=Culvert (Inlet Controls 0.69 cfs @ 2.06 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 38P: Catch Basin

Inflow Area = 0.082 ac, 76.49% Impervious, Inflow Depth = 1.97" for 1 Year event
 Inflow = 0.32 cfs @ 11.91 hrs, Volume= 0.013 af
 Outflow = 0.32 cfs @ 11.91 hrs, Volume= 0.013 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.32 cfs @ 11.91 hrs, Volume= 0.013 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,249.28' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,249.00'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,249.00' / 2,248.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,253.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.31 cfs @ 11.91 hrs HW=2,249.28' (Free Discharge)

1=Culvert (Inlet Controls 0.31 cfs @ 1.79 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 43P: 12" HDPE Pipe

Inflow Area = 0.089 ac, 77.76% Impervious, Inflow Depth = 2.06" for 1 Year event
 Inflow = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af
 Outflow = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.36 cfs @ 11.91 hrs, Volume= 0.015 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,997.85' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,997.50'	12.0" Round Culvert L= 20.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,997.50' / 1,997.40' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,002.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.35 cfs @ 11.91 hrs HW=1,997.85' (Free Discharge)

1=Culvert (Barrel Controls 0.35 cfs @ 2.12 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 44P: 12" HDPE Pipe

Inflow Area = 0.172 ac, 79.89% Impervious, Inflow Depth = 2.11" for 1 Year event
 Inflow = 0.71 cfs @ 11.91 hrs, Volume= 0.030 af
 Outflow = 0.71 cfs @ 11.91 hrs, Volume= 0.030 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.71 cfs @ 11.91 hrs, Volume= 0.030 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,997.82' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,997.40'	12.0" Round Culvert L= 30.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,997.40' / 1,997.00' S= 0.0133 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,002.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.69 cfs @ 11.91 hrs HW=1,997.82' (Free Discharge)

1=Culvert (Inlet Controls 0.69 cfs @ 2.21 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 50P: 30" HDPE Pipe

Inflow Area = 4.233 ac, 33.60% Impervious, Inflow Depth = 1.20" for 1 Year event
 Inflow = 7.90 cfs @ 11.95 hrs, Volume= 0.425 af
 Outflow = 7.90 cfs @ 11.95 hrs, Volume= 0.425 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.90 cfs @ 11.95 hrs, Volume= 0.425 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,025.14' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,024.00'	30.0" Round Culvert L= 52.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,024.00' / 2,020.00' S= 0.0769 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,030.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=7.81 cfs @ 11.95 hrs HW=2,025.13' (Free Discharge)

- 1=Culvert (Inlet Controls 7.81 cfs @ 3.62 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 51P: 18" HDPE Pipe

Inflow Area = 0.406 ac, 20.38% Impervious, Inflow Depth = 0.83" for 1 Year event
 Inflow = 0.63 cfs @ 11.96 hrs, Volume= 0.028 af
 Outflow = 0.63 cfs @ 11.96 hrs, Volume= 0.028 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.63 cfs @ 11.96 hrs, Volume= 0.028 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,026.35' @ 11.96 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,026.00'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,026.00' / 2,025.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,030.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.62 cfs @ 11.96 hrs HW=2,026.35' (Free Discharge)

- 1=Culvert (Inlet Controls 0.62 cfs @ 2.00 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 52P: 30" HDPE Pipe

Inflow Area = 3.737 ac, 33.43% Impervious, Inflow Depth = 1.21" for 1 Year event
 Inflow = 6.98 cfs @ 11.95 hrs, Volume= 0.377 af
 Outflow = 6.98 cfs @ 11.95 hrs, Volume= 0.377 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.98 cfs @ 11.95 hrs, Volume= 0.377 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,059.56' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,058.50'	30.0" Round Culvert L= 301.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,058.50' / 2,026.00' S= 0.1080 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,064.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=6.88 cfs @ 11.95 hrs HW=2,059.55' (Free Discharge)

1=Culvert (Inlet Controls 6.88 cfs @ 3.50 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 53P: 18" HDPE Pipe

Inflow Area =	0.442 ac, 18.13% Impervious, Inflow Depth = 0.78" for 1 Year event
Inflow =	0.66 cfs @ 11.95 hrs, Volume= 0.029 af
Outflow =	0.66 cfs @ 11.95 hrs, Volume= 0.029 af, Atten= 0%, Lag= 0.0 min
Primary =	0.66 cfs @ 11.95 hrs, Volume= 0.029 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,060.86' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,060.50'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,060.50' / 2,060.14' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,064.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.64 cfs @ 11.95 hrs HW=2,060.85' (Free Discharge)

1=Culvert (Inlet Controls 0.64 cfs @ 2.02 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 54P: 24" HDPE Pipe

Inflow Area =	2.551 ac, 36.52% Impervious, Inflow Depth = 1.29" for 1 Year event
Inflow =	4.82 cfs @ 11.98 hrs, Volume= 0.273 af
Outflow =	4.82 cfs @ 11.98 hrs, Volume= 0.273 af, Atten= 0%, Lag= 0.0 min
Primary =	4.82 cfs @ 11.98 hrs, Volume= 0.273 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,101.94' @ 11.98 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,101.00'	24.0" Round Culvert L= 201.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,101.00' / 2,059.50' S= 0.2065 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,106.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.79 cfs @ 11.98 hrs HW=2,101.94' (Free Discharge)

1=Culvert (Inlet Controls 4.79 cfs @ 3.30 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 55P: 18" HDPE Pipe

Inflow Area = 0.351 ac, 80.16% Impervious, Inflow Depth = 2.06" for 1 Year event
 Inflow = 1.38 cfs @ 11.91 hrs, Volume= 0.060 af
 Outflow = 1.38 cfs @ 11.91 hrs, Volume= 0.060 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.38 cfs @ 11.91 hrs, Volume= 0.060 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,102.53' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,102.00'	18.0" Round Culvert L= 48.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,102.00' / 2,101.00' S= 0.0208 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,106.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.36 cfs @ 11.91 hrs HW=2,102.52' (Free Discharge)

1=Culvert (Inlet Controls 1.36 cfs @ 2.47 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 56P: 18" HDPE Pipe

Inflow Area = 0.526 ac, 38.55% Impervious, Inflow Depth = 1.33" for 1 Year event
 Inflow = 1.38 cfs @ 11.92 hrs, Volume= 0.058 af
 Outflow = 1.38 cfs @ 11.92 hrs, Volume= 0.058 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.38 cfs @ 11.92 hrs, Volume= 0.058 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,082.03' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,081.50'	18.0" Round Culvert L= 299.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,081.50' / 2,060.00' S= 0.0719 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,086.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.34 cfs @ 11.92 hrs HW=2,082.02' (Free Discharge)

1=Culvert (Inlet Controls 1.34 cfs @ 2.46 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 57P: 18" HDPE Pipe

Inflow Area = 0.112 ac, 82.97% Impervious, Inflow Depth = 2.16" for 1 Year event
 Inflow = 0.45 cfs @ 11.92 hrs, Volume= 0.020 af
 Outflow = 0.45 cfs @ 11.92 hrs, Volume= 0.020 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.45 cfs @ 11.92 hrs, Volume= 0.020 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,082.29' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,082.00'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,082.00' / 2,081.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,086.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.44 cfs @ 11.92 hrs HW=2,082.29' (Free Discharge)

- ↑1=Culvert (Inlet Controls 0.44 cfs @ 1.83 fps)
- ↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 62P: Catch Basin

Inflow Area = 1.479 ac, 4.03% Impervious, Inflow Depth = 0.35" for 1 Year event
 Inflow = 0.62 cfs @ 12.03 hrs, Volume= 0.043 af
 Outflow = 0.62 cfs @ 12.03 hrs, Volume= 0.043 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.62 cfs @ 12.03 hrs, Volume= 0.043 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,083.34' @ 12.03 hrs

Device	Routing	Invert	Outlet Devices
#1	Secondary	2,087.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Primary	2,083.00'	18.0" Round Culvert L= 207.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,083.00' / 2,080.00' S= 0.0145 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=0.61 cfs @ 12.03 hrs HW=2,083.34' (Free Discharge)

- ↑2=Culvert (Inlet Controls 0.61 cfs @ 1.99 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,083.00' (Free Discharge)

- ↑1=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 65A: Manhole

Inflow Area = 2.041 ac, 24.02% Impervious, Inflow Depth = 0.81" for 1 Year event
 Inflow = 2.22 cfs @ 11.94 hrs, Volume= 0.138 af
 Outflow = 2.22 cfs @ 11.94 hrs, Volume= 0.138 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.22 cfs @ 11.94 hrs, Volume= 0.138 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,080.16' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,079.40'	24.0" Round Culvert L= 125.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,079.40' / 2,079.00' S= 0.0032 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=2.20 cfs @ 11.94 hrs HW=2,080.16' (Free Discharge)

1=Culvert (Barrel Controls 2.20 cfs @ 2.99 fps)

Summary for Pond 65P: Catch Basin

Inflow Area = 2.041 ac, 24.02% Impervious, Inflow Depth = 0.81" for 1 Year event
 Inflow = 2.22 cfs @ 11.94 hrs, Volume= 0.138 af
 Outflow = 2.22 cfs @ 11.94 hrs, Volume= 0.138 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.22 cfs @ 11.94 hrs, Volume= 0.138 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,080.66' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,080.00'	24.0" Round Culvert L= 65.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,080.00' / 2,079.50' S= 0.0077 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,096.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.20 cfs @ 11.94 hrs HW=2,080.66' (Free Discharge)

1=Culvert (Barrel Controls 2.20 cfs @ 3.66 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 66R: (2) 24" culvert

Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,990.00' @ 0.00 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,990.00'	24.0" Round Culvert X 2.00 L= 75.0' CPP, end-section conforming to fill, Ke= 0.500

Inlet / Outlet Invert= 1,990.00' / 1,984.00' S= 0.0800 '/ Cc= 0.900
 n= 0.013 Corrugated PE, smooth interior
 #2 Primary 1,992.50' **40.0' long x 25.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60
 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,990.00' (Free Discharge)

- 1=Culvert (Controls 0.00 cfs)
- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 81: 24" culvert

Inflow Area = 2.837 ac, 0.00% Impervious, Inflow Depth = 0.65" for 1 Year event
 Inflow = 3.20 cfs @ 11.97 hrs, Volume= 0.153 af
 Outflow = 3.20 cfs @ 11.97 hrs, Volume= 0.153 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.20 cfs @ 11.97 hrs, Volume= 0.153 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,013.75' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,013.00'	24.0" Round Culvert L= 350.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,013.00' / 1,983.90' S= 0.0831 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,016.00'	40.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=3.16 cfs @ 11.97 hrs HW=2,013.75' (Free Discharge)

- 1=Culvert (Inlet Controls 3.16 cfs @ 2.95 fps)
- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 200: 36" Steel Culvert

Inflow Area = 76.410 ac, 0.43% Impervious, Inflow Depth = 0.61" for 1 Year event
 Inflow = 38.77 cfs @ 12.20 hrs, Volume= 3.859 af
 Outflow = 38.77 cfs @ 12.20 hrs, Volume= 3.859 af, Atten= 0%, Lag= 0.0 min
 Primary = 33.94 cfs @ 12.20 hrs, Volume= 3.783 af
 Secondary = 4.83 cfs @ 12.20 hrs, Volume= 0.076 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,236.50' @ 12.20 hrs
 Flood Elev= 2,248.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,234.00'	36.0" Round Culvert L= 50.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,234.00' / 2,228.00' S= 0.1200 '/ Cc= 0.900

n= 0.025 Corrugated metal
 #2 Secondary 2,236.00' **5.0' long x 25.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60
 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=33.87 cfs @ 12.20 hrs HW=2,236.50' (Free Discharge)

↑1=Culvert (Inlet Controls 33.87 cfs @ 5.38 fps)

Secondary OutFlow Max=4.76 cfs @ 12.20 hrs HW=2,236.50' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 4.76 cfs @ 1.91 fps)

Summary for Pond 201: 36" Steel Culvert

Inflow Area = 12.214 ac, 2.97% Impervious, Inflow Depth = 0.65" for 1 Year event
 Inflow = 7.26 cfs @ 12.17 hrs, Volume= 0.660 af
 Outflow = 7.26 cfs @ 12.17 hrs, Volume= 0.660 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.26 cfs @ 12.17 hrs, Volume= 0.660 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,235.02' @ 12.17 hrs

Flood Elev= 2,248.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,234.00'	36.0" Round Culvert L= 30.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,234.00' / 2,233.00' S= 0.0333 '/' Cc= 0.900 n= 0.025 Corrugated metal
#2	Secondary	2,236.00'	5.0' long x 30.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=7.22 cfs @ 12.17 hrs HW=2,235.02' (Free Discharge)

↑1=Culvert (Barrel Controls 7.22 cfs @ 5.10 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,234.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 297A: culvert

Inflow Area = 22.407 ac, 0.53% Impervious, Inflow Depth = 0.63" for 1 Year event
 Inflow = 9.14 cfs @ 12.38 hrs, Volume= 1.172 af
 Outflow = 9.14 cfs @ 12.38 hrs, Volume= 1.172 af, Atten= 0%, Lag= 0.0 min
 Primary = 9.14 cfs @ 12.38 hrs, Volume= 1.172 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,113.23' @ 12.38 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,112.00'	36.0" Round Culvert L= 93.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 2,112.00' / 2,099.00' S= 0.1398 '/' Cc= 0.900

n= 0.013 Corrugated PE, smooth interior
 #2 Primary 2,116.00' **85.0' long x 70.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60
 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=9.11 cfs @ 12.38 hrs HW=2,113.23' (Free Discharge)

- 1=Culvert (Inlet Controls 9.11 cfs @ 3.33 fps)
- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 300R: 18" Steel Culvert

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 0.61" for 1 Year event
 Inflow = 8.97 cfs @ 12.17 hrs, Volume= 0.826 af
 Outflow = 8.97 cfs @ 12.17 hrs, Volume= 0.826 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.40 cfs @ 12.17 hrs, Volume= 0.821 af
 Secondary = 0.57 cfs @ 12.17 hrs, Volume= 0.005 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,260.72' @ 12.17 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,259.00'	18.0" Round 18" Steel Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,259.00' / 2,256.00' S= 0.0750 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,260.50'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=8.38 cfs @ 12.17 hrs HW=2,260.72' (Free Discharge)

- 1=18" Steel Culvert (Inlet Controls 8.38 cfs @ 4.74 fps)

Secondary OutFlow Max=0.55 cfs @ 12.17 hrs HW=2,260.72' (Free Discharge)

- 2=Broad-Crested Rectangular Weir (Weir Controls 0.55 cfs @ 1.26 fps)

Summary for Pond 302R: culvert

Inflow Area = 7.179 ac, 0.00% Impervious, Inflow Depth = 0.74" for 1 Year event
 Inflow = 5.83 cfs @ 12.11 hrs, Volume= 0.441 af
 Outflow = 5.83 cfs @ 12.11 hrs, Volume= 0.441 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.83 cfs @ 12.11 hrs, Volume= 0.441 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,860.88' @ 12.11 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,954.00'	18.0" Round Culvert L= 100.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,954.00' / 1,952.00' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,858.00'	12.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=5.81 cfs @ 12.11 hrs HW=1,860.86' (Free Discharge)

└1=Culvert (Controls 0.00 cfs)

└2=Orifice/Grate (Orifice Controls 5.81 cfs @ 7.40 fps)

Summary for Pond MH8: Manhole

Inflow Area = 7.919 ac, 33.56% Impervious, Inflow Depth = 1.05" for 1 Year event
 Inflow = 13.27 cfs @ 11.92 hrs, Volume= 0.695 af
 Outflow = 13.27 cfs @ 11.92 hrs, Volume= 0.695 af, Atten= 0%, Lag= 0.0 min
 Primary = 13.27 cfs @ 11.92 hrs, Volume= 0.695 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,035.31' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,033.90'	36.0" Round Culvert L= 158.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,033.90' / 1,997.00' S= 0.2335 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=12.99 cfs @ 11.92 hrs HW=2,035.30' (Free Discharge)

└1=Culvert (Inlet Controls 12.99 cfs @ 4.03 fps)

Summary for Pond O1: 12" HDPE Pipe

Inflow Area = 4.430 ac, 15.50% Impervious, Inflow Depth = 0.74" for 1 Year event
 Inflow = 0.22 cfs @ 14.46 hrs, Volume= 0.272 af
 Outflow = 0.22 cfs @ 14.46 hrs, Volume= 0.272 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.22 cfs @ 14.46 hrs, Volume= 0.272 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

Peak Elev= 1,834.73' @ 14.46 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,834.50'	12.0" Round Culvert L= 334.0' Square-edged headwall, Ke= 0.500 Inlet / Outlet Invert= 1,834.50' / 1,780.00' S= 0.1632 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=0.22 cfs @ 14.46 hrs HW=1,834.73' (Free Discharge)

└1=Culvert (Inlet Controls 0.22 cfs @ 1.63 fps)

Summary for Reach 1R: overland flow

Inflow Area = 16.946 ac, 22.50% Impervious, Inflow Depth = 3.44" for 10 Year event
Inflow = 68.85 cfs @ 11.94 hrs, Volume= 4.858 af
Outflow = 68.78 cfs @ 11.95 hrs, Volume= 4.858 af, Atten= 0%, Lag= 0.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 11.63 fps, Min. Travel Time= 0.1 min
Avg. Velocity = 2.90 fps, Avg. Travel Time= 0.4 min

Peak Storage= 445 cf @ 11.95 hrs
Average Depth at Peak Storage= 1.57'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 103.60 cfs

3.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 0.5 '/' Top Width= 5.00'
Length= 75.0' Slope= 0.1733 '/'
Inlet Invert= 1,963.00', Outlet Invert= 1,950.00'



Summary for Reach 3: Rip Rap Channel

Inflow Area = 130.257 ac, 1.76% Impervious, Inflow Depth = 2.84" for 10 Year event
Inflow = 298.44 cfs @ 12.26 hrs, Volume= 30.853 af
Outflow = 298.39 cfs @ 12.26 hrs, Volume= 30.853 af, Atten= 0%, Lag= 0.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 24.76 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 3.75 fps, Avg. Travel Time= 0.2 min

Peak Storage= 614 cf @ 12.26 hrs
Average Depth at Peak Storage= 2.22'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 257.29 cfs

5.00' x 2.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 0.2 '/' Top Width= 5.80'
Length= 51.0' Slope= 0.5098 '/'
Inlet Invert= 1,740.00', Outlet Invert= 1,714.00'




Summary for Reach 3R: Swale along RR Tracks

Inflow Area = 8.723 ac, 9.84% Impervious, Inflow Depth = 2.77" for 10 Year event
Inflow = 26.28 cfs @ 12.07 hrs, Volume= 2.013 af
Outflow = 21.15 cfs @ 12.21 hrs, Volume= 2.013 af, Atten= 20%, Lag= 8.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.93 fps, Min. Travel Time= 4.4 min
Avg. Velocity = 0.99 fps, Avg. Travel Time= 17.6 min

Peak Storage= 5,678 cf @ 12.13 hrs
Average Depth at Peak Storage= 1.22'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 103.07 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 12.00'
Length= 1,045.0' Slope= 0.0172 '/'
Inlet Invert= 1,750.00', Outlet Invert= 1,732.00'

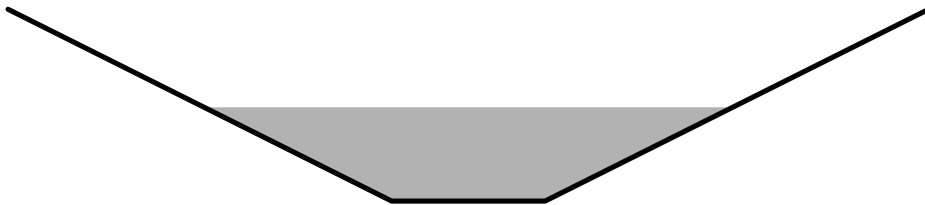

Summary for Reach 5: Stream Channel

Inflow Area = 33.644 ac, 4.16% Impervious, Inflow Depth = 2.92" for 10 Year event
Inflow = 73.70 cfs @ 12.09 hrs, Volume= 8.196 af
Outflow = 73.54 cfs @ 12.10 hrs, Volume= 8.196 af, Atten= 0%, Lag= 0.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 12.75 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 3.20 fps, Avg. Travel Time= 0.8 min

Peak Storage= 926 cf @ 12.09 hrs
Average Depth at Peak Storage= 0.97'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 1,318.86 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 160.0' Slope= 0.3000 '/'
Inlet Invert= 2,060.00', Outlet Invert= 2,012.00'



Summary for Reach 5A: Stream Channel

Inflow Area = 41.552 ac, 5.67% Impervious, Inflow Depth = 2.93" for 10 Year event
Inflow = 73.86 cfs @ 12.10 hrs, Volume= 10.142 af
Outflow = 73.20 cfs @ 12.11 hrs, Volume= 10.142 af, Atten= 1%, Lag= 1.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 11.47 fps, Min. Travel Time= 0.5 min
Avg. Velocity = 2.19 fps, Avg. Travel Time= 2.6 min

Peak Storage= 2,188 cf @ 12.10 hrs
Average Depth at Peak Storage= 1.05'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 1,138.43 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 340.0' Slope= 0.2235 '/'
Inlet Invert= 2,012.00', Outlet Invert= 1,936.00'



Summary for Reach 5B: Stream Channel

Inflow Area = 46.285 ac, 5.15% Impervious, Inflow Depth = 2.92" for 10 Year event
Inflow = 79.56 cfs @ 12.09 hrs, Volume= 11.249 af
Outflow = 79.26 cfs @ 12.10 hrs, Volume= 11.249 af, Atten= 0%, Lag= 0.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Max. Velocity= 10.55 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 1.97 fps, Avg. Travel Time= 1.0 min

Peak Storage= 903 cf @ 12.09 hrs
Average Depth at Peak Storage= 1.18'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 983.02 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 120.0' Slope= 0.1667 '/'
Inlet Invert= 1,936.00', Outlet Invert= 1,916.00'



Summary for Reach 5C: Stream Channel

Inflow Area = 67.707 ac, 9.43% Impervious, Inflow Depth = 3.03" for 10 Year event
Inflow = 111.92 cfs @ 12.14 hrs, Volume= 17.083 af
Outflow = 111.78 cfs @ 12.16 hrs, Volume= 17.083 af, Atten= 0%, Lag= 0.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 11.21 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 2.14 fps, Avg. Travel Time= 2.2 min

Peak Storage= 2,766 cf @ 12.15 hrs
Average Depth at Peak Storage= 1.45'
Bank-Full Depth= 4.00', Capacity at Bank-Full= 937.61 cfs

4.00' x 4.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 20.00'
Length= 277.0' Slope= 0.1516 '/'
Inlet Invert= 1,916.00', Outlet Invert= 1,874.00'




Summary for Reach 5D: Stream Channel

Inflow Area = 75.446 ac, 8.80% Impervious, Inflow Depth = 2.98" for 10 Year event
Inflow = 122.90 cfs @ 12.10 hrs, Volume= 18.750 af
Outflow = 122.86 cfs @ 12.11 hrs, Volume= 18.750 af, Atten= 0%, Lag= 0.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 15.56 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 3.17 fps, Avg. Travel Time= 1.6 min

Peak Storage= 2,369 cf @ 12.11 hrs
Average Depth at Peak Storage= 1.55'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 357.03 cfs

2.00' x 2.50' deep channel, n= 0.040
Side Slope Z-value= 2.0 '/' Top Width= 12.00'
Length= 300.0' Slope= 0.2067 '/'
Inlet Invert= 1,874.00', Outlet Invert= 1,812.00'

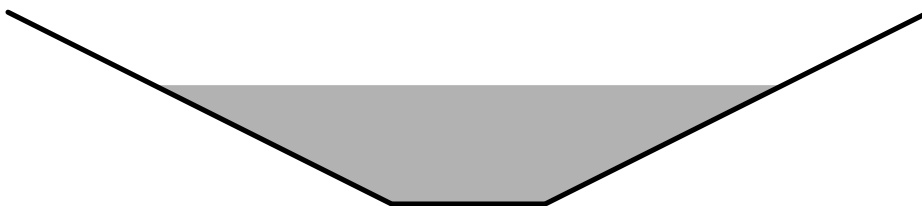

Summary for Reach 5R: roadside swale

Inflow Area = 4.919 ac, 18.04% Impervious, Inflow Depth = 2.96" for 10 Year event
Inflow = 18.56 cfs @ 12.01 hrs, Volume= 1.211 af
Outflow = 17.29 cfs @ 12.06 hrs, Volume= 1.211 af, Atten= 7%, Lag= 3.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.51 fps, Min. Travel Time= 1.8 min
Avg. Velocity = 1.33 fps, Avg. Travel Time= 7.6 min

Peak Storage= 1,908 cf @ 12.03 hrs
Average Depth at Peak Storage= 1.04'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 61.25 cfs

2.00' x 2.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/ Top Width= 6.00'
Length= 607.0' Slope= 0.0626 '/
Inlet Invert= 2,122.00', Outlet Invert= 2,084.00'



Summary for Reach 6: SWALE

Inflow Area = 21.422 ac, 18.68% Impervious, Inflow Depth = 3.27" for 10 Year event
Inflow = 39.33 cfs @ 12.19 hrs, Volume= 5.834 af
Outflow = 39.13 cfs @ 12.22 hrs, Volume= 5.834 af, Atten= 1%, Lag= 1.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.03 fps, Min. Travel Time= 1.0 min
Avg. Velocity = 0.90 fps, Avg. Travel Time= 5.5 min

Peak Storage= 2,337 cf @ 12.20 hrs
Average Depth at Peak Storage= 1.43'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 108.04 cfs

4.00' x 2.50' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/ Top Width= 9.00'
Length= 300.0' Slope= 0.0300 '/
Inlet Invert= 1,939.00', Outlet Invert= 1,930.00'



Summary for Reach 6R: Clean Swale

Inflow Area = 22.295 ac, 15.82% Impervious, Inflow Depth > 3.16" for 10 Year event
Inflow = 46.82 cfs @ 12.16 hrs, Volume= 5.879 af
Outflow = 46.53 cfs @ 12.18 hrs, Volume= 5.879 af, Atten= 1%, Lag= 1.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.79 fps, Min. Travel Time= 0.5 min
Avg. Velocity = 1.63 fps, Avg. Travel Time= 2.5 min

Peak Storage= 1,303 cf @ 12.16 hrs
Average Depth at Peak Storage= 1.21'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 139.88 cfs

2.00' x 2.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 245.0' Slope= 0.0490 '/'
Inlet Invert= 1,842.00', Outlet Invert= 1,830.00'




Summary for Reach 7A: CULVERT

Inflow Area = 0.577 ac, 11.54% Impervious, Inflow Depth = 3.09" for 10 Year event
Inflow = 3.13 cfs @ 11.98 hrs, Volume= 0.148 af
Outflow = 3.09 cfs @ 11.98 hrs, Volume= 0.148 af, Atten= 1%, Lag= 0.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.39 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 2.05 fps, Avg. Travel Time= 0.9 min

Peak Storage= 56 cf @ 11.98 hrs
Average Depth at Peak Storage= 0.60'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 4.70 cfs

12.0" Round Pipe
n= 0.013 Corrugated PE, smooth interior
Length= 115.0' Slope= 0.0174 '/'
Inlet Invert= 1,900.00', Outlet Invert= 1,898.00'




Summary for Reach 7B: Existing Ditch

Inflow Area = 0.577 ac, 11.54% Impervious, Inflow Depth = 3.09" for 10 Year event
Inflow = 3.09 cfs @ 11.98 hrs, Volume= 0.148 af
Outflow = 3.05 cfs @ 12.00 hrs, Volume= 0.148 af, Atten= 1%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.91 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 1.33 fps, Avg. Travel Time= 1.6 min

Peak Storage= 78 cf @ 11.99 hrs
Average Depth at Peak Storage= 0.28'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 172.60 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/ Top Width= 7.00'
Length= 125.0' Slope= 0.1280 '/
Inlet Invert= 1,896.00', Outlet Invert= 1,880.00'

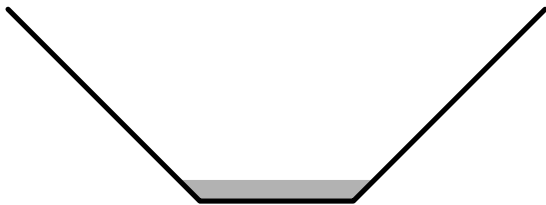


Summary for Reach 7C: Existing Ditch

Inflow Area = 12.983 ac, 1.90% Impervious, Inflow Depth = 2.73" for 10 Year event
Inflow = 39.44 cfs @ 12.07 hrs, Volume= 2.948 af
Outflow = 38.80 cfs @ 12.10 hrs, Volume= 2.948 af, Atten= 2%, Lag= 2.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.17 fps, Min. Travel Time= 1.1 min
Avg. Velocity = 1.50 fps, Avg. Travel Time= 5.9 min

Peak Storage= 2,532 cf @ 12.08 hrs
Average Depth at Peak Storage= 1.40'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 123.26 cfs

2.00' x 2.50' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/ Top Width= 7.00'
Length= 530.0' Slope= 0.1020 '/
Inlet Invert= 1,880.00', Outlet Invert= 1,825.94'

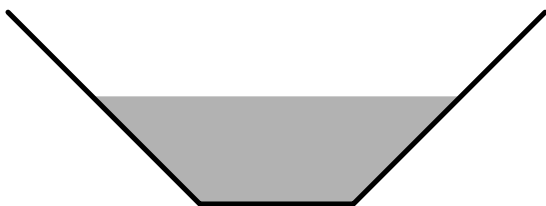

Summary for Reach 8: Stream Channel

Inflow Area = 92.038 ac, 7.66% Impervious, Inflow Depth = 2.95" for 10 Year event
Inflow = 165.27 cfs @ 12.09 hrs, Volume= 22.599 af
Outflow = 164.87 cfs @ 12.10 hrs, Volume= 22.599 af, Atten= 0%, Lag= 0.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Max. Velocity= 12.90 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 2.44 fps, Avg. Travel Time= 1.7 min

Peak Storage= 3,135 cf @ 12.10 hrs
Average Depth at Peak Storage= 1.25'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 473.46 cfs

4.00' x 2.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 5.0 '/ Top Width= 24.00'
Length= 245.0' Slope= 0.2694 '/
Inlet Invert= 1,816.00', Outlet Invert= 1,750.00'



Summary for Reach 9R: swale

Inflow Area = 0.723 ac, 0.00% Impervious, Inflow Depth = 2.90" for 10 Year event
Inflow = 3.49 cfs @ 11.99 hrs, Volume= 0.175 af
Outflow = 3.38 cfs @ 12.03 hrs, Volume= 0.175 af, Atten= 3%, Lag= 2.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.24 fps, Min. Travel Time= 1.4 min
Avg. Velocity = 0.79 fps, Avg. Travel Time= 5.9 min

Peak Storage= 294 cf @ 12.01 hrs
Average Depth at Peak Storage= 0.47'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 11.64 cfs

2.00' x 1.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 0.5 '/ Top Width= 3.00'
Length= 280.0' Slope= 0.0179 '/
Inlet Invert= 2,225.00', Outlet Invert= 2,220.00'



Summary for Reach 11R: Overland Flow

Inflow Area = 20.182 ac, 16.70% Impervious, Inflow Depth > 3.17" for 10 Year event
Inflow = 44.73 cfs @ 12.00 hrs, Volume= 5.335 af
Outflow = 38.99 cfs @ 12.15 hrs, Volume= 5.335 af, Atten= 13%, Lag= 9.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.55 fps, Min. Travel Time= 5.0 min
Avg. Velocity = 0.44 fps, Avg. Travel Time= 28.8 min

Peak Storage= 11,678 cf @ 12.07 hrs
Average Depth at Peak Storage= 0.20'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 626.02 cfs

75.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 15.0 '/' Top Width= 105.00'
Length= 760.0' Slope= 0.1724 '/'
Inlet Invert= 1,973.00', Outlet Invert= 1,842.00'



Summary for Reach 12R: Overland Flow

Inflow Area = 2.112 ac, 7.43% Impervious, Inflow Depth = 3.09" for 10 Year event
Inflow = 8.75 cfs @ 12.06 hrs, Volume= 0.544 af
Outflow = 8.02 cfs @ 12.18 hrs, Volume= 0.544 af, Atten= 8%, Lag= 7.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.04 fps, Min. Travel Time= 4.6 min
Avg. Velocity = 0.52 fps, Avg. Travel Time= 17.8 min

Peak Storage= 2,224 cf @ 12.11 hrs
Average Depth at Peak Storage= 0.12'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 315.94 cfs

30.00' x 1.00' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 15.0 '/' Top Width= 60.00'
Length= 562.0' Slope= 0.2100 '/'
Inlet Invert= 1,960.00', Outlet Invert= 1,842.00'



Summary for Reach 13: Channel at tracks

Inflow Area = 100.761 ac, 7.85% Impervious, Inflow Depth = 2.93" for 10 Year event
Inflow = 178.33 cfs @ 12.15 hrs, Volume= 24.612 af
Outflow = 177.51 cfs @ 12.18 hrs, Volume= 24.612 af, Atten= 0%, Lag= 1.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.07 fps, Min. Travel Time= 0.8 min
Avg. Velocity = 1.40 fps, Avg. Travel Time= 4.3 min

Peak Storage= 9,056 cf @ 12.16 hrs
Average Depth at Peak Storage= 2.06'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 423.37 cfs

4.00' x 3.00' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 4.0 '/' Top Width= 28.00'
Length= 360.0' Slope= 0.0444 '/'
Inlet Invert= 1,750.00', Outlet Invert= 1,734.00'



Summary for Reach 40R: Swale

Inflow Area = 19.549 ac, 16.10% Impervious, Inflow Depth > 3.15" for 10 Year event
Inflow = 42.54 cfs @ 12.00 hrs, Volume= 5.125 af
Outflow = 42.08 cfs @ 12.01 hrs, Volume= 5.125 af, Atten= 1%, Lag= 0.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Max. Velocity= 6.45 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 1.16 fps, Avg. Travel Time= 1.4 min

Peak Storage= 623 cf @ 12.00 hrs
Average Depth at Peak Storage= 1.29'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 106.53 cfs

2.50' x 2.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 10.50'
Length= 95.0' Slope= 0.0411 '/'
Inlet Invert= 1,983.90', Outlet Invert= 1,980.00'



Summary for Reach 51R: Swale

Inflow Area = 4.233 ac, 33.60% Impervious, Inflow Depth = 3.91" for 10 Year event
Inflow = 25.69 cfs @ 11.95 hrs, Volume= 1.378 af
Outflow = 24.91 cfs @ 11.99 hrs, Volume= 1.378 af, Atten= 3%, Lag= 2.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.30 fps, Min. Travel Time= 1.4 min
Avg. Velocity = 1.61 fps, Avg. Travel Time= 5.5 min

Peak Storage= 2,137 cf @ 11.96 hrs
Average Depth at Peak Storage= 0.87'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 162.52 cfs

2.00' x 2.00' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 3.0 '/ Top Width= 14.00'
Length= 535.0' Slope= 0.0374 '/
Inlet Invert= 2,020.00', Outlet Invert= 2,000.00'




Summary for Reach 58a: Swale along RR Tracks

Inflow Area = 34.486 ac, 12.14% Impervious, Inflow Depth = 3.10" for 10 Year event
Inflow = 86.57 cfs @ 12.15 hrs, Volume= 8.920 af
Outflow = 85.58 cfs @ 12.19 hrs, Volume= 8.919 af, Atten= 1%, Lag= 2.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.70 fps, Min. Travel Time= 1.4 min
Avg. Velocity = 1.18 fps, Avg. Travel Time= 7.7 min

Peak Storage= 6,944 cf @ 12.17 hrs
Average Depth at Peak Storage= 2.08'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 130.53 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/ Top Width= 12.00'
Length= 543.0' Slope= 0.0276 '/
Inlet Invert= 1,788.00', Outlet Invert= 1,773.00'

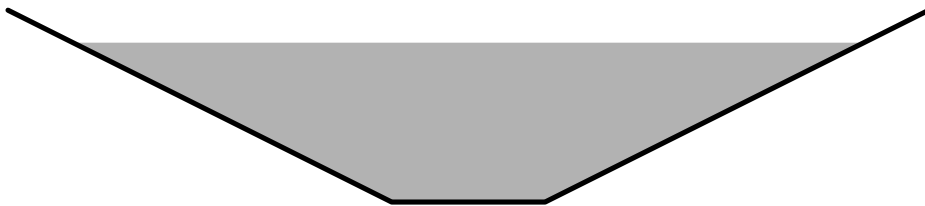

Summary for Reach 63R: OVERLAND

Inflow Area = 2.621 ac, 35.67% Impervious, Inflow Depth = 3.45" for 10 Year event
Inflow = 13.23 cfs @ 11.96 hrs, Volume= 0.753 af
Outflow = 13.10 cfs @ 11.97 hrs, Volume= 0.753 af, Atten= 1%, Lag= 0.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.26 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 1.21 fps, Avg. Travel Time= 1.7 min

Peak Storage= 316 cf @ 11.97 hrs
Average Depth at Peak Storage= 0.10'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 290.92 cfs

20.00' x 0.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 50.0 '/' Top Width= 70.00'
Length= 126.0' Slope= 0.3095 '/'
Inlet Invert= 2,079.00', Outlet Invert= 2,040.00'



Summary for Reach 64R: Swale

Inflow Area = 7.908 ac, 12.10% Impervious, Inflow Depth > 2.95" for 10 Year event
Inflow = 5.49 cfs @ 12.43 hrs, Volume= 1.947 af
Outflow = 5.45 cfs @ 12.50 hrs, Volume= 1.946 af, Atten= 1%, Lag= 4.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.68 fps, Min. Travel Time= 2.2 min
Avg. Velocity = 0.53 fps, Avg. Travel Time= 6.9 min

Peak Storage= 722 cf @ 12.46 hrs
Average Depth at Peak Storage= 0.87'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 31.81 cfs

2.00' x 2.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 222.0' Slope= 0.0045 '/'
Inlet Invert= 2,016.50', Outlet Invert= 2,015.50'



Summary for Reach 69R: Wetland Flow

Inflow Area = 3.895 ac, 4.53% Impervious, Inflow Depth = 3.18" for 10 Year event
Inflow = 20.51 cfs @ 11.99 hrs, Volume= 1.034 af
Outflow = 16.96 cfs @ 12.15 hrs, Volume= 1.034 af, Atten= 17%, Lag= 9.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.34 fps, Min. Travel Time= 6.1 min
Avg. Velocity = 0.29 fps, Avg. Travel Time= 28.1 min

Peak Storage= 6,222 cf @ 12.04 hrs
Average Depth at Peak Storage= 0.14'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 172.83 cfs

76.00' x 0.50' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 100.0 ' Top Width= 176.00'
Length= 487.0' Slope= 0.0657 '
Inlet Invert= 2,098.00', Outlet Invert= 2,066.00'



Summary for Reach 197: Stream Channel

Inflow Area = 121.913 ac, 1.88% Impervious, Inflow Depth = 2.84" for 10 Year event
Inflow = 291.10 cfs @ 12.24 hrs, Volume= 28.838 af
Outflow = 290.13 cfs @ 12.26 hrs, Volume= 28.838 af, Atten= 0%, Lag= 1.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 13.04 fps, Min. Travel Time= 0.8 min
Avg. Velocity = 3.03 fps, Avg. Travel Time= 3.3 min

Peak Storage= 13,352 cf @ 12.25 hrs
Average Depth at Peak Storage= 1.01'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 12,157.92 cfs

15.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 7.0 ' Top Width= 99.00'
Length= 599.0' Slope= 0.2771 '
Inlet Invert= 1,910.00', Outlet Invert= 1,744.00'




Summary for Reach 197A: Stream Channel

Inflow Area = 114.943 ac, 1.85% Impervious, Inflow Depth = 2.83" for 10 Year event
Inflow = 286.56 cfs @ 12.22 hrs, Volume= 27.130 af
Outflow = 285.42 cfs @ 12.24 hrs, Volume= 27.130 af, Atten= 0%, Lag= 1.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 12.01 fps, Min. Travel Time= 0.8 min
Avg. Velocity = 2.57 fps, Avg. Travel Time= 3.9 min

Peak Storage= 14,314 cf @ 12.23 hrs
Average Depth at Peak Storage= 1.99'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 3,907.44 cfs

4.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 52.00'
Length= 601.0' Slope= 0.1331 '/'
Inlet Invert= 1,990.00', Outlet Invert= 1,910.00'

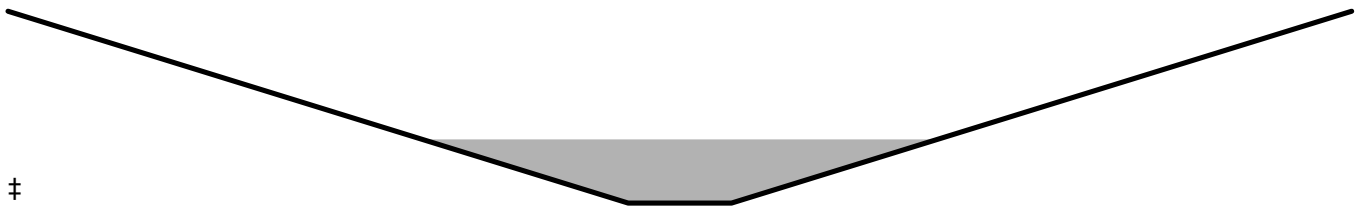


Summary for Reach 197B: Stream Channel

Inflow Area = 110.322 ac, 1.58% Impervious, Inflow Depth = 2.83" for 10 Year event
Inflow = 283.45 cfs @ 12.21 hrs, Volume= 26.006 af
Outflow = 282.80 cfs @ 12.22 hrs, Volume= 26.006 af, Atten= 0%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 10.74 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 2.25 fps, Avg. Travel Time= 1.9 min

Peak Storage= 6,646 cf @ 12.22 hrs
Average Depth at Peak Storage= 2.12'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 3,373.30 cfs

4.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 52.00'
Length= 252.0' Slope= 0.0992 '/'
Inlet Invert= 2,015.00', Outlet Invert= 1,990.00'

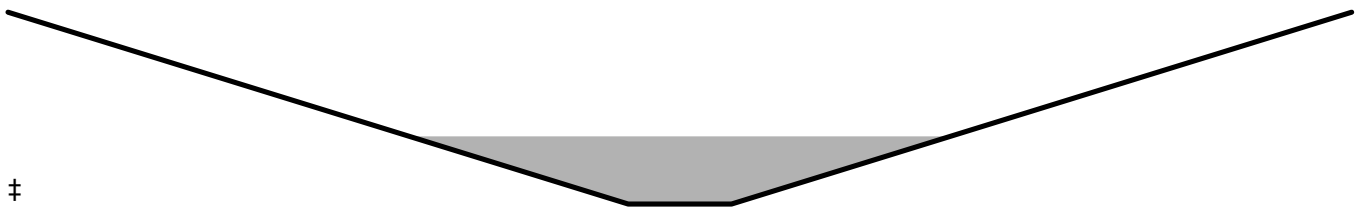


Summary for Reach 197C: Stream Channel

Inflow Area = 95.895 ac, 1.22% Impervious, Inflow Depth = 2.84" for 10 Year event
Inflow = 263.71 cfs @ 12.21 hrs, Volume= 22.684 af
Outflow = 262.56 cfs @ 12.23 hrs, Volume= 22.684 af, Atten= 0%, Lag= 1.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 12.37 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 4.47 fps, Avg. Travel Time= 1.6 min

Peak Storage= 9,070 cf @ 12.22 hrs
Average Depth at Peak Storage= 1.86'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 4,183.47 cfs

4.00' x 6.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/ Top Width= 52.00'
Length= 426.0' Slope= 0.1526 '/
Inlet Invert= 2,080.00', Outlet Invert= 2,015.00'

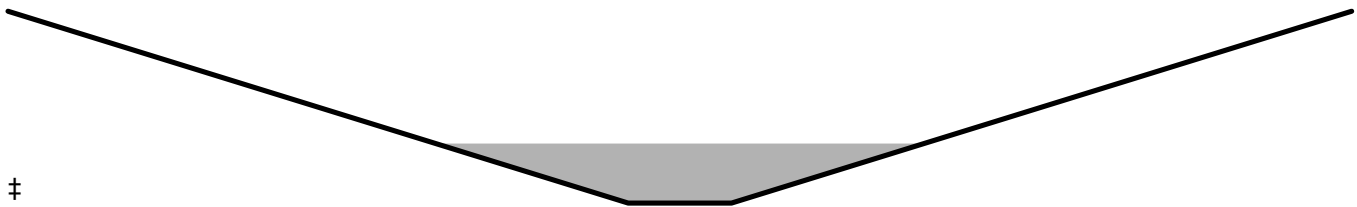


Summary for Reach 198: Stream Channel

Inflow Area = 88.624 ac, 0.78% Impervious, Inflow Depth = 2.82" for 10 Year event
Inflow = 252.17 cfs @ 12.17 hrs, Volume= 20.813 af
Outflow = 249.95 cfs @ 12.22 hrs, Volume= 20.813 af, Atten= 1%, Lag= 2.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 12.67 fps, Min. Travel Time= 1.7 min
Avg. Velocity = 4.63 fps, Avg. Travel Time= 4.5 min

Peak Storage= 24,905 cf @ 12.19 hrs
Average Depth at Peak Storage= 1.78'
Bank-Full Depth= 6.00', Capacity at Bank-Full= 4,399.92 cfs

4.00' x 6.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 4.0 '/ Top Width= 52.00'
Length= 1,262.0' Slope= 0.1688 '/
Inlet Invert= 2,228.00', Outlet Invert= 2,015.00'

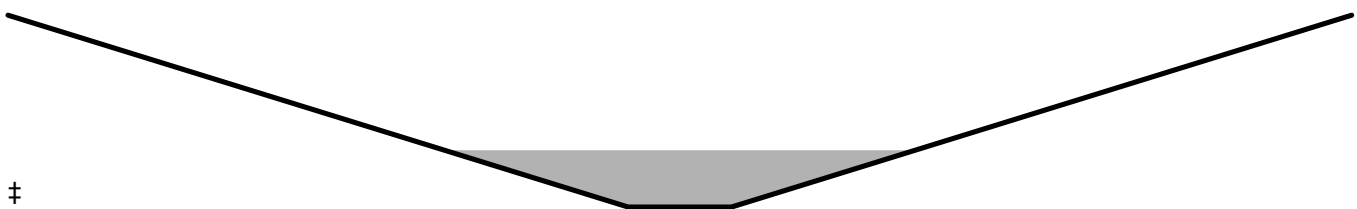

Summary for Reach 199: Overland Flow

Inflow Area = 12.214 ac, 2.97% Impervious, Inflow Depth = 2.90" for 10 Year event
Inflow = 37.69 cfs @ 12.15 hrs, Volume= 2.950 af
Outflow = 37.39 cfs @ 12.17 hrs, Volume= 2.950 af, Atten= 1%, Lag= 1.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.41 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 1.28 fps, Avg. Travel Time= 3.2 min

Peak Storage= 2,132 cf @ 12.16 hrs
Average Depth at Peak Storage= 0.13'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 458.82 cfs

50.00' x 0.50' deep channel, n= 0.040 Earth, dense weeds
Side Slope Z-value= 100.0 ' Top Width= 150.00'
Length= 250.0' Slope= 0.2640 '
Inlet Invert= 2,234.00', Outlet Invert= 2,168.00'




Summary for Reach 295: Roadside Channel

Inflow Area = 27.327 ac, 3.68% Impervious, Inflow Depth = 2.87" for 10 Year event
Inflow = 56.52 cfs @ 12.31 hrs, Volume= 6.539 af
Outflow = 56.29 cfs @ 12.33 hrs, Volume= 6.539 af, Atten= 0%, Lag= 1.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.01 fps, Min. Travel Time= 0.7 min
Avg. Velocity = 1.94 fps, Avg. Travel Time= 2.4 min

Peak Storage= 2,252 cf @ 12.32 hrs
Average Depth at Peak Storage= 1.67'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 144.47 cfs

1.50' x 2.50' deep channel, n= 0.050 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 ' Top Width= 11.50'
Length= 280.0' Slope= 0.0643 '
Inlet Invert= 2,084.00', Outlet Invert= 2,066.00'

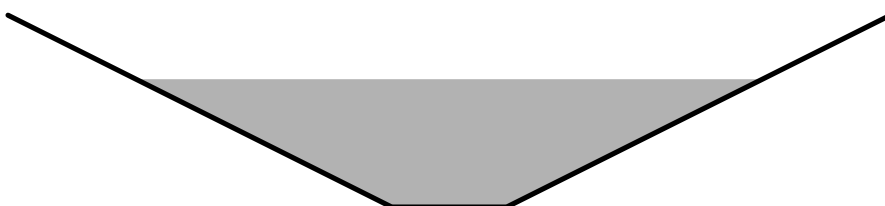

Summary for Reach 296: Wetland Flow

Inflow Area = 22.407 ac, 0.53% Impervious, Inflow Depth = 2.85" for 10 Year event
Inflow = 52.89 cfs @ 12.25 hrs, Volume= 5.327 af
Outflow = 51.91 cfs @ 12.32 hrs, Volume= 5.327 af, Atten= 2%, Lag= 4.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.92 fps, Min. Travel Time= 2.4 min
Avg. Velocity = 0.88 fps, Avg. Travel Time= 8.1 min

Peak Storage= 7,607 cf @ 12.27 hrs
Average Depth at Peak Storage= 0.92'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 251.85 cfs

12.00' x 2.00' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 8.0 '/' Top Width= 44.00'
Length= 427.0' Slope= 0.0328 '/'
Inlet Invert= 2,098.00', Outlet Invert= 2,084.00'



Summary for Reach 297: Overland Flow

Inflow Area = 17.082 ac, 0.44% Impervious, Inflow Depth = 2.81" for 10 Year event
Inflow = 49.30 cfs @ 12.24 hrs, Volume= 3.999 af
Outflow = 49.13 cfs @ 12.25 hrs, Volume= 3.999 af, Atten= 0%, Lag= 0.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.26 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 1.99 fps, Avg. Travel Time= 1.6 min

Peak Storage= 1,324 cf @ 12.24 hrs
Average Depth at Peak Storage= 0.18'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 358.18 cfs

30.00' x 0.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 50.0 '/' Top Width= 80.00'
Length= 195.0' Slope= 0.2872 '/'
Inlet Invert= 2,170.00', Outlet Invert= 2,114.00'



Summary for Reach 298: Wetland Flow

Inflow Area = 17.082 ac, 0.44% Impervious, Inflow Depth = 2.81" for 10 Year event
Inflow = 50.68 cfs @ 12.15 hrs, Volume= 3.999 af
Outflow = 49.30 cfs @ 12.24 hrs, Volume= 3.999 af, Atten= 3%, Lag= 5.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.15 fps, Min. Travel Time= 3.2 min
Avg. Velocity = 0.56 fps, Avg. Travel Time= 12.1 min

Peak Storage= 9,402 cf @ 12.18 hrs
Average Depth at Peak Storage= 0.21'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 802.14 cfs

100.00' x 1.00' deep channel, n= 0.070 Sluggish weedy reaches w/pools
Side Slope Z-value= 50.0 ' Top Width= 200.00'
Length= 408.0' Slope= 0.0931 '
Inlet Invert= 2,208.00', Outlet Invert= 2,170.00'



Summary for Reach 299: Overland Flow

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10 Year event
Inflow = 49.29 cfs @ 12.14 hrs, Volume= 3.824 af
Outflow = 49.11 cfs @ 12.15 hrs, Volume= 3.824 af, Atten= 0%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.95 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 2.15 fps, Avg. Travel Time= 1.0 min

Peak Storage= 1,118 cf @ 12.15 hrs
Average Depth at Peak Storage= 0.32'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 134.95 cfs

10.00' x 0.50' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 50.0 ' Top Width= 60.00'
Length= 135.0' Slope= 0.3481 '
Inlet Invert= 2,255.00', Outlet Invert= 2,208.00'



Summary for Reach O3: Overland Flow

Inflow = 22.52 cfs @ 11.99 hrs, Volume= 0.640 af
Outflow = 21.94 cfs @ 12.01 hrs, Volume= 0.640 af, Atten= 3%, Lag= 1.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.00 fps, Min. Travel Time= 0.7 min
Avg. Velocity = 0.83 fps, Avg. Travel Time= 3.6 min

Peak Storage= 997 cf @ 12.00 hrs
Average Depth at Peak Storage= 0.13'
Bank-Full Depth= 0.25', Capacity at Bank-Full= 78.90 cfs

30.00' x 0.25' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 100.0 ' Top Width= 80.00'
Length= 178.0' Slope= 0.1404 '
Inlet Invert= 1,838.00', Outlet Invert= 1,813.00'



Summary for Reach O4: Swale

Inflow = 21.94 cfs @ 12.01 hrs, Volume= 0.640 af
Outflow = 21.25 cfs @ 12.03 hrs, Volume= 0.640 af, Atten= 3%, Lag= 1.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.10 fps, Min. Travel Time= 0.8 min
Avg. Velocity = 1.44 fps, Avg. Travel Time= 3.3 min

Peak Storage= 1,010 cf @ 12.02 hrs
Average Depth at Peak Storage= 0.92'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 59.96 cfs

2.00' x 1.50' deep channel, n= 0.033 Earth, grassed & winding
Side Slope Z-value= 2.0 ' Top Width= 8.00'
Length= 286.0' Slope= 0.0385 '
Inlet Invert= 1,810.00', Outlet Invert= 1,799.00'



Summary for Reach X1: Swale

Inflow Area = 2.495 ac, 6.71% Impervious, Inflow Depth = 2.53" for 10 Year event
Inflow = 10.37 cfs @ 12.01 hrs, Volume= 0.526 af
Outflow = 10.00 cfs @ 12.03 hrs, Volume= 0.526 af, Atten= 4%, Lag= 1.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.24 fps, Min. Travel Time= 0.5 min
Avg. Velocity = 1.40 fps, Avg. Travel Time= 2.4 min

Peak Storage= 335 cf @ 12.01 hrs
Average Depth at Peak Storage= 0.54'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 153.60 cfs

2.00' x 2.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 200.0' Slope= 0.1050 '/'
Inlet Invert= 1,794.00', Outlet Invert= 1,773.00'



Summary for Pond 1P: Catch Basin/Culvert

Inflow Area = 1.239 ac, 57.09% Impervious, Inflow Depth = 4.63" for 10 Year event
 Inflow = 8.44 cfs @ 12.01 hrs, Volume= 0.478 af
 Outflow = 8.44 cfs @ 12.01 hrs, Volume= 0.478 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.44 cfs @ 12.01 hrs, Volume= 0.478 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,981.10' @ 12.01 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,980.00'	36.0" Round Culvert L= 200.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,980.00' / 1,964.00' S= 0.0800 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,002.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=8.37 cfs @ 12.01 hrs HW=1,981.10' (Free Discharge)

- 1=Culvert (Inlet Controls 8.37 cfs @ 3.57 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 2P: Catch Basin

Inflow Area = 8.528 ac, 36.42% Impervious, Inflow Depth = 3.56" for 10 Year event
 Inflow = 49.00 cfs @ 11.93 hrs, Volume= 2.533 af
 Outflow = 49.00 cfs @ 11.93 hrs, Volume= 2.533 af, Atten= 0%, Lag= 0.0 min
 Primary = 49.00 cfs @ 11.93 hrs, Volume= 2.533 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,999.69' @ 11.93 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,996.00'	36.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,996.00' / 1,995.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,002.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=48.20 cfs @ 11.93 hrs HW=1,999.64' (Free Discharge)

- 1=Culvert (Barrel Controls 48.20 cfs @ 7.14 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 2R: 48" CMP Culvert

Inflow Area = 130.257 ac, 1.76% Impervious, Inflow Depth = 2.84" for 10 Year event
 Inflow = 298.44 cfs @ 12.26 hrs, Volume= 30.853 af
 Outflow = 298.44 cfs @ 12.26 hrs, Volume= 30.853 af, Atten= 0%, Lag= 0.0 min
 Primary = 139.43 cfs @ 12.26 hrs, Volume= 25.036 af
 Secondary = 159.00 cfs @ 12.26 hrs, Volume= 5.817 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,749.31' @ 12.26 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,742.00'	48.0" Round Culvert L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 1,742.00' / 1,740.00' S= 0.0667 '/ Cc= 0.900 n= 0.025
#2	Secondary	1,746.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=139.33 cfs @ 12.26 hrs HW=1,749.30' (Free Discharge)

↳1=**Culvert** (Inlet Controls 139.33 cfs @ 11.09 fps)

Secondary OutFlow Max=158.44 cfs @ 12.26 hrs HW=1,749.30' (Free Discharge)

↳2=**Broad-Crested Rectangular Weir** (Weir Controls 158.44 cfs @ 4.80 fps)

Summary for Pond 3P: Catch Basin

Inflow Area = 0.284 ac, 69.74% Impervious, Inflow Depth = 4.97" for 10 Year event
 Inflow = 2.57 cfs @ 11.91 hrs, Volume= 0.118 af
 Outflow = 2.57 cfs @ 11.91 hrs, Volume= 0.118 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.57 cfs @ 11.91 hrs, Volume= 0.118 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,009.93' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,009.19'	18.0" Round Culvert L= 304.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,009.19' / 1,997.21' S= 0.0394 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,014.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.54 cfs @ 11.91 hrs HW=2,009.93' (Free Discharge)

↳1=**Culvert** (Inlet Controls 2.54 cfs @ 2.93 fps)

↳2=**Orifice/Grate** (Controls 0.00 cfs)

Summary for Pond 4P: Catch Basin

Inflow Area = 0.103 ac, 100.00% Impervious, Inflow Depth = 5.76" for 10 Year event
 Inflow = 0.99 cfs @ 11.91 hrs, Volume= 0.050 af
 Outflow = 0.99 cfs @ 11.91 hrs, Volume= 0.050 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.99 cfs @ 11.91 hrs, Volume= 0.050 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,010.20' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,009.71'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,009.71' / 2,009.53' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

#2 Primary 2,014.00' **24.0" x 24.0" Horiz. Orifice/Grate** C= 0.600
 Limited to weir flow at low heads

Primary OutFlow Max=0.99 cfs @ 11.91 hrs HW=2,010.20' (Free Discharge)

- ↑1=Culvert (Barrel Controls 0.99 cfs @ 2.98 fps)
- ↑2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 4R: (2) 36" Culverts

Inflow Area = 33.644 ac, 4.16% Impervious, Inflow Depth = 2.92" for 10 Year event
 Inflow = 73.70 cfs @ 12.09 hrs, Volume= 8.196 af
 Outflow = 73.70 cfs @ 12.09 hrs, Volume= 8.196 af, Atten= 0%, Lag= 0.0 min
 Primary = 73.70 cfs @ 12.09 hrs, Volume= 8.196 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,066.66' @ 12.09 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,064.00'	36.0" Round Culvert X 2.00 L= 70.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,064.00' / 2,063.00' S= 0.0143 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Secondary	2,070.00'	50.0' long x 35.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=73.65 cfs @ 12.09 hrs HW=2,066.66' (Free Discharge)

- ↑1=Culvert (Inlet Controls 73.65 cfs @ 5.55 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,064.00' (Free Discharge)

- ↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 7P: Catch Basin

Inflow Area = 0.262 ac, 70.83% Impervious, Inflow Depth = 4.96" for 10 Year event
 Inflow = 2.27 cfs @ 11.94 hrs, Volume= 0.108 af
 Outflow = 2.27 cfs @ 11.94 hrs, Volume= 0.108 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.27 cfs @ 11.94 hrs, Volume= 0.108 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,066.36' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,065.43'	12.0" Round Culvert L= 11.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,065.43' / 2,065.25' S= 0.0164 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,070.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.25 cfs @ 11.94 hrs HW=2,066.36' (Free Discharge)

↑1=Culvert (Barrel Controls 2.25 cfs @ 3.86 fps)

↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 7R: (2) 36" Steel Culverts

Inflow Area = 92.038 ac, 7.66% Impervious, Inflow Depth = 2.95" for 10 Year event
 Inflow = 165.27 cfs @ 12.09 hrs, Volume= 22.599 af
 Outflow = 165.27 cfs @ 12.09 hrs, Volume= 22.599 af, Atten= 0%, Lag= 0.0 min
 Primary = 124.45 cfs @ 12.09 hrs, Volume= 21.662 af
 Secondary = 40.82 cfs @ 12.09 hrs, Volume= 0.937 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,816.84' @ 12.09 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,812.00'	36.0" Round Culvert X 2.00 L= 30.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,812.00' / 1,811.00' S= 0.0333 '/ n= 0.012
#2	Secondary	1,816.00'	20.0' long x 20.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=124.42 cfs @ 12.09 hrs HW=1,816.84' (Free Discharge)

↑1=Culvert (Inlet Controls 124.42 cfs @ 8.80 fps)

Secondary OutFlow Max=40.69 cfs @ 12.09 hrs HW=1,816.84' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 40.69 cfs @ 2.42 fps)

Summary for Pond 8R: 36" hdpe

Inflow Area = 34.486 ac, 12.14% Impervious, Inflow Depth = 3.10" for 10 Year event
 Inflow = 86.57 cfs @ 12.15 hrs, Volume= 8.920 af
 Outflow = 86.57 cfs @ 12.15 hrs, Volume= 8.920 af, Atten= 0%, Lag= 0.0 min
 Primary = 86.57 cfs @ 12.15 hrs, Volume= 8.920 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,837.97' @ 12.15 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,830.00'	36.0" Round Culvert L= 245.0' Ke= 0.500 Inlet / Outlet Invert= 1,830.00' / 1,788.00' S= 0.1714 '/ n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=86.52 cfs @ 12.15 hrs HW=1,837.96' (Free Discharge)

↑1=Culvert (Inlet Controls 86.52 cfs @ 12.24 fps)

Summary for Pond 9P: Catch Basin

Inflow Area = 0.167 ac, 83.21% Impervious, Inflow Depth = 5.32" for 10 Year event
 Inflow = 1.59 cfs @ 11.91 hrs, Volume= 0.074 af
 Outflow = 1.59 cfs @ 11.91 hrs, Volume= 0.074 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.59 cfs @ 11.91 hrs, Volume= 0.074 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,035.05' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,034.40'	24.0" Round Culvert L= 136.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,034.40' / 2,034.00' S= 0.0029 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,039.40'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=1.56 cfs @ 11.91 hrs HW=2,035.04' (Free Discharge)
 1=Culvert (Barrel Controls 1.56 cfs @ 2.66 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 10P: Catch Basin

Inflow Area = 0.088 ac, 94.81% Impervious, Inflow Depth = 5.64" for 10 Year event
 Inflow = 0.86 cfs @ 11.91 hrs, Volume= 0.042 af
 Outflow = 0.86 cfs @ 11.91 hrs, Volume= 0.042 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.86 cfs @ 11.91 hrs, Volume= 0.042 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,035.81' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,035.29'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,035.29' / 2,035.11' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,039.40'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.85 cfs @ 11.91 hrs HW=2,035.81' (Free Discharge)
 1=Culvert (Barrel Controls 0.85 cfs @ 3.00 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 10R: 14" and 16" HDPE Culverts

Inflow Area = 20.182 ac, 16.70% Impervious, Inflow Depth > 3.17" for 10 Year event
 Inflow = 44.73 cfs @ 12.00 hrs, Volume= 5.335 af
 Outflow = 44.73 cfs @ 12.00 hrs, Volume= 5.335 af, Atten= 0%, Lag= 0.0 min
 Primary = 12.41 cfs @ 12.00 hrs, Volume= 4.176 af
 Secondary = 32.31 cfs @ 12.00 hrs, Volume= 1.160 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

Peak Elev= 1,977.39' @ 12.00 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,975.00'	14.0" Round 14" Culvert L= 50.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,975.00' / 1,974.50' S= 0.0100 '/ Cc= 0.900 n= 0.011
#2	Primary	1,975.00'	16.0" Round 16" Culvert L= 50.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,975.00' / 1,974.50' S= 0.0100 '/ Cc= 0.900 n= 0.011
#3	Secondary	1,977.00'	50.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=12.41 cfs @ 12.00 hrs HW=1,977.38' (Free Discharge)

↑1=14" Culvert (Inlet Controls 5.45 cfs @ 5.10 fps)

↑2=16" Culvert (Inlet Controls 6.96 cfs @ 4.98 fps)

Secondary OutFlow Max=32.21 cfs @ 12.00 hrs HW=1,977.38' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Weir Controls 32.21 cfs @ 1.67 fps)

Summary for Pond 11P: Catch Basin

Inflow Area = 7.752 ac, 32.48% Impervious, Inflow Depth = 3.41" for 10 Year event
 Inflow = 42.22 cfs @ 11.93 hrs, Volume= 2.201 af
 Outflow = 42.22 cfs @ 11.93 hrs, Volume= 2.201 af, Atten= 0%, Lag= 0.0 min
 Primary = 42.22 cfs @ 11.93 hrs, Volume= 2.201 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,058.04' @ 11.93 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,055.00'	36.0" Round Culvert L= 90.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,055.00' / 2,040.74' S= 0.1584 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,060.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=41.61 cfs @ 11.93 hrs HW=2,057.99' (Free Discharge)

↑1=Culvert (Inlet Controls 41.61 cfs @ 5.89 fps)

↑2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 12P: Catch Basin

Inflow Area = 0.067 ac, 88.78% Impervious, Inflow Depth = 5.41" for 10 Year event
 Inflow = 0.65 cfs @ 11.90 hrs, Volume= 0.030 af
 Outflow = 0.65 cfs @ 11.90 hrs, Volume= 0.030 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.65 cfs @ 11.90 hrs, Volume= 0.030 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,055.41' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,055.00'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,055.00' / 2,054.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,060.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.63 cfs @ 11.90 hrs HW=2,055.40' (Free Discharge)

↑1=Culvert (Inlet Controls 0.63 cfs @ 2.15 fps)

↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 13P: Manhole

Inflow Area = 7.315 ac, 30.04% Impervious, Inflow Depth = 3.31" for 10 Year event
 Inflow = 38.80 cfs @ 11.94 hrs, Volume= 2.018 af
 Outflow = 38.80 cfs @ 11.94 hrs, Volume= 2.018 af, Atten= 0%, Lag= 0.0 min
 Primary = 38.80 cfs @ 11.94 hrs, Volume= 2.018 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,066.66' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,063.88'	36.0" Round Culvert L= 137.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,063.88' / 2,055.10' S= 0.0641 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,072.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=38.49 cfs @ 11.94 hrs HW=2,066.64' (Free Discharge)

↑1=Culvert (Inlet Controls 38.49 cfs @ 5.66 fps)

↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 13R: 16" CMP Culvert

Inflow Area = 2.112 ac, 7.43% Impervious, Inflow Depth = 3.09" for 10 Year event
 Inflow = 8.75 cfs @ 12.06 hrs, Volume= 0.544 af
 Outflow = 8.75 cfs @ 12.06 hrs, Volume= 0.544 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.75 cfs @ 12.06 hrs, Volume= 0.544 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,970.36' @ 12.06 hrs

Flood Elev= 1,969.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,968.00'	16.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 1,968.00' / 1,965.00' S= 0.0750 '/ Cc= 0.900 n= 0.025

Primary OutFlow Max=8.75 cfs @ 12.06 hrs HW=1,970.36' (Free Discharge)

↑1=Culvert (Inlet Controls 8.75 cfs @ 6.26 fps)

Summary for Pond 15P: Catch Basin

Inflow Area = 0.609 ac, 66.13% Impervious, Inflow Depth = 4.83" for 10 Year event
 Inflow = 5.26 cfs @ 11.93 hrs, Volume= 0.245 af
 Outflow = 5.26 cfs @ 11.93 hrs, Volume= 0.245 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.26 cfs @ 11.93 hrs, Volume= 0.245 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,067.86' @ 11.93 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,065.43'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,065.43' / 2,065.25' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,070.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=5.17 cfs @ 11.93 hrs HW=2,067.80' (Free Discharge)

- 1=Culvert (Inlet Controls 5.17 cfs @ 6.58 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 16P: Catch Basin

Inflow Area = 0.168 ac, 93.81% Impervious, Inflow Depth = 5.64" for 10 Year event
 Inflow = 1.63 cfs @ 11.91 hrs, Volume= 0.079 af
 Outflow = 1.63 cfs @ 11.91 hrs, Volume= 0.079 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.63 cfs @ 11.91 hrs, Volume= 0.079 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,081.36' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,080.59'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,080.59' / 2,080.41' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,084.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.61 cfs @ 11.91 hrs HW=2,081.36' (Free Discharge)

- 1=Culvert (Barrel Controls 1.61 cfs @ 3.45 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 17P: Catch Basin

Inflow Area = 6.537 ac, 25.96% Impervious, Inflow Depth = 3.13" for 10 Year event
 Inflow = 32.12 cfs @ 11.94 hrs, Volume= 1.708 af
 Outflow = 32.12 cfs @ 11.94 hrs, Volume= 1.708 af, Atten= 0%, Lag= 0.0 min
 Primary = 32.12 cfs @ 11.94 hrs, Volume= 1.708 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,081.91' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,079.50'	36.0" Round Culvert L= 213.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,079.50' / 2,067.47' S= 0.0565 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,084.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=31.92 cfs @ 11.94 hrs HW=2,081.90' (Free Discharge)

↑1=**Culvert** (Inlet Controls 31.92 cfs @ 5.27 fps)

↓2=**Orifice/Grate** (Controls 0.00 cfs)

Summary for Pond 18P: Catch Basin

Inflow Area = 0.696 ac, 90.27% Impervious, Inflow Depth = 5.53" for 10 Year event
 Inflow = 6.65 cfs @ 11.91 hrs, Volume= 0.321 af
 Outflow = 6.65 cfs @ 11.91 hrs, Volume= 0.321 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.65 cfs @ 11.91 hrs, Volume= 0.321 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,095.81' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,092.21'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,092.21' / 2,092.03' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,096.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=6.64 cfs @ 11.91 hrs HW=2,095.79' (Free Discharge)

↑1=**Culvert** (Inlet Controls 6.64 cfs @ 8.46 fps)

↓2=**Orifice/Grate** (Controls 0.00 cfs)

Summary for Pond 19P: Catch Basin

Inflow Area = 5.536 ac, 25.26% Impervious, Inflow Depth = 3.13" for 10 Year event
 Inflow = 27.43 cfs @ 11.94 hrs, Volume= 1.444 af
 Outflow = 27.43 cfs @ 11.94 hrs, Volume= 1.444 af, Atten= 0%, Lag= 0.0 min
 Primary = 27.43 cfs @ 11.94 hrs, Volume= 1.444 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,093.17' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,091.00'	36.0" Round Culvert L= 250.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,091.00' / 2,077.47' S= 0.0541 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,096.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=27.25 cfs @ 11.94 hrs HW=2,093.16' (Free Discharge)

└1=Culvert (Inlet Controls 27.25 cfs @ 5.00 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 20: CB20

Inflow Area = 3.895 ac, 4.53% Impervious, Inflow Depth = 3.18" for 10 Year event
 Inflow = 20.51 cfs @ 11.99 hrs, Volume= 1.034 af
 Outflow = 20.51 cfs @ 11.99 hrs, Volume= 1.034 af, Atten= 0%, Lag= 0.0 min
 Primary = 20.51 cfs @ 11.99 hrs, Volume= 1.034 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,110.56' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,104.00'	18.0" Round Culvert L= 65.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,104.00' / 2,094.00' S= 0.1538 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,112.00'	75.0' long x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

Primary OutFlow Max=20.32 cfs @ 11.99 hrs HW=2,110.45' (Free Discharge)

└1=Culvert (Inlet Controls 20.32 cfs @ 11.50 fps)

└2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 20P: Manhole

Inflow Area = 4.748 ac, 14.80% Impervious, Inflow Depth = 2.74" for 10 Year event
 Inflow = 21.14 cfs @ 11.96 hrs, Volume= 1.084 af
 Outflow = 21.14 cfs @ 11.96 hrs, Volume= 1.084 af, Atten= 0%, Lag= 0.0 min
 Primary = 21.14 cfs @ 11.96 hrs, Volume= 1.084 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,096.46' @ 11.96 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,094.40'	30.0" Round Culvert L= 107.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,094.40' / 2,091.00' S= 0.0318 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=20.80 cfs @ 11.96 hrs HW=2,096.44' (Free Discharge)

└1=Culvert (Inlet Controls 20.80 cfs @ 4.86 fps)

Summary for Pond 21P: Catch Basin

Inflow Area = 0.702 ac, 72.23% Impervious, Inflow Depth = 4.98" for 10 Year event
 Inflow = 6.43 cfs @ 11.91 hrs, Volume= 0.292 af
 Outflow = 6.43 cfs @ 11.91 hrs, Volume= 0.292 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.43 cfs @ 11.91 hrs, Volume= 0.292 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,114.23' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,113.21'	30.0" Round Culvert L= 138.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,113.21' / 2,098.84' S= 0.1041 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,118.50'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=6.41 cfs @ 11.91 hrs HW=2,114.22' (Free Discharge)
 1=Culvert (Inlet Controls 6.41 cfs @ 3.43 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 22P: Catch Basin

Inflow Area = 0.427 ac, 71.34% Impervious, Inflow Depth = 4.96" for 10 Year event
 Inflow = 3.89 cfs @ 11.91 hrs, Volume= 0.176 af
 Outflow = 3.89 cfs @ 11.91 hrs, Volume= 0.176 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.89 cfs @ 11.91 hrs, Volume= 0.176 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,115.72' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,114.64'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,114.64' / 2,114.46' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,118.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=3.89 cfs @ 11.91 hrs HW=2,115.72' (Free Discharge)
 1=Culvert (Barrel Controls 3.89 cfs @ 4.00 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 23A: Catch Basin

Inflow Area = 0.733 ac, 9.68% Impervious, Inflow Depth = 2.35" for 10 Year event
 Inflow = 2.97 cfs @ 11.99 hrs, Volume= 0.144 af
 Outflow = 2.97 cfs @ 11.99 hrs, Volume= 0.144 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.97 cfs @ 11.99 hrs, Volume= 0.144 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,093.40' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,092.59'	18.0" Round Culvert L= 198.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,092.59' / 2,083.20' S= 0.0474 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,097.50'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.92 cfs @ 11.99 hrs HW=2,093.39' (Free Discharge)

1=Culvert (Inlet Controls 2.92 cfs @ 3.04 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 23B: Catch Basin

Inflow Area = 0.733 ac, 9.68% Impervious, Inflow Depth = 2.35" for 10 Year event
 Inflow = 2.97 cfs @ 11.99 hrs, Volume= 0.144 af
 Outflow = 2.97 cfs @ 11.99 hrs, Volume= 0.144 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.97 cfs @ 11.99 hrs, Volume= 0.144 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,083.88' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,083.07'	18.0" Round Culvert L= 51.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,083.07' / 2,079.50' S= 0.0700 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,096.50'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.91 cfs @ 11.99 hrs HW=2,083.87' (Free Discharge)

1=Culvert (Inlet Controls 2.91 cfs @ 3.04 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 24A: Catch Basin

Inflow Area = 4.046 ac, 4.84% Impervious, Inflow Depth = 2.35" for 10 Year event
 Inflow = 16.98 cfs @ 11.98 hrs, Volume= 0.793 af
 Outflow = 16.98 cfs @ 11.98 hrs, Volume= 0.793 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.98 cfs @ 11.98 hrs, Volume= 0.793 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,099.78' @ 11.98 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,098.00'	30.0" Round Culvert L= 149.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,098.00' / 2,096.51' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,102.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=16.79 cfs @ 11.98 hrs HW=2,099.77' (Free Discharge)

1=Culvert (Inlet Controls 16.79 cfs @ 4.53 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 24B: Catch Basin

Inflow Area = 4.046 ac, 4.84% Impervious, Inflow Depth = 2.35" for 10 Year event
 Inflow = 16.98 cfs @ 11.98 hrs, Volume= 0.793 af
 Outflow = 16.98 cfs @ 11.98 hrs, Volume= 0.793 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.98 cfs @ 11.98 hrs, Volume= 0.793 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,096.94' @ 11.98 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,095.00'	30.0" Round Culvert L= 49.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,095.00' / 2,094.51' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,100.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=16.79 cfs @ 11.98 hrs HW=2,096.92' (Free Discharge)
 1=Culvert (Barrel Controls 16.79 cfs @ 5.73 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 25P: Catch Basin

Inflow Area = 0.170 ac, 74.09% Impervious, Inflow Depth = 5.07" for 10 Year event
 Inflow = 1.58 cfs @ 11.91 hrs, Volume= 0.072 af
 Outflow = 1.58 cfs @ 11.91 hrs, Volume= 0.072 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.58 cfs @ 11.91 hrs, Volume= 0.072 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,123.40' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,122.88'	24.0" Round Culvert L= 270.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,122.88' / 2,113.50' S= 0.0347 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,135.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.55 cfs @ 11.91 hrs HW=2,123.39' (Free Discharge)
 1=Culvert (Inlet Controls 1.55 cfs @ 2.44 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 26P: Catch Basin

Inflow Area = 0.084 ac, 75.17% Impervious, Inflow Depth = 5.07" for 10 Year event
 Inflow = 0.78 cfs @ 11.91 hrs, Volume= 0.035 af
 Outflow = 0.78 cfs @ 11.91 hrs, Volume= 0.035 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.78 cfs @ 11.91 hrs, Volume= 0.035 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,131.54' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,131.05'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,131.05' / 2,130.87' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,135.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.77 cfs @ 11.91 hrs HW=2,131.54' (Free Discharge)

1=Culvert (Barrel Controls 0.77 cfs @ 2.94 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 27P: Catch Basin

Inflow Area = 0.815 ac, 74.18% Impervious, Inflow Depth = 5.04" for 10 Year event
 Inflow = 7.63 cfs @ 11.90 hrs, Volume= 0.343 af
 Outflow = 7.63 cfs @ 11.90 hrs, Volume= 0.343 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.63 cfs @ 11.90 hrs, Volume= 0.343 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,149.07' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,147.75'	21.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,147.75' / 2,145.50' S= 0.0450 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,152.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=7.46 cfs @ 11.90 hrs HW=2,149.05' (Free Discharge)

1=Culvert (Inlet Controls 7.46 cfs @ 3.89 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 28P: Catch Basin

Inflow Area = 0.093 ac, 76.11% Impervious, Inflow Depth = 5.07" for 10 Year event
 Inflow = 0.87 cfs @ 11.91 hrs, Volume= 0.039 af
 Outflow = 0.87 cfs @ 11.91 hrs, Volume= 0.039 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.87 cfs @ 11.91 hrs, Volume= 0.039 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,148.50' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,148.00'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,148.00' / 2,147.75' S= 0.0139 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,152.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=0.86 cfs @ 11.91 hrs HW=2,148.49' (Free Discharge)

↑1=Culvert (Barrel Controls 0.86 cfs @ 3.26 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 29P: Manhole

Inflow Area = 0.631 ac, 73.96% Impervious, Inflow Depth = 5.04" for 10 Year event
 Inflow = 5.89 cfs @ 11.90 hrs, Volume= 0.265 af
 Outflow = 5.89 cfs @ 11.90 hrs, Volume= 0.265 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.89 cfs @ 11.90 hrs, Volume= 0.265 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,163.12' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,162.00'	21.0" Round Culvert L= 125.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,162.00' / 2,147.75' S= 0.1140 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=5.76 cfs @ 11.90 hrs HW=2,163.11' (Free Discharge)

↑1=Culvert (Inlet Controls 5.76 cfs @ 3.59 fps)

Summary for Pond 30P: Catch Basin

Inflow Area = 0.631 ac, 73.96% Impervious, Inflow Depth = 5.04" for 10 Year event
 Inflow = 5.89 cfs @ 11.90 hrs, Volume= 0.265 af
 Outflow = 5.89 cfs @ 11.90 hrs, Volume= 0.265 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.89 cfs @ 11.90 hrs, Volume= 0.265 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,175.28' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,174.16'	21.0" Round Culvert L= 93.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,174.16' / 2,162.64' S= 0.1239 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,181.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=5.76 cfs @ 11.90 hrs HW=2,175.27' (Free Discharge)

↑1=Culvert (Inlet Controls 5.76 cfs @ 3.59 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 31P: Catch Basin

Inflow Area = 0.067 ac, 74.25% Impervious, Inflow Depth = 5.07" for 10 Year event
 Inflow = 0.63 cfs @ 11.90 hrs, Volume= 0.028 af
 Outflow = 0.63 cfs @ 11.90 hrs, Volume= 0.028 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.63 cfs @ 11.90 hrs, Volume= 0.028 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,177.62' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,177.18'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,177.18' / 2,177.00' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,181.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.61 cfs @ 11.90 hrs HW=2,177.61' (Free Discharge)

- 1=Culvert (Barrel Controls 0.61 cfs @ 2.80 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 32P: Catch Basin

Inflow Area = 0.501 ac, 73.93% Impervious, Inflow Depth = 5.03" for 10 Year event
 Inflow = 4.68 cfs @ 11.90 hrs, Volume= 0.210 af
 Outflow = 4.68 cfs @ 11.90 hrs, Volume= 0.210 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.68 cfs @ 11.90 hrs, Volume= 0.210 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,196.42' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,195.44'	21.0" Round Culvert L= 175.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,195.44' / 2,174.62' S= 0.1190 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,202.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.58 cfs @ 11.90 hrs HW=2,196.41' (Free Discharge)

- 1=Culvert (Inlet Controls 4.58 cfs @ 3.35 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 33P: Catch Basin

Inflow Area = 0.086 ac, 74.41% Impervious, Inflow Depth = 5.07" for 10 Year event
 Inflow = 0.81 cfs @ 11.90 hrs, Volume= 0.036 af
 Outflow = 0.81 cfs @ 11.90 hrs, Volume= 0.036 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.81 cfs @ 11.90 hrs, Volume= 0.036 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,198.46' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,198.00'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,198.00' / 2,197.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,202.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.79 cfs @ 11.90 hrs HW=2,198.45' (Free Discharge)

↑1=Culvert (Inlet Controls 0.79 cfs @ 2.29 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 34P: Manhole

Inflow Area = 0.334 ac, 73.86% Impervious, Inflow Depth = 5.01" for 10 Year event
 Inflow = 3.10 cfs @ 11.91 hrs, Volume= 0.139 af
 Outflow = 3.10 cfs @ 11.91 hrs, Volume= 0.139 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.10 cfs @ 11.91 hrs, Volume= 0.139 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,209.83' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,209.00'	18.0" Round Culvert L= 90.3' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,209.00' / 2,195.92' S= 0.1449 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=3.04 cfs @ 11.91 hrs HW=2,209.82' (Free Discharge)

↑1=Culvert (Inlet Controls 3.04 cfs @ 3.08 fps)

Summary for Pond 35P: Catch Basin

Inflow Area = 0.334 ac, 73.86% Impervious, Inflow Depth = 5.01" for 10 Year event
 Inflow = 3.10 cfs @ 11.91 hrs, Volume= 0.139 af
 Outflow = 3.10 cfs @ 11.91 hrs, Volume= 0.139 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.10 cfs @ 11.91 hrs, Volume= 0.139 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,225.83' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,225.00'	18.0" Round Culvert L= 121.4' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,225.00' / 2,209.50' S= 0.1277 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,229.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=3.04 cfs @ 11.91 hrs HW=2,225.82' (Free Discharge)

↑1=Culvert (Inlet Controls 3.04 cfs @ 3.08 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 36P: Catch Basin

Inflow Area = 0.074 ac, 74.91% Impervious, Inflow Depth = 5.07" for 10 Year event
 Inflow = 0.69 cfs @ 11.90 hrs, Volume= 0.031 af
 Outflow = 0.69 cfs @ 11.90 hrs, Volume= 0.031 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.69 cfs @ 11.90 hrs, Volume= 0.031 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,225.92' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,225.50'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,225.50' / 2,225.14' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,229.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.67 cfs @ 11.90 hrs HW=2,225.91' (Free Discharge)

- 1=Culvert (Inlet Controls 0.67 cfs @ 2.19 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 37P: Catch Basin

Inflow Area = 0.184 ac, 73.98% Impervious, Inflow Depth = 5.01" for 10 Year event
 Inflow = 1.71 cfs @ 11.91 hrs, Volume= 0.077 af
 Outflow = 1.71 cfs @ 11.91 hrs, Volume= 0.077 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.71 cfs @ 11.91 hrs, Volume= 0.077 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,249.09' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,248.50'	18.0" Round Culvert L= 200.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,248.50' / 2,225.10' S= 0.1170 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,253.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.68 cfs @ 11.91 hrs HW=2,249.09' (Free Discharge)

- 1=Culvert (Inlet Controls 1.68 cfs @ 2.61 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 38P: Catch Basin

Inflow Area = 0.082 ac, 76.49% Impervious, Inflow Depth = 5.07" for 10 Year event
 Inflow = 0.77 cfs @ 11.91 hrs, Volume= 0.035 af
 Outflow = 0.77 cfs @ 11.91 hrs, Volume= 0.035 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.77 cfs @ 11.91 hrs, Volume= 0.035 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,249.45' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,249.00'	12.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,249.00' / 2,248.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,253.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.75 cfs @ 11.91 hrs HW=2,249.44' (Free Discharge)

1=Culvert (Inlet Controls 0.75 cfs @ 2.26 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 43P: 12" HDPE Pipe

Inflow Area = 0.089 ac, 77.76% Impervious, Inflow Depth = 5.18" for 10 Year event
 Inflow = 0.84 cfs @ 11.90 hrs, Volume= 0.038 af
 Outflow = 0.84 cfs @ 11.90 hrs, Volume= 0.038 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.84 cfs @ 11.90 hrs, Volume= 0.038 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,998.07' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,997.50'	12.0" Round Culvert L= 20.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,997.50' / 1,997.40' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,002.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.82 cfs @ 11.90 hrs HW=1,998.06' (Free Discharge)

1=Culvert (Barrel Controls 0.82 cfs @ 2.63 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 44P: 12" HDPE Pipe

Inflow Area = 0.172 ac, 79.89% Impervious, Inflow Depth = 5.24" for 10 Year event
 Inflow = 1.64 cfs @ 11.90 hrs, Volume= 0.075 af
 Outflow = 1.64 cfs @ 11.90 hrs, Volume= 0.075 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.64 cfs @ 11.90 hrs, Volume= 0.075 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,998.10' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,997.40'	12.0" Round Culvert L= 30.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,997.40' / 1,997.00' S= 0.0133 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,002.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.61 cfs @ 11.90 hrs HW=1,998.09' (Free Discharge)

1=Culvert (Barrel Controls 1.61 cfs @ 3.91 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 50P: 30" HDPE Pipe

Inflow Area = 4.233 ac, 33.60% Impervious, Inflow Depth = 3.91" for 10 Year event
 Inflow = 25.69 cfs @ 11.95 hrs, Volume= 1.378 af
 Outflow = 25.69 cfs @ 11.95 hrs, Volume= 1.378 af, Atten= 0%, Lag= 0.0 min
 Primary = 25.69 cfs @ 11.95 hrs, Volume= 1.378 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,026.41' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,024.00'	30.0" Round Culvert L= 52.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,024.00' / 2,020.00' S= 0.0769 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,030.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=25.49 cfs @ 11.95 hrs HW=2,026.39' (Free Discharge)
 1=Culvert (Inlet Controls 25.49 cfs @ 5.27 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 51P: 18" HDPE Pipe

Inflow Area = 0.406 ac, 20.38% Impervious, Inflow Depth = 3.28" for 10 Year event
 Inflow = 2.48 cfs @ 11.95 hrs, Volume= 0.111 af
 Outflow = 2.48 cfs @ 11.95 hrs, Volume= 0.111 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.48 cfs @ 11.95 hrs, Volume= 0.111 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,026.73' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,026.00'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,026.00' / 2,025.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,030.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.43 cfs @ 11.95 hrs HW=2,026.72' (Free Discharge)
 1=Culvert (Barrel Controls 2.43 cfs @ 4.23 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 52P: 30" HDPE Pipe

Inflow Area = 3.737 ac, 33.43% Impervious, Inflow Depth = 3.93" for 10 Year event
 Inflow = 22.54 cfs @ 11.95 hrs, Volume= 1.224 af
 Outflow = 22.54 cfs @ 11.95 hrs, Volume= 1.224 af, Atten= 0%, Lag= 0.0 min
 Primary = 22.54 cfs @ 11.95 hrs, Volume= 1.224 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,060.66' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,058.50'	30.0" Round Culvert L= 301.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,058.50' / 2,026.00' S= 0.1080 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,064.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=22.32 cfs @ 11.95 hrs HW=2,060.64' (Free Discharge)

1=Culvert (Inlet Controls 22.32 cfs @ 4.98 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 53P: 18" HDPE Pipe

Inflow Area = 0.442 ac, 18.13% Impervious, Inflow Depth = 3.18" for 10 Year event
 Inflow = 2.69 cfs @ 11.94 hrs, Volume= 0.117 af
 Outflow = 2.69 cfs @ 11.94 hrs, Volume= 0.117 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.69 cfs @ 11.94 hrs, Volume= 0.117 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,061.27' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,060.50'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,060.50' / 2,060.14' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,064.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.66 cfs @ 11.94 hrs HW=2,061.26' (Free Discharge)

1=Culvert (Barrel Controls 2.66 cfs @ 4.29 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 54P: 24" HDPE Pipe

Inflow Area = 2.551 ac, 36.52% Impervious, Inflow Depth = 4.06" for 10 Year event
 Inflow = 15.27 cfs @ 11.98 hrs, Volume= 0.863 af
 Outflow = 15.27 cfs @ 11.98 hrs, Volume= 0.863 af, Atten= 0%, Lag= 0.0 min
 Primary = 15.27 cfs @ 11.98 hrs, Volume= 0.863 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,103.02' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,101.00'	24.0" Round Culvert L= 201.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,101.00' / 2,059.50' S= 0.2065 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,106.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=15.17 cfs @ 11.98 hrs HW=2,103.01' (Free Discharge)

1=Culvert (Inlet Controls 15.17 cfs @ 4.83 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 55P: 18" HDPE Pipe

Inflow Area = 0.351 ac, 80.16% Impervious, Inflow Depth = 5.18" for 10 Year event
 Inflow = 3.24 cfs @ 11.91 hrs, Volume= 0.151 af
 Outflow = 3.24 cfs @ 11.91 hrs, Volume= 0.151 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.24 cfs @ 11.91 hrs, Volume= 0.151 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,102.85' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,102.00'	18.0" Round Culvert L= 48.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,102.00' / 2,101.00' S= 0.0208 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,106.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=3.21 cfs @ 11.91 hrs HW=2,102.85' (Free Discharge)

1=Culvert (Inlet Controls 3.21 cfs @ 3.13 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 56P: 18" HDPE Pipe

Inflow Area = 0.526 ac, 38.55% Impervious, Inflow Depth = 4.10" for 10 Year event
 Inflow = 4.10 cfs @ 11.92 hrs, Volume= 0.180 af
 Outflow = 4.10 cfs @ 11.92 hrs, Volume= 0.180 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.10 cfs @ 11.92 hrs, Volume= 0.180 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,082.48' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,081.50'	18.0" Round Culvert L= 299.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,081.50' / 2,060.00' S= 0.0719 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,086.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.03 cfs @ 11.92 hrs HW=2,082.47' (Free Discharge)

1=Culvert (Inlet Controls 4.03 cfs @ 3.35 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 57P: 18" HDPE Pipe

Inflow Area = 0.112 ac, 82.97% Impervious, Inflow Depth = 5.30" for 10 Year event
 Inflow = 1.03 cfs @ 11.92 hrs, Volume= 0.049 af
 Outflow = 1.03 cfs @ 11.92 hrs, Volume= 0.049 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.03 cfs @ 11.92 hrs, Volume= 0.049 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,082.45' @ 11.92 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,082.00'	18.0" Round Culvert L= 18.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,082.00' / 2,081.64' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,086.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.02 cfs @ 11.92 hrs HW=2,082.45' (Free Discharge)

- ↑1=Culvert (Inlet Controls 1.02 cfs @ 2.28 fps)
- ↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 62P: Catch Basin

Inflow Area = 1.479 ac, 4.03% Impervious, Inflow Depth = 2.18" for 10 Year event
 Inflow = 5.26 cfs @ 12.00 hrs, Volume= 0.268 af
 Outflow = 5.26 cfs @ 12.00 hrs, Volume= 0.268 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.26 cfs @ 12.00 hrs, Volume= 0.268 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,084.14' @ 12.00 hrs

Device	Routing	Invert	Outlet Devices
#1	Secondary	2,087.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Primary	2,083.00'	18.0" Round Culvert L= 207.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,083.00' / 2,080.00' S= 0.0145 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=5.24 cfs @ 12.00 hrs HW=2,084.14' (Free Discharge)

- ↑2=Culvert (Inlet Controls 5.24 cfs @ 3.64 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,083.00' (Free Discharge)

- ↑1=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 65A: Manhole

Inflow Area = 2.041 ac, 24.02% Impervious, Inflow Depth = 2.99" for 10 Year event
 Inflow = 8.77 cfs @ 11.95 hrs, Volume= 0.508 af
 Outflow = 8.77 cfs @ 11.95 hrs, Volume= 0.508 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.77 cfs @ 11.95 hrs, Volume= 0.508 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,081.05' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,079.40'	24.0" Round Culvert L= 125.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,079.40' / 2,079.00' S= 0.0032 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=8.67 cfs @ 11.95 hrs HW=2,081.04' (Free Discharge)

1=Culvert (Barrel Controls 8.67 cfs @ 4.29 fps)

Summary for Pond 65P: Catch Basin

Inflow Area = 2.041 ac, 24.02% Impervious, Inflow Depth = 2.99" for 10 Year event
 Inflow = 8.77 cfs @ 11.95 hrs, Volume= 0.508 af
 Outflow = 8.77 cfs @ 11.95 hrs, Volume= 0.508 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.77 cfs @ 11.95 hrs, Volume= 0.508 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,081.46' @ 11.95 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,080.00'	24.0" Round Culvert L= 65.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,080.00' / 2,079.50' S= 0.0077 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,096.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=8.67 cfs @ 11.95 hrs HW=2,081.45' (Free Discharge)

1=Culvert (Barrel Controls 8.67 cfs @ 4.96 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 66R: (2) 24" culvert

Inflow = 4.92 cfs @ 11.99 hrs, Volume= 0.069 af
 Outflow = 4.92 cfs @ 11.99 hrs, Volume= 0.069 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.92 cfs @ 11.99 hrs, Volume= 0.069 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,990.65' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,990.00'	24.0" Round Culvert X 2.00 L= 75.0' CPP, end-section conforming to fill, Ke= 0.500

Inlet / Outlet Invert= 1,990.00' / 1,984.00' S= 0.0800 '/ Cc= 0.900
 n= 0.013 Corrugated PE, smooth interior
 #2 Primary 1,992.50' **40.0' long x 25.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60
 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=4.83 cfs @ 11.99 hrs HW=1,990.65' (Free Discharge)

- 1=Culvert (Inlet Controls 4.83 cfs @ 2.74 fps)
- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 81: 24" culvert

Inflow Area = 2.837 ac, 0.00% Impervious, Inflow Depth = 2.90" for 10 Year event
 Inflow = 15.06 cfs @ 11.96 hrs, Volume= 0.685 af
 Outflow = 15.06 cfs @ 11.96 hrs, Volume= 0.685 af, Atten= 0%, Lag= 0.0 min
 Primary = 15.06 cfs @ 11.96 hrs, Volume= 0.685 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,014.98' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,013.00'	24.0" Round Culvert L= 350.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,013.00' / 1,983.90' S= 0.0831 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,016.00'	40.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=14.90 cfs @ 11.96 hrs HW=2,014.96' (Free Discharge)

- 1=Culvert (Inlet Controls 14.90 cfs @ 4.77 fps)
- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 200: 36" Steel Culvert

Inflow Area = 76.410 ac, 0.43% Impervious, Inflow Depth = 2.81" for 10 Year event
 Inflow = 214.79 cfs @ 12.17 hrs, Volume= 17.862 af
 Outflow = 214.79 cfs @ 12.17 hrs, Volume= 17.862 af, Atten= 0%, Lag= 0.0 min
 Primary = 78.08 cfs @ 12.17 hrs, Volume= 13.324 af
 Secondary = 136.71 cfs @ 12.17 hrs, Volume= 4.538 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,240.76' @ 12.17 hrs
 Flood Elev= 2,248.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,234.00'	36.0" Round Culvert L= 50.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,234.00' / 2,228.00' S= 0.1200 '/ Cc= 0.900

n= 0.025 Corrugated metal
 #2 Secondary 2,236.00' **5.0' long x 25.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60
 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=77.98 cfs @ 12.17 hrs HW=2,240.75' (Free Discharge)

↑1=Culvert (Inlet Controls 77.98 cfs @ 11.03 fps)

Secondary OutFlow Max=136.11 cfs @ 12.17 hrs HW=2,240.75' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 136.11 cfs @ 5.73 fps)

Summary for Pond 201: 36" Steel Culvert

Inflow Area = 12.214 ac, 2.97% Impervious, Inflow Depth = 2.90" for 10 Year event
 Inflow = 37.69 cfs @ 12.15 hrs, Volume= 2.950 af
 Outflow = 37.69 cfs @ 12.15 hrs, Volume= 2.950 af, Atten= 0%, Lag= 0.0 min
 Primary = 32.60 cfs @ 12.15 hrs, Volume= 2.873 af
 Secondary = 5.09 cfs @ 12.15 hrs, Volume= 0.077 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,236.52' @ 12.15 hrs

Flood Elev= 2,248.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,234.00'	36.0" Round Culvert L= 30.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 2,234.00' / 2,233.00' S= 0.0333 '/' Cc= 0.900 n= 0.025 Corrugated metal
#2	Secondary	2,236.00'	5.0' long x 30.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=32.55 cfs @ 12.15 hrs HW=2,236.52' (Free Discharge)

↑1=Culvert (Barrel Controls 32.55 cfs @ 6.94 fps)

Secondary OutFlow Max=5.06 cfs @ 12.15 hrs HW=2,236.52' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 5.06 cfs @ 1.95 fps)

Summary for Pond 297A: culvert

Inflow Area = 22.407 ac, 0.53% Impervious, Inflow Depth = 2.85" for 10 Year event
 Inflow = 52.89 cfs @ 12.25 hrs, Volume= 5.327 af
 Outflow = 52.89 cfs @ 12.25 hrs, Volume= 5.327 af, Atten= 0%, Lag= 0.0 min
 Primary = 52.89 cfs @ 12.25 hrs, Volume= 5.327 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,116.07' @ 12.25 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,112.00'	36.0" Round Culvert L= 93.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 2,112.00' / 2,099.00' S= 0.1398 '/' Cc= 0.900

n= 0.013 Corrugated PE, smooth interior
 #2 Primary 2,116.00' **85.0' long x 70.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60
 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=52.70 cfs @ 12.25 hrs HW=2,116.07' (Free Discharge)

- 1=Culvert (Inlet Controls 48.17 cfs @ 6.82 fps)
- 2=Broad-Crested Rectangular Weir (Weir Controls 4.52 cfs @ 0.73 fps)

Summary for Pond 300R: 18" Steel Culvert

Inflow Area = 16.359 ac, 0.46% Impervious, Inflow Depth = 2.81" for 10 Year event
 Inflow = 49.29 cfs @ 12.14 hrs, Volume= 3.824 af
 Outflow = 49.29 cfs @ 12.14 hrs, Volume= 3.824 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.29 cfs @ 12.14 hrs, Volume= 2.851 af
 Secondary = 33.01 cfs @ 12.14 hrs, Volume= 0.973 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,263.41' @ 12.14 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,259.00'	18.0" Round 18" Steel Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,259.00' / 2,256.00' S= 0.0750 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,260.50'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=16.26 cfs @ 12.14 hrs HW=2,263.40' (Free Discharge)

- 1=18" Steel Culvert (Inlet Controls 16.26 cfs @ 9.20 fps)

Secondary OutFlow Max=32.84 cfs @ 12.14 hrs HW=2,263.40' (Free Discharge)

- 2=Broad-Crested Rectangular Weir (Weir Controls 32.84 cfs @ 5.65 fps)

Summary for Pond 302R: culvert

Inflow Area = 7.179 ac, 0.00% Impervious, Inflow Depth = 3.09" for 10 Year event
 Inflow = 26.82 cfs @ 12.10 hrs, Volume= 1.848 af
 Outflow = 26.82 cfs @ 12.10 hrs, Volume= 1.848 af, Atten= 0%, Lag= 0.0 min
 Primary = 26.82 cfs @ 12.10 hrs, Volume= 1.848 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,908.80' @ 12.10 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,954.00'	18.0" Round Culvert L= 100.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,954.00' / 1,952.00' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,858.00'	12.0" Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=26.71 cfs @ 12.10 hrs HW=1,908.38' (Free Discharge)

- └1=Culvert (Controls 0.00 cfs)
- └2=Orifice/Grate (Orifice Controls 26.71 cfs @ 34.01 fps)

Summary for Pond MH8: Manhole

Inflow Area = 7.919 ac, 33.56% Impervious, Inflow Depth = 3.45" for 10 Year event
 Inflow = 43.66 cfs @ 11.93 hrs, Volume= 2.275 af
 Outflow = 43.66 cfs @ 11.93 hrs, Volume= 2.275 af, Atten= 0%, Lag= 0.0 min
 Primary = 43.66 cfs @ 11.93 hrs, Volume= 2.275 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,037.05' @ 11.93 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,033.90'	36.0" Round Culvert L= 158.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,033.90' / 1,997.00' S= 0.2335 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=43.01 cfs @ 11.93 hrs HW=2,037.00' (Free Discharge)

- └1=Culvert (Inlet Controls 43.01 cfs @ 6.08 fps)

Summary for Pond O1: 12" HDPE Pipe

Inflow Area = 4.430 ac, 15.50% Impervious, Inflow Depth = 1.35" for 10 Year event
 Inflow = 0.29 cfs @ 11.99 hrs, Volume= 0.500 af
 Outflow = 0.29 cfs @ 11.99 hrs, Volume= 0.500 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.29 cfs @ 11.99 hrs, Volume= 0.500 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,834.76' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,834.50'	12.0" Round Culvert L= 334.0' Square-edged headwall, Ke= 0.500 Inlet / Outlet Invert= 1,834.50' / 1,780.00' S= 0.1632 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=0.29 cfs @ 11.99 hrs HW=1,834.76' (Free Discharge)

- └1=Culvert (Inlet Controls 0.29 cfs @ 1.74 fps)

Pond Summaries
1, 10 & 100-yr Storm Events

Summary for Pond B4: bioretention

Inflow Area = 4.919 ac, 18.04% Impervious, Inflow Depth = 0.80" for 1 Year event
 Inflow = 6.17 cfs @ 11.94 hrs, Volume= 0.326 af
 Outflow = 0.23 cfs @ 14.81 hrs, Volume= 0.267 af, Atten= 96%, Lag= 172.2 min
 Primary = 0.23 cfs @ 14.81 hrs, Volume= 0.267 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,143.21' @ 14.81 hrs Surf.Area= 19,493 sf Storage= 7,742 cf

Plug-Flow detention time= 431.7 min calculated for 0.267 af (82% of inflow)
 Center-of-Mass det. time= 349.3 min (1,199.1 - 849.8)

Volume	Invert	Avail.Storage	Storage Description
#1	2,138.00'	2,551 cf	stone underdrain (Prismatic) Listed below (Recalc) 6,377 cf Overall x 40.0% Voids
#2	2,139.00'	3,826 cf	filter media (Prismatic) Listed below (Recalc) 25,508 cf Overall x 15.0% Voids
#3	2,143.00'	16,265 cf	surface storage (Prismatic) Listed below (Recalc)
		22,642 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,138.00	6,377	0	0
2,139.00	6,377	6,377	6,377

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,139.00	6,377	0	0
2,143.00	6,377	25,508	25,508

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,143.00	6,377	0	0
2,144.00	8,116	7,247	7,247
2,145.00	9,920	9,018	16,265

Device	Routing	Invert	Outlet Devices
#1	Primary	2,139.00'	8.0" Round Culvert L= 100.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,139.00' / 2,137.00' S= 0.0200 1/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,138.00'	0.500 in/hr Exfiltration over Surface area
#3	Device 1	2,143.50'	8.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Secondary	2,144.25'	20.0' long x 4.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

Primary OutFlow Max=0.23 cfs @ 14.81 hrs HW=2,143.21' (Free Discharge)

1=Culvert (Passes 0.23 cfs of 3.05 cfs potential flow)

2=Exfiltration (Exfiltration Controls 0.23 cfs)

3=Orifice/Grate (Controls 0.00 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,138.00' (Free Discharge)

4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond H: Pond H

Inflow Area = 14.937 ac, 17.76% Impervious, Inflow Depth = 0.78" for 1 Year event
 Inflow = 14.87 cfs @ 12.02 hrs, Volume= 0.966 af
 Outflow = 0.66 cfs @ 15.71 hrs, Volume= 0.962 af, Atten= 96%, Lag= 221.9 min
 Primary = 0.66 cfs @ 15.71 hrs, Volume= 0.962 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 1,996.00' Surf.Area= 4,665 sf Storage= 6,646 cf
 Peak Elev= 1,999.16' @ 15.71 hrs Surf.Area= 11,812 sf Storage= 32,715 cf (26,069 cf above start)

Plug-Flow detention time= 1,611.1 min calculated for 0.809 af (84% of inflow)
 Center-of-Mass det. time= 1,298.8 min (2,174.9 - 876.1)

Volume	Invert	Avail.Storage	Storage Description
#1	1,993.00'	95,049 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,993.00	385	0	0
1,994.00	1,192	789	789
1,996.00	4,665	5,857	6,646
1,997.00	6,868	5,767	12,412
1,998.00	9,300	8,084	20,496
2,000.00	13,640	22,940	43,436
2,002.00	18,315	31,955	75,391
2,003.00	21,000	19,658	95,049

Device	Routing	Invert	Outlet Devices
#1	Primary	1,995.00'	24.0" Round Culvert L= 335.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,995.00' / 1,983.90' S= 0.0331 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	1,996.00'	2.0" Vert. Orifice/Grate C= 0.600
#3	Device 1	1,999.10'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	2,002.00'	10.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=0.55 cfs @ 15.71 hrs HW=1,999.16' (Free Discharge)

- 1=Culvert (Passes 0.55 cfs of 26.88 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.18 cfs @ 8.44 fps)
- 3=Orifice/Grate (Weir Controls 0.36 cfs @ 0.78 fps)
- 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond J: OPEN SWALE

Inflow Area = 1.775 ac, 27.88% Impervious, Inflow Depth = 1.25" for 1 Year event
 Inflow = 3.87 cfs @ 11.92 hrs, Volume= 0.185 af
 Outflow = 1.26 cfs @ 12.03 hrs, Volume= 0.185 af, Atten= 68%, Lag= 6.6 min
 Primary = 1.26 cfs @ 12.03 hrs, Volume= 0.185 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,990.54' @ 12.03 hrs Surf.Area= 6,153 sf Storage= 2,566 cf

Plug-Flow detention time= 116.4 min calculated for 0.185 af (100% of inflow)
 Center-of-Mass det. time= 116.5 min (924.4 - 807.9)

Volume	Invert	Avail.Storage	Storage Description
#1	1,986.50'	720 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 1,800 cf Overall x 40.0% Voids
#2	1,987.50'	675 cf	Filter Media (Prismatic) Listed below (Recalc) 4,500 cf Overall x 15.0% Voids
#3	1,990.00'	8,500 cf	Surface Storage (Prismatic) Listed below (Recalc)
		9,895 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,986.50	1,800	0	0
1,987.50	1,800	1,800	1,800

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,987.50	1,800	0	0
1,990.00	1,800	4,500	4,500

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,990.00	1,800	0	0
1,991.00	3,200	2,500	2,500
1,992.50	4,800	6,000	8,500

Device	Routing	Invert	Outlet Devices
#1	Primary	1,986.50'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,989.50'	8.0" Round Culvert L= 70.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,989.50' / 1,984.00' S= 0.0786 1/1' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#3	Secondary	1,991.50'	6.0' long x 2.0' breadth Broad-Crested Rectangular Weir

			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00	2.50
				3.00	3.50									
			Coef. (English)	2.54	2.61	2.61	2.60	2.66	2.70	2.77	2.89	2.88	2.85	3.07
				3.20	3.32									
#4	Primary	1,992.00'	10.0' long x 30.0' breadth Broad-Crested Rectangular Weir											
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60			
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63			

Primary OutFlow Max=1.26 cfs @ 12.03 hrs HW=1,990.54' (Free Discharge)

- 1=Exfiltration (Exfiltration Controls 0.14 cfs)
- 2=Culvert (Inlet Controls 1.11 cfs @ 3.19 fps)
- 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,986.50' (Free Discharge)

- 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond K: P1

Inflow Area = 7.908 ac, 12.10% Impervious, Inflow Depth = 0.73" for 1 Year event
 Inflow = 6.05 cfs @ 12.02 hrs, Volume= 0.483 af
 Outflow = 0.14 cfs @ 23.39 hrs, Volume= 0.483 af, Atten= 98%, Lag= 682.3 min
 Primary = 0.14 cfs @ 23.39 hrs, Volume= 0.483 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 2,018.00' Surf.Area= 2,252 sf Storage= 4,088 cf
 Peak Elev= 2,021.38' @ 23.39 hrs Surf.Area= 7,553 sf Storage= 18,868 cf (14,780 cf above start)

Plug-Flow detention time= 1,613.2 min calculated for 0.389 af (81% of inflow)
 Center-of-Mass det. time= 1,242.2 min (2,101.1 - 858.9)

Volume	Invert	Avail.Storage	Storage Description
#1	2,014.00'	56,425 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,014.00	117	0	0
2,016.00	896	1,013	1,013
2,016.50	1,162	515	1,528
2,018.00	2,252	2,561	4,088
2,020.00	4,326	6,578	10,666
2,022.00	9,000	13,326	23,992
2,024.00	15,031	24,031	48,023
2,024.50	18,575	8,402	56,425

Device	Routing	Invert	Outlet Devices
#1	Primary	2,017.50'	24.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,017.50' / 2,016.50' S= 0.0200 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	2,018.00'	1.7" Vert. Orifice/Grate C= 0.600
#3	Device 1	2,021.50'	3.0" Vert. Orifice/Grate C= 0.600
#4	Device 1	2,023.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600

#5	Primary	2,024.00'	Limited to weir flow at low heads 51.0' long x 1.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00
			Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.14 cfs @ 23.39 hrs HW=2,021.38' (Free Discharge)

- 1=Culvert (Passes 0.14 cfs of 25.67 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.14 cfs @ 8.76 fps)
- 3=Orifice/Grate (Controls 0.00 cfs)
- 4=Orifice/Grate (Controls 0.00 cfs)
- 5=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond L: Pond L - P1

Inflow Area = 21.422 ac, 18.68% Impervious, Inflow Depth = 0.90" for 1 Year event
 Inflow = 20.64 cfs @ 11.94 hrs, Volume= 1.603 af
 Outflow = 0.83 cfs @ 15.93 hrs, Volume= 1.601 af, Atten= 96%, Lag= 239.3 min
 Primary = 0.83 cfs @ 15.93 hrs, Volume= 1.601 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 1,944.00' Surf.Area= 5,350 sf Storage= 8,885 cf
 Peak Elev= 1,948.06' @ 15.93 hrs Surf.Area= 18,179 sf Storage= 55,157 cf (46,272 cf above start)

Plug-Flow detention time= 1,512.8 min calculated for 1.397 af (87% of inflow)
 Center-of-Mass det. time= 1,263.9 min (2,108.0 - 844.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,941.50'	133,175 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,941.50	1,964	0	0
1,942.00	2,435	1,100	1,100
1,944.00	5,350	7,785	8,885
1,946.00	11,083	16,433	25,318
1,948.00	17,735	28,818	54,136
1,949.00	25,553	21,644	75,780
1,949.75	27,569	19,921	95,701
1,950.00	29,207	7,097	102,798
1,951.00	31,547	30,377	133,175

Device	Routing	Invert	Outlet Devices
#1	Primary	1,943.00'	21.0" Round Culvert L= 60.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,943.00' / 1,942.50' S= 0.0083 1/1' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	1,944.00'	2.7" Vert. Orifice/Grate C= 0.600
#3	Device 1	1,948.00'	30.0" x 30.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	1,949.50'	20.0' long x 4.0' breadth Broad-Crested Rectangular Weir

Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00	2.50
	3.00	3.50	4.00	4.50	5.00	5.50					
Coef. (English)	2.38	2.54	2.69	2.68	2.67	2.67	2.65	2.66	2.66	2.68	2.72
	2.73	2.76	2.79	2.88	3.07	3.32					

Primary OutFlow Max=0.82 cfs @ 15.93 hrs HW=1,948.06' (Free Discharge)

- 1=Culvert (Passes 0.82 cfs of 23.68 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.38 cfs @ 9.56 fps)
- 3=Orifice/Grate (Weir Controls 0.44 cfs @ 0.78 fps)
- 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond M: OPEN SWALE

Inflow Area = 4.790 ac, 2.76% Impervious, Inflow Depth = 0.45" for 1 Year event
 Inflow = 3.31 cfs @ 11.99 hrs, Volume= 0.181 af
 Outflow = 0.12 cfs @ 16.36 hrs, Volume= 0.167 af, Atten= 96%, Lag= 262.5 min
 Primary = 0.12 cfs @ 16.36 hrs, Volume= 0.167 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,887.90' @ 16.36 hrs Surf.Area= 10,200 sf Storage= 3,776 cf

Plug-Flow detention time= 415.1 min calculated for 0.167 af (92% of inflow)
 Center-of-Mass det. time= 376.9 min (1,279.5 - 902.7)

Volume	Invert	Avail.Storage	Storage Description
#1	1,884.00'	1,198 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,995 cf Overall x 40.0% Voids
#2	1,885.00'	1,123 cf	Filter Media (Prismatic) Listed below (Recalc) 7,488 cf Overall x 15.0% Voids
#3	1,887.50'	19,290 cf	Surface Storage (Prismatic) Listed below (Recalc)
		21,611 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,884.00	2,995	0	0
1,885.00	2,995	2,995	2,995

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,885.00	2,995	0	0
1,887.50	2,995	7,488	7,488

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,887.50	2,995	0	0
1,888.00	4,500	1,874	1,874
1,889.00	6,437	5,469	7,342
1,890.00	8,574	7,506	14,848
1,890.50	9,195	4,442	19,290

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,884.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,884.50'	6.0" Vert. Culvert C= 0.600
#3	Primary	1,889.00'	5.0' long x 2.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50
			3.00 3.50
			Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07
			3.20 3.32

Primary OutFlow Max=0.12 cfs @ 16.36 hrs HW=1,887.90' (Free Discharge)

- 2=Culvert (Passes 0.12 cfs of 1.68 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.12 cfs)
- 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond N: OPEN SWALE

Inflow Area = 1.568 ac, 2.65% Impervious, Inflow Depth = 0.38" for 1 Year event
 Inflow = 0.89 cfs @ 11.98 hrs, Volume= 0.050 af
 Outflow = 0.03 cfs @ 17.85 hrs, Volume= 0.050 af, Atten= 97%, Lag= 351.9 min
 Primary = 0.03 cfs @ 17.85 hrs, Volume= 0.050 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,874.07' @ 17.85 hrs Surf.Area= 2,603 sf Storage= 1,068 cf

Plug-Flow detention time= 488.7 min calculated for 0.050 af (100% of inflow)
 Center-of-Mass det. time= 489.0 min (1,402.0 - 913.1)

Volume	Invert	Avail.Storage	Storage Description
#1	1,870.00'	258 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 644 cf Overall x 40.0% Voids
#2	1,871.00'	242 cf	Filter Media (Prismatic) Listed below (Recalc) 1,610 cf Overall x 15.0% Voids
#3	1,873.50'	4,639 cf	Surface Storage (Prismatic) Listed below (Recalc)
		5,138 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,870.00	644	0	0
1,871.00	644	644	644

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,871.00	644	0	0
1,873.50	644	1,610	1,610

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,873.50	644	0	0
1,874.00	1,260	476	476
1,875.00	2,031	1,646	2,122
1,876.00	3,003	2,517	4,639

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,870.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,870.00'	6.0" Vert. culvert C= 0.600
#3	Primary	1,875.00'	5.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=0.03 cfs @ 17.85 hrs HW=1,874.07' (Free Discharge)

- 2=culvert (Passes 0.03 cfs of 1.85 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.03 cfs)
- 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond O: Open Swale

Inflow Area =	4.430 ac, 15.50% Impervious, Inflow Depth = 0.74" for 1 Year event
Inflow =	6.06 cfs @ 11.96 hrs, Volume= 0.272 af
Outflow =	0.22 cfs @ 14.46 hrs, Volume= 0.272 af, Atten= 96%, Lag= 150.2 min
Primary =	0.22 cfs @ 14.46 hrs, Volume= 0.272 af
Secondary =	0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,838.66' @ 14.46 hrs Surf.Area= 9,462 sf Storage= 5,749 cf

Plug-Flow detention time= 340.8 min calculated for 0.272 af (100% of inflow)
 Center-of-Mass det. time= 340.6 min (1,210.4 - 869.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,834.00'	814 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,035 cf Overall x 40.0% Voids
#2	1,835.00'	763 cf	Filter Bed (Prismatic) Listed below (Recalc) 5,088 cf Overall x 15.0% Voids
#3	1,837.50'	13,965 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		15,542 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,834.00	2,035	0	0
1,835.00	2,035	2,035	2,035

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,835.00	2,035	0	0
1,837.50	2,035	5,088	5,088

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 9

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,837.50	2,035	0	0
1,838.00	3,275	1,328	1,328
1,839.00	6,500	4,888	6,215
1,840.00	9,000	7,750	13,965

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,834.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,834.00'	6.0" Vert. culvert C= 0.600
#3	Secondary	1,839.25'	25.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=0.22 cfs @ 14.46 hrs HW=1,838.66' (Free Discharge)

↑2=**culvert** (Passes 0.22 cfs of 1.98 cfs potential flow)

↑1=**Exfiltration** (Exfiltration Controls 0.22 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,834.00' (Free Discharge)

↑3=**Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond Q: OPEN SWALE

Inflow Area = 3.629 ac, 5.69% Impervious, Inflow Depth = 0.45" for 1 Year event
 Inflow = 2.43 cfs @ 12.00 hrs, Volume= 0.137 af
 Outflow = 0.10 cfs @ 15.94 hrs, Volume= 0.137 af, Atten= 96%, Lag= 236.4 min
 Primary = 0.10 cfs @ 15.94 hrs, Volume= 0.137 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,877.78' @ 15.94 hrs Surf.Area= 8,244 sf Storage= 2,750 cf

Plug-Flow detention time= 406.4 min calculated for 0.137 af (100% of inflow)
 Center-of-Mass det. time= 406.7 min (1,309.9 - 903.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,874.00'	928 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,319 cf Overall x 40.0% Voids
#2	1,875.00'	870 cf	Filter Media (Prismatic) Listed below (Recalc) 5,798 cf Overall x 15.0% Voids
#3	1,877.50'	11,728 cf	Surface Storage (Prismatic) Listed below (Recalc)
		13,525 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,874.00	2,319	0	0
1,875.00	2,319	2,319	2,319

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 10

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,875.00	2,319	0	0
1,877.50	2,319	5,798	5,798

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,877.50	3,319	0	0
1,878.00	3,840	1,790	1,790
1,879.00	4,913	4,377	6,166
1,880.00	6,211	5,562	11,728

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,874.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,874.00'	6.0" Vert. Culvert C= 0.600
#3	Primary	1,879.00'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50
			3.00
			Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31
			3.32

Primary OutFlow Max=0.10 cfs @ 15.94 hrs HW=1,877.78' (Free Discharge)

- 2=Culvert (Passes 0.10 cfs of 1.78 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.10 cfs)
- 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond S: Open Swale

Inflow Area = 2.213 ac, 4.27% Impervious, Inflow Depth = 0.53" for 1 Year event
 Inflow = 1.78 cfs @ 12.00 hrs, Volume= 0.097 af
 Outflow = 0.06 cfs @ 16.83 hrs, Volume= 0.097 af, Atten= 97%, Lag= 289.8 min
 Primary = 0.06 cfs @ 16.83 hrs, Volume= 0.097 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,918.14' @ 16.83 hrs Surf.Area= 5,004 sf Storage= 2,153 cf

Plug-Flow detention time= 492.0 min calculated for 0.097 af (100% of inflow)
 Center-of-Mass det. time= 492.3 min (1,385.9 - 893.7)

Volume	Invert	Avail.Storage	Storage Description
#1	1,914.50'	549 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 1,372 cf Overall x 40.0% Voids
#2	1,915.50'	412 cf	Filter Media (Prismatic) Listed below (Recalc) 2,744 cf Overall x 15.0% Voids
#3	1,917.50'	6,299 cf	Surface Storage (Prismatic) Listed below (Recalc)
		7,259 cf	Total Available Storage

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 11

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,914.50	1,372	0	0
1,915.50	1,372	1,372	1,372

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,915.50	1,372	0	0
1,917.50	1,372	2,744	2,744

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,917.50	1,372	0	0
1,918.00	2,190	891	891
1,920.00	3,218	5,408	6,299

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,914.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,914.50'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,919.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00			
Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32			

Primary OutFlow Max=0.06 cfs @ 16.83 hrs HW=1,918.14' (Free Discharge)

↳ **2=Culvert** (Passes 0.06 cfs of 1.74 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.06 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,914.50' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond sp1: Storm Planters

Inflow Area = 0.986 ac, 86.08% Impervious, Inflow Depth = 2.06" for 1 Year event
 Inflow = 3.53 cfs @ 11.96 hrs, Volume= 0.170 af
 Outflow = 0.28 cfs @ 12.03 hrs, Volume= 0.115 af, Atten= 92%, Lag= 4.3 min
 Primary = 0.28 cfs @ 12.03 hrs, Volume= 0.115 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,150.09' @ 12.48 hrs Surf.Area= 11,960 sf Storage= 4,280 cf

Plug-Flow detention time= 246.9 min calculated for 0.115 af (68% of inflow)
 Center-of-Mass det. time= 148.1 min (941.4 - 793.3)

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 12

Volume	Invert	Avail.Storage	Storage Description
#1	2,147.50'	2,392 cf	stone underdrain (Prismatic) Listed below (Recalc) -Impervious 5,980 cf Overall x 40.0% Voids
#2	2,148.50'	1,346 cf	filter media (Prismatic) Listed below (Recalc) 8,970 cf Overall x 15.0% Voids
#3	2,150.00'	11,960 cf	surface storage (Prismatic) Listed below (Recalc)
		15,698 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,147.50	5,980	0	0
2,148.50	5,980	5,980	5,980

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,148.50	5,980	0	0
2,150.00	5,980	8,970	8,970

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,150.00	5,980	0	0
2,151.00	5,980	5,980	5,980
2,152.00	5,980	5,980	11,960

Device	Routing	Invert	Outlet Devices
#1	Primary	2,147.50'	24.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,147.50' / 2,080.00' S= 0.1929 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,147.50'	1.000 in/hr Exfiltration over Surface area
#3	Device 1	2,151.00'	6.0" Horiz. Orifice/Grate X 3.00 C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=0.28 cfs @ 12.03 hrs HW=2,150.02' (Free Discharge)

1=Culvert (Passes 0.28 cfs of 18.63 cfs potential flow)

2=Exfiltration (Exfiltration Controls 0.28 cfs)

3=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond T: Open Swale

Inflow Area = 1.813 ac, 7.66% Impervious, Inflow Depth = 0.61" for 1 Year event
 Inflow = 2.14 cfs @ 11.94 hrs, Volume= 0.092 af
 Outflow = 0.04 cfs @ 18.28 hrs, Volume= 0.092 af, Atten= 98%, Lag= 380.9 min
 Primary = 0.04 cfs @ 18.28 hrs, Volume= 0.092 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,990.65' @ 18.28 hrs Surf.Area= 3,788 sf Storage= 2,302 cf

Plug-Flow detention time= 660.0 min calculated for 0.092 af (100% of inflow)
 Center-of-Mass det. time= 660.2 min (1,540.3 - 880.1)

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 13

Volume	Invert	Avail.Storage	Storage Description
#1	1,986.50'	374 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 935 cf Overall x 40.0% Voids
#2	1,987.50'	281 cf	Filter Media (Prismatic) Listed below (Recalc) 1,870 cf Overall x 15.0% Voids
#3	1,989.50'	5,089 cf	Surface Storage (Prismatic) Listed below (Recalc)
		5,744 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,986.50	935	0	0
1,987.50	935	935	935

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,987.50	935	0	0
1,989.50	935	1,870	1,870

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,989.50	935	0	0
1,990.00	1,375	578	578
1,991.00	2,211	1,793	2,371
1,992.00	3,226	2,719	5,089

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,986.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,985.50'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,991.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.04 cfs @ 18.28 hrs HW=1,990.65' (Free Discharge)

↑2=Culvert (Passes 0.04 cfs of 2.09 cfs potential flow)

↑1=Exfiltration (Exfiltration Controls 0.04 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,986.50' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond U: Open Swale

Inflow Area = 6.478 ac, 8.75% Impervious, Inflow Depth = 0.57" for 1 Year event
 Inflow = 4.49 cfs @ 12.06 hrs, Volume= 0.305 af
 Outflow = 0.13 cfs @ 19.47 hrs, Volume= 0.305 af, Atten= 97%, Lag= 444.7 min
 Primary = 0.13 cfs @ 19.47 hrs, Volume= 0.305 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 14

Peak Elev= 2,014.83' @ 19.47 hrs Surf.Area= 11,222 sf Storage= 8,012 cf

Plug-Flow detention time= 747.4 min calculated for 0.305 af (100% of inflow)

Center-of-Mass det. time= 747.8 min (1,641.8 - 893.9)

Volume	Invert	Avail.Storage	Storage Description
#1	2,010.50'	1,034 cf	Stone Layer (Prismatic) Listed below (Recalc) 2,584 cf Overall x 40.0% Voids
#2	2,011.50'	775 cf	Filter Media (Prismatic) Listed below (Recalc) 5,168 cf Overall x 15.0% Voids
#3	2,013.50'	18,070 cf	Surface Storage (Prismatic) Listed below (Recalc)
		19,878 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,010.50	2,584	0	0
2,011.50	2,584	2,584	2,584

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,011.50	2,584	0	0
2,013.50	2,584	5,168	5,168

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,013.50	2,584	0	0
2,014.00	4,540	1,781	1,781
2,015.00	6,354	5,447	7,228
2,016.00	7,336	6,845	14,073
2,016.50	8,650	3,997	18,070

Device	Routing	Invert	Outlet Devices
#1	Device 2	2,010.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	2,010.50'	6.0" Round Culvert L= 25.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,010.50' / 2,010.25' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#3	Primary	2,015.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.13 cfs @ 19.47 hrs HW=2,014.83' (Free Discharge)

- 2=Culvert (Passes 0.13 cfs of 1.51 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.13 cfs)
- 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond W: Open Swale

Inflow Area = 8.723 ac, 9.84% Impervious, Inflow Depth = 0.60" for 1 Year event
 Inflow = 3.22 cfs @ 11.98 hrs, Volume= 0.434 af
 Outflow = 0.22 cfs @ 24.05 hrs, Volume= 0.434 af, Atten= 93%, Lag= 723.9 min
 Primary = 0.22 cfs @ 24.05 hrs, Volume= 0.434 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,788.98' @ 24.05 hrs Surf.Area= 9,380 sf Storage= 7,025 cf

Plug-Flow detention time= 407.8 min calculated for 0.434 af (100% of inflow)
 Center-of-Mass det. time= 407.7 min (1,503.1 - 1,095.4)

Volume	Invert	Avail.Storage	Storage Description
#1	1,784.00'	960 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 2,399 cf Overall x 40.0% Voids
#2	1,785.00'	900 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 5,998 cf Overall x 15.0% Voids
#3	1,787.50'	25,064 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,923 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,784.00	2,399	0	0
1,785.00	2,399	2,399	2,399

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,785.00	2,399	0	0
1,787.50	2,399	5,998	5,998

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,787.50	2,399	0	0
1,788.00	3,136	1,384	1,384
1,789.00	4,612	3,874	5,258
1,790.00	8,000	6,306	11,564
1,791.50	10,000	13,500	25,064

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,784.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,784.00'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,789.50'	10.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=0.22 cfs @ 24.05 hrs HW=1,788.98' (Free Discharge)

↳ **2=Culvert** (Passes 0.22 cfs of 2.06 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.22 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,784.00' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond X: Open Swale

Inflow Area = 2.495 ac, 6.71% Impervious, Inflow Depth = 0.49" for 1 Year event
 Inflow = 1.91 cfs @ 11.99 hrs, Volume= 0.102 af
 Outflow = 0.11 cfs @ 13.92 hrs, Volume= 0.102 af, Atten= 94%, Lag= 115.7 min
 Primary = 0.11 cfs @ 13.92 hrs, Volume= 0.102 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,797.89' @ 13.92 hrs Surf.Area= 4,585 sf Storage= 1,704 cf

Plug-Flow detention time= 221.6 min calculated for 0.102 af (100% of inflow)
 Center-of-Mass det. time= 221.7 min (1,119.2 - 897.5)

Volume	Invert	Avail.Storage	Storage Description
#1	1,794.00'	556 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 1,391 cf Overall x 40.0% Voids
#2	1,795.00'	522 cf	Filter Media (Prismatic) Listed below (Recalc) 3,478 cf Overall x 15.0% Voids
#3	1,797.50'	9,040 cf	Surface Storage (Prismatic) Listed below (Recalc)
		10,118 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,794.00	1,391	0	0
1,795.00	1,391	1,391	1,391

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,795.00	1,391	0	0
1,797.50	1,391	3,478	3,478

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,797.50	1,391	0	0
1,798.00	1,916	827	827
1,799.00	2,930	2,423	3,250
1,800.00	4,105	3,518	6,767
1,800.50	4,984	2,272	9,040

07074_Pro-WildacresWest

Type II 24-hr 1 Year Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 17

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,794.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,794.00'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,799.00'	15.0' long x 2.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50
			3.00 3.50
			Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07
			3.20 3.32

Primary OutFlow Max=0.11 cfs @ 13.92 hrs HW=1,797.89' (Free Discharge)

↳ **2=Culvert** (Passes 0.11 cfs of 1.80 cfs potential flow)

↳ ↳ **1=Exfiltration** (Exfiltration Controls 0.11 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,794.00' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond B4: bioretention

Inflow Area = 4.919 ac, 18.04% Impervious, Inflow Depth = 3.10" for 10 Year event
 Inflow = 26.19 cfs @ 11.94 hrs, Volume= 1.270 af
 Outflow = 18.56 cfs @ 12.01 hrs, Volume= 1.211 af, Atten= 29%, Lag= 3.9 min
 Primary = 2.11 cfs @ 12.01 hrs, Volume= 0.931 af
 Secondary = 16.45 cfs @ 12.01 hrs, Volume= 0.280 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,144.72' @ 12.01 hrs Surf.Area= 22,161 sf Storage= 19,891 cf

Plug-Flow detention time= 212.0 min calculated for 1.211 af (95% of inflow)
 Center-of-Mass det. time= 185.1 min (1,003.2 - 818.2)

Volume	Invert	Avail.Storage	Storage Description
#1	2,138.00'	2,551 cf	stone underdrain (Prismatic) Listed below (Recalc) 6,377 cf Overall x 40.0% Voids
#2	2,139.00'	3,826 cf	filter media (Prismatic) Listed below (Recalc) 25,508 cf Overall x 15.0% Voids
#3	2,143.00'	16,265 cf	surface storage (Prismatic) Listed below (Recalc)
		22,642 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,138.00	6,377	0	0
2,139.00	6,377	6,377	6,377

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,139.00	6,377	0	0
2,143.00	6,377	25,508	25,508

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,143.00	6,377	0	0
2,144.00	8,116	7,247	7,247
2,145.00	9,920	9,018	16,265

Device	Routing	Invert	Outlet Devices
#1	Primary	2,139.00'	8.0" Round Culvert L= 100.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,139.00' / 2,137.00' S= 0.0200 1/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,138.00'	0.500 in/hr Exfiltration over Surface area
#3	Device 1	2,143.50'	8.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Secondary	2,144.25'	20.0' long x 4.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

Primary OutFlow Max=2.10 cfs @ 12.01 hrs HW=2,144.71' (Free Discharge)

- 1=Culvert (Passes 2.10 cfs of 3.43 cfs potential flow)
- 2=Exfiltration (Exfiltration Controls 0.26 cfs)
- 3=Orifice/Grate (Orifice Controls 1.85 cfs @ 5.29 fps)

Secondary OutFlow Max=16.08 cfs @ 12.01 hrs HW=2,144.71' (Free Discharge)

- 4=Broad-Crested Rectangular Weir (Weir Controls 16.08 cfs @ 1.75 fps)

Summary for Pond H: Pond H

Inflow Area = 14.937 ac, 17.76% Impervious, Inflow Depth = 3.11" for 10 Year event
 Inflow = 65.89 cfs @ 12.00 hrs, Volume= 3.872 af
 Outflow = 27.64 cfs @ 12.14 hrs, Volume= 3.867 af, Atten= 58%, Lag= 8.2 min
 Primary = 27.64 cfs @ 12.14 hrs, Volume= 3.867 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 1,996.00' Surf.Area= 4,665 sf Storage= 6,646 cf
 Peak Elev= 2,001.12' @ 12.14 hrs Surf.Area= 16,268 sf Storage= 60,250 cf (53,604 cf above start)

Plug-Flow detention time= 407.2 min calculated for 3.714 af (96% of inflow)
 Center-of-Mass det. time= 361.6 min (1,211.8 - 850.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,993.00'	95,049 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,993.00	385	0	0
1,994.00	1,192	789	789
1,996.00	4,665	5,857	6,646
1,997.00	6,868	5,767	12,412
1,998.00	9,300	8,084	20,496
2,000.00	13,640	22,940	43,436
2,002.00	18,315	31,955	75,391
2,003.00	21,000	19,658	95,049

Device	Routing	Invert	Outlet Devices
#1	Primary	1,995.00'	24.0" Round Culvert L= 335.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,995.00' / 1,983.90' S= 0.0331 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	1,996.00'	2.0" Vert. Orifice/Grate C= 0.600
#3	Device 1	1,999.10'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	2,002.00'	10.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=27.61 cfs @ 12.14 hrs HW=2,001.12' (Free Discharge)

- 1=Culvert (Passes 27.61 cfs of 34.23 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.24 cfs @ 10.81 fps)
- 3=Orifice/Grate (Orifice Controls 27.37 cfs @ 6.84 fps)
- 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond J: OPEN SWALE

Inflow Area = 1.775 ac, 27.88% Impervious, Inflow Depth = 3.87" for 10 Year event
 Inflow = 12.01 cfs @ 11.92 hrs, Volume= 0.573 af
 Outflow = 7.03 cfs @ 11.99 hrs, Volume= 0.573 af, Atten= 41%, Lag= 4.6 min
 Primary = 2.12 cfs @ 11.99 hrs, Volume= 0.504 af
 Secondary = 4.92 cfs @ 11.99 hrs, Volume= 0.069 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,991.96' @ 11.99 hrs Surf.Area= 7,826 sf Storage= 7,467 cf

Plug-Flow detention time= 67.3 min calculated for 0.573 af (100% of inflow)
 Center-of-Mass det. time= 67.4 min (858.1 - 790.7)

Volume	Invert	Avail.Storage	Storage Description
#1	1,986.50'	720 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 1,800 cf Overall x 40.0% Voids
#2	1,987.50'	675 cf	Filter Media (Prismatic) Listed below (Recalc) 4,500 cf Overall x 15.0% Voids
#3	1,990.00'	8,500 cf	Surface Storage (Prismatic) Listed below (Recalc)
		9,895 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,986.50	1,800	0	0
1,987.50	1,800	1,800	1,800

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,987.50	1,800	0	0
1,990.00	1,800	4,500	4,500

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,990.00	1,800	0	0
1,991.00	3,200	2,500	2,500
1,992.50	4,800	6,000	8,500

Device	Routing	Invert	Outlet Devices
#1	Primary	1,986.50'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,989.50'	8.0" Round Culvert L= 70.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,989.50' / 1,984.00' S= 0.0786 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#3	Secondary	1,991.50'	6.0' long x 2.0' breadth Broad-Crested Rectangular Weir

			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00	2.50
				3.00	3.50									
			Coef. (English)	2.54	2.61	2.61	2.60	2.66	2.70	2.77	2.89	2.88	2.85	3.07
				3.20	3.32									
#4	Primary	1,992.00'	10.0' long x 30.0' breadth Broad-Crested Rectangular Weir											
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60			
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63			

Primary OutFlow Max=2.11 cfs @ 11.99 hrs HW=1,991.96' (Free Discharge)

- 1=Exfiltration (Exfiltration Controls 0.18 cfs)
- 2=Culvert (Inlet Controls 1.93 cfs @ 5.54 fps)
- 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Secondary OutFlow Max=4.83 cfs @ 11.99 hrs HW=1,991.96' (Free Discharge)

- 3=Broad-Crested Rectangular Weir (Weir Controls 4.83 cfs @ 1.76 fps)

Summary for Pond K: P1

Inflow Area = 7.908 ac, 12.10% Impervious, Inflow Depth = 2.96" for 10 Year event
 Inflow = 28.69 cfs @ 12.02 hrs, Volume= 1.948 af
 Outflow = 5.49 cfs @ 12.43 hrs, Volume= 1.947 af, Atten= 81%, Lag= 24.3 min
 Primary = 5.49 cfs @ 12.43 hrs, Volume= 1.947 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 2,018.00' Surf.Area= 2,252 sf Storage= 4,088 cf
 Peak Elev= 2,023.83' @ 12.43 hrs Surf.Area= 14,512 sf Storage= 45,481 cf (41,393 cf above start)

Plug-Flow detention time= 898.5 min calculated for 1.853 af (95% of inflow)
 Center-of-Mass det. time= 821.9 min (1,650.0 - 828.1)

Volume	Invert	Avail.Storage	Storage Description
#1	2,014.00'	56,425 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,014.00	117	0	0
2,016.00	896	1,013	1,013
2,016.50	1,162	515	1,528
2,018.00	2,252	2,561	4,088
2,020.00	4,326	6,578	10,666
2,022.00	9,000	13,326	23,992
2,024.00	15,031	24,031	48,023
2,024.50	18,575	8,402	56,425

Device	Routing	Invert	Outlet Devices
#1	Primary	2,017.50'	24.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,017.50' / 2,016.50' S= 0.0200 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	2,018.00'	1.7" Vert. Orifice/Grate C= 0.600
#3	Device 1	2,021.50'	3.0" Vert. Orifice/Grate C= 0.600
#4	Device 1	2,023.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600

#5	Primary	2,024.00'	Limited to weir flow at low heads 51.0' long x 1.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00
			Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=5.44 cfs @ 12.43 hrs HW=2,023.83' (Free Discharge)

- 1=Culvert (Passes 5.44 cfs of 34.91 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.18 cfs @ 11.55 fps)
- 3=Orifice/Grate (Orifice Controls 0.35 cfs @ 7.15 fps)
- 4=Orifice/Grate (Weir Controls 4.90 cfs @ 1.87 fps)
- 5=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond L: Pond L - P1

Inflow Area =	21.422 ac, 18.68% Impervious, Inflow Depth = 3.27" for 10 Year event
Inflow =	80.52 cfs @ 11.96 hrs, Volume= 5.836 af
Outflow =	39.33 cfs @ 12.19 hrs, Volume= 5.834 af, Atten= 51%, Lag= 13.5 min
Primary =	39.33 cfs @ 12.19 hrs, Volume= 5.834 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 1,944.00' Surf.Area= 5,350 sf Storage= 8,885 cf
 Peak Elev= 1,949.86' @ 12.19 hrs Surf.Area= 28,310 sf Storage= 98,860 cf (89,975 cf above start)

Plug-Flow detention time= 420.2 min calculated for 5.630 af (96% of inflow)
 Center-of-Mass det. time= 379.6 min (1,197.0 - 817.4)

Volume	Invert	Avail.Storage	Storage Description
#1	1,941.50'	133,175 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,941.50	1,964	0	0
1,942.00	2,435	1,100	1,100
1,944.00	5,350	7,785	8,885
1,946.00	11,083	16,433	25,318
1,948.00	17,735	28,818	54,136
1,949.00	25,553	21,644	75,780
1,949.75	27,569	19,921	95,701
1,950.00	29,207	7,097	102,798
1,951.00	31,547	30,377	133,175

Device	Routing	Invert	Outlet Devices
#1	Primary	1,943.00'	21.0" Round Culvert L= 60.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,943.00' / 1,942.50' S= 0.0083 1/8" Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	1,944.00'	2.7" Vert. Orifice/Grate C= 0.600
#3	Device 1	1,948.00'	30.0" x 30.0" Horiz. Orifice/Grate C= 0.600
			Limited to weir flow at low heads
#4	Primary	1,949.50'	20.0' long x 4.0' breadth Broad-Crested Rectangular Weir

Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00	2.50
	3.00	3.50	4.00	4.50	5.00	5.50					
Coef. (English)	2.38	2.54	2.69	2.68	2.67	2.67	2.65	2.66	2.66	2.68	2.72
	2.73	2.76	2.79	2.88	3.07	3.32					

Primary OutFlow Max=39.24 cfs @ 12.19 hrs HW=1,949.86' (Free Discharge)

- 1=Culvert (Inlet Controls 28.34 cfs @ 11.78 fps)
- 2=Orifice/Grate (Passes < 0.46 cfs potential flow)
- 3=Orifice/Grate (Passes < 41.06 cfs potential flow)
- 4=Broad-Crested Rectangular Weir (Weir Controls 10.90 cfs @ 1.51 fps)

Summary for Pond M: OPEN SWALE

Inflow Area = 4.790 ac, 2.76% Impervious, Inflow Depth = 2.44" for 10 Year event
 Inflow = 20.96 cfs @ 11.97 hrs, Volume= 0.974 af
 Outflow = 8.59 cfs @ 12.08 hrs, Volume= 0.960 af, Atten= 59%, Lag= 6.3 min
 Primary = 8.59 cfs @ 12.08 hrs, Volume= 0.960 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,889.75' @ 12.08 hrs Surf.Area= 14,026 sf Storage= 15,079 cf

Plug-Flow detention time= 316.0 min calculated for 0.960 af (99% of inflow)
 Center-of-Mass det. time= 308.3 min (1,152.6 - 844.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,884.00'	1,198 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,995 cf Overall x 40.0% Voids
#2	1,885.00'	1,123 cf	Filter Media (Prismatic) Listed below (Recalc) 7,488 cf Overall x 15.0% Voids
#3	1,887.50'	19,290 cf	Surface Storage (Prismatic) Listed below (Recalc)
		21,611 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,884.00	2,995	0	0
1,885.00	2,995	2,995	2,995

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,885.00	2,995	0	0
1,887.50	2,995	7,488	7,488

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,887.50	2,995	0	0
1,888.00	4,500	1,874	1,874
1,889.00	6,437	5,469	7,342
1,890.00	8,574	7,506	14,848
1,890.50	9,195	4,442	19,290

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,884.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,884.50'	6.0" Vert. Culvert C= 0.600
#3	Primary	1,889.00'	5.0' long x 2.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50
			3.00 3.50
			Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07
			3.20 3.32

Primary OutFlow Max=8.52 cfs @ 12.08 hrs HW=1,889.74' (Free Discharge)

- 2=Culvert (Passes 0.16 cfs of 2.11 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.16 cfs)
- 3=Broad-Crested Rectangular Weir (Weir Controls 8.35 cfs @ 2.25 fps)

Summary for Pond N: OPEN SWALE

Inflow Area = 1.568 ac, 2.65% Impervious, Inflow Depth = 2.26" for 10 Year event
 Inflow = 6.58 cfs @ 11.96 hrs, Volume= 0.296 af
 Outflow = 4.55 cfs @ 12.03 hrs, Volume= 0.296 af, Atten= 31%, Lag= 3.8 min
 Primary = 4.55 cfs @ 12.03 hrs, Volume= 0.296 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,875.49' @ 12.03 hrs Surf.Area= 3,797 sf Storage= 3,736 cf

Plug-Flow detention time= 297.8 min calculated for 0.296 af (100% of inflow)
 Center-of-Mass det. time= 298.3 min (1,146.6 - 848.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,870.00'	258 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 644 cf Overall x 40.0% Voids
#2	1,871.00'	242 cf	Filter Media (Prismatic) Listed below (Recalc) 1,610 cf Overall x 15.0% Voids
#3	1,873.50'	4,639 cf	Surface Storage (Prismatic) Listed below (Recalc)
		5,138 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,870.00	644	0	0
1,871.00	644	644	644

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,871.00	644	0	0
1,873.50	644	1,610	1,610

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,873.50	644	0	0
1,874.00	1,260	476	476
1,875.00	2,031	1,646	2,122
1,876.00	3,003	2,517	4,639

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,870.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,870.00'	6.0" Vert. culvert C= 0.600
#3	Primary	1,875.00'	5.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=4.50 cfs @ 12.03 hrs HW=1,875.49' (Free Discharge)

- 2=culvert (Passes 0.04 cfs of 2.16 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.04 cfs)
- 3=Broad-Crested Rectangular Weir (Weir Controls 4.46 cfs @ 1.82 fps)

Summary for Pond O: Open Swale

Inflow Area = 4.430 ac, 15.50% Impervious, Inflow Depth = 3.09" for 10 Year event
 Inflow = 25.79 cfs @ 11.95 hrs, Volume= 1.140 af
 Outflow = 22.81 cfs @ 11.99 hrs, Volume= 1.140 af, Atten= 12%, Lag= 2.1 min
 Primary = 0.29 cfs @ 11.99 hrs, Volume= 0.500 af
 Secondary = 22.52 cfs @ 11.99 hrs, Volume= 0.640 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,839.74' @ 11.99 hrs Surf.Area= 12,425 sf Storage= 13,302 cf

Plug-Flow detention time= 218.5 min calculated for 1.140 af (100% of inflow)
 Center-of-Mass det. time= 218.8 min (1,045.0 - 826.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,834.00'	814 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,035 cf Overall x 40.0% Voids
#2	1,835.00'	763 cf	Filter Bed (Prismatic) Listed below (Recalc) 5,088 cf Overall x 15.0% Voids
#3	1,837.50'	13,965 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		15,542 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,834.00	2,035	0	0
1,835.00	2,035	2,035	2,035

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,835.00	2,035	0	0
1,837.50	2,035	5,088	5,088

07074_Pro-WildacresWest

Type II 24-hr 10 Year Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 26

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,837.50	2,035	0	0
1,838.00	3,275	1,328	1,328
1,839.00	6,500	4,888	6,215
1,840.00	9,000	7,750	13,965

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,834.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,834.00'	6.0" Vert. culvert C= 0.600
#3	Secondary	1,839.25'	25.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=0.29 cfs @ 11.99 hrs HW=1,839.73' (Free Discharge)

↳ **2=culvert** (Passes 0.29 cfs of 2.21 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.29 cfs)

Secondary OutFlow Max=22.04 cfs @ 11.99 hrs HW=1,839.73' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 22.04 cfs @ 1.82 fps)

Summary for Pond Q: OPEN SWALE

Inflow Area = 3.629 ac, 5.69% Impervious, Inflow Depth = 2.44" for 10 Year event
 Inflow = 15.50 cfs @ 11.98 hrs, Volume= 0.738 af
 Outflow = 9.42 cfs @ 12.06 hrs, Volume= 0.738 af, Atten= 39%, Lag= 4.9 min
 Primary = 9.42 cfs @ 12.06 hrs, Volume= 0.738 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,879.49' @ 12.06 hrs Surf.Area= 10,183 sf Storage= 10,510 cf

Plug-Flow detention time= 360.4 min calculated for 0.738 af (100% of inflow)
 Center-of-Mass det. time= 360.9 min (1,205.7 - 844.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,874.00'	928 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,319 cf Overall x 40.0% Voids
#2	1,875.00'	870 cf	Filter Media (Prismatic) Listed below (Recalc) 5,798 cf Overall x 15.0% Voids
#3	1,877.50'	11,728 cf	Surface Storage (Prismatic) Listed below (Recalc)
		13,525 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,874.00	2,319	0	0
1,875.00	2,319	2,319	2,319

07074_Pro-WildacresWest

Type II 24-hr 10 Year Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 27

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,875.00	2,319	0	0
1,877.50	2,319	5,798	5,798

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,877.50	3,319	0	0
1,878.00	3,840	1,790	1,790
1,879.00	4,913	4,377	6,166
1,880.00	6,211	5,562	11,728

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,874.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,874.00'	6.0" Vert. Culvert C= 0.600
#3	Primary	1,879.00'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00			
Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32			

Primary OutFlow Max=9.35 cfs @ 12.06 hrs HW=1,879.49' (Free Discharge)

- 2=Culvert (Passes 0.12 cfs of 2.16 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.12 cfs)
- 3=Broad-Crested Rectangular Weir (Weir Controls 9.23 cfs @ 1.90 fps)

Summary for Pond S: Open Swale

Inflow Area = 2.213 ac, 4.27% Impervious, Inflow Depth = 2.62" for 10 Year event
 Inflow = 9.99 cfs @ 11.99 hrs, Volume= 0.483 af
 Outflow = 11.00 cfs @ 11.98 hrs, Volume= 0.483 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.06 cfs @ 11.97 hrs, Volume= 0.166 af
 Secondary = 10.94 cfs @ 11.98 hrs, Volume= 0.317 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,919.18' @ 11.97 hrs Surf.Area= 5,538 sf Storage= 4,779 cf

Plug-Flow detention time= 285.4 min calculated for 0.483 af (100% of inflow)
 Center-of-Mass det. time= 285.8 min (1,126.4 - 840.5)

Volume	Invert	Avail.Storage	Storage Description
#1	1,914.50'	549 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 1,372 cf Overall x 40.0% Voids
#2	1,915.50'	412 cf	Filter Media (Prismatic) Listed below (Recalc) 2,744 cf Overall x 15.0% Voids
#3	1,917.50'	6,299 cf	Surface Storage (Prismatic) Listed below (Recalc)
		7,259 cf	Total Available Storage

07074_Pro-WildacresWest

Type II 24-hr 10 Year Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 28

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,914.50	1,372	0	0
1,915.50	1,372	1,372	1,372

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,915.50	1,372	0	0
1,917.50	1,372	2,744	2,744

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,917.50	1,372	0	0
1,918.00	2,190	891	891
1,920.00	3,218	5,408	6,299

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,914.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,914.50'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,919.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00			
Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31			
3.32			

Primary OutFlow Max=0.06 cfs @ 11.97 hrs HW=1,919.18' (Free Discharge)

↑2=Culvert (Passes 0.06 cfs of 1.99 cfs potential flow)

↑1=Exfiltration (Exfiltration Controls 0.06 cfs)

Secondary OutFlow Max=9.78 cfs @ 11.98 hrs HW=1,919.17' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Weir Controls 9.78 cfs @ 1.12 fps)

Summary for Pond sp1: Storm Planters

Inflow Area = 0.986 ac, 86.08% Impervious, Inflow Depth = 5.18" for 10 Year event
 Inflow = 8.33 cfs @ 11.96 hrs, Volume= 0.426 af
 Outflow = 1.06 cfs @ 12.19 hrs, Volume= 0.371 af, Atten= 87%, Lag= 14.0 min
 Primary = 1.06 cfs @ 12.19 hrs, Volume= 0.371 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,151.14' @ 12.19 hrs Surf.Area= 11,960 sf Storage= 10,537 cf

Plug-Flow detention time= 346.4 min calculated for 0.371 af (87% of inflow)
 Center-of-Mass det. time= 284.8 min (1,053.4 - 768.5)

07074_Pro-WildacresWest

Type II 24-hr 10 Year Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 29

Volume	Invert	Avail.Storage	Storage Description
#1	2,147.50'	2,392 cf	stone underdrain (Prismatic) Listed below (Recalc) -Impervious 5,980 cf Overall x 40.0% Voids
#2	2,148.50'	1,346 cf	filter media (Prismatic) Listed below (Recalc) 8,970 cf Overall x 15.0% Voids
#3	2,150.00'	11,960 cf	surface storage (Prismatic) Listed below (Recalc)
		15,698 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,147.50	5,980	0	0
2,148.50	5,980	5,980	5,980

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,148.50	5,980	0	0
2,150.00	5,980	8,970	8,970

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,150.00	5,980	0	0
2,151.00	5,980	5,980	5,980
2,152.00	5,980	5,980	11,960

Device	Routing	Invert	Outlet Devices
#1	Primary	2,147.50'	24.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,147.50' / 2,080.00' S= 0.1929 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,147.50'	1.000 in/hr Exfiltration over Surface area
#3	Device 1	2,151.00'	6.0" Horiz. Orifice/Grate X 3.00 C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.06 cfs @ 12.19 hrs HW=2,151.14' (Free Discharge)

1=Culvert (Passes 1.06 cfs of 24.56 cfs potential flow)

2=Exfiltration (Exfiltration Controls 0.28 cfs)

3=Orifice/Grate (Weir Controls 0.78 cfs @ 1.21 fps)

Summary for Pond T: Open Swale

Inflow Area = 1.813 ac, 7.66% Impervious, Inflow Depth = 2.81" for 10 Year event
 Inflow = 10.30 cfs @ 11.93 hrs, Volume= 0.424 af
 Outflow = 10.09 cfs @ 11.93 hrs, Volume= 0.424 af, Atten= 2%, Lag= 0.4 min
 Primary = 0.05 cfs @ 11.93 hrs, Volume= 0.121 af
 Secondary = 10.04 cfs @ 11.93 hrs, Volume= 0.303 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,991.18' @ 11.93 hrs Surf.Area= 4,261 sf Storage= 3,433 cf

Plug-Flow detention time= 229.8 min calculated for 0.424 af (100% of inflow)
 Center-of-Mass det. time= 229.7 min (1,061.0 - 831.3)

07074_Pro-WildacresWest

Type II 24-hr 10 Year Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 30

Volume	Invert	Avail.Storage	Storage Description
#1	1,986.50'	374 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 935 cf Overall x 40.0% Voids
#2	1,987.50'	281 cf	Filter Media (Prismatic) Listed below (Recalc) 1,870 cf Overall x 15.0% Voids
#3	1,989.50'	5,089 cf	Surface Storage (Prismatic) Listed below (Recalc)
		5,744 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,986.50	935	0	0
1,987.50	935	935	935

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,987.50	935	0	0
1,989.50	935	1,870	1,870

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,989.50	935	0	0
1,990.00	1,375	578	578
1,991.00	2,211	1,793	2,371
1,992.00	3,226	2,719	5,089

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,986.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,985.50'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,991.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.05 cfs @ 11.93 hrs HW=1,991.17' (Free Discharge)

↳ **2=Culvert** (Passes 0.05 cfs of 2.20 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.05 cfs)

Secondary OutFlow Max=9.82 cfs @ 11.93 hrs HW=1,991.17' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 9.82 cfs @ 1.12 fps)

Summary for Pond U: Open Swale

Inflow Area = 6.478 ac, 8.75% Impervious, Inflow Depth = 2.71" for 10 Year event
 Inflow = 24.91 cfs @ 12.04 hrs, Volume= 1.464 af
 Outflow = 24.48 cfs @ 12.06 hrs, Volume= 1.464 af, Atten= 2%, Lag= 1.0 min
 Primary = 24.48 cfs @ 12.06 hrs, Volume= 1.464 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresWest

Type II 24-hr 10 Year Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 31

Peak Elev= 2,015.32' @ 12.06 hrs Surf.Area= 11,834 sf Storage= 11,107 cf

Plug-Flow detention time= 203.0 min calculated for 1.463 af (100% of inflow)

Center-of-Mass det. time= 203.3 min (1,046.4 - 843.1)

Volume	Invert	Avail.Storage	Storage Description
#1	2,010.50'	1,034 cf	Stone Layer (Prismatic) Listed below (Recalc) 2,584 cf Overall x 40.0% Voids
#2	2,011.50'	775 cf	Filter Media (Prismatic) Listed below (Recalc) 5,168 cf Overall x 15.0% Voids
#3	2,013.50'	18,070 cf	Surface Storage (Prismatic) Listed below (Recalc)
		19,878 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,010.50	2,584	0	0
2,011.50	2,584	2,584	2,584

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,011.50	2,584	0	0
2,013.50	2,584	5,168	5,168

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,013.50	2,584	0	0
2,014.00	4,540	1,781	1,781
2,015.00	6,354	5,447	7,228
2,016.00	7,336	6,845	14,073
2,016.50	8,650	3,997	18,070

Device	Routing	Invert	Outlet Devices
#1	Device 2	2,010.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	2,010.50'	6.0" Round Culvert L= 25.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,010.50' / 2,010.25' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#3	Primary	2,015.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=24.37 cfs @ 12.06 hrs HW=2,015.32' (Free Discharge)

- 2=Culvert (Passes 0.14 cfs of 1.60 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.14 cfs)
- 3=Broad-Crested Rectangular Weir (Weir Controls 24.24 cfs @ 1.53 fps)

Summary for Pond W: Open Swale

Inflow Area = 8.723 ac, 9.84% Impervious, Inflow Depth = 2.77" for 10 Year event
 Inflow = 36.51 cfs @ 12.01 hrs, Volume= 2.013 af
 Outflow = 26.28 cfs @ 12.07 hrs, Volume= 2.013 af, Atten= 28%, Lag= 3.9 min
 Primary = 0.31 cfs @ 12.07 hrs, Volume= 0.724 af
 Secondary = 25.97 cfs @ 12.07 hrs, Volume= 1.289 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,790.49' @ 12.07 hrs Surf.Area= 13,445 sf Storage= 17,462 cf

Plug-Flow detention time= 199.4 min calculated for 2.013 af (100% of inflow)
 Center-of-Mass det. time= 199.1 min (1,158.4 - 959.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,784.00'	960 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 2,399 cf Overall x 40.0% Voids
#2	1,785.00'	900 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 5,998 cf Overall x 15.0% Voids
#3	1,787.50'	25,064 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,923 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,784.00	2,399	0	0
1,785.00	2,399	2,399	2,399

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,785.00	2,399	0	0
1,787.50	2,399	5,998	5,998

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,787.50	2,399	0	0
1,788.00	3,136	1,384	1,384
1,789.00	4,612	3,874	5,258
1,790.00	8,000	6,306	11,564
1,791.50	10,000	13,500	25,064

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,784.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,784.00'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,789.50'	10.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=0.31 cfs @ 12.07 hrs HW=1,790.47' (Free Discharge)

↳ **2=Culvert** (Passes 0.31 cfs of 2.36 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.31 cfs)

Secondary OutFlow Max=25.49 cfs @ 12.07 hrs HW=1,790.47' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 25.49 cfs @ 2.62 fps)

Summary for Pond X: Open Swale

Inflow Area = 2.495 ac, 6.71% Impervious, Inflow Depth = 2.53" for 10 Year event
 Inflow = 11.33 cfs @ 11.97 hrs, Volume= 0.526 af
 Outflow = 10.37 cfs @ 12.01 hrs, Volume= 0.526 af, Atten= 8%, Lag= 2.1 min
 Primary = 0.14 cfs @ 12.01 hrs, Volume= 0.239 af
 Secondary = 10.23 cfs @ 12.01 hrs, Volume= 0.287 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,799.41' @ 12.01 hrs Surf.Area= 6,192 sf Storage= 5,623 cf

Plug-Flow detention time= 204.0 min calculated for 0.526 af (100% of inflow)
 Center-of-Mass det. time= 203.8 min (1,045.7 - 841.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,794.00'	556 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 1,391 cf Overall x 40.0% Voids
#2	1,795.00'	522 cf	Filter Media (Prismatic) Listed below (Recalc) 3,478 cf Overall x 15.0% Voids
#3	1,797.50'	9,040 cf	Surface Storage (Prismatic) Listed below (Recalc)
		10,118 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,794.00	1,391	0	0
1,795.00	1,391	1,391	1,391

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,795.00	1,391	0	0
1,797.50	1,391	3,478	3,478

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,797.50	1,391	0	0
1,798.00	1,916	827	827
1,799.00	2,930	2,423	3,250
1,800.00	4,105	3,518	6,767
1,800.50	4,984	2,272	9,040

07074_Pro-WildacresWest

Type II 24-hr 10 Year Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 34

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,794.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,794.00'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,799.00'	15.0' long x 2.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50
			Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=0.14 cfs @ 12.01 hrs HW=1,799.40' (Free Discharge)

↳ **2=Culvert** (Passes 0.14 cfs of 2.15 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.14 cfs)

Secondary OutFlow Max=9.96 cfs @ 12.01 hrs HW=1,799.40' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 9.96 cfs @ 1.65 fps)

Summary for Pond B4: bioretention

Inflow Area = 4.919 ac, 18.04% Impervious, Inflow Depth = 4.79" for 100 Year event
 Inflow = 40.42 cfs @ 11.94 hrs, Volume= 1.964 af
 Outflow = 36.57 cfs @ 11.97 hrs, Volume= 1.906 af, Atten= 10%, Lag= 2.0 min
 Primary = 2.31 cfs @ 11.97 hrs, Volume= 1.171 af
 Secondary = 34.25 cfs @ 11.97 hrs, Volume= 0.735 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,144.99' @ 11.97 hrs Surf.Area= 22,658 sf Storage= 22,554 cf

Plug-Flow detention time= 148.3 min calculated for 1.905 af (97% of inflow)
 Center-of-Mass det. time= 130.8 min (938.5 - 807.7)

Volume	Invert	Avail.Storage	Storage Description
#1	2,138.00'	2,551 cf	stone underdrain (Prismatic) Listed below (Recalc) 6,377 cf Overall x 40.0% Voids
#2	2,139.00'	3,826 cf	filter media (Prismatic) Listed below (Recalc) 25,508 cf Overall x 15.0% Voids
#3	2,143.00'	16,265 cf	surface storage (Prismatic) Listed below (Recalc)
		22,642 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,138.00	6,377	0	0
2,139.00	6,377	6,377	6,377

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,139.00	6,377	0	0
2,143.00	6,377	25,508	25,508

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,143.00	6,377	0	0
2,144.00	8,116	7,247	7,247
2,145.00	9,920	9,018	16,265

Device	Routing	Invert	Outlet Devices
#1	Primary	2,139.00'	8.0" Round Culvert L= 100.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,139.00' / 2,137.00' S= 0.0200 1/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,138.00'	0.500 in/hr Exfiltration over Surface area
#3	Device 1	2,143.50'	8.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Secondary	2,144.25'	20.0' long x 4.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

Primary OutFlow Max=2.31 cfs @ 11.97 hrs HW=2,144.99' (Free Discharge)

1=Culvert (Passes 2.31 cfs of 3.50 cfs potential flow)

2=Exfiltration (Exfiltration Controls 0.26 cfs)

3=Orifice/Grate (Orifice Controls 2.05 cfs @ 5.87 fps)

Secondary OutFlow Max=33.98 cfs @ 11.97 hrs HW=2,144.99' (Free Discharge)

4=Broad-Crested Rectangular Weir (Weir Controls 33.98 cfs @ 2.30 fps)

Summary for Pond H: Pond H

Inflow Area = 14.937 ac, 17.76% Impervious, Inflow Depth = 4.82" for 100 Year event
 Inflow = 103.90 cfs @ 12.00 hrs, Volume= 5.994 af
 Outflow = 50.50 cfs @ 12.12 hrs, Volume= 5.989 af, Atten= 51%, Lag= 7.3 min
 Primary = 50.50 cfs @ 12.12 hrs, Volume= 5.989 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 1,996.00' Surf.Area= 4,665 sf Storage= 6,646 cf
 Peak Elev= 2,002.66' @ 12.12 hrs Surf.Area= 20,079 sf Storage= 88,004 cf (81,358 cf above start)

Plug-Flow detention time= 276.5 min calculated for 5.835 af (97% of inflow)
 Center-of-Mass det. time= 250.0 min (1,083.4 - 833.4)

Volume	Invert	Avail.Storage	Storage Description
#1	1,993.00'	95,049 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,993.00	385	0	0
1,994.00	1,192	789	789
1,996.00	4,665	5,857	6,646
1,997.00	6,868	5,767	12,412
1,998.00	9,300	8,084	20,496
2,000.00	13,640	22,940	43,436
2,002.00	18,315	31,955	75,391
2,003.00	21,000	19,658	95,049

Device	Routing	Invert	Outlet Devices
#1	Primary	1,995.00'	24.0" Round Culvert L= 335.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,995.00' / 1,983.90' S= 0.0331 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	1,996.00'	2.0" Vert. Orifice/Grate C= 0.600
#3	Device 1	1,999.10'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	2,002.00'	10.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=50.41 cfs @ 12.12 hrs HW=2,002.66' (Free Discharge)

- 1=Culvert (Passes 36.58 cfs of 39.02 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.27 cfs @ 12.34 fps)
- 3=Orifice/Grate (Orifice Controls 36.31 cfs @ 9.08 fps)
- 4=Broad-Crested Rectangular Weir (Weir Controls 13.83 cfs @ 2.11 fps)

Summary for Pond J: OPEN SWALE

Inflow Area = 1.775 ac, 27.88% Impervious, Inflow Depth = 5.69" for 100 Year event
 Inflow = 17.44 cfs @ 11.92 hrs, Volume= 0.841 af
 Outflow = 14.83 cfs @ 11.96 hrs, Volume= 0.841 af, Atten= 15%, Lag= 2.5 min
 Primary = 5.14 cfs @ 11.96 hrs, Volume= 0.675 af
 Secondary = 9.68 cfs @ 11.96 hrs, Volume= 0.166 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,992.23' @ 11.96 hrs Surf.Area= 8,109 sf Storage= 8,624 cf

Plug-Flow detention time= 52.3 min calculated for 0.841 af (100% of inflow)
 Center-of-Mass det. time= 52.4 min (836.0 - 783.6)

Volume	Invert	Avail.Storage	Storage Description
#1	1,986.50'	720 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 1,800 cf Overall x 40.0% Voids
#2	1,987.50'	675 cf	Filter Media (Prismatic) Listed below (Recalc) 4,500 cf Overall x 15.0% Voids
#3	1,990.00'	8,500 cf	Surface Storage (Prismatic) Listed below (Recalc)
		9,895 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,986.50	1,800	0	0
1,987.50	1,800	1,800	1,800

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,987.50	1,800	0	0
1,990.00	1,800	4,500	4,500

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,990.00	1,800	0	0
1,991.00	3,200	2,500	2,500
1,992.50	4,800	6,000	8,500

Device	Routing	Invert	Outlet Devices
#1	Primary	1,986.50'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,989.50'	8.0" Round Culvert L= 70.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 1,989.50' / 1,984.00' S= 0.0786 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#3	Secondary	1,991.50'	6.0' long x 2.0' breadth Broad-Crested Rectangular Weir

			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00	2.50
				3.00	3.50									
			Coef. (English)	2.54	2.61	2.61	2.60	2.66	2.70	2.77	2.89	2.88	2.85	3.07
				3.20	3.32									
#4	Primary	1,992.00'	10.0' long x 30.0' breadth Broad-Crested Rectangular Weir											
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60			
			Coef. (English)	2.68	2.70	2.70	2.64	2.63	2.64	2.64	2.63			

Primary OutFlow Max=4.98 cfs @ 11.96 hrs HW=1,992.22' (Free Discharge)

- 1=Exfiltration (Exfiltration Controls 0.19 cfs)
- 2=Culvert (Inlet Controls 2.05 cfs @ 5.87 fps)
- 4=Broad-Crested Rectangular Weir (Weir Controls 2.74 cfs @ 1.25 fps)

Secondary OutFlow Max=9.52 cfs @ 11.96 hrs HW=1,992.22' (Free Discharge)

- 3=Broad-Crested Rectangular Weir (Weir Controls 9.52 cfs @ 2.21 fps)

Summary for Pond K: P1

Inflow Area =	7.908 ac, 12.10% Impervious, Inflow Depth = 4.61" for 100 Year event
Inflow =	45.30 cfs @ 12.02 hrs, Volume= 3.041 af
Outflow =	33.99 cfs @ 12.13 hrs, Volume= 3.040 af, Atten= 25%, Lag= 6.2 min
Primary =	33.99 cfs @ 12.13 hrs, Volume= 3.040 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 2,018.00' Surf.Area= 2,252 sf Storage= 4,088 cf
 Peak Elev= 2,024.25' @ 12.13 hrs Surf.Area= 16,785 sf Storage= 51,959 cf (47,871 cf above start)

Plug-Flow detention time= 585.6 min calculated for 2.946 af (97% of inflow)
 Center-of-Mass det. time= 544.4 min (1,362.1 - 817.7)

Volume	Invert	Avail.Storage	Storage Description
#1	2,014.00'	56,425 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,014.00	117	0	0
2,016.00	896	1,013	1,013
2,016.50	1,162	515	1,528
2,018.00	2,252	2,561	4,088
2,020.00	4,326	6,578	10,666
2,022.00	9,000	13,326	23,992
2,024.00	15,031	24,031	48,023
2,024.50	18,575	8,402	56,425

Device	Routing	Invert	Outlet Devices
#1	Primary	2,017.50'	24.0" Round Culvert L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,017.50' / 2,016.50' S= 0.0200 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	2,018.00'	1.7" Vert. Orifice/Grate C= 0.600
#3	Device 1	2,021.50'	3.0" Vert. Orifice/Grate C= 0.600
#4	Device 1	2,023.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600

#5 Primary 2,024.00' Limited to weir flow at low heads
51.0' long x 1.0' breadth Broad-Crested Rectangular Weir
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50
 3.00
 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31
 3.32

Primary OutFlow Max=33.84 cfs @ 12.13 hrs HW=2,024.24' (Free Discharge)

- 1=Culvert (Passes 17.19 cfs of 36.26 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.19 cfs @ 11.96 fps)
- 3=Orifice/Grate (Orifice Controls 0.38 cfs @ 7.79 fps)
- 4=Orifice/Grate (Orifice Controls 16.62 cfs @ 4.16 fps)
- 5=Broad-Crested Rectangular Weir (Weir Controls 16.65 cfs @ 1.33 fps)

Summary for Pond L: Pond L - P1

Inflow Area = 21.422 ac, 18.68% Impervious, Inflow Depth = 4.99" for 100 Year event
 Inflow = 123.83 cfs @ 11.96 hrs, Volume= 8.899 af
 Outflow = 90.24 cfs @ 12.09 hrs, Volume= 8.897 af, Atten= 27%, Lag= 7.8 min
 Primary = 90.24 cfs @ 12.09 hrs, Volume= 8.897 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Starting Elev= 1,944.00' Surf.Area= 5,350 sf Storage= 8,885 cf
 Peak Elev= 1,950.58' @ 12.09 hrs Surf.Area= 30,572 sf Storage= 120,230 cf (111,345 cf above start)

Plug-Flow detention time= 283.5 min calculated for 8.690 af (98% of inflow)
 Center-of-Mass det. time= 259.8 min (1,067.7 - 808.0)

Volume	Invert	Avail.Storage	Storage Description
#1	1,941.50'	133,175 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,941.50	1,964	0	0
1,942.00	2,435	1,100	1,100
1,944.00	5,350	7,785	8,885
1,946.00	11,083	16,433	25,318
1,948.00	17,735	28,818	54,136
1,949.00	25,553	21,644	75,780
1,949.75	27,569	19,921	95,701
1,950.00	29,207	7,097	102,798
1,951.00	31,547	30,377	133,175

Device	Routing	Invert	Outlet Devices
#1	Primary	1,943.00'	21.0" Round Culvert L= 60.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,943.00' / 1,942.50' S= 0.0083 1/8" Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Device 1	1,944.00'	2.7" Vert. Orifice/Grate C= 0.600
#3	Device 1	1,948.00'	30.0" x 30.0" Horiz. Orifice/Grate C= 0.600
			Limited to weir flow at low heads
#4	Primary	1,949.50'	20.0' long x 4.0' breadth Broad-Crested Rectangular Weir

Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00	2.50
	3.00	3.50	4.00	4.50	5.00	5.50					
Coef. (English)	2.38	2.54	2.69	2.68	2.67	2.67	2.65	2.66	2.66	2.68	2.72
	2.73	2.76	2.79	2.88	3.07	3.32					

Primary OutFlow Max=90.02 cfs @ 12.09 hrs HW=1,950.58' (Free Discharge)

- 1=Culvert (Inlet Controls 29.99 cfs @ 12.47 fps)
- 2=Orifice/Grate (Passes < 0.49 cfs potential flow)
- 3=Orifice/Grate (Passes < 48.35 cfs potential flow)
- 4=Broad-Crested Rectangular Weir (Weir Controls 60.03 cfs @ 2.78 fps)

Summary for Pond M: OPEN SWALE

Inflow Area = 4.790 ac, 2.76% Impervious, Inflow Depth = 4.01" for 100 Year event
 Inflow = 34.32 cfs @ 11.97 hrs, Volume= 1.600 af
 Outflow = 23.30 cfs @ 12.04 hrs, Volume= 1.586 af, Atten= 32%, Lag= 4.0 min
 Primary = 23.30 cfs @ 12.04 hrs, Volume= 1.586 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,890.41' @ 12.04 hrs Surf.Area= 15,067 sf Storage= 20,746 cf

Plug-Flow detention time= 201.2 min calculated for 1.586 af (99% of inflow)
 Center-of-Mass det. time= 195.7 min (1,025.6 - 829.9)

Volume	Invert	Avail.Storage	Storage Description
#1	1,884.00'	1,198 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,995 cf Overall x 40.0% Voids
#2	1,885.00'	1,123 cf	Filter Media (Prismatic) Listed below (Recalc) 7,488 cf Overall x 15.0% Voids
#3	1,887.50'	19,290 cf	Surface Storage (Prismatic) Listed below (Recalc)
		21,611 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,884.00	2,995	0	0
1,885.00	2,995	2,995	2,995

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,885.00	2,995	0	0
1,887.50	2,995	7,488	7,488

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,887.50	2,995	0	0
1,888.00	4,500	1,874	1,874
1,889.00	6,437	5,469	7,342
1,890.00	8,574	7,506	14,848
1,890.50	9,195	4,442	19,290

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,884.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,884.50'	6.0" Vert. Culvert C= 0.600
#3	Primary	1,889.00'	5.0' long x 2.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50
			3.00 3.50
			Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07
			3.20 3.32

Primary OutFlow Max=23.00 cfs @ 12.04 hrs HW=1,890.40' (Free Discharge)

2=Culvert (Passes 0.17 cfs of 2.25 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.17 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 22.83 cfs @ 3.27 fps)

Summary for Pond N: OPEN SWALE

Inflow Area = 1.568 ac, 2.65% Impervious, Inflow Depth = 3.78" for 100 Year event
 Inflow = 10.98 cfs @ 11.96 hrs, Volume= 0.494 af
 Outflow = 9.64 cfs @ 12.00 hrs, Volume= 0.494 af, Atten= 12%, Lag= 2.1 min
 Primary = 9.64 cfs @ 12.00 hrs, Volume= 0.494 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,875.82' @ 12.00 hrs Surf.Area= 4,111 sf Storage= 4,599 cf

Plug-Flow detention time= 183.2 min calculated for 0.494 af (100% of inflow)
 Center-of-Mass det. time= 183.7 min (1,016.9 - 833.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,870.00'	258 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 644 cf Overall x 40.0% Voids
#2	1,871.00'	242 cf	Filter Media (Prismatic) Listed below (Recalc) 1,610 cf Overall x 15.0% Voids
#3	1,873.50'	4,639 cf	Surface Storage (Prismatic) Listed below (Recalc)
		5,138 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,870.00	644	0	0
1,871.00	644	644	644

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,871.00	644	0	0
1,873.50	644	1,610	1,610

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,873.50	644	0	0
1,874.00	1,260	476	476
1,875.00	2,031	1,646	2,122
1,876.00	3,003	2,517	4,639

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,870.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,870.00'	6.0" Vert. culvert C= 0.600
#3	Primary	1,875.00'	5.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=9.58 cfs @ 12.00 hrs HW=1,875.81' (Free Discharge)

- 2=culvert (Passes 0.05 cfs of 2.23 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.05 cfs)
- 3=Broad-Crested Rectangular Weir (Weir Controls 9.53 cfs @ 2.35 fps)

Summary for Pond O: Open Swale

Inflow Area = 4.430 ac, 15.50% Impervious, Inflow Depth = 4.81" for 100 Year event
 Inflow = 39.54 cfs @ 11.95 hrs, Volume= 1.776 af
 Outflow = 36.92 cfs @ 11.97 hrs, Volume= 1.776 af, Atten= 7%, Lag= 1.5 min
 Primary = 0.30 cfs @ 11.97 hrs, Volume= 0.522 af
 Secondary = 36.62 cfs @ 11.97 hrs, Volume= 1.254 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,839.93' @ 11.97 hrs Surf.Area= 12,897 sf Storage= 14,927 cf

Plug-Flow detention time= 146.1 min calculated for 1.775 af (100% of inflow)
 Center-of-Mass det. time= 146.4 min (960.0 - 813.6)

Volume	Invert	Avail.Storage	Storage Description
#1	1,834.00'	814 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,035 cf Overall x 40.0% Voids
#2	1,835.00'	763 cf	Filter Bed (Prismatic) Listed below (Recalc) 5,088 cf Overall x 15.0% Voids
#3	1,837.50'	13,965 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		15,542 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,834.00	2,035	0	0
1,835.00	2,035	2,035	2,035

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,835.00	2,035	0	0
1,837.50	2,035	5,088	5,088

07074_Pro-WildacresWest

Type II 24-hr 100 Year Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 43

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,837.50	2,035	0	0
1,838.00	3,275	1,328	1,328
1,839.00	6,500	4,888	6,215
1,840.00	9,000	7,750	13,965

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,834.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,834.00'	6.0" Vert. culvert C= 0.600
#3	Secondary	1,839.25'	25.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=0.30 cfs @ 11.97 hrs HW=1,839.93' (Free Discharge)

↑2=**culvert** (Passes 0.30 cfs of 2.25 cfs potential flow)

↑1=**Exfiltration** (Exfiltration Controls 0.30 cfs)

Secondary OutFlow Max=36.32 cfs @ 11.97 hrs HW=1,839.93' (Free Discharge)

↑3=**Broad-Crested Rectangular Weir** (Weir Controls 36.32 cfs @ 2.14 fps)

Summary for Pond Q: OPEN SWALE

Inflow Area = 3.629 ac, 5.69% Impervious, Inflow Depth = 4.01" for 100 Year event
 Inflow = 25.41 cfs @ 11.98 hrs, Volume= 1.212 af
 Outflow = 22.67 cfs @ 12.02 hrs, Volume= 1.212 af, Atten= 11%, Lag= 2.2 min
 Primary = 22.67 cfs @ 12.02 hrs, Volume= 1.212 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,879.85' @ 12.02 hrs Surf.Area= 10,653 sf Storage= 12,602 cf

Plug-Flow detention time= 225.2 min calculated for 1.212 af (100% of inflow)
 Center-of-Mass det. time= 225.7 min (1,056.1 - 830.4)

Volume	Invert	Avail.Storage	Storage Description
#1	1,874.00'	928 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 2,319 cf Overall x 40.0% Voids
#2	1,875.00'	870 cf	Filter Media (Prismatic) Listed below (Recalc) 5,798 cf Overall x 15.0% Voids
#3	1,877.50'	11,728 cf	Surface Storage (Prismatic) Listed below (Recalc)
		13,525 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,874.00	2,319	0	0
1,875.00	2,319	2,319	2,319

07074_Pro-WildacresWest

Type II 24-hr 100 Year Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 44

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,875.00	2,319	0	0
1,877.50	2,319	5,798	5,798

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,877.50	3,319	0	0
1,878.00	3,840	1,790	1,790
1,879.00	4,913	4,377	6,166
1,880.00	6,211	5,562	11,728

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,874.00'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,874.00'	6.0" Vert. Culvert C= 0.600
#3	Primary	1,879.00'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=22.30 cfs @ 12.02 hrs HW=1,879.84' (Free Discharge)

- 2=Culvert (Passes 0.12 cfs of 2.24 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.12 cfs)
- 3=Broad-Crested Rectangular Weir (Weir Controls 22.18 cfs @ 2.64 fps)

Summary for Pond S: Open Swale

Inflow Area = 2.213 ac, 4.27% Impervious, Inflow Depth = 4.24" for 100 Year event
 Inflow = 16.02 cfs @ 11.98 hrs, Volume= 0.781 af
 Outflow = 15.98 cfs @ 11.99 hrs, Volume= 0.781 af, Atten= 0%, Lag= 0.5 min
 Primary = 0.06 cfs @ 11.99 hrs, Volume= 0.171 af
 Secondary = 15.92 cfs @ 11.99 hrs, Volume= 0.611 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,919.24' @ 11.99 hrs Surf.Area= 5,572 sf Storage= 4,963 cf

Plug-Flow detention time= 180.0 min calculated for 0.781 af (100% of inflow)
 Center-of-Mass det. time= 180.6 min (1,007.3 - 826.7)

Volume	Invert	Avail.Storage	Storage Description
#1	1,914.50'	549 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 1,372 cf Overall x 40.0% Voids
#2	1,915.50'	412 cf	Filter Media (Prismatic) Listed below (Recalc) 2,744 cf Overall x 15.0% Voids
#3	1,917.50'	6,299 cf	Surface Storage (Prismatic) Listed below (Recalc)
		7,259 cf	Total Available Storage

07074_Pro-WildacresWest

Type II 24-hr 100 Year Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 45

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,914.50	1,372	0	0
1,915.50	1,372	1,372	1,372

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,915.50	1,372	0	0
1,917.50	1,372	2,744	2,744

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,917.50	1,372	0	0
1,918.00	2,190	891	891
1,920.00	3,218	5,408	6,299

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,914.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,914.50'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,919.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00			
Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31			
3.32			

Primary OutFlow Max=0.06 cfs @ 11.99 hrs HW=1,919.24' (Free Discharge)

↑2=**Culvert** (Passes 0.06 cfs of 2.00 cfs potential flow)

↑1=**Exfiltration** (Exfiltration Controls 0.06 cfs)

Secondary OutFlow Max=15.66 cfs @ 11.99 hrs HW=1,919.24' (Free Discharge)

↑3=**Broad-Crested Rectangular Weir** (Weir Controls 15.66 cfs @ 1.32 fps)

Summary for Pond sp1: Storm Planters

Inflow Area = 0.986 ac, 86.08% Impervious, Inflow Depth = 7.16" for 100 Year event
 Inflow = 11.29 cfs @ 11.96 hrs, Volume= 0.589 af
 Outflow = 2.47 cfs @ 12.10 hrs, Volume= 0.534 af, Atten= 78%, Lag= 8.6 min
 Primary = 2.47 cfs @ 12.10 hrs, Volume= 0.534 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 2,151.60' @ 12.10 hrs Surf.Area= 11,960 sf Storage= 13,292 cf

Plug-Flow detention time= 290.9 min calculated for 0.534 af (91% of inflow)
 Center-of-Mass det. time= 242.0 min (1,002.7 - 760.7)

07074_Pro-WildacresWest

Type II 24-hr 100 Year Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 46

Volume	Invert	Avail.Storage	Storage Description
#1	2,147.50'	2,392 cf	stone underdrain (Prismatic) Listed below (Recalc) -Impervious 5,980 cf Overall x 40.0% Voids
#2	2,148.50'	1,346 cf	filter media (Prismatic) Listed below (Recalc) 8,970 cf Overall x 15.0% Voids
#3	2,150.00'	11,960 cf	surface storage (Prismatic) Listed below (Recalc)
		15,698 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,147.50	5,980	0	0
2,148.50	5,980	5,980	5,980

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,148.50	5,980	0	0
2,150.00	5,980	8,970	8,970

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,150.00	5,980	0	0
2,151.00	5,980	5,980	5,980
2,152.00	5,980	5,980	11,960

Device	Routing	Invert	Outlet Devices
#1	Primary	2,147.50'	24.0" Round Culvert L= 350.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,147.50' / 2,080.00' S= 0.1929 1/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	2,147.50'	1.000 in/hr Exfiltration over Surface area
#3	Device 1	2,151.00'	6.0" Horiz. Orifice/Grate X 3.00 C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.47 cfs @ 12.10 hrs HW=2,151.60' (Free Discharge)

- 1=Culvert (Passes 2.47 cfs of 26.61 cfs potential flow)
- 2=Exfiltration (Exfiltration Controls 0.28 cfs)
- 3=Orifice/Grate (Orifice Controls 2.19 cfs @ 3.72 fps)

Summary for Pond T: Open Swale

Inflow Area = 1.813 ac, 7.66% Impervious, Inflow Depth = 4.46" for 100 Year event
 Inflow = 15.99 cfs @ 11.92 hrs, Volume= 0.675 af
 Outflow = 15.84 cfs @ 11.93 hrs, Volume= 0.674 af, Atten= 1%, Lag= 0.3 min
 Primary = 0.05 cfs @ 11.93 hrs, Volume= 0.124 af
 Secondary = 15.79 cfs @ 11.93 hrs, Volume= 0.550 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,991.24' @ 11.93 hrs Surf.Area= 4,324 sf Storage= 3,583 cf

Plug-Flow detention time= 147.9 min calculated for 0.674 af (100% of inflow)
 Center-of-Mass det. time= 148.2 min (966.2 - 818.0)

07074_Pro-WildacresWest

Type II 24-hr 100 Year Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 47

Volume	Invert	Avail.Storage	Storage Description
#1	1,986.50'	374 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 935 cf Overall x 40.0% Voids
#2	1,987.50'	281 cf	Filter Media (Prismatic) Listed below (Recalc) 1,870 cf Overall x 15.0% Voids
#3	1,989.50'	5,089 cf	Surface Storage (Prismatic) Listed below (Recalc)
		5,744 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,986.50	935	0	0
1,987.50	935	935	935

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,987.50	935	0	0
1,989.50	935	1,870	1,870

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,989.50	935	0	0
1,990.00	1,375	578	578
1,991.00	2,211	1,793	2,371
1,992.00	3,226	2,719	5,089

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,986.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	1,985.50'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,991.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.05 cfs @ 11.93 hrs HW=1,991.24' (Free Discharge)

↑2=Culvert (Passes 0.05 cfs of 2.21 cfs potential flow)

↑1=Exfiltration (Exfiltration Controls 0.05 cfs)

Secondary OutFlow Max=15.39 cfs @ 11.93 hrs HW=1,991.24' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Weir Controls 15.39 cfs @ 1.31 fps)

Summary for Pond U: Open Swale

Inflow Area = 6.478 ac, 8.75% Impervious, Inflow Depth = 4.35" for 100 Year event
 Inflow = 39.97 cfs @ 12.04 hrs, Volume= 2.348 af
 Outflow = 39.43 cfs @ 12.05 hrs, Volume= 2.349 af, Atten= 1%, Lag= 0.8 min
 Primary = 39.43 cfs @ 12.05 hrs, Volume= 2.349 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresWest

Type II 24-hr 100 Year Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 48

Peak Elev= 2,015.44' @ 12.05 hrs Surf.Area= 11,950 sf Storage= 11,901 cf

Plug-Flow detention time= 129.8 min calculated for 2.348 af (100% of inflow)

Center-of-Mass det. time= 130.5 min (960.0 - 829.5)

Volume	Invert	Avail.Storage	Storage Description
#1	2,010.50'	1,034 cf	Stone Layer (Prismatic) Listed below (Recalc) 2,584 cf Overall x 40.0% Voids
#2	2,011.50'	775 cf	Filter Media (Prismatic) Listed below (Recalc) 5,168 cf Overall x 15.0% Voids
#3	2,013.50'	18,070 cf	Surface Storage (Prismatic) Listed below (Recalc)
		19,878 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,010.50	2,584	0	0
2,011.50	2,584	2,584	2,584

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,011.50	2,584	0	0
2,013.50	2,584	5,168	5,168

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
2,013.50	2,584	0	0
2,014.00	4,540	1,781	1,781
2,015.00	6,354	5,447	7,228
2,016.00	7,336	6,845	14,073
2,016.50	8,650	3,997	18,070

Device	Routing	Invert	Outlet Devices
#1	Device 2	2,010.50'	0.500 in/hr Exfiltration over Surface area
#2	Primary	2,010.50'	6.0" Round Culvert L= 25.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,010.50' / 2,010.25' S= 0.0100 1/1' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#3	Primary	2,015.00'	50.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=39.14 cfs @ 12.05 hrs HW=2,015.43' (Free Discharge)

2=Culvert (Passes 0.14 cfs of 1.62 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.14 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 39.00 cfs @ 1.80 fps)

Summary for Pond W: Open Swale

Inflow Area = 8.723 ac, 9.84% Impervious, Inflow Depth = 4.42" for 100 Year event
 Inflow = 63.70 cfs @ 11.98 hrs, Volume= 3.209 af
 Outflow = 56.77 cfs @ 12.02 hrs, Volume= 3.209 af, Atten= 11%, Lag= 2.4 min
 Primary = 0.33 cfs @ 12.02 hrs, Volume= 0.746 af
 Secondary = 56.44 cfs @ 12.02 hrs, Volume= 2.463 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,791.07' @ 12.02 hrs Surf.Area= 14,225 sf Storage= 22,748 cf

Plug-Flow detention time= 129.1 min calculated for 3.208 af (100% of inflow)
 Center-of-Mass det. time= 129.1 min (1,032.3 - 903.2)

Volume	Invert	Avail.Storage	Storage Description
#1	1,784.00'	960 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 2,399 cf Overall x 40.0% Voids
#2	1,785.00'	900 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 5,998 cf Overall x 15.0% Voids
#3	1,787.50'	25,064 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,923 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,784.00	2,399	0	0
1,785.00	2,399	2,399	2,399

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,785.00	2,399	0	0
1,787.50	2,399	5,998	5,998

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,787.50	2,399	0	0
1,788.00	3,136	1,384	1,384
1,789.00	4,612	3,874	5,258
1,790.00	8,000	6,306	11,564
1,791.50	10,000	13,500	25,064

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,784.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,784.00'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,789.50'	10.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=0.33 cfs @ 12.02 hrs HW=1,791.06' (Free Discharge)

↳ **2=Culvert** (Passes 0.33 cfs of 2.47 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.33 cfs)

Secondary OutFlow Max=56.03 cfs @ 12.02 hrs HW=1,791.06' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 56.03 cfs @ 3.59 fps)

Summary for Pond X: Open Swale

Inflow Area = 2.495 ac, 6.71% Impervious, Inflow Depth = 4.12" for 100 Year event
 Inflow = 18.36 cfs @ 11.97 hrs, Volume= 0.857 af
 Outflow = 17.64 cfs @ 11.99 hrs, Volume= 0.857 af, Atten= 4%, Lag= 1.3 min
 Primary = 0.15 cfs @ 11.99 hrs, Volume= 0.248 af
 Secondary = 17.49 cfs @ 11.99 hrs, Volume= 0.609 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,799.58' @ 11.99 hrs Surf.Area= 6,398 sf Storage= 6,240 cf

Plug-Flow detention time= 129.1 min calculated for 0.857 af (100% of inflow)
 Center-of-Mass det. time= 129.4 min (957.2 - 827.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,794.00'	556 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 1,391 cf Overall x 40.0% Voids
#2	1,795.00'	522 cf	Filter Media (Prismatic) Listed below (Recalc) 3,478 cf Overall x 15.0% Voids
#3	1,797.50'	9,040 cf	Surface Storage (Prismatic) Listed below (Recalc)
		10,118 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,794.00	1,391	0	0
1,795.00	1,391	1,391	1,391

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,795.00	1,391	0	0
1,797.50	1,391	3,478	3,478

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,797.50	1,391	0	0
1,798.00	1,916	827	827
1,799.00	2,930	2,423	3,250
1,800.00	4,105	3,518	6,767
1,800.50	4,984	2,272	9,040

07074_Pro-WildacresWest

Type II 24-hr 100 Year Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 51

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,794.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,794.00'	6.0" Vert. Culvert C= 0.600
#3	Secondary	1,799.00'	15.0' long x 2.0' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50
			Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=0.15 cfs @ 11.99 hrs HW=1,799.58' (Free Discharge)

↳ **2=Culvert** (Passes 0.15 cfs of 2.18 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.15 cfs)

Secondary OutFlow Max=17.23 cfs @ 11.99 hrs HW=1,799.58' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 17.23 cfs @ 1.99 fps)

Design Point Summary

1-yr Storm Event

Design Point Totals

10, 25 & 100-yr Storm Events

Summary for Pond DP 7: Design Point 7

Inflow Area = 130.681 ac, 1.83% Impervious, Inflow Depth = 0.62" for 1 Year event
Inflow = 50.89 cfs @ 12.39 hrs, Volume= 6.798 af
Primary = 50.89 cfs @ 12.39 hrs, Volume= 6.798 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 8: Design Point 8

Inflow Area = 110.933 ac, 7.24% Impervious, Inflow Depth > 0.68" for 1 Year event
Inflow = 22.63 cfs @ 12.05 hrs, Volume= 6.268 af
Primary = 22.63 cfs @ 12.05 hrs, Volume= 6.268 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 9: Design Point 9

Inflow Area = 45.925 ac, 10.39% Impervious, Inflow Depth > 0.74" for 1 Year event
Inflow = 15.26 cfs @ 12.21 hrs, Volume= 2.814 af
Primary = 15.26 cfs @ 12.21 hrs, Volume= 2.814 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

07074_Pro-WildacresWest

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10 Year Rainfall=6.00"

Printed 2/27/2012

Page 1

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 7: Design Point 7

Inflow=298.77 cfs 30.976 af
Primary=298.77 cfs 30.976 af

Pond DP 8: Design Point 8

Inflow=188.59 cfs 26.990 af
Primary=188.59 cfs 26.990 af

Pond DP 9: Design Point 9

Inflow=116.13 cfs 11.676 af
Primary=116.13 cfs 11.676 af

07074_Pro-WildacresWest

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 25 Year Rainfall=6.50"

Printed 2/27/2012

Page 2

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 7: Design Point 7

Inflow=343.50 cfs 35.378 af
Primary=343.50 cfs 35.378 af

Pond DP 8: Design Point 8

Inflow=241.25 cfs 30.741 af
Primary=241.25 cfs 30.741 af

Pond DP 9: Design Point 9

Inflow=136.19 cfs 13.262 af
Primary=136.19 cfs 13.262 af

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 7: Design Point 7

Inflow=483.32 cfs 49.138 af
Primary=483.32 cfs 49.138 af

Pond DP 8: Design Point 8

Inflow=416.82 cfs 42.447 af
Primary=416.82 cfs 42.447 af

Pond DP 9: Design Point 9




Inflow=193.69 cfs 18.193 af
Primary=193.69 cfs 18.193 af

APPENDIX G

HydroCAD Data – Proposed Model – Wildacres East

- 1. Proposed Model Diagram, Area/Soil Listings and Subcatchment Summaries**
- 2. Proposed Reach and Culvert Summaries – 1 & 10-yr Storm Events**
- 3. Proposed Pond Summaries – 1, 10 & 100-yr Storm Events**
- 4. Proposed Design Point Summaries - 1-yr Event**
- 5. Proposed Design Point Totals – 10, 25 and 100-yr Storm Events**

**Model Diagram, Area and Soil Listings
and Subcatchment Summaries**

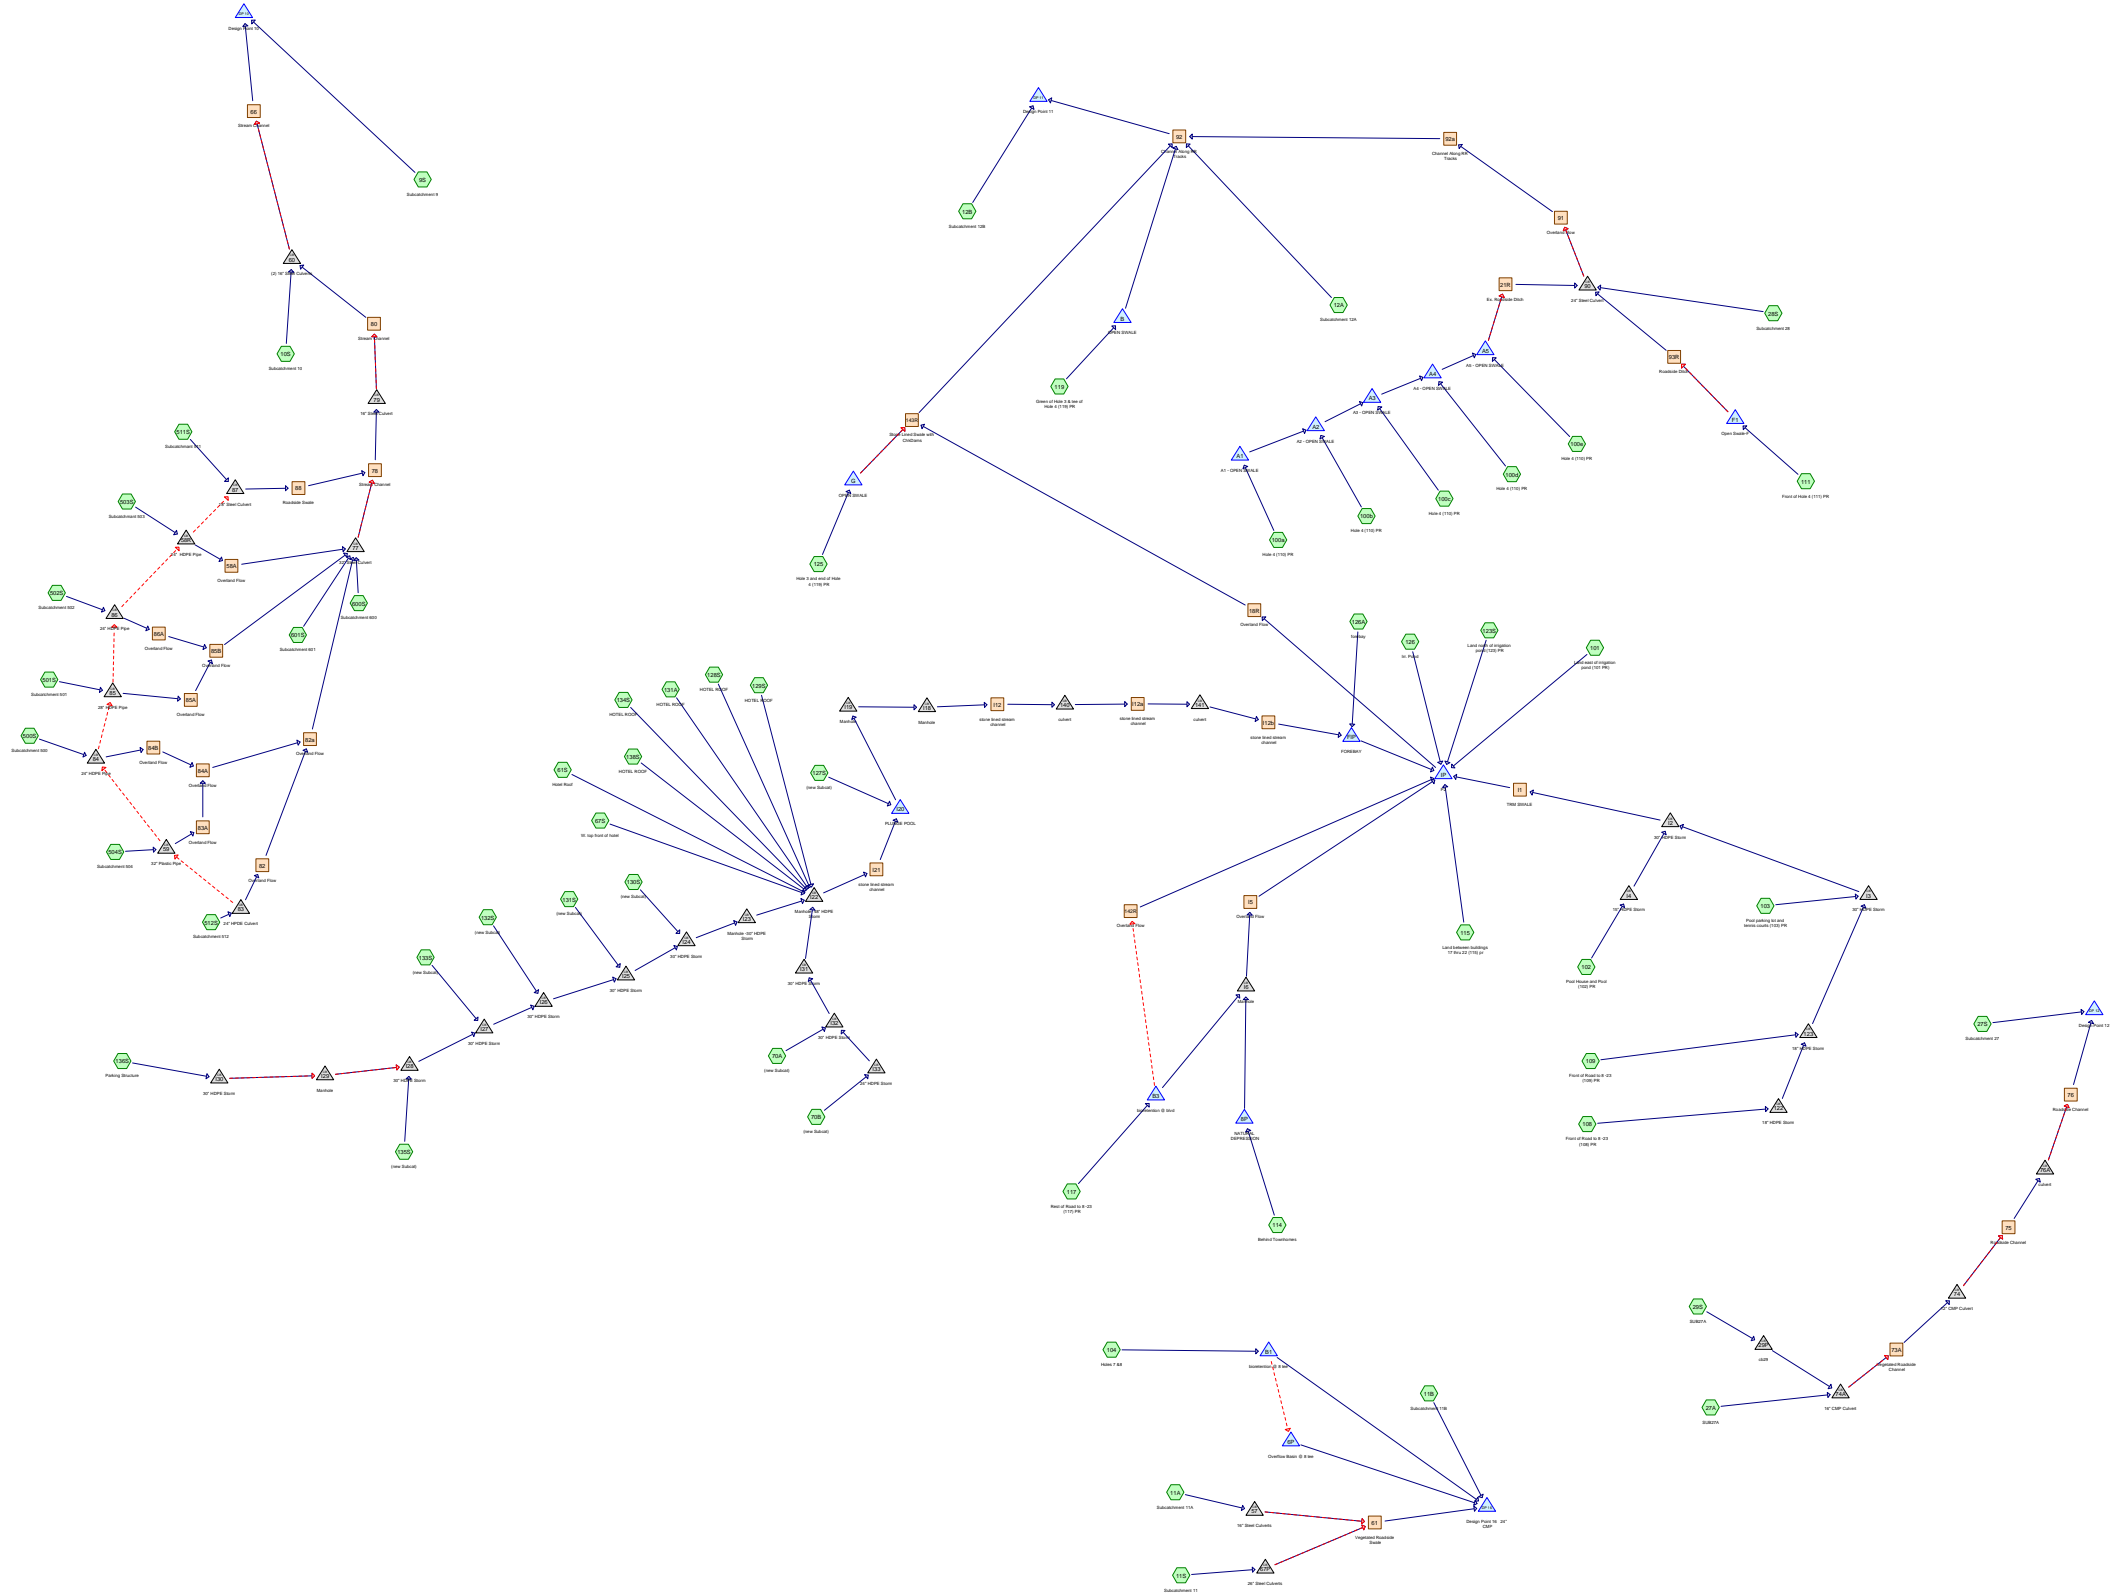

Drainage Diagram for 07074_Pro-WildacresEast
 Prepared by The LA group, Printed 2/27/2012
 HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
23.643	61	>75% Grass cover, Good, HSG B (9S, 11B, 12A, 27A, 100a, 100b, 100c, 100d, 100e, 104, 111, 114, 115, 119, 123S, 125, 127S)
0.635	68	Porous Pavement (127S)
175.556	70	Woods, Good, HSG C (9S, 10S, 11A, 11B, 11S, 12A, 12B, 27A, 27S, 28S, 100a, 100b, 104, 114, 119, 125, 127S, 135S, 500S, 501S, 502S, 503S, 504S, 511S, 512S, 600S, 601S)
16.030	71	Meadow, non-grazed, HSG C (9S, 10S, 27A, 28S, 500S, 501S, 502S)
0.674	73	Woods, Fair, HSG C (115, 117)
33.488	74	>75% Grass cover, Good, HSG C (11B, 12A, 12B, 27S, 29S, 70A, 70B, 100a, 100b, 100c, 100d, 100e, 101, 103, 104, 108, 109, 111, 114, 115, 117, 119, 125, 126, 127S, 130S, 131S, 132S, 133S, 135S, 504S)
1.107	98	Paved (27A, 29S, 61S, 108)
9.384	98	Paved parking & roofs (11A, 11B, 11S, 12A, 70A, 70B, 102, 103, 109, 115, 117, 130S, 131A, 131S, 132S, 134S, 136S)
0.393	98	Paved parking, HSG C (9S, 135S)
0.432	98	Pavement (27S)
1.292	98	Pond (126)
1.700	98	Porous Pavement (11B, 12A, 70A, 70B, 100a, 100b, 100c, 100d, 100e, 104, 111, 119, 125)
0.268	98	Porus Pavement (115)
0.783	98	Road (504S, 600S, 601S)
0.363	98	Road/Drive (10S)
0.726	98	Roadway (500S, 501S, 502S)
1.424	98	Roof (27A, 27S, 67S, 128S, 129S, 138S)
0.195	98	Roof Area (9S)
1.862	98	Roofs (10S, 12A, 101, 102, 115)
0.184	98	Water Surface, 0% imp, HSG C (126A)
0.269	98	Water Surface, HSG C (117)
0.217	98	porous paving (9S)

07074_Pro-WildacresEast

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Printed 2/27/2012

Page 2

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
23.643	HSG B	9S, 11B, 12A, 27A, 100a, 100b, 100c, 100d, 100e, 104, 111, 114, 115, 119, 123S, 125, 127S
226.593	HSG C	9S, 10S, 11A, 11B, 11S, 12A, 12B, 27A, 27S, 28S, 29S, 70A, 70B, 100a, 100b, 100c, 100d, 100e, 101, 103, 104, 108, 109, 111, 114, 115, 117, 119, 125, 126, 126A, 127S, 130S, 131S, 132S, 133S, 135S, 500S, 501S, 502S, 503S, 504S, 511S, 512S, 600S, 601S
0.000	HSG D	
20.389	Other	9S, 10S, 11A, 11B, 11S, 12A, 27A, 27S, 29S, 61S, 67S, 70A, 70B, 100a, 100b, 100c, 100d, 100e, 101, 102, 103, 104, 108, 109, 111, 115, 117, 119, 125, 126, 127S, 128S, 129S, 130S, 131A, 131S, 132S, 134S, 136S, 138S, 500S, 501S, 502S, 504S, 600S, 601S

Summary for Subcatchment 9S: Subcatchment 9

Runoff = 42.73 cfs @ 11.94 hrs, Volume= 1.818 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 8,494	98	Roof Area
57,978	71	Meadow, non-grazed, HSG C
1,355,532	70	Woods, Good, HSG C
13,112	98	Paved parking, HSG C
* 9,470	98	porous paving
21,295	61	>75% Grass cover, Good, HSG B
1,465,881	71	Weighted Average
1,434,805		97.88% Pervious Area
31,076		2.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.3	1,923	0.1100	13.81	662.89	Trap/Vee/Rect Channel Flow, Flow through Rock Channel Bot.W=20.00' D=2.00' Z= 2.0 '/' Top.W=28.00' n= 0.050 Mountain streams w/large boulders

Summary for Subcatchment 10S: Subcatchment 10

Runoff = 14.65 cfs @ 12.31 hrs, Volume= 1.772 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
890,947	70	Woods, Good, HSG C
514,750	71	Meadow, non-grazed, HSG C
* 15,812	98	Road/Drive
* 7,623	98	Roofs
1,429,132	71	Weighted Average
1,405,697		98.36% Pervious Area
23,435		1.64% Impervious Area

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 2

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.1000	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
11.9	600	0.0780	0.84		Shallow Concentrated Flow, SC Flow through Woods Kv= 3.0 fps
2.7	455	0.1600	2.80		Shallow Concentrated Flow, SC Flow through Grass Short Grass Pasture Kv= 7.0 fps
4.6	330	0.1570	1.19		Shallow Concentrated Flow, SC Flow through Woods Kv= 3.0 fps
1.6	685	0.0945	7.35	33.08	Trap/Vee/Rect Channel Flow, Stream Channel Bot.W=4.00' D=1.00' Z= 0.5 '/' Top.W=5.00' n= 0.050
0.0	30	0.0500	13.31	18.59	Pipe Channel, 16" Steel Culvert 16.0" Round Area= 1.4 sf Perim= 4.2' r= 0.33' n= 0.012 Steel, smooth
1.4	645	0.0483	7.65	91.77	Trap/Vee/Rect Channel Flow, Stream Channel Bot.W=5.00' D=2.00' Z= 0.5 '/' Top.W=7.00' n= 0.050
32.3	2,845	Total			

Summary for Subcatchment 11A: Subcatchment 11A

Runoff = 0.83 cfs @ 12.15 hrs, Volume= 0.072 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
55,013	70	Woods, Good, HSG C
2,726	98	Paved parking & roofs
57,739	71	Weighted Average
55,013		95.28% Pervious Area
2,726		4.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.0	100	0.0800	0.15		Sheet Flow, Sheet Flow through woods Woods: Light underbrush n= 0.400 P2= 4.00"
8.6	380	0.0875	0.74		Shallow Concentrated Flow, SC flow through Woods Forest w/Heavy Litter Kv= 2.5 fps
19.6	480	Total			

Summary for Subcatchment 11B: Subcatchment 11B

Runoff = 1.61 cfs @ 12.29 hrs, Volume= 0.176 af, Depth= 0.88"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 3

Area (sf)	CN	Description
50,820	70	Woods, Good, HSG C
19,475	98	Paved parking & roofs
27,337	74	>75% Grass cover, Good, HSG C
* 2,120	98	Porous Pavement
4,400	61	>75% Grass cover, Good, HSG B
104,152	76	Weighted Average
82,557		79.27% Pervious Area
21,595		20.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
25.3	100	0.0100	0.07		Sheet Flow, Sheet Flow through woods Woods: Light underbrush n= 0.400 P2= 4.00"
6.9	436	0.0440	1.05		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
32.2	536	Total			

Summary for Subcatchment 11S: Subcatchment 11

Runoff = 3.47 cfs @ 12.08 hrs, Volume= 0.242 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
169,300	70	Woods, Good, HSG C
13,434	98	Paved parking & roofs
182,734	72	Weighted Average
169,300		92.65% Pervious Area
13,434		7.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.2	25	0.0800	2.03		Sheet Flow, Sheet Flow off Roof Smooth surfaces n= 0.011 P2= 4.00"
3.9	75	0.0625	0.32		Sheet Flow, Sheet flow over meadow Range n= 0.130 P2= 4.00"
2.9	330	0.0750	1.92		Shallow Concentrated Flow, Sheet Flow through Meadow Short Grass Pasture Kv= 7.0 fps
6.8	300	0.0875	0.74		Shallow Concentrated Flow, SC Flow through Woods Forest w/Heavy Litter Kv= 2.5 fps
0.6	254	0.0500	7.39	16.25	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=2.00' D=1.00' Z= 0.2 '/' Top.W=2.40' n= 0.030
14.4	984	Total			

Summary for Subcatchment 12A: Subcatchment 12A

Runoff = 16.89 cfs @ 11.99 hrs, Volume= 0.826 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
172,175	74	>75% Grass cover, Good, HSG C
265,310	70	Woods, Good, HSG C
43,737	98	Paved parking & roofs
* 4,020	98	Porous Pavement
* 19,225	98	Roofs
45,983	61	>75% Grass cover, Good, HSG B
550,450	74	Weighted Average
483,468		87.83% Pervious Area
66,982		12.17% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.4	33	0.0300	1.45		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
1.6	264	0.0300	2.79		Shallow Concentrated Flow, SC Flow through Developed area Unpaved Kv= 16.1 fps
4.4	1,813	0.0200	6.80	71.42	Trap/Vee/Rect Channel Flow, roadside ditch Bot.W=2.00' D=3.00' Z= 0.5 '/ Top.W=5.00' n= 0.035 Earth, dense weeds
6.4	2,110	Total			

Summary for Subcatchment 12B: Subcatchment 12B

Runoff = 3.97 cfs @ 12.71 hrs, Volume= 0.760 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
630,510	70	Woods, Good, HSG C
25,422	74	>75% Grass cover, Good, HSG C
655,932	70	Weighted Average
655,932		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
19.2	100	0.0800	0.09		Sheet Flow, sheet through woods Woods: Dense underbrush n= 0.800 P2= 4.00"
39.5	1,600	0.0730	0.68		Shallow Concentrated Flow, SC Flow through Woods Forest w/Heavy Litter Kv= 2.5 fps
58.7	1,700	Total			

Summary for Subcatchment 27A: SUB27A

Runoff = 4.20 cfs @ 11.98 hrs, Volume= 0.204 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
51,722	70	Woods, Good, HSG C
* 11,934	98	Paved
* 5,722	98	Roof
64,538	71	Meadow, non-grazed, HSG C
2,062	61	>75% Grass cover, Good, HSG B
135,978	74	Weighted Average
118,322		87.02% Pervious Area
17,656		12.98% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	100	0.0900	0.35		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
1.1	264	0.0700	3.97		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
0.3	254	0.0600	13.66	20.49	Channel Flow, roadside ditch Area= 1.5 sf Perim= 2.0' r= 0.75' n= 0.022 Earth, clean & straight
6.2	618	Total			

Summary for Subcatchment 27S: Subcatchment 27

Runoff = 4.04 cfs @ 11.91 hrs, Volume= 0.159 af, Depth= 1.22"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 6,900	98	Roof
* 18,822	98	Pavement
29,912	74	>75% Grass cover, Good, HSG C
12,420	70	Woods, Good, HSG C
68,054	82	Weighted Average
42,332		62.20% Pervious Area
25,722		37.80% Impervious Area

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 6

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.1	40	0.0560	5.58	4.38	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.025 Corrugated metal
0.1	70	0.0560	9.51	38.05	Trap/Vee/Rect Channel Flow, Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030 Earth, grassed & winding
0.2	80	0.0560	5.58	4.38	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.025 Corrugated metal
0.2	128	0.0560	9.51	38.05	Trap/Vee/Rect Channel Flow, Bot.W=1.00' D=2.00' Z= 0.5 '/' Top.W=3.00' n= 0.030 Earth, grassed & winding
0.2	60	0.0560	5.58	4.38	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.025 Corrugated metal
0.8	378	Total			

Summary for Subcatchment 28S: Subcatchment 28

Runoff = 1.20 cfs @ 12.39 hrs, Volume= 0.164 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
33,932	71	Meadow, non-grazed, HSG C
107,420	70	Woods, Good, HSG C
141,352	70	Weighted Average
141,352		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.3	100	0.0500	0.13		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
4.2	326	0.0680	1.30		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
19.3	392	0.0130	0.34	0.51	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=1.00' D=1.00' Z= 0.5 '/' Top.W=2.00' n= 0.300
36.8	818	Total			

Summary for Subcatchment 29S: SUB27A

Runoff = 1.21 cfs @ 11.91 hrs, Volume= 0.048 af, Depth= 0.99"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 7

Area (sf)	CN	Description
* 4,025	98	Paved
21,330	74	>75% Grass cover, Good, HSG C
25,355	78	Weighted Average
21,330		84.13% Pervious Area
4,025		15.87% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.4	30	0.0300	1.42		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.7	218	0.0600	4.97		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.1	248	Total			

Summary for Subcatchment 61S: Hotel Roof

Runoff = 1.39 cfs @ 11.96 hrs, Volume= 0.074 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 15,005	98	Paved
15,005		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 67S: W. top front of hotel

Runoff = 1.39 cfs @ 11.96 hrs, Volume= 0.074 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 15,005	98	Roof
15,005		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 70A: (new Subcat)

Runoff = 1.21 cfs @ 11.95 hrs, Volume= 0.052 af, Depth= 1.35"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
12,012	74	>75% Grass cover, Good, HSG C
7,200	98	Paved parking & roofs
* 1,000	98	Porous Pavement
20,212	84	Weighted Average
12,012		59.43% Pervious Area
8,200		40.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.4	34	0.0588	0.24		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.6	66	0.0450	1.96		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
0.2	21	0.0450	1.48		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.0	8	0.1110	6.76		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.1	11	0.1110	2.33		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.4	67	0.0200	2.87		Shallow Concentrated Flow, Paved Kv= 20.3 fps
3.7	207	Total			

Summary for Subcatchment 70B: (new Subcat)

Runoff = 1.44 cfs @ 11.97 hrs, Volume= 0.066 af, Depth= 1.16"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
7,200	98	Paved parking & roofs
20,394	74	>75% Grass cover, Good, HSG C
* 1,880	98	Porous Pavement
29,474	81	Weighted Average
20,394		69.19% Pervious Area
9,080		30.81% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.6	100	0.1000	0.36		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.2	37	0.2160	3.25		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.2	61	0.0660	5.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.3	37	0.1176	2.40		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
5.3	235	Total			

Summary for Subcatchment 100a: Hole 4 (110) PR

Runoff = 1.12 cfs @ 12.04 hrs, Volume= 0.067 af, Depth= 0.69"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
25,572	74	>75% Grass cover, Good, HSG C
9,715	70	Woods, Good, HSG C
* 3,940	98	Porous Pavement
11,267	61	>75% Grass cover, Good, HSG B
50,494	72	Weighted Average
46,554		92.20% Pervious Area
3,940		7.80% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	100	0.0600	0.20		Sheet Flow, Sheet Flow Along Golf Course Grass: Dense n= 0.240 P2= 4.00"
2.3	319	0.1070	2.29		Shallow Concentrated Flow, SC Flow on golf course Short Grass Pasture Kv= 7.0 fps
10.5	419	Total			

Summary for Subcatchment 100b: Hole 4 (110) PR

Runoff = 0.28 cfs @ 12.05 hrs, Volume= 0.019 af, Depth= 0.49"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 10

Area (sf)	CN	Description
5,558	74	>75% Grass cover, Good, HSG C
2,890	70	Woods, Good, HSG C
11,040	61	>75% Grass cover, Good, HSG B
* 650	98	Porous Pavement
20,138	67	Weighted Average
19,488		96.77% Pervious Area
650		3.23% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	100	0.0600	0.20		Sheet Flow, Sheet Flow Along Golf Course Grass: Dense n= 0.240 P2= 4.00"
2.3	319	0.1070	2.29		Shallow Concentrated Flow, SC Flow on golf course Short Grass Pasture Kv= 7.0 fps
10.5	419	Total			

Summary for Subcatchment 100c: Hole 4 (110) PR

Runoff = 0.41 cfs @ 12.05 hrs, Volume= 0.029 af, Depth= 0.45"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
6,495	74	>75% Grass cover, Good, HSG C
* 2,610	98	Porous Pavement
23,895	61	>75% Grass cover, Good, HSG B
33,000	66	Weighted Average
30,390		92.09% Pervious Area
2,610		7.91% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	100	0.0600	0.20		Sheet Flow, Sheet Flow Along Golf Course Grass: Dense n= 0.240 P2= 4.00"
2.3	319	0.1070	2.29		Shallow Concentrated Flow, SC Flow on golf course Short Grass Pasture Kv= 7.0 fps
10.5	419	Total			

Summary for Subcatchment 100d: Hole 4 (110) PR

Runoff = 0.26 cfs @ 12.05 hrs, Volume= 0.019 af, Depth= 0.42"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 11

Area (sf)	CN	Description
2,916	74	>75% Grass cover, Good, HSG C
* 1,300	98	Porous Pavement
19,488	61	>75% Grass cover, Good, HSG B
23,704	65	Weighted Average
22,404		94.52% Pervious Area
1,300		5.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	100	0.0600	0.20		Sheet Flow, Sheet Flow Along Golf Course Grass: Dense n= 0.240 P2= 4.00"
2.3	319	0.1070	2.29		Shallow Concentrated Flow, SC Flow on golf course Short Grass Pasture Kv= 7.0 fps
10.5	419	Total			

Summary for Subcatchment 100e: Hole 4 (110) PR

Runoff = 1.11 cfs @ 12.04 hrs, Volume= 0.070 af, Depth= 0.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
27,442	74	>75% Grass cover, Good, HSG C
* 3,930	98	Porous Pavement
33,414	61	>75% Grass cover, Good, HSG B
64,786	69	Weighted Average
60,856		93.93% Pervious Area
3,930		6.07% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	100	0.0600	0.20		Sheet Flow, Sheet Flow Along Golf Course Grass: Dense n= 0.240 P2= 4.00"
2.3	319	0.1070	2.29		Shallow Concentrated Flow, SC Flow on golf course Short Grass Pasture Kv= 7.0 fps
10.5	419	Total			

Summary for Subcatchment 101: Land east of irrigation pond (101 PR)

Runoff = 1.88 cfs @ 11.93 hrs, Volume= 0.077 af, Depth= 1.04"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 12

Area (sf)	CN	Description
31,112	74	>75% Grass cover, Good, HSG C
* 7,596	98	Roofs
38,708	79	Weighted Average
31,112		80.38% Pervious Area
7,596		19.62% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	68	0.0144	1.25		Sheet Flow, Sheet Flow Across Roof Smooth surfaces n= 0.011 P2= 4.00"
1.4	191	0.0990	2.20		Shallow Concentrated Flow, SC Flow Short Grass Pasture Kv= 7.0 fps
0.1	35	0.0570	8.39	12.58	Channel Flow, Roadside Ditch Area= 1.5 sf Perim= 4.0' r= 0.38' n= 0.022 Earth, clean & straight

2.4 294 Total

Summary for Subcatchment 102: Pool House and Pool (102) PR

Runoff = 1.67 cfs @ 11.90 hrs, Volume= 0.079 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
11,423	98	Paved parking & roofs
* 4,650	98	Roofs
16,073	98	Weighted Average
16,073		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.1	10	0.0570	1.48		Sheet Flow, Sheet Flow Along Roof or into Pool Smooth surfaces n= 0.011 P2= 4.00"
0.3	70	0.0500	4.54		Shallow Concentrated Flow, Shallow Flow on Pavement Paved Kv= 20.3 fps

0.4 80 Total

Summary for Subcatchment 103: Pool parking lot and tennis courts (103) PR

Runoff = 6.05 cfs @ 12.00 hrs, Volume= 0.315 af, Depth= 1.42"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 13

Area (sf)	CN	Description
62,227	74	>75% Grass cover, Good, HSG C
53,467	98	Paved parking & roofs
115,694	85	Weighted Average
62,227		53.79% Pervious Area
53,467		46.21% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	100	0.0900	0.35		Sheet Flow, Sheet Flow Along Steep Hill Grass: Short n= 0.150 P2= 4.00"
2.1	150	0.0300	1.21		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.9	352	0.0227	3.06		Shallow Concentrated Flow, Paved Kv= 20.3 fps
8.8	602	Total			

Summary for Subcatchment 104: Holes 7 & 8

Runoff = 3.84 cfs @ 12.22 hrs, Volume= 0.426 af, Depth= 0.49"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 25,420	98	Porous Pavement
104,543	74	>75% Grass cover, Good, HSG C
45,415	70	Woods, Good, HSG C
280,195	61	>75% Grass cover, Good, HSG B
455,573	67	Weighted Average
430,153		94.42% Pervious Area
25,420		5.58% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.8	39	0.0510	0.23		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
12.0	61	0.0240	0.08		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 4.00"
1.8	133	0.0600	1.22		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
1.6	167	0.0600	1.71		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
4.2	300	0.0570	1.19		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
1.0	122	0.0820	2.00		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.3	209	0.0670	10.38	54.52	Trap/Vee/Rect Channel Flow, Bot.W=2.00' D=1.50' Z= 1.0 '/' Top.W=5.00' n= 0.033 Earth, grassed & winding
23.7	1,031	Total			

Summary for Subcatchment 108: Front of Road to 8 -23 (108) PR

Runoff = 1.89 cfs @ 11.93 hrs, Volume= 0.086 af, Depth= 2.16"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
3,491	74	>75% Grass cover, Good, HSG C
17,269	98	Paved
20,760	94	Weighted Average
3,491		16.82% Pervious Area
17,269		83.18% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	100	0.0200	1.54		Sheet Flow, Sheet Flow Roof Smooth surfaces n= 0.011 P2= 4.00"
0.2	13	0.0200	0.99		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.2	369	0.0600	4.97		Shallow Concentrated Flow, Flow in Concrete Curb Paved Kv= 20.3 fps
2.5	482	Total			

Summary for Subcatchment 109: Front of Road to 8 -23 (109) PR

Runoff = 0.72 cfs @ 11.92 hrs, Volume= 0.031 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
2,105	74	>75% Grass cover, Good, HSG C
6,175	98	Paved parking & roofs
8,280	92	Weighted Average
2,105		25.42% Pervious Area
6,175		74.58% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	100	0.0310	1.83		Sheet Flow, Sheet Flow on Pavement Smooth surfaces n= 0.011 P2= 4.00"
0.8	258	0.0700	5.37		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.7	358	Total			

Summary for Subcatchment 111: Front of Hole 4 (111) PR

Runoff = 1.75 cfs @ 12.01 hrs, Volume= 0.097 af, Depth= 0.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
33,460	74	>75% Grass cover, Good, HSG C
* 6,880	98	Porous Pavement
49,040	61	>75% Grass cover, Good, HSG B
89,380	69	Weighted Average
82,500		92.30% Pervious Area
6,880		7.70% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.9	100	0.1400	0.28		Sheet Flow, Sheet Flow Along Golf Course Grass: Dense n= 0.240 P2= 4.00"
1.8	293	0.1500	2.71		Shallow Concentrated Flow, SC Flow on golf course Short Grass Pasture Kv= 7.0 fps
7.7	393	Total			

Summary for Subcatchment 114: Behind Townhomes

Runoff = 2.28 cfs @ 12.10 hrs, Volume= 0.174 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
88,388	74	>75% Grass cover, Good, HSG C
21,938	70	Woods, Good, HSG C
39,975	61	>75% Grass cover, Good, HSG B
150,301	70	Weighted Average
150,301		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	100	0.0750	0.22		Sheet Flow, Sheet Flow Along Golf Course Grass: Dense n= 0.240 P2= 4.00"
8.2	830	0.0580	1.69		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
15.7	930	Total			

Summary for Subcatchment 115: Land between buildings 17 thru 22 (115) pr

Runoff = 11.65 cfs @ 12.06 hrs, Volume= 0.734 af, Depth= 0.83"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
1,000	98	Paved parking & roofs
* 42,019	98	Roofs
304,107	74	>75% Grass cover, Good, HSG C
78,570	61	>75% Grass cover, Good, HSG B
23,492	73	Woods, Fair, HSG C
* 11,655	98	Porus Pavement
460,843	75	Weighted Average
406,169		88.14% Pervious Area
54,674		11.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.3	100	0.0800	0.23		Sheet Flow, Sheet Flow Grass: Dense n= 0.240 P2= 4.00"
5.6	709	0.0900	2.10		Shallow Concentrated Flow, SC Flow in Swale Short Grass Pasture Kv= 7.0 fps
12.9	809	Total			

Summary for Subcatchment 117: Rest of Road to 8 -23 (117) PR

Runoff = 10.09 cfs @ 12.09 hrs, Volume= 0.677 af, Depth= 1.49"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
108,508	74	>75% Grass cover, Good, HSG C
111,127	98	Paved parking & roofs
5,863	73	Woods, Fair, HSG C
11,700	98	Water Surface, HSG C
237,198	86	Weighted Average
114,371		48.22% Pervious Area
122,827		51.78% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	100	0.0600	0.20		Sheet Flow, Sheet Flow in Side Yard Grass: Dense n= 0.240 P2= 4.00"
8.1	830	0.0600	1.71		Shallow Concentrated Flow, SC Flow in Swale Short Grass Pasture Kv= 7.0 fps
16.3	930	Total			

Summary for Subcatchment 119: Green of Hole 3 & tee of Hole 4 (119) PR

Runoff = 2.31 cfs @ 12.06 hrs, Volume= 0.158 af, Depth= 0.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
49,282	74	>75% Grass cover, Good, HSG C
18,600	70	Woods, Good, HSG C
70,125	61	>75% Grass cover, Good, HSG B
* 8,380	98	Porous Pavement
146,387	69	Weighted Average
138,007		94.28% Pervious Area
8,380		5.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.7	100	0.0700	0.22		Sheet Flow, Sheet Flow Along Golf Course Grass: Dense n= 0.240 P2= 4.00"
0.5	54	0.0740	1.90		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.8	176	0.1110	1.67		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
2.4	397	0.0910	2.71		Shallow Concentrated Flow, SC Flow on golf course Cultivated Straight Rows Kv= 9.0 fps
12.4	727	Total			

Summary for Subcatchment 123S: Land north of irrigation pond (123) PR

Runoff = 0.29 cfs @ 12.04 hrs, Volume= 0.025 af, Depth= 0.29"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
43,890	61	>75% Grass cover, Good, HSG B
43,890		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	100	0.0600	0.20		Sheet Flow, Sheet Flow Through Golf Course Grass: Dense n= 0.240 P2= 4.00"
0.4	46	0.0430	1.87		Shallow Concentrated Flow, SC Flow in Swale Cultivated Straight Rows Kv= 9.0 fps
8.6	146	Total			

Summary for Subcatchment 125: Hole 3 and end of Hole 4 (119) PR

Runoff = 2.15 cfs @ 12.03 hrs, Volume= 0.140 af, Depth= 0.45"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
17,968	74	>75% Grass cover, Good, HSG C
8,956	70	Woods, Good, HSG C
* 11,910	98	Porous Pavement
122,325	61	>75% Grass cover, Good, HSG B
161,159	66	Weighted Average
149,249		92.61% Pervious Area
11,910		7.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, Sheet Flow Along Golf Course Grass: Short n= 0.150 P2= 4.00"
3.6	1,031	0.1040	4.84		Shallow Concentrated Flow, SC Flow on golf course Grassed Waterway Kv= 15.0 fps
9.2	1,131	Total			

Summary for Subcatchment 126: Irr. Pond

Runoff = 5.96 cfs @ 11.96 hrs, Volume= 0.283 af, Depth= 1.97"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 56,286	98	Pond
18,705	74	>75% Grass cover, Good, HSG C
74,991	92	Weighted Average
18,705		24.94% Pervious Area
56,286		75.06% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 126A: forebay

Runoff = 0.74 cfs @ 11.96 hrs, Volume= 0.039 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 19

Area (sf)	CN	Description
8,000	98	Water Surface, 0% imp, HSG C
8,000		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 127S: (new Subcat)

Runoff = 10.76 cfs @ 11.91 hrs, Volume= 0.452 af, Depth= 0.53"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 27,670	68	Porous Pavement
151,709	74	>75% Grass cover, Good, HSG C
96,570	70	Woods, Good, HSG C
172,945	61	>75% Grass cover, Good, HSG B
448,894	68	Weighted Average
448,894		100.00% Pervious Area

Summary for Subcatchment 128S: HOTEL ROOF

Runoff = 0.64 cfs @ 11.96 hrs, Volume= 0.034 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 6,878	98	Roof
6,878		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 129S: HOTEL ROOF

Runoff = 1.28 cfs @ 11.96 hrs, Volume= 0.068 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 20

	Area (sf)	CN	Description
*	13,760	98	Roof
	13,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 130S: (new Subcat)

Runoff = 1.81 cfs @ 11.97 hrs, Volume= 0.083 af, Depth= 1.10"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

	Area (sf)	CN	Description
	9,220	98	Paved parking & roofs
	29,927	74	>75% Grass cover, Good, HSG C
	39,147	80	Weighted Average
	29,927		76.45% Pervious Area
	9,220		23.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,
0.3	21	0.0200	1.13		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
5.3	21	Total			

Summary for Subcatchment 131A: HOTEL ROOF

Runoff = 4.76 cfs @ 11.96 hrs, Volume= 0.252 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

	Area (sf)	CN	Description
	51,300	98	Paved parking & roofs
	51,300		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 131S: (new Subcat)

Runoff = 1.69 cfs @ 12.02 hrs, Volume= 0.093 af, Depth= 1.72"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
10,863	74	>75% Grass cover, Good, HSG C
17,500	98	Paved parking & roofs
28,363	89	Weighted Average
10,863		38.30% Pervious Area
17,500		61.70% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,
5.1	64	0.0310	0.21		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
10.1	64	Total			

Summary for Subcatchment 132S: (new Subcat)

Runoff = 0.52 cfs @ 11.94 hrs, Volume= 0.022 af, Depth= 0.93"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
1,650	98	Paved parking & roofs
10,495	74	>75% Grass cover, Good, HSG C
12,145	77	Weighted Average
10,495		86.41% Pervious Area
1,650		13.59% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.9	92	0.2600	0.52		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.1	11	0.0100	2.03		Shallow Concentrated Flow, Paved Kv= 20.3 fps
3.0	103	Total			

Summary for Subcatchment 133S: (new Subcat)

Runoff = 1.05 cfs @ 11.94 hrs, Volume= 0.044 af, Depth= 0.78"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 22

Area (sf)	CN	Description
29,164	74	>75% Grass cover, Good, HSG C
29,164		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.4	20	0.0100	0.84		Sheet Flow, Smooth surfaces n= 0.011 P2= 4.00"
2.1	30	0.0670	0.24		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
2.5	50	Total			

Summary for Subcatchment 134S: HOTEL ROOF

Runoff = 0.64 cfs @ 11.96 hrs, Volume= 0.034 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
6,878	98	Paved parking & roofs
6,878		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 135S: (new Subcat)

Runoff = 0.83 cfs @ 11.95 hrs, Volume= 0.037 af, Depth= 1.04"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
4,000	98	Paved parking, HSG C
12,105	74	>75% Grass cover, Good, HSG C
2,192	70	Woods, Good, HSG C
18,297	79	Weighted Average
14,297		78.14% Pervious Area
4,000		21.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.5	100	0.2000	0.48		Sheet Flow, Grass: Short n= 0.150 P2= 4.00"
0.2	71	0.4790	4.84		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.4	75	0.0267	3.32		Shallow Concentrated Flow, Paved Kv= 20.3 fps
4.1	246	Total			

Summary for Subcatchment 136S: Parking Structure

Runoff = 4.45 cfs @ 11.93 hrs, Volume= 0.222 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
45,262	98	Paved parking & roofs
45,262		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.4	100	0.0100	1.17		Sheet Flow, Pavement of parking structure Smooth surfaces n= 0.011 P2= 4.00"
1.7	206	0.0100	2.03		Shallow Concentrated Flow, Pavement of parking structure Paved Kv= 20.3 fps
3.1	306	Total			

Summary for Subcatchment 138S: HOTEL ROOF

Runoff = 1.28 cfs @ 11.96 hrs, Volume= 0.068 af, Depth= 2.57"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 13,760	98	Roof
13,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Summary for Subcatchment 500S: Subcatchment 500

Runoff = 13.91 cfs @ 12.31 hrs, Volume= 1.675 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
9,017	71	Meadow, non-grazed, HSG C
* 29,185	98	Roadway
1,312,724	70	Woods, Good, HSG C
1,350,926	71	Weighted Average
1,321,741		97.84% Pervious Area
29,185		2.16% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2	100	0.3330	0.27		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
25.7	3,665	0.2266	2.38		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.1	110	0.1066	16.65	133.22	Trap/Vee/Rect Channel Flow, Roadside Swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.030
32.0	3,875	Total			

Summary for Subcatchment 501S: Subcatchment 501

Runoff = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
9,017	71	Meadow, non-grazed, HSG C
* 1,002	98	Roadway
176,462	70	Woods, Good, HSG C
186,481	70	Weighted Average
185,479		99.46% Pervious Area
1,002		0.54% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2	100	0.3330	0.27		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
13.1	1,930	0.2410	2.45		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
19.3	2,030	Total			

Summary for Subcatchment 502S: Subcatchment 502

Runoff = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
9,017	71	Meadow, non-grazed, HSG C
* 1,437	98	Roadway
178,596	70	Woods, Good, HSG C
189,050	70	Weighted Average
187,613		99.24% Pervious Area
1,437		0.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2	100	0.3330	0.27		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
6.5	935	0.2266	2.38		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	265	0.1066	16.65	133.22	Trap/Vee/Rect Channel Flow, Roadside Swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.030
13.0	1,300	Total			

Summary for Subcatchment 503S: Subcatchment 503

Runoff = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
130,680	70	Woods, Good, HSG C
130,680		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.1000	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
6.2	655	0.1250	1.77		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	255	0.1066	16.65	133.22	Trap/Vee/Rect Channel Flow, Roadside swale Bot.W=2.00' D=2.00' Z= 1.0 '/' Top.W=6.00' n= 0.030
16.6	1,010	Total			

Summary for Subcatchment 504S: Subcatchment 504

Runoff = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
1,292,556	70	Woods, Good, HSG C
* 13,939	98	Road
14,026	74	>75% Grass cover, Good, HSG C
1,320,521	70	Weighted Average
1,306,582		98.94% Pervious Area
13,939		1.06% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.4375	0.30		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
19.1	2,860	0.2500	2.50		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	320	0.1910	15.31	321.48	Trap/Vee/Rect Channel Flow, Mountain Stream Bot.W=4.00' D=3.00' Z= 1.0 '/' Top.W=10.00' n= 0.060
25.0	3,280	Total			

Summary for Subcatchment 511S: Subcatchmant 511

Runoff = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
87,120	70	Woods, Good, HSG C
87,120		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.1000	0.17		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
5.5	580	0.1250	1.77		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
15.6	680	Total			

Summary for Subcatchment 512S: Subcatchment 512

Runoff = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af, Depth= 0.61"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
56,628	70	Woods, Good, HSG C
56,628		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.1	100	0.3125	0.15		Sheet Flow, Sheet Flow through Woods Woods: Dense underbrush n= 0.800 P2= 4.00"
2.6	345	0.1900	2.18		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
0.3	155	0.1000	8.43	10.12	Trap/Vee/Rect Channel Flow, Roadside Vegated Swale Bot.W=1.00' D=1.00' Z= 0.2 '/ Top.W=1.40' n= 0.030 Earth, grassed & winding
14.0	600	Total			

Summary for Subcatchment 600S: Subcatchment 600

Runoff = 5.40 cfs @ 12.14 hrs, Volume= 0.459 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 9,670	98	Road
360,198	70	Woods, Good, HSG C
369,868	71	Weighted Average
360,198		97.39% Pervious Area
9,670		2.61% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.1	10	0.0500	1.40		Sheet Flow, Sheet Flow off Road Smooth surfaces n= 0.011 P2= 4.00"
7.2	90	0.1875	0.21		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
12.0	1,510	0.1764	2.10		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
19.3	1,610	Total			

Summary for Subcatchment 601S: Subcatchment 601

Runoff = 4.56 cfs @ 12.09 hrs, Volume= 0.332 af, Depth= 0.65"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Type II 24-hr 1-YEAR Rainfall=2.80"

Area (sf)	CN	Description
* 10,498	98	Road
257,004	70	Woods, Good, HSG C
267,502	71	Weighted Average
257,004		96.08% Pervious Area
10,498		3.92% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.1	10	0.0500	1.40		Sheet Flow, Sheet Flow off Road Smooth surfaces n= 0.011 P2= 4.00"
7.2	90	0.1875	0.21		Sheet Flow, Sheet Flow through Woods Woods: Light underbrush n= 0.400 P2= 4.00"
7.7	970	0.1764	2.10		Shallow Concentrated Flow, SC Flow through Woods Woodland Kv= 5.0 fps
15.0	1,070	Total			

**Reach and Culvert Summaries
1 & 10-yr Storm Events**

Summary for Reach 18R: Overland Flow

Inflow Area = 45.186 ac, 28.04% Impervious, Inflow Depth = 0.00" for 1-YEAR event
Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.00 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 0.00 fps, Avg. Travel Time= 0.0 min

Peak Storage= 0 cf @ 0.00 hrs
Average Depth at Peak Storage= 0.00'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 214.48 cfs

30.00' x 0.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 75.0 '/' Top Width= 105.00'
Length= 535.0' Slope= 0.0748 '/'
Inlet Invert= 1,937.00', Outlet Invert= 1,897.00'



Summary for Reach 21R: Ex. Roadside Ditch

Inflow Area = 4.411 ac, 6.47% Impervious, Inflow Depth = 0.50" for 1-YEAR event
Inflow = 0.04 cfs @ 24.12 hrs, Volume= 0.186 af
Outflow = 0.04 cfs @ 24.19 hrs, Volume= 0.186 af, Atten= 0%, Lag= 4.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.73 fps, Min. Travel Time= 2.8 min
Avg. Velocity = 0.66 fps, Avg. Travel Time= 3.0 min

Peak Storage= 7 cf @ 24.14 hrs
Average Depth at Peak Storage= 0.03'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 36.63 cfs

2.00' x 1.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 1.0 '/' Top Width= 5.00'
Length= 120.0' Slope= 0.0250 '/'
Inlet Invert= 1,897.00', Outlet Invert= 1,894.00'



Summary for Reach 58A: Overland Flow

Inflow Area = 3.000 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af
Outflow = 0.46 cfs @ 13.75 hrs, Volume= 0.152 af, Atten= 76%, Lag= 98.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.11 fps, Min. Travel Time= 71.2 min
Avg. Velocity = 0.05 fps, Avg. Travel Time= 151.8 min

Peak Storage= 1,948 cf @ 12.56 hrs
Average Depth at Peak Storage= 0.04'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 151.22 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 478.0' Slope= 0.0711 '
Inlet Invert= 2,212.00', Outlet Invert= 2,178.00'




Summary for Reach 61: Vegetated Roadside Swale

Inflow Area = 5.521 ac, 6.72% Impervious, Inflow Depth = 0.68" for 1-YEAR event
Inflow = 4.22 cfs @ 12.09 hrs, Volume= 0.313 af
Outflow = 4.01 cfs @ 12.17 hrs, Volume= 0.313 af, Atten= 5%, Lag= 4.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.60 fps, Min. Travel Time= 2.7 min
Avg. Velocity = 1.73 fps, Avg. Travel Time= 7.2 min

Peak Storage= 659 cf @ 12.13 hrs
Average Depth at Peak Storage= 0.66'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 67.71 cfs

1.00' x 3.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 ' Top Width= 4.00'
Length= 751.0' Slope= 0.0613 '
Inlet Invert= 2,000.00', Outlet Invert= 1,954.00'



Summary for Reach 66: Stream Channel

Inflow Area = 123.689 ac, 1.65% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 24.56 cfs @ 12.30 hrs, Volume= 6.522 af
Outflow = 22.77 cfs @ 12.47 hrs, Volume= 6.522 af, Atten= 7%, Lag= 10.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.65 fps, Min. Travel Time= 5.6 min
Avg. Velocity = 1.42 fps, Avg. Travel Time= 22.2 min

Peak Storage= 7,591 cf @ 12.38 hrs
Average Depth at Peak Storage= 0.56'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 297.74 cfs

5.00' x 2.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/ Top Width= 21.00'
Length= 1,884.0' Slope= 0.1152 '/
Inlet Invert= 2,017.00', Outlet Invert= 1,800.00'




Summary for Reach 73A: Vegetated Roadside Channel

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 0.82" for 1-YEAR event
Inflow = 4.89 cfs @ 11.97 hrs, Volume= 0.252 af
Outflow = 4.84 cfs @ 11.97 hrs, Volume= 0.252 af, Atten= 1%, Lag= 0.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.67 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 1.54 fps, Avg. Travel Time= 0.7 min

Peak Storage= 63 cf @ 11.97 hrs
Average Depth at Peak Storage= 0.76'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 28.54 cfs

1.00' x 2.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 '/ Top Width= 3.00'
Length= 60.0' Slope= 0.0560 '/
Inlet Invert= 1,920.00', Outlet Invert= 1,916.64'




Summary for Reach 75: Roadside Channel

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 0.82" for 1-YEAR event
Inflow = 4.84 cfs @ 11.97 hrs, Volume= 0.252 af
Outflow = 4.76 cfs @ 11.99 hrs, Volume= 0.252 af, Atten= 2%, Lag= 1.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.59 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 1.51 fps, Avg. Travel Time= 1.8 min

Peak Storage= 174 cf @ 11.98 hrs
Average Depth at Peak Storage= 0.76'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 28.08 cfs

1.00' x 2.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 '/ Top Width= 3.00'
Length= 166.0' Slope= 0.0542 '/
Inlet Invert= 1,911.00', Outlet Invert= 1,902.00'




Summary for Reach 76: Roadside Channel

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 0.82" for 1-YEAR event
Inflow = 4.76 cfs @ 11.99 hrs, Volume= 0.252 af
Outflow = 4.72 cfs @ 12.00 hrs, Volume= 0.252 af, Atten= 1%, Lag= 0.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.64 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 1.52 fps, Avg. Travel Time= 0.7 min

Peak Storage= 63 cf @ 11.99 hrs
Average Depth at Peak Storage= 0.75'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 28.53 cfs

1.00' x 2.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 '/ Top Width= 3.00'
Length= 62.0' Slope= 0.0560 '/
Inlet Invert= 1,902.00', Outlet Invert= 1,898.53'



Summary for Reach 78: Stream Channel

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 17.10 cfs @ 13.58 hrs, Volume= 4.750 af
Outflow = 17.07 cfs @ 13.64 hrs, Volume= 4.750 af, Atten= 0%, Lag= 3.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.67 fps, Min. Travel Time= 2.0 min
Avg. Velocity = 1.39 fps, Avg. Travel Time= 8.2 min

Peak Storage= 2,060 cf @ 13.61 hrs
Average Depth at Peak Storage= 0.40'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 213.41 cfs

6.00' x 1.50' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 18.00'
Length= 685.0' Slope= 0.1635 '/'
Inlet Invert= 2,170.00', Outlet Invert= 2,058.00'



Summary for Reach 80: Stream Channel

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 17.07 cfs @ 13.64 hrs, Volume= 4.750 af
Outflow = 16.98 cfs @ 13.74 hrs, Volume= 4.750 af, Atten= 1%, Lag= 6.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.70 fps, Min. Travel Time= 3.3 min
Avg. Velocity = 0.90 fps, Avg. Travel Time= 13.7 min

Peak Storage= 3,397 cf @ 13.68 hrs
Average Depth at Peak Storage= 0.56'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 209.43 cfs

6.00' x 2.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 22.00'
Length= 740.0' Slope= 0.0473 '/'
Inlet Invert= 2,055.00', Outlet Invert= 2,020.00'



Summary for Reach 82: Overland Flow

Inflow Area = 1.300 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af
Outflow = 0.09 cfs @ 16.94 hrs, Volume= 0.066 af, Atten= 90%, Lag= 291.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.07 fps, Min. Travel Time= 215.5 min
Avg. Velocity = 0.04 fps, Avg. Travel Time= 361.8 min

Peak Storage= 1,136 cf @ 13.35 hrs
Average Depth at Peak Storage= 0.01'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 53.31 cfs

100.00' x 0.50' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 200.00'
Length= 938.0' Slope= 0.1354 '
Inlet Invert= 2,347.00', Outlet Invert= 2,220.00'



Summary for Reach 82a: Overland Flow

Inflow Area = 62.628 ac, 1.58% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 19.39 cfs @ 12.98 hrs, Volume= 3.272 af
Outflow = 14.95 cfs @ 13.58 hrs, Volume= 3.272 af, Atten= 23%, Lag= 36.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.41 fps, Min. Travel Time= 19.3 min
Avg. Velocity = 0.08 fps, Avg. Travel Time= 96.5 min

Peak Storage= 17,297 cf @ 13.26 hrs
Average Depth at Peak Storage= 0.28'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 164.89 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 473.0' Slope= 0.0846 '
Inlet Invert= 2,220.00', Outlet Invert= 2,180.00'



Summary for Reach 83A: Overland Flow

Inflow Area = 30.315 ac, 1.06% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af
Outflow = 10.29 cfs @ 12.67 hrs, Volume= 1.531 af, Atten= 30%, Lag= 26.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.46 fps, Min. Travel Time= 16.1 min
Avg. Velocity = 0.13 fps, Avg. Travel Time= 57.9 min

Peak Storage= 9,967 cf @ 12.40 hrs
Average Depth at Peak Storage= 0.19'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 232.26 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 441.0' Slope= 0.1678 '
Inlet Invert= 2,326.00', Outlet Invert= 2,252.00'



Summary for Reach 84A: Overland Flow

Inflow Area = 61.328 ac, 1.61% Impervious, Inflow Depth = 0.63" for 1-YEAR event
Inflow = 21.55 cfs @ 12.68 hrs, Volume= 3.206 af
Outflow = 19.39 cfs @ 12.98 hrs, Volume= 3.206 af, Atten= 10%, Lag= 17.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.49 fps, Min. Travel Time= 9.3 min
Avg. Velocity = 0.13 fps, Avg. Travel Time= 35.6 min

Peak Storage= 10,876 cf @ 12.82 hrs
Average Depth at Peak Storage= 0.30'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 192.72 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 277.0' Slope= 0.1155 '
Inlet Invert= 2,252.00', Outlet Invert= 2,220.00'



Summary for Reach 84B: Overland Flow

Inflow Area = 31.013 ac, 2.16% Impervious, Inflow Depth = 0.65" for 1-YEAR event
Inflow = 13.91 cfs @ 12.31 hrs, Volume= 1.675 af
Outflow = 11.30 cfs @ 12.70 hrs, Volume= 1.675 af, Atten= 19%, Lag= 22.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.46 fps, Min. Travel Time= 13.3 min
Avg. Velocity = 0.13 fps, Avg. Travel Time= 46.4 min

Peak Storage= 9,002 cf @ 12.48 hrs
Average Depth at Peak Storage= 0.20'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 228.33 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 370.0' Slope= 0.1622 '
Inlet Invert= 2,312.00', Outlet Invert= 2,252.00'




Summary for Reach 85A: Overland Flow

Inflow Area = 4.281 ac, 0.54% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af
Outflow = 0.86 cfs @ 13.27 hrs, Volume= 0.216 af, Atten= 65%, Lag= 67.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.18 fps, Min. Travel Time= 46.5 min
Avg. Velocity = 0.08 fps, Avg. Travel Time= 107.2 min

Peak Storage= 2,406 cf @ 12.49 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 221.40 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 505.0' Slope= 0.1525 '
Inlet Invert= 2,292.00', Outlet Invert= 2,215.00'

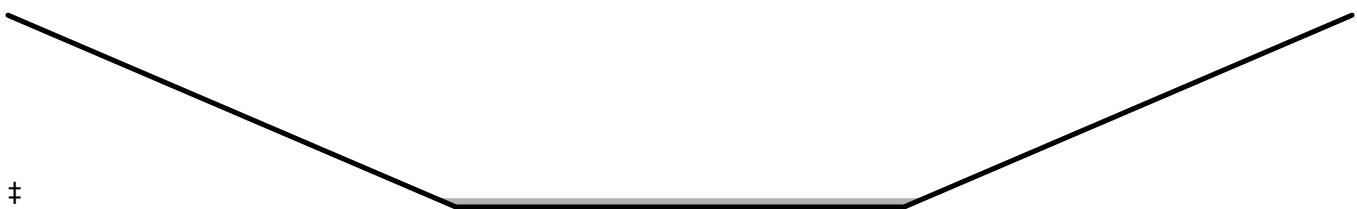

Summary for Reach 85B: Overland Flow

Inflow Area = 8.621 ac, 0.65% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 1.84 cfs @ 12.44 hrs, Volume= 0.435 af
Outflow = 1.09 cfs @ 14.39 hrs, Volume= 0.435 af, Atten= 41%, Lag= 116.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.16 fps, Min. Travel Time= 47.3 min
Avg. Velocity = 0.06 fps, Avg. Travel Time= 116.5 min

Peak Storage= 3,091 cf @ 13.60 hrs
Average Depth at Peak Storage= 0.06'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 157.60 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 453.0' Slope= 0.0773 '
Inlet Invert= 2,215.00', Outlet Invert= 2,180.00'



Summary for Reach 86A: Overland Flow

Inflow Area = 4.340 ac, 0.76% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af
Outflow = 1.84 cfs @ 12.44 hrs, Volume= 0.219 af, Atten= 42%, Lag= 22.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.22 fps, Min. Travel Time= 14.9 min
Avg. Velocity = 0.07 fps, Avg. Travel Time= 43.4 min

Peak Storage= 1,652 cf @ 12.19 hrs
Average Depth at Peak Storage= 0.08'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 190.45 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 195.0' Slope= 0.1128 '
Inlet Invert= 2,237.00', Outlet Invert= 2,215.00'




Summary for Reach 88: Roadside Swale

Inflow Area = 2.000 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
Inflow = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af
Outflow = 1.28 cfs @ 12.17 hrs, Volume= 0.101 af, Atten= 4%, Lag= 4.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.29 fps, Min. Travel Time= 2.4 min
Avg. Velocity = 1.09 fps, Avg. Travel Time= 7.2 min

Peak Storage= 185 cf @ 12.13 hrs
Average Depth at Peak Storage= 0.19'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 63.06 cfs

2.00' x 2.00' deep channel, n= 0.035
Side Slope Z-value= 0.5 '/ Top Width= 4.00'
Length= 472.0' Slope= 0.0678 '/
Inlet Invert= 2,207.00', Outlet Invert= 2,175.00'

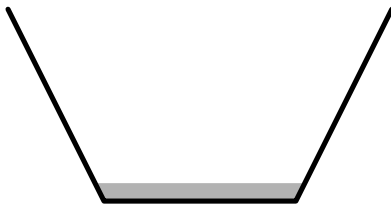

Summary for Reach 91: Overland Flow

Inflow Area = 9.707 ac, 4.57% Impervious, Inflow Depth = 0.54" for 1-YEAR event
Inflow = 1.27 cfs @ 12.39 hrs, Volume= 0.439 af
Outflow = 1.15 cfs @ 12.69 hrs, Volume= 0.439 af, Atten= 10%, Lag= 17.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.33 fps, Min. Travel Time= 10.0 min
Avg. Velocity = 0.11 fps, Avg. Travel Time= 29.7 min

Peak Storage= 690 cf @ 12.52 hrs
Average Depth at Peak Storage= 0.03'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 126.11 cfs

100.00' x 0.50' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 100.0 '/ Top Width= 200.00'
Length= 198.0' Slope= 0.0303 '/
Inlet Invert= 1,893.00', Outlet Invert= 1,887.00'



‡


Summary for Reach 92: Channel Along RR Tracks

Inflow Area = 74.590 ac, 20.27% Impervious, Inflow Depth = 0.25" for 1-YEAR event
Inflow = 16.89 cfs @ 11.99 hrs, Volume= 1.549 af
Outflow = 15.76 cfs @ 12.05 hrs, Volume= 1.549 af, Atten= 7%, Lag= 3.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.20 fps, Min. Travel Time= 2.2 min
Avg. Velocity = 1.07 fps, Avg. Travel Time= 10.6 min

Peak Storage= 2,066 cf @ 12.01 hrs
Average Depth at Peak Storage= 0.83'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 255.39 cfs

2.00' x 3.00' deep channel, n= 0.035
Side Slope Z-value= 2.0 '/' Top Width= 14.00'
Length= 675.0' Slope= 0.0348 '/'
Inlet Invert= 1,848.50', Outlet Invert= 1,825.00'

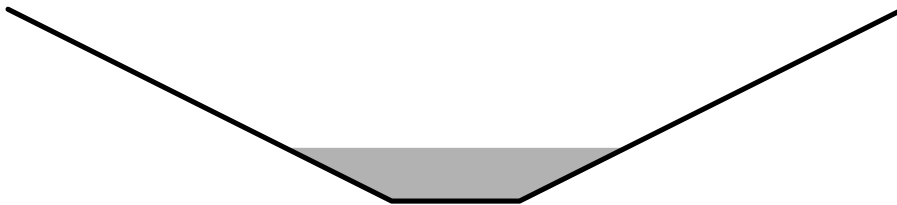

Summary for Reach 92a: Channel Along RR Tracks

Inflow Area = 9.707 ac, 4.57% Impervious, Inflow Depth = 0.54" for 1-YEAR event
Inflow = 1.15 cfs @ 12.69 hrs, Volume= 0.439 af
Outflow = 1.06 cfs @ 12.96 hrs, Volume= 0.439 af, Atten= 8%, Lag= 16.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.26 fps, Min. Travel Time= 9.0 min
Avg. Velocity = 0.84 fps, Avg. Travel Time= 24.1 min

Peak Storage= 570 cf @ 12.81 hrs
Average Depth at Peak Storage= 0.20'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 243.54 cfs

2.00' x 3.00' deep channel, n= 0.035
Side Slope Z-value= 2.0 '/' Top Width= 14.00'
Length= 1,216.0' Slope= 0.0317 '/'
Inlet Invert= 1,887.00', Outlet Invert= 1,848.50'



Summary for Reach 93R: Roadside Ditch

Inflow Area = 2.052 ac, 7.70% Impervious, Inflow Depth = 0.52" for 1-YEAR event
Inflow = 0.06 cfs @ 15.87 hrs, Volume= 0.090 af
Outflow = 0.06 cfs @ 16.10 hrs, Volume= 0.090 af, Atten= 0%, Lag= 14.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Max. Velocity= 0.46 fps, Min. Travel Time= 8.6 min
Avg. Velocity = 0.39 fps, Avg. Travel Time= 10.2 min

Peak Storage= 33 cf @ 15.96 hrs
Average Depth at Peak Storage= 0.07'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 19.90 cfs

2.00' x 1.50' deep channel, n= 0.033 Earth, grassed & winding
Side Slope Z-value= 2.0 ' Top Width= 8.00'
Length= 236.0' Slope= 0.0042 '
Inlet Invert= 1,895.00', Outlet Invert= 1,894.00'



Summary for Reach 142R: Overland Flow

Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.00 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 0.00 fps, Avg. Travel Time= 0.0 min

Peak Storage= 0 cf @ 0.00 hrs
Average Depth at Peak Storage= 0.00'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 209.00 cfs

40.00' x 0.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 60.0 ' Top Width= 100.00'
Length= 280.0' Slope= 0.0589 '
Inlet Invert= 1,960.00', Outlet Invert= 1,943.50'



‡

Summary for Reach 143R: Stone Lined Swale with ChkDams

Inflow Area = 48.885 ac, 26.48% Impervious, Inflow Depth = 0.03" for 1-YEAR event
Inflow = 0.20 cfs @ 13.26 hrs, Volume= 0.139 af
Outflow = 0.20 cfs @ 13.36 hrs, Volume= 0.139 af, Atten= 0%, Lag= 5.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 1.61 fps, Min. Travel Time= 3.5 min
Avg. Velocity = 1.08 fps, Avg. Travel Time= 5.1 min

Peak Storage= 42 cf @ 13.30 hrs
Average Depth at Peak Storage= 0.06'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 142.04 cfs

2.00' x 2.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/ Top Width= 10.00'
Length= 335.0' Slope= 0.1403 '/
Inlet Invert= 1,897.00', Outlet Invert= 1,850.00'



Summary for Reach I1: TRM SWALE

Inflow Area = 3.692 ac, 57.82% Impervious, Inflow Depth = 1.66" for 1-YEAR event
Inflow = 8.53 cfs @ 11.95 hrs, Volume= 0.511 af
Outflow = 8.42 cfs @ 11.97 hrs, Volume= 0.511 af, Atten= 1%, Lag= 1.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 3.13 fps, Min. Travel Time= 0.8 min
Avg. Velocity = 0.79 fps, Avg. Travel Time= 3.1 min

Peak Storage= 392 cf @ 11.96 hrs
Average Depth at Peak Storage= 0.77'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 33.85 cfs

2.00' x 1.50' deep channel, n= 0.035 TRM
Side Slope Z-value= 2.0 '/ Top Width= 8.00'
Length= 145.0' Slope= 0.0138 '/
Inlet Invert= 1,943.00', Outlet Invert= 1,941.00'



Summary for Reach I12: stone lined stream channel

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 1.10" for 1-YEAR event
Inflow = 22.88 cfs @ 12.05 hrs, Volume= 1.673 af
Outflow = 22.69 cfs @ 12.06 hrs, Volume= 1.673 af, Atten= 1%, Lag= 0.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.95 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 1.37 fps, Avg. Travel Time= 1.7 min

Peak Storage= 546 cf @ 12.05 hrs
Average Depth at Peak Storage= 0.80'
Bank-Full Depth= 2.25', Capacity at Bank-Full= 142.16 cfs

4.00' x 2.25' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 8.50'
Length= 142.0' Slope= 0.0493 '/'
Inlet Invert= 2,000.00', Outlet Invert= 1,993.00'




Summary for Reach I12a: stone lined stream channel

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 1.10" for 1-YEAR event
Inflow = 22.69 cfs @ 12.06 hrs, Volume= 1.673 af
Outflow = 22.47 cfs @ 12.06 hrs, Volume= 1.673 af, Atten= 1%, Lag= 0.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.07 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 2.10 fps, Avg. Travel Time= 1.3 min

Peak Storage= 448 cf @ 12.06 hrs
Average Depth at Peak Storage= 0.95'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 147.72 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 7.00'
Length= 160.0' Slope= 0.0938 '/'
Inlet Invert= 1,991.00', Outlet Invert= 1,976.00'

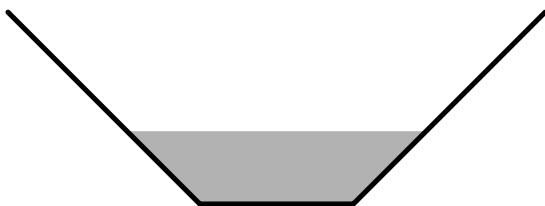

Summary for Reach I12b: stone lined stream channel

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 1.10" for 1-YEAR event
Inflow = 22.47 cfs @ 12.06 hrs, Volume= 1.673 af
Outflow = 22.16 cfs @ 12.09 hrs, Volume= 1.673 af, Atten= 1%, Lag= 1.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.99 fps, Min. Travel Time= 1.0 min
Avg. Velocity = 1.89 fps, Avg. Travel Time= 3.9 min

Peak Storage= 1,405 cf @ 12.08 hrs
Average Depth at Peak Storage= 0.86'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 133.69 cfs

2.00' x 2.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 440.0' Slope= 0.0795 '/'
Inlet Invert= 1,975.00', Outlet Invert= 1,940.00'



Summary for Reach I21: stone lined stream channel

Inflow Area = 7.912 ac, 63.11% Impervious, Inflow Depth = 1.85" for 1-YEAR event
Inflow = 23.65 cfs @ 11.95 hrs, Volume= 1.221 af
Outflow = 21.33 cfs @ 12.04 hrs, Volume= 1.221 af, Atten= 10%, Lag= 5.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.49 fps, Min. Travel Time= 3.5 min
Avg. Velocity = 1.80 fps, Avg. Travel Time= 14.7 min

Peak Storage= 4,512 cf @ 11.98 hrs
Average Depth at Peak Storage= 0.86'
Bank-Full Depth= 1.75', Capacity at Bank-Full= 88.29 cfs

2.00' x 1.75' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.5 '/' Top Width= 7.25'
Length= 1,585.0' Slope= 0.0893 '/'
Inlet Invert= 2,170.05', Outlet Invert= 2,028.50'



Summary for Reach I5: Overland Flow

Inflow Area = 8.896 ac, 31.70% Impervious, Inflow Depth = 0.91" for 1-YEAR event
Inflow = 0.82 cfs @ 13.10 hrs, Volume= 0.677 af
Outflow = 0.82 cfs @ 13.15 hrs, Volume= 0.677 af, Atten= 0%, Lag= 2.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.40 fps, Min. Travel Time= 1.9 min
Avg. Velocity = 0.22 fps, Avg. Travel Time= 3.4 min

Peak Storage= 92 cf @ 13.12 hrs
Average Depth at Peak Storage= 0.02'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 215.99 cfs

100.00' x 0.50' deep channel, n= 0.120 Sheet flow over Short Grass
Side Slope Z-value= 100.0 ' Top Width= 200.00'
Length= 45.0' Slope= 0.2000 '
Inlet Invert= 1,952.50', Outlet Invert= 1,943.50'



Summary for Pond 29P: cb29

Inflow Area = 0.582 ac, 15.87% Impervious, Inflow Depth = 0.99" for 1-YEAR event
 Inflow = 1.21 cfs @ 11.91 hrs, Volume= 0.048 af
 Outflow = 1.21 cfs @ 11.91 hrs, Volume= 0.048 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.21 cfs @ 11.91 hrs, Volume= 0.048 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,924.54' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,924.00'	18.0" Round Culvert L= 30.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,924.00' / 1,923.75' S= 0.0083 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,928.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.18 cfs @ 11.91 hrs HW=1,924.53' (Free Discharge)

- 1=Culvert (Barrel Controls 1.18 cfs @ 3.12 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 57: 16" Steel Culverts

Inflow Area = 1.326 ac, 4.72% Impervious, Inflow Depth = 0.65" for 1-YEAR event
 Inflow = 0.83 cfs @ 12.15 hrs, Volume= 0.072 af
 Outflow = 0.83 cfs @ 12.15 hrs, Volume= 0.072 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.83 cfs @ 12.15 hrs, Volume= 0.072 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,004.48' @ 12.15 hrs
 Flood Elev= 2,008.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,004.00'	16.0" Round 16" Smooth Steel Culvert (old) L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,004.00' / 2,000.00' S= 0.0667 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,006.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.83 cfs @ 12.15 hrs HW=2,004.48' (Free Discharge)

- 1=16" Smooth Steel Culvert (old) (Inlet Controls 0.83 cfs @ 1.86 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,004.00' (Free Discharge)

- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 58R: 24" HDPE Pipe

Inflow Area = 3.000 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af
 Outflow = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.92 cfs @ 12.11 hrs, Volume= 0.152 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,215.65' @ 12.11 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,215.00'	24.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,215.00' / 2,212.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,218.50'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=1.90 cfs @ 12.11 hrs HW=2,215.65' (Free Discharge)
 ↑1=Culvert (Inlet Controls 1.90 cfs @ 2.16 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,215.00' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 59: 32" Plastic Pipe

Inflow Area = 30.315 ac, 1.06% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af
 Outflow = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af, Atten= 0%, Lag= 0.0 min
 Primary = 14.76 cfs @ 12.22 hrs, Volume= 1.531 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,328.82' @ 12.22 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,327.00'	32.0" Round 32" Plastic Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,327.00' / 2,324.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,331.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=14.71 cfs @ 12.22 hrs HW=2,328.82' (Free Discharge)

↑1=32" Plastic Culvert (Inlet Controls 14.71 cfs @ 3.62 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,327.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 60: (2) 16" Steel Culverts

Inflow Area = 123.689 ac, 1.65% Impervious, Inflow Depth = 0.63" for 1-YEAR event
 Inflow = 24.56 cfs @ 12.30 hrs, Volume= 6.522 af
 Outflow = 24.56 cfs @ 12.30 hrs, Volume= 6.522 af, Atten= 0%, Lag= 0.0 min
 Primary = 24.56 cfs @ 12.30 hrs, Volume= 6.522 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,022.00' @ 12.30 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,018.00'	16.0" Round Culvert X 2.00 L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 2,018.00' / 2,017.00' S= 0.0500 '/ n= 0.012 Cc= 0.900
#2	Secondary	2,022.50'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=24.55 cfs @ 12.30 hrs HW=2,022.00' (Free Discharge)

↑1=Culvert (Inlet Controls 24.55 cfs @ 8.79 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,018.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 67P: 26" Steel Culverts

Inflow Area = 4.195 ac, 7.35% Impervious, Inflow Depth = 0.69" for 1-YEAR event
 Inflow = 3.47 cfs @ 12.08 hrs, Volume= 0.242 af
 Outflow = 3.47 cfs @ 12.08 hrs, Volume= 0.242 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.47 cfs @ 12.08 hrs, Volume= 0.242 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,003.87' @ 12.08 hrs

Flood Elev= 2,008.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,003.00'	26.0" Round 26" Smooth Steel Culvert (old) L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,003.00' / 2,000.00' S= 0.0500 '/ n= 0.012 Cc= 0.900
#2	Secondary	2,006.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50

3.00

Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31
3.32

Primary OutFlow Max=3.44 cfs @ 12.08 hrs HW=2,003.87' (Free Discharge)

↑1=26" Smooth Steel Culvert (old) (Inlet Controls 3.44 cfs @ 2.50 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,003.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 74: 12" CMP Culvert

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 0.82" for 1-YEAR event
 Inflow = 4.84 cfs @ 11.97 hrs, Volume= 0.252 af
 Outflow = 4.84 cfs @ 11.97 hrs, Volume= 0.252 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.84 cfs @ 11.97 hrs, Volume= 0.252 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,916.39' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,914.00'	12.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 1,914.00' / 1,911.76' S= 0.0560 '/ Cc= 0.900 n= 0.025
#2	Secondary	1,917.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=4.81 cfs @ 11.97 hrs HW=1,916.34' (Free Discharge)

↑1=Culvert (Barrel Controls 4.81 cfs @ 6.13 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,914.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 74A: 16" CMP Culvert

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 0.82" for 1-YEAR event
 Inflow = 4.89 cfs @ 11.97 hrs, Volume= 0.252 af
 Outflow = 4.89 cfs @ 11.97 hrs, Volume= 0.252 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.89 cfs @ 11.97 hrs, Volume= 0.252 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,922.69' @ 11.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,921.50'	16.0" Round Culvert L= 35.0' Ke= 0.500 Inlet / Outlet Invert= 1,921.50' / 1,920.00' S= 0.0429 '/ Cc= 0.900

n= 0.025
 #2 Secondary 1,924.50' **2.0' long x 1.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50
 3.00
 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31
 3.32

Primary OutFlow Max=4.87 cfs @ 11.97 hrs HW=1,922.69' (Free Discharge)

↑1=Culvert (Inlet Controls 4.87 cfs @ 3.71 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,921.50' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 76A: culvert

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 0.82" for 1-YEAR event
 Inflow = 4.76 cfs @ 11.99 hrs, Volume= 0.252 af
 Outflow = 4.76 cfs @ 11.99 hrs, Volume= 0.252 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.72 cfs @ 11.99 hrs, Volume= 0.252 af
 Secondary = 0.04 cfs @ 12.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,904.06' @ 11.99 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,902.00'	12.0" Round Culvert L= 60.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,902.00' / 1,898.00' S= 0.0667 '/' Cc= 0.900 n= 0.025 Corrugated metal
#2	Secondary	1,904.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=4.66 cfs @ 11.99 hrs HW=1,904.02' (Free Discharge)

↑1=Culvert (Inlet Controls 4.66 cfs @ 5.94 fps)

Secondary OutFlow Max=0.04 cfs @ 12.00 hrs HW=1,904.04' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 0.04 cfs @ 0.52 fps)

Summary for Pond 77: 32" Steel Culvert

Inflow Area = 88.881 ac, 1.70% Impervious, Inflow Depth = 0.63" for 1-YEAR event
 Inflow = 16.97 cfs @ 13.58 hrs, Volume= 4.649 af
 Outflow = 16.97 cfs @ 13.58 hrs, Volume= 4.649 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.97 cfs @ 13.58 hrs, Volume= 4.649 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,181.72' @ 13.58 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,180.00'	32.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,180.00' / 2,179.00' S= 0.0250 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,183.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=16.96 cfs @ 13.58 hrs HW=2,181.72' (Free Discharge)

↳1=Culvert (Inlet Controls 16.96 cfs @ 4.46 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,180.00' (Free Discharge)

↳2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 79: 16" Steel Culvert

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 0.63" for 1-YEAR event
 Inflow = 17.07 cfs @ 13.64 hrs, Volume= 4.750 af
 Outflow = 17.07 cfs @ 13.64 hrs, Volume= 4.750 af, Atten= 0%, Lag= 0.0 min
 Primary = 9.67 cfs @ 13.64 hrs, Volume= 4.197 af
 Secondary = 7.39 cfs @ 13.64 hrs, Volume= 0.553 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,058.74' @ 13.64 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,056.00'	16.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 2,056.00' / 2,055.00' S= 0.0500 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,057.50'	2.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=9.67 cfs @ 13.64 hrs HW=2,058.74' (Free Discharge)

↳1=Culvert (Inlet Controls 9.67 cfs @ 6.93 fps)

Secondary OutFlow Max=7.39 cfs @ 13.64 hrs HW=2,058.74' (Free Discharge)

↳2=Broad-Crested Rectangular Weir (Weir Controls 7.39 cfs @ 2.99 fps)

Summary for Pond 83: 24" HPDE Culvert

Inflow Area = 1.300 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af
 Outflow = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.92 cfs @ 12.08 hrs, Volume= 0.066 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,360.44' @ 12.08 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,360.00'	24.0" Round 24" Plastic Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,360.00' / 2,357.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,364.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=0.91 cfs @ 12.08 hrs HW=2,360.44' (Free Discharge)

↳1=**24" Plastic Culvert** (Inlet Controls 0.91 cfs @ 1.78 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,360.00' (Free Discharge)

↳2=**Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond 84: 24" HDPE Pipe

Inflow Area =	31.013 ac,	2.16% Impervious,	Inflow Depth = 0.65"	for 1-YEAR event
Inflow =	13.91 cfs @	12.31 hrs,	Volume=	1.675 af
Outflow =	13.91 cfs @	12.31 hrs,	Volume=	1.675 af, Atten= 0%, Lag= 0.0 min
Primary =	13.91 cfs @	12.31 hrs,	Volume=	1.675 af
Secondary =	0.00 cfs @	0.00 hrs,	Volume=	0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,316.66' @ 12.31 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,315.00'	36.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,315.00' / 2,312.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,320.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=13.89 cfs @ 12.31 hrs HW=2,316.66' (Free Discharge)

↳1=**Culvert** (Inlet Controls 13.89 cfs @ 3.46 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,315.00' (Free Discharge)

↳2=**Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond 85: 28" HDPE Pipe

Inflow Area = 4.281 ac, 0.54% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af
 Outflow = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.48 cfs @ 12.15 hrs, Volume= 0.216 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,295.69' @ 12.15 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,295.00'	30.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,295.00' / 2,292.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,300.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=2.48 cfs @ 12.15 hrs HW=2,295.69' (Free Discharge)
 ↑1=Culvert (Inlet Controls 2.48 cfs @ 2.24 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,295.00' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 86: 24" HDPE Pipe

Inflow Area = 4.340 ac, 0.76% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af
 Outflow = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.20 cfs @ 12.07 hrs, Volume= 0.219 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,240.86' @ 12.07 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,240.00'	24.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,240.00' / 2,237.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,245.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=3.17 cfs @ 12.07 hrs HW=2,240.85' (Free Discharge)

↑1=Culvert (Inlet Controls 3.17 cfs @ 2.48 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,240.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 87: 18" Steel Culvert

Inflow Area = 2.000 ac, 0.00% Impervious, Inflow Depth = 0.61" for 1-YEAR event
 Inflow = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af
 Outflow = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.33 cfs @ 12.10 hrs, Volume= 0.101 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,208.59' @ 12.10 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,208.00'	18.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,208.00' / 2,207.00' S= 0.0167 '/ Cc= 0.900 n= 0.012

Primary OutFlow Max=1.32 cfs @ 12.10 hrs HW=2,208.59' (Free Discharge)

↑1=Culvert (Inlet Controls 1.32 cfs @ 2.06 fps)

Summary for Pond 90: 24" Steel Culvert

Inflow Area = 9.707 ac, 4.57% Impervious, Inflow Depth = 0.54" for 1-YEAR event
 Inflow = 1.27 cfs @ 12.39 hrs, Volume= 0.439 af
 Outflow = 1.27 cfs @ 12.39 hrs, Volume= 0.439 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.27 cfs @ 12.39 hrs, Volume= 0.439 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,890.46' @ 12.39 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,890.00'	24.0" Round Culvert L= 25.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 1,890.00' / 1,889.50' S= 0.0200 '/ Cc= 0.900 n= 0.012
#2	Secondary	1,895.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=1.27 cfs @ 12.39 hrs HW=1,890.46' (Free Discharge)

↑1=Culvert (Inlet Controls 1.27 cfs @ 2.31 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,890.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 122: 18" HDPE Storm

Inflow Area = 0.477 ac, 83.18% Impervious, Inflow Depth = 2.16" for 1-YEAR event
 Inflow = 1.89 cfs @ 11.93 hrs, Volume= 0.086 af
 Outflow = 1.89 cfs @ 11.93 hrs, Volume= 0.086 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.89 cfs @ 11.93 hrs, Volume= 0.086 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,946.76' @ 11.93 hrs
 Flood Elev= 1,961.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,946.00'	18.0" Round Culvert L= 22.0' Ke= 0.500 Inlet / Outlet Invert= 1,946.00' / 1,945.89' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,949.33'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.84 cfs @ 11.93 hrs HW=1,946.74' (Free Discharge)

- 1=Culvert (Barrel Controls 1.84 cfs @ 3.06 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 123: 18" HDPE Storm

Inflow Area = 0.667 ac, 80.73% Impervious, Inflow Depth = 2.10" for 1-YEAR event
 Inflow = 2.60 cfs @ 11.93 hrs, Volume= 0.117 af
 Outflow = 2.60 cfs @ 11.93 hrs, Volume= 0.117 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.60 cfs @ 11.93 hrs, Volume= 0.117 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,946.74' @ 11.93 hrs
 Flood Elev= 1,961.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,945.89'	18.0" Round Culvert L= 124.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,945.89' / 1,945.27' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,949.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=2.53 cfs @ 11.93 hrs HW=1,946.73' (Free Discharge)

- 1=Culvert (Barrel Controls 2.53 cfs @ 3.59 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 140: culvert

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 1.10" for 1-YEAR event
 Inflow = 22.69 cfs @ 12.06 hrs, Volume= 1.673 af
 Outflow = 22.69 cfs @ 12.06 hrs, Volume= 1.673 af, Atten= 0%, Lag= 0.0 min
 Primary = 22.69 cfs @ 12.06 hrs, Volume= 1.673 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,993.53' @ 12.06 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,991.50'	36.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 1,991.50' / 1,991.00' S= 0.0250 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,995.00'	25.0' long x 20.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=22.58 cfs @ 12.06 hrs HW=1,993.53' (Free Discharge)

- 1=Culvert (Barrel Controls 22.58 cfs @ 6.28 fps)
- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 141: culvert

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 1.10" for 1-YEAR event
 Inflow = 22.47 cfs @ 12.06 hrs, Volume= 1.673 af
 Outflow = 22.47 cfs @ 12.06 hrs, Volume= 1.673 af, Atten= 0%, Lag= 0.0 min
 Primary = 22.47 cfs @ 12.06 hrs, Volume= 1.673 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,977.92' @ 12.06 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,976.00'	36.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 1,976.00' / 1,975.00' S= 0.0500 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,980.00'	25.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=22.42 cfs @ 12.06 hrs HW=1,977.91' (Free Discharge)

- 1=Culvert (Inlet Controls 22.42 cfs @ 4.71 fps)
- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond I18: Manhole

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 1.10" for 1-YEAR event
 Inflow = 22.88 cfs @ 12.05 hrs, Volume= 1.673 af
 Outflow = 22.88 cfs @ 12.05 hrs, Volume= 1.673 af, Atten= 0%, Lag= 0.0 min
 Primary = 22.88 cfs @ 12.05 hrs, Volume= 1.673 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,007.71' @ 12.05 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,006.00'	48.0" Round Culvert L= 304.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,006.00' / 2,000.00' S= 0.0197 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=22.61 cfs @ 12.05 hrs HW=2,007.70' (Free Discharge)

↳1=Culvert (Inlet Controls 22.61 cfs @ 4.44 fps)

Summary for Pond I19: Manhole

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 1.10" for 1-YEAR event
 Inflow = 22.88 cfs @ 12.05 hrs, Volume= 1.673 af
 Outflow = 22.88 cfs @ 12.05 hrs, Volume= 1.673 af, Atten= 0%, Lag= 0.0 min
 Primary = 22.88 cfs @ 12.05 hrs, Volume= 1.673 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,018.71' @ 12.05 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,017.00'	48.0" Round Culvert L= 348.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,017.00' / 2,006.00' S= 0.0316 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=22.61 cfs @ 12.05 hrs HW=2,018.70' (Free Discharge)

↳1=Culvert (Inlet Controls 22.61 cfs @ 4.44 fps)

Summary for Pond I2: 30" HDPE Storm

Inflow Area = 3.692 ac, 57.82% Impervious, Inflow Depth = 1.66" for 1-YEAR event
 Inflow = 8.53 cfs @ 11.95 hrs, Volume= 0.511 af
 Outflow = 8.53 cfs @ 11.95 hrs, Volume= 0.511 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.53 cfs @ 11.95 hrs, Volume= 0.511 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,945.21' @ 11.95 hrs
 Flood Elev= 1,955.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,943.90'	30.0" Round Culvert L= 170.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,943.90' / 1,943.00' S= 0.0053 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=8.46 cfs @ 11.95 hrs HW=1,945.20' (Free Discharge)

↳1=Culvert (Barrel Controls 8.46 cfs @ 4.76 fps)

Summary for Pond I22: Manhole- 48" HDPE Storm

Inflow Area = 7.912 ac, 63.11% Impervious, Inflow Depth = 1.85" for 1-YEAR event
 Inflow = 23.65 cfs @ 11.95 hrs, Volume= 1.221 af
 Outflow = 23.65 cfs @ 11.95 hrs, Volume= 1.221 af, Atten= 0%, Lag= 0.0 min
 Primary = 23.65 cfs @ 11.95 hrs, Volume= 1.221 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,172.35' @ 11.95 hrs

Flood Elev= 2,182.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,170.15'	48.0" Round Culvert L= 49.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,170.15' / 2,170.05' S= 0.0020 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,182.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=23.26 cfs @ 11.95 hrs HW=2,172.33' (Free Discharge)

1=Culvert (Barrel Controls 23.26 cfs @ 4.82 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I23: Manhole -30" HDPE Storm

Inflow Area = 3.957 ac, 45.04% Impervious, Inflow Depth = 1.52" for 1-YEAR event
 Inflow = 9.79 cfs @ 11.95 hrs, Volume= 0.500 af
 Outflow = 9.79 cfs @ 11.95 hrs, Volume= 0.500 af, Atten= 0%, Lag= 0.0 min
 Primary = 9.79 cfs @ 11.95 hrs, Volume= 0.500 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,185.00' @ 11.95 hrs

Flood Elev= 2,189.20'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,183.72'	30.0" Round Culvert L= 171.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,183.72' / 2,176.64' S= 0.0414 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,189.19'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=9.66 cfs @ 11.95 hrs HW=2,184.99' (Free Discharge)

1=Culvert (Inlet Controls 9.66 cfs @ 3.84 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I24: 30" HDPE Storm

Inflow Area = 3.957 ac, 45.04% Impervious, Inflow Depth = 1.52" for 1-YEAR event
 Inflow = 9.79 cfs @ 11.95 hrs, Volume= 0.500 af
 Outflow = 9.79 cfs @ 11.95 hrs, Volume= 0.500 af, Atten= 0%, Lag= 0.0 min
 Primary = 9.79 cfs @ 11.95 hrs, Volume= 0.500 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,190.31' @ 11.95 hrs

Flood Elev= 2,194.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,189.03'	30.0" Round Culvert L= 63.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,189.03' / 2,183.82' S= 0.0827 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,194.48'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=9.66 cfs @ 11.95 hrs HW=2,190.30' (Free Discharge)

1=Culvert (Inlet Controls 9.66 cfs @ 3.84 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I25: 30" HDPE Storm

Inflow Area = 3.059 ac, 51.35% Impervious, Inflow Depth = 1.64" for 1-YEAR event
 Inflow = 8.09 cfs @ 11.94 hrs, Volume= 0.418 af
 Outflow = 8.09 cfs @ 11.94 hrs, Volume= 0.418 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.09 cfs @ 11.94 hrs, Volume= 0.418 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,192.65' @ 11.94 hrs

Flood Elev= 2,205.80'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,191.50'	30.0" Round Culvert L= 253.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,191.50' / 2,189.13' S= 0.0094 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,205.80'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=8.05 cfs @ 11.94 hrs HW=2,192.65' (Free Discharge)

1=Culvert (Inlet Controls 8.05 cfs @ 3.65 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I26: 30" HDPE Storm

Inflow Area = 2.407 ac, 48.55% Impervious, Inflow Depth = 1.62" for 1-YEAR event
 Inflow = 6.82 cfs @ 11.94 hrs, Volume= 0.324 af
 Outflow = 6.82 cfs @ 11.94 hrs, Volume= 0.324 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.82 cfs @ 11.94 hrs, Volume= 0.324 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,193.29' @ 11.94 hrs

Flood Elev= 2,208.54'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,191.80'	30.0" Round Culvert L= 201.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,191.80' / 2,191.60' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,195.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=6.74 cfs @ 11.94 hrs HW=2,193.28' (Free Discharge)

1=Culvert (Barrel Controls 6.74 cfs @ 3.21 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I27: 30" HDPE Storm

Inflow Area = 2.129 ac, 53.13% Impervious, Inflow Depth = 1.71" for 1-YEAR event
 Inflow = 6.30 cfs @ 11.94 hrs, Volume= 0.303 af
 Outflow = 6.30 cfs @ 11.94 hrs, Volume= 0.303 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.30 cfs @ 11.94 hrs, Volume= 0.303 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,193.37' @ 11.94 hrs
 Flood Elev= 2,208.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,192.00'	30.0" Round Culvert L= 98.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,192.00' / 2,191.90' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,208.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=6.22 cfs @ 11.94 hrs HW=2,193.36' (Free Discharge)

- 1=Culvert (Barrel Controls 6.22 cfs @ 3.30 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I28: 30" HDPE Storm

Inflow Area = 1.459 ac, 77.51% Impervious, Inflow Depth = 2.13" for 1-YEAR event
 Inflow = 5.25 cfs @ 11.94 hrs, Volume= 0.259 af
 Outflow = 5.25 cfs @ 11.94 hrs, Volume= 0.259 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.25 cfs @ 11.94 hrs, Volume= 0.259 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,193.61' @ 11.94 hrs
 Flood Elev= 2,195.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,192.30'	30.0" Round Culvert L= 236.0' Ke= 0.500 Inlet / Outlet Invert= 2,192.30' / 2,192.07' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,197.80'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=5.19 cfs @ 11.94 hrs HW=2,193.61' (Free Discharge)

- 1=Culvert (Barrel Controls 5.19 cfs @ 2.91 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I29: Manhole

Inflow Area = 1.039 ac, 100.00% Impervious, Inflow Depth = 2.57" for 1-YEAR event
 Inflow = 4.45 cfs @ 11.93 hrs, Volume= 0.222 af
 Outflow = 4.45 cfs @ 11.93 hrs, Volume= 0.222 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.45 cfs @ 11.93 hrs, Volume= 0.222 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,193.64' @ 11.93 hrs
 Flood Elev= 2,208.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,192.50'	30.0" Round Culvert L= 98.0' Ke= 0.500 Inlet / Outlet Invert= 2,192.50' / 2,192.40' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=4.36 cfs @ 11.93 hrs HW=2,193.63' (Free Discharge)
 ↖1=Culvert (Barrel Controls 4.36 cfs @ 2.96 fps)

Summary for Pond I3: 30" HDPE Storm

Inflow Area = 3.323 ac, 53.14% Impervious, Inflow Depth = 1.56" for 1-YEAR event
 Inflow = 7.57 cfs @ 11.97 hrs, Volume= 0.432 af
 Outflow = 7.57 cfs @ 11.97 hrs, Volume= 0.432 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.57 cfs @ 11.97 hrs, Volume= 0.432 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,946.39' @ 11.97 hrs
 Flood Elev= 1,949.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,945.17'	30.0" Round Culvert L= 231.0' Ke= 0.500 Inlet / Outlet Invert= 1,945.17' / 1,944.02' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,949.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=7.57 cfs @ 11.97 hrs HW=1,946.39' (Free Discharge)
 ↖1=Culvert (Barrel Controls 7.57 cfs @ 4.63 fps)
 ↘2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I30: 30" HDPE Storm

Inflow Area = 1.039 ac, 100.00% Impervious, Inflow Depth = 2.57" for 1-YEAR event
 Inflow = 4.45 cfs @ 11.93 hrs, Volume= 0.222 af
 Outflow = 4.45 cfs @ 11.93 hrs, Volume= 0.222 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.45 cfs @ 11.93 hrs, Volume= 0.222 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,195.21' @ 11.93 hrs
 Flood Elev= 2,204.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,194.08'	30.0" Round Culvert L= 79.0' Ke= 0.500 Inlet / Outlet Invert= 2,194.08' / 2,194.00' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,199.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.37 cfs @ 11.93 hrs HW=2,195.20' (Free Discharge)

└1=Culvert (Barrel Controls 4.37 cfs @ 3.01 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I31: 30" HDPE Storm

Inflow Area = 1.141 ac, 34.78% Impervious, Inflow Depth = 1.24" for 1-YEAR event
 Inflow = 2.61 cfs @ 11.96 hrs, Volume= 0.118 af
 Outflow = 2.61 cfs @ 11.96 hrs, Volume= 0.118 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.61 cfs @ 11.96 hrs, Volume= 0.118 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,171.29' @ 11.96 hrs

Flood Elev= 2,180.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,170.50'	30.0" Round Culvert L= 55.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,170.50' / 2,170.35' S= 0.0027 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=2.55 cfs @ 11.96 hrs HW=2,171.28' (Free Discharge)

└1=Culvert (Barrel Controls 2.55 cfs @ 2.91 fps)

Summary for Pond I32: 30" HDPE Storm

Inflow Area = 1.141 ac, 34.78% Impervious, Inflow Depth = 1.24" for 1-YEAR event
 Inflow = 2.61 cfs @ 11.96 hrs, Volume= 0.118 af
 Outflow = 2.61 cfs @ 11.96 hrs, Volume= 0.118 af, Atten= 0%, Lag= 0.0 min
 Primary = 2.61 cfs @ 11.96 hrs, Volume= 0.118 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,171.67' @ 11.96 hrs

Flood Elev= 2,180.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,170.85'	30.0" Round Culvert L= 119.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,170.85' / 2,170.60' S= 0.0021 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,180.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=2.55 cfs @ 11.96 hrs HW=2,171.66' (Free Discharge)

└1=Culvert (Barrel Controls 2.55 cfs @ 2.76 fps)

└2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I33: 24" HDPE Storm

Inflow Area = 0.677 ac, 30.81% Impervious, Inflow Depth = 1.16" for 1-YEAR event
 Inflow = 1.44 cfs @ 11.97 hrs, Volume= 0.066 af
 Outflow = 1.44 cfs @ 11.97 hrs, Volume= 0.066 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.44 cfs @ 11.97 hrs, Volume= 0.066 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,171.96' @ 11.97 hrs
 Flood Elev= 2,175.80'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,171.30'	24.0" Round Culvert L= 175.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,171.30' / 2,170.95' S= 0.0020 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,175.80'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.43 cfs @ 11.97 hrs HW=2,171.96' (Free Discharge)
 ↑1=Culvert (Barrel Controls 1.43 cfs @ 2.35 fps)
 ↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I4: 15" HDPE Storm

Inflow Area = 0.369 ac, 100.00% Impervious, Inflow Depth = 2.57" for 1-YEAR event
 Inflow = 1.67 cfs @ 11.90 hrs, Volume= 0.079 af
 Outflow = 1.67 cfs @ 11.90 hrs, Volume= 0.079 af, Atten= 0%, Lag= 0.0 min
 Primary = 1.67 cfs @ 11.90 hrs, Volume= 0.079 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,952.13' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,951.50'	15.0" Round Culvert L= 140.0' Ke= 0.500 Inlet / Outlet Invert= 1,951.50' / 1,950.00' S= 0.0107 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=1.62 cfs @ 11.90 hrs HW=1,952.12' (Free Discharge)
 ↑1=Culvert (Inlet Controls 1.62 cfs @ 2.68 fps)

Summary for Pond I6: Manhole

Inflow Area = 8.896 ac, 31.70% Impervious, Inflow Depth = 0.91" for 1-YEAR event
 Inflow = 0.82 cfs @ 13.10 hrs, Volume= 0.677 af
 Outflow = 0.82 cfs @ 13.10 hrs, Volume= 0.677 af, Atten= 0%, Lag= 0.0 min
 Primary = 0.82 cfs @ 13.10 hrs, Volume= 0.677 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,952.92' @ 13.10 hrs

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 19

Device	Routing	Invert	Outlet Devices
#1	Primary	1,952.50'	36.0" Round Culvert L= 186.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,952.50' / 1,952.00' S= 0.0027 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=0.82 cfs @ 13.10 hrs HW=1,952.92' (Free Discharge)

↑1=Culvert (Barrel Controls 0.82 cfs @ 2.05 fps)

Summary for Reach 18R: Overland Flow

Inflow Area = 45.186 ac, 28.04% Impervious, Inflow Depth > 2.42" for 10-YEAR event
Inflow = 9.18 cfs @ 13.90 hrs, Volume= 9.123 af
Outflow = 9.18 cfs @ 14.00 hrs, Volume= 9.122 af, Atten= 0%, Lag= 5.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 2.54 fps, Min. Travel Time= 3.5 min
Avg. Velocity = 0.87 fps, Avg. Travel Time= 10.3 min

Peak Storage= 1,934 cf @ 13.94 hrs
Average Depth at Peak Storage= 0.10'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 214.48 cfs

30.00' x 0.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 75.0 '/' Top Width= 105.00'
Length= 535.0' Slope= 0.0748 '/'
Inlet Invert= 1,937.00', Outlet Invert= 1,897.00'



Summary for Reach 21R: Ex. Roadside Ditch

Inflow Area = 4.411 ac, 6.47% Impervious, Inflow Depth = 2.63" for 10-YEAR event
Inflow = 16.31 cfs @ 12.07 hrs, Volume= 0.966 af
Outflow = 15.61 cfs @ 12.09 hrs, Volume= 0.966 af, Atten= 4%, Lag= 1.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.57 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 0.84 fps, Avg. Travel Time= 2.4 min

Peak Storage= 341 cf @ 12.08 hrs
Average Depth at Peak Storage= 0.96'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 36.63 cfs

2.00' x 1.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 1.0 '/' Top Width= 5.00'
Length= 120.0' Slope= 0.0250 '/'
Inlet Invert= 1,897.00', Outlet Invert= 1,894.00'



Summary for Reach 58A: Overland Flow

Inflow Area = 3.000 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 10.31 cfs @ 12.09 hrs, Volume= 0.701 af
Outflow = 4.96 cfs @ 12.78 hrs, Volume= 0.701 af, Atten= 52%, Lag= 41.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.27 fps, Min. Travel Time= 29.8 min
Avg. Velocity = 0.07 fps, Avg. Travel Time= 121.9 min

Peak Storage= 8,863 cf @ 12.28 hrs
Average Depth at Peak Storage= 0.16'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 151.22 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 478.0' Slope= 0.0711 '
Inlet Invert= 2,212.00', Outlet Invert= 2,178.00'




Summary for Reach 61: Vegetated Roadside Swale

Inflow Area = 5.521 ac, 6.72% Impervious, Inflow Depth = 2.97" for 10-YEAR event
Inflow = 20.53 cfs @ 12.07 hrs, Volume= 1.367 af
Outflow = 20.13 cfs @ 12.13 hrs, Volume= 1.367 af, Atten= 2%, Lag= 3.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.80 fps, Min. Travel Time= 1.8 min
Avg. Velocity = 2.42 fps, Avg. Travel Time= 5.2 min

Peak Storage= 2,222 cf @ 12.10 hrs
Average Depth at Peak Storage= 1.63'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 67.71 cfs

1.00' x 3.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 ' Top Width= 4.00'
Length= 751.0' Slope= 0.0613 '
Inlet Invert= 2,000.00', Outlet Invert= 1,954.00'



Summary for Reach 66: Stream Channel

Inflow Area = 123.689 ac, 1.65% Impervious, Inflow Depth = 2.86" for 10-YEAR event
Inflow = 145.90 cfs @ 13.04 hrs, Volume= 29.526 af
Outflow = 144.73 cfs @ 13.14 hrs, Volume= 29.526 af, Atten= 1%, Lag= 5.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 9.48 fps, Min. Travel Time= 3.3 min
Avg. Velocity = 1.84 fps, Avg. Travel Time= 17.0 min

Peak Storage= 28,778 cf @ 13.08 hrs
Average Depth at Peak Storage= 1.43'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 297.74 cfs

5.00' x 2.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/' Top Width= 21.00'
Length= 1,884.0' Slope= 0.1152 '/'
Inlet Invert= 2,017.00', Outlet Invert= 1,800.00'




Summary for Reach 73A: Vegetated Roadside Channel

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 3.25" for 10-YEAR event
Inflow = 20.04 cfs @ 11.96 hrs, Volume= 1.002 af
Outflow = 19.92 cfs @ 11.96 hrs, Volume= 1.002 af, Atten= 1%, Lag= 0.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.56 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 2.10 fps, Avg. Travel Time= 0.5 min

Peak Storage= 183 cf @ 11.96 hrs
Average Depth at Peak Storage= 1.66'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 28.54 cfs

1.00' x 2.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 '/' Top Width= 3.00'
Length= 60.0' Slope= 0.0560 '/'
Inlet Invert= 1,920.00', Outlet Invert= 1,916.64'




Summary for Reach 75: Roadside Channel

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 3.25" for 10-YEAR event
Inflow = 19.92 cfs @ 11.96 hrs, Volume= 1.002 af
Outflow = 19.64 cfs @ 11.98 hrs, Volume= 1.002 af, Atten= 1%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.47 fps, Min. Travel Time= 0.4 min
Avg. Velocity = 2.06 fps, Avg. Travel Time= 1.3 min

Peak Storage= 509 cf @ 11.97 hrs
Average Depth at Peak Storage= 1.67'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 28.08 cfs

1.00' x 2.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 '/ Top Width= 3.00'
Length= 166.0' Slope= 0.0542 '/
Inlet Invert= 1,911.00', Outlet Invert= 1,902.00'




Summary for Reach 76: Roadside Channel

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 3.25" for 10-YEAR event
Inflow = 19.64 cfs @ 11.98 hrs, Volume= 1.002 af
Outflow = 19.54 cfs @ 11.98 hrs, Volume= 1.002 af, Atten= 1%, Lag= 0.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.53 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 2.08 fps, Avg. Travel Time= 0.5 min

Peak Storage= 186 cf @ 11.98 hrs
Average Depth at Peak Storage= 1.65'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 28.53 cfs

1.00' x 2.00' deep channel, n= 0.040
Side Slope Z-value= 0.5 '/ Top Width= 3.00'
Length= 62.0' Slope= 0.0560 '/
Inlet Invert= 1,902.00', Outlet Invert= 1,898.53'



Summary for Reach 78: Stream Channel

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 2.85" for 10-YEAR event
Inflow = 130.68 cfs @ 12.97 hrs, Volume= 21.601 af
Outflow = 130.41 cfs @ 13.01 hrs, Volume= 21.601 af, Atten= 0%, Lag= 1.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 10.37 fps, Min. Travel Time= 1.1 min
Avg. Velocity = 1.83 fps, Avg. Travel Time= 6.2 min

Peak Storage= 8,622 cf @ 12.99 hrs
Average Depth at Peak Storage= 1.18'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 213.41 cfs

6.00' x 1.50' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/ Top Width= 18.00'
Length= 685.0' Slope= 0.1635 '/
Inlet Invert= 2,170.00', Outlet Invert= 2,058.00'



Summary for Reach 80: Stream Channel

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 2.85" for 10-YEAR event
Inflow = 130.41 cfs @ 13.01 hrs, Volume= 21.601 af
Outflow = 130.05 cfs @ 13.06 hrs, Volume= 21.601 af, Atten= 0%, Lag= 3.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.59 fps, Min. Travel Time= 1.9 min
Avg. Velocity = 1.17 fps, Avg. Travel Time= 10.6 min

Peak Storage= 14,598 cf @ 13.03 hrs
Average Depth at Peak Storage= 1.59'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 209.43 cfs

6.00' x 2.00' deep channel, n= 0.050
Side Slope Z-value= 4.0 '/ Top Width= 22.00'
Length= 740.0' Slope= 0.0473 '/
Inlet Invert= 2,055.00', Outlet Invert= 2,020.00'



Summary for Reach 82: Overland Flow

Inflow Area = 1.300 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 4.87 cfs @ 12.06 hrs, Volume= 0.304 af
Outflow = 1.08 cfs @ 13.77 hrs, Volume= 0.304 af, Atten= 78%, Lag= 102.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.19 fps, Min. Travel Time= 82.5 min
Avg. Velocity = 0.05 fps, Avg. Travel Time= 306.3 min

Peak Storage= 5,366 cf @ 12.39 hrs
Average Depth at Peak Storage= 0.05'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 53.31 cfs

100.00' x 0.50' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 200.00'
Length= 938.0' Slope= 0.1354 '
Inlet Invert= 2,347.00', Outlet Invert= 2,220.00'



Summary for Reach 82a: Overland Flow

Inflow Area = 62.628 ac, 1.58% Impervious, Inflow Depth = 2.68" for 10-YEAR event
Inflow = 101.52 cfs @ 12.67 hrs, Volume= 13.991 af
Outflow = 92.40 cfs @ 13.01 hrs, Volume= 13.991 af, Atten= 9%, Lag= 20.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.70 fps, Min. Travel Time= 11.2 min
Avg. Velocity = 0.10 fps, Avg. Travel Time= 75.6 min

Peak Storage= 62,178 cf @ 12.82 hrs
Average Depth at Peak Storage= 0.75'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 164.89 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 473.0' Slope= 0.0846 '
Inlet Invert= 2,220.00', Outlet Invert= 2,180.00'



Summary for Reach 83A: Overland Flow

Inflow Area = 30.315 ac, 1.06% Impervious, Inflow Depth = 2.48" for 10-YEAR event
Inflow = 46.42 cfs @ 12.19 hrs, Volume= 6.253 af
Outflow = 42.96 cfs @ 12.51 hrs, Volume= 6.253 af, Atten= 7%, Lag= 19.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.72 fps, Min. Travel Time= 10.2 min
Avg. Velocity = 0.18 fps, Avg. Travel Time= 41.7 min

Peak Storage= 26,373 cf @ 12.34 hrs
Average Depth at Peak Storage= 0.42'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 232.26 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 441.0' Slope= 0.1678 '
Inlet Invert= 2,326.00', Outlet Invert= 2,252.00'



Summary for Reach 84A: Overland Flow

Inflow Area = 61.328 ac, 1.61% Impervious, Inflow Depth = 2.68" for 10-YEAR event
Inflow = 104.13 cfs @ 12.49 hrs, Volume= 13.687 af
Outflow = 101.51 cfs @ 12.67 hrs, Volume= 13.687 af, Atten= 3%, Lag= 10.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.81 fps, Min. Travel Time= 5.7 min
Avg. Velocity = 0.18 fps, Avg. Travel Time= 25.6 min

Peak Storage= 34,815 cf @ 12.58 hrs
Average Depth at Peak Storage= 0.73'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 192.72 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 277.0' Slope= 0.1155 '
Inlet Invert= 2,252.00', Outlet Invert= 2,220.00'



Summary for Reach 84B: Overland Flow

Inflow Area = 31.013 ac, 2.16% Impervious, Inflow Depth = 2.88" for 10-YEAR event
Inflow = 64.69 cfs @ 12.23 hrs, Volume= 7.434 af
Outflow = 61.22 cfs @ 12.48 hrs, Volume= 7.434 af, Atten= 5%, Lag= 15.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.79 fps, Min. Travel Time= 7.8 min
Avg. Velocity = 0.19 fps, Avg. Travel Time= 33.0 min

Peak Storage= 28,726 cf @ 12.35 hrs
Average Depth at Peak Storage= 0.51'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 228.33 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 370.0' Slope= 0.1622 '
Inlet Invert= 2,312.00', Outlet Invert= 2,252.00'



Summary for Reach 85A: Overland Flow

Inflow Area = 4.281 ac, 0.54% Impervious, Inflow Depth = 4.95" for 10-YEAR event
Inflow = 40.92 cfs @ 12.21 hrs, Volume= 1.765 af
Outflow = 30.67 cfs @ 12.58 hrs, Volume= 1.765 af, Atten= 25%, Lag= 21.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.63 fps, Min. Travel Time= 13.4 min
Avg. Velocity = 0.10 fps, Avg. Travel Time= 80.5 min

Peak Storage= 24,784 cf @ 12.36 hrs
Average Depth at Peak Storage= 0.36'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 221.40 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 505.0' Slope= 0.1525 '
Inlet Invert= 2,292.00', Outlet Invert= 2,215.00'



Summary for Reach 85B: Overland Flow

Inflow Area = 8.621 ac, 0.65% Impervious, Inflow Depth = 4.05" for 10-YEAR event
Inflow = 36.47 cfs @ 12.55 hrs, Volume= 2.906 af
Outflow = 29.55 cfs @ 12.93 hrs, Volume= 2.906 af, Atten= 19%, Lag= 22.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.49 fps, Min. Travel Time= 15.4 min
Avg. Velocity = 0.09 fps, Avg. Travel Time= 87.5 min

Peak Storage= 27,375 cf @ 12.67 hrs
Average Depth at Peak Storage= 0.42'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 157.60 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 453.0' Slope= 0.0773 '
Inlet Invert= 2,215.00', Outlet Invert= 2,180.00'



Summary for Reach 86A: Overland Flow

Inflow Area = 4.340 ac, 0.76% Impervious, Inflow Depth = 3.16" for 10-YEAR event
Inflow = 19.66 cfs @ 12.19 hrs, Volume= 1.142 af
Outflow = 17.29 cfs @ 12.35 hrs, Volume= 1.142 af, Atten= 12%, Lag= 9.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.47 fps, Min. Travel Time= 6.9 min
Avg. Velocity = 0.10 fps, Avg. Travel Time= 31.1 min

Peak Storage= 7,157 cf @ 12.24 hrs
Average Depth at Peak Storage= 0.29'
Bank-Full Depth= 1.00', Capacity at Bank-Full= 190.45 cfs

100.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush
Side Slope Z-value= 100.0 ' Top Width= 300.00'
Length= 195.0' Slope= 0.1128 '
Inlet Invert= 2,237.00', Outlet Invert= 2,215.00'




Summary for Reach 88: Roadside Swale

Inflow Area = 2.000 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
Inflow = 7.10 cfs @ 12.08 hrs, Volume= 0.468 af
Outflow = 7.00 cfs @ 12.12 hrs, Volume= 0.468 af, Atten= 1%, Lag= 2.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.79 fps, Min. Travel Time= 1.4 min
Avg. Velocity = 1.65 fps, Avg. Travel Time= 4.8 min

Peak Storage= 573 cf @ 12.10 hrs
Average Depth at Peak Storage= 0.54'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 63.06 cfs

2.00' x 2.00' deep channel, n= 0.035
Side Slope Z-value= 0.5 '/' Top Width= 4.00'
Length= 472.0' Slope= 0.0678 '/'
Inlet Invert= 2,207.00', Outlet Invert= 2,175.00'

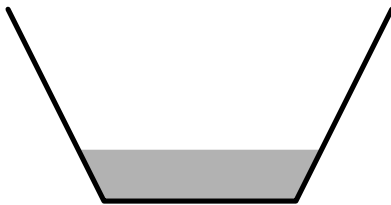

Summary for Reach 91: Overland Flow

Inflow Area = 9.707 ac, 4.57% Impervious, Inflow Depth = 2.70" for 10-YEAR event
Inflow = 27.22 cfs @ 12.09 hrs, Volume= 2.183 af
Outflow = 23.78 cfs @ 12.19 hrs, Volume= 2.183 af, Atten= 13%, Lag= 6.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.99 fps, Min. Travel Time= 3.3 min
Avg. Velocity = 0.14 fps, Avg. Travel Time= 23.8 min

Peak Storage= 4,753 cf @ 12.13 hrs
Average Depth at Peak Storage= 0.20'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 126.11 cfs

100.00' x 0.50' deep channel, n= 0.080 Earth, long dense weeds
Side Slope Z-value= 100.0 '/' Top Width= 200.00'
Length= 198.0' Slope= 0.0303 '/'
Inlet Invert= 1,893.00', Outlet Invert= 1,887.00'



‡


Summary for Reach 92: Channel Along RR Tracks

Inflow Area = 74.590 ac, 20.27% Impervious, Inflow Depth > 2.60" for 10-YEAR event
Inflow = 70.90 cfs @ 11.98 hrs, Volume= 16.158 af
Outflow = 68.58 cfs @ 12.03 hrs, Volume= 16.157 af, Atten= 3%, Lag= 3.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 7.64 fps, Min. Travel Time= 1.5 min
Avg. Velocity = 1.87 fps, Avg. Travel Time= 6.0 min

Peak Storage= 6,096 cf @ 12.00 hrs
Average Depth at Peak Storage= 1.68'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 255.39 cfs

2.00' x 3.00' deep channel, n= 0.035
Side Slope Z-value= 2.0 '/' Top Width= 14.00'
Length= 675.0' Slope= 0.0348 '/'
Inlet Invert= 1,848.50', Outlet Invert= 1,825.00'

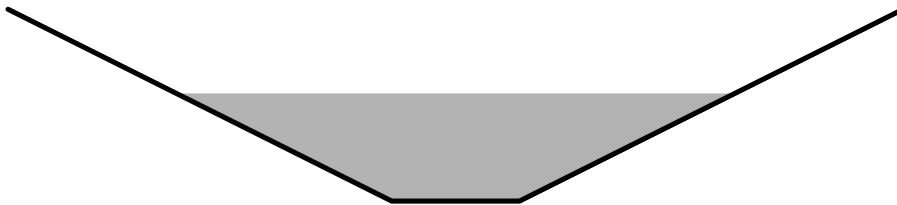


Summary for Reach 92a: Channel Along RR Tracks

Inflow Area = 9.707 ac, 4.57% Impervious, Inflow Depth = 2.70" for 10-YEAR event
Inflow = 23.78 cfs @ 12.19 hrs, Volume= 2.183 af
Outflow = 20.78 cfs @ 12.31 hrs, Volume= 2.183 af, Atten= 13%, Lag= 7.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 5.41 fps, Min. Travel Time= 3.7 min
Avg. Velocity = 1.02 fps, Avg. Travel Time= 19.9 min

Peak Storage= 4,685 cf @ 12.25 hrs
Average Depth at Peak Storage= 0.98'
Bank-Full Depth= 3.00', Capacity at Bank-Full= 243.54 cfs

2.00' x 3.00' deep channel, n= 0.035
Side Slope Z-value= 2.0 '/' Top Width= 14.00'
Length= 1,216.0' Slope= 0.0317 '/'
Inlet Invert= 1,887.00', Outlet Invert= 1,848.50'

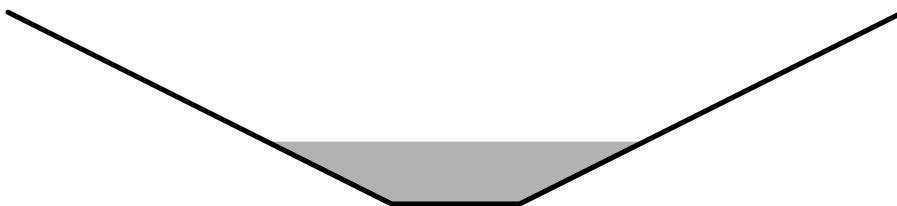

Summary for Reach 93R: Roadside Ditch

Inflow Area = 2.052 ac, 7.70% Impervious, Inflow Depth = 2.68" for 10-YEAR event
Inflow = 9.23 cfs @ 12.01 hrs, Volume= 0.459 af
Outflow = 8.37 cfs @ 12.07 hrs, Volume= 0.459 af, Atten= 9%, Lag= 3.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Max. Velocity= 2.11 fps, Min. Travel Time= 1.9 min
Avg. Velocity = 0.50 fps, Avg. Travel Time= 7.8 min

Peak Storage= 936 cf @ 12.04 hrs
Average Depth at Peak Storage= 0.99'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 19.90 cfs

2.00' x 1.50' deep channel, n= 0.033 Earth, grassed & winding
Side Slope Z-value= 2.0 '/ Top Width= 8.00'
Length= 236.0' Slope= 0.0042 '/
Inlet Invert= 1,895.00', Outlet Invert= 1,894.00'



Summary for Reach 142R: Overland Flow

Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 0.00 fps, Min. Travel Time= 0.0 min
Avg. Velocity = 0.00 fps, Avg. Travel Time= 0.0 min

Peak Storage= 0 cf @ 0.00 hrs
Average Depth at Peak Storage= 0.00'
Bank-Full Depth= 0.50', Capacity at Bank-Full= 209.00 cfs

40.00' x 0.50' deep channel, n= 0.030 Earth, grassed & winding
Side Slope Z-value= 60.0 '/ Top Width= 100.00'
Length= 280.0' Slope= 0.0589 '/
Inlet Invert= 1,960.00', Outlet Invert= 1,943.50'



‡

Summary for Reach 143R: Stone Lined Swale with ChkDams

Inflow Area = 48.885 ac, 26.48% Impervious, Inflow Depth > 2.42" for 10-YEAR event
Inflow = 11.87 cfs @ 12.07 hrs, Volume= 9.876 af
Outflow = 10.59 cfs @ 12.11 hrs, Volume= 9.875 af, Atten= 11%, Lag= 2.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 6.08 fps, Min. Travel Time= 0.9 min
Avg. Velocity = 2.06 fps, Avg. Travel Time= 2.7 min

Peak Storage= 629 cf @ 12.09 hrs
Average Depth at Peak Storage= 0.59'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 142.04 cfs

2.00' x 2.00' deep channel, n= 0.050 Mountain streams w/large boulders
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 335.0' Slope= 0.1403 '/'
Inlet Invert= 1,897.00', Outlet Invert= 1,850.00'



Summary for Reach I1: TRM SWALE

Inflow Area = 3.692 ac, 57.82% Impervious, Inflow Depth = 4.62" for 10-YEAR event
Inflow = 23.21 cfs @ 11.95 hrs, Volume= 1.420 af
Outflow = 22.98 cfs @ 11.97 hrs, Volume= 1.420 af, Atten= 1%, Lag= 1.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 4.09 fps, Min. Travel Time= 0.6 min
Avg. Velocity = 1.12 fps, Avg. Travel Time= 2.2 min

Peak Storage= 820 cf @ 11.96 hrs
Average Depth at Peak Storage= 1.25'
Bank-Full Depth= 1.50', Capacity at Bank-Full= 33.85 cfs

2.00' x 1.50' deep channel, n= 0.035 TRM
Side Slope Z-value= 2.0 '/' Top Width= 8.00'
Length= 145.0' Slope= 0.0138 '/'
Inlet Invert= 1,943.00', Outlet Invert= 1,941.00'



Summary for Reach I12: stone lined stream channel

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 3.56" for 10-YEAR event
Inflow = 84.95 cfs @ 11.93 hrs, Volume= 5.410 af
Outflow = 84.46 cfs @ 11.94 hrs, Volume= 5.410 af, Atten= 1%, Lag= 0.5 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 8.77 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 1.98 fps, Avg. Travel Time= 1.2 min

Peak Storage= 1,374 cf @ 11.93 hrs
Average Depth at Peak Storage= 1.70'
Bank-Full Depth= 2.25', Capacity at Bank-Full= 142.16 cfs

4.00' x 2.25' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 8.50'
Length= 142.0' Slope= 0.0493 '/'
Inlet Invert= 2,000.00', Outlet Invert= 1,993.00'




Summary for Reach I12a: stone lined stream channel

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 3.56" for 10-YEAR event
Inflow = 84.46 cfs @ 11.94 hrs, Volume= 5.410 af
Outflow = 84.00 cfs @ 11.94 hrs, Volume= 5.410 af, Atten= 1%, Lag= 0.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 11.41 fps, Min. Travel Time= 0.2 min
Avg. Velocity = 2.96 fps, Avg. Travel Time= 0.9 min

Peak Storage= 1,185 cf @ 11.94 hrs
Average Depth at Peak Storage= 1.90'
Bank-Full Depth= 2.50', Capacity at Bank-Full= 147.72 cfs

2.00' x 2.50' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.0 '/' Top Width= 7.00'
Length= 160.0' Slope= 0.0938 '/'
Inlet Invert= 1,991.00', Outlet Invert= 1,976.00'

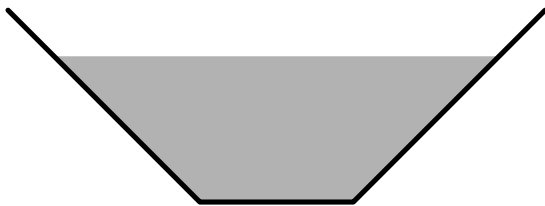

Summary for Reach I12b: stone lined stream channel

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 3.56" for 10-YEAR event
Inflow = 84.00 cfs @ 11.94 hrs, Volume= 5.410 af
Outflow = 82.54 cfs @ 11.97 hrs, Volume= 5.410 af, Atten= 2%, Lag= 1.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 9.87 fps, Min. Travel Time= 0.7 min
Avg. Velocity = 2.64 fps, Avg. Travel Time= 2.8 min

Peak Storage= 3,721 cf @ 11.95 hrs
Average Depth at Peak Storage= 1.62'
Bank-Full Depth= 2.00', Capacity at Bank-Full= 133.69 cfs

2.00' x 2.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 2.0 '/' Top Width= 10.00'
Length= 440.0' Slope= 0.0795 '/'
Inlet Invert= 1,975.00', Outlet Invert= 1,940.00'



Summary for Reach I21: stone lined stream channel

Inflow Area = 7.912 ac, 63.11% Impervious, Inflow Depth = 4.79" for 10-YEAR event
Inflow = 60.29 cfs @ 11.95 hrs, Volume= 3.159 af
Outflow = 55.44 cfs @ 12.02 hrs, Volume= 3.159 af, Atten= 8%, Lag= 4.4 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
Max. Velocity= 9.71 fps, Min. Travel Time= 2.7 min
Avg. Velocity = 2.44 fps, Avg. Travel Time= 10.8 min

Peak Storage= 9,183 cf @ 11.98 hrs
Average Depth at Peak Storage= 1.41'
Bank-Full Depth= 1.75', Capacity at Bank-Full= 88.29 cfs

2.00' x 1.75' deep channel, n= 0.040 Earth, cobble bottom, clean sides
Side Slope Z-value= 1.5 '/' Top Width= 7.25'
Length= 1,585.0' Slope= 0.0893 '/'
Inlet Invert= 2,170.05', Outlet Invert= 2,028.50'



Summary for Reach I5: Overland Flow

Inflow Area = 8.896 ac, 31.70% Impervious, Inflow Depth = 3.10" for 10-YEAR event
 Inflow = 19.76 cfs @ 12.20 hrs, Volume= 2.300 af
 Outflow = 19.72 cfs @ 12.22 hrs, Volume= 2.300 af, Atten= 0%, Lag= 1.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Max. Velocity= 1.33 fps, Min. Travel Time= 0.6 min
 Avg. Velocity = 0.22 fps, Avg. Travel Time= 3.4 min

Peak Storage= 669 cf @ 12.21 hrs
 Average Depth at Peak Storage= 0.13'
 Bank-Full Depth= 0.50', Capacity at Bank-Full= 215.99 cfs

100.00' x 0.50' deep channel, n= 0.120 Sheet flow over Short Grass
 Side Slope Z-value= 100.0 ' Top Width= 200.00'
 Length= 45.0' Slope= 0.2000 ' '
 Inlet Invert= 1,952.50', Outlet Invert= 1,943.50'



Summary for Pond 29P: cb29

Inflow Area = 0.582 ac, 15.87% Impervious, Inflow Depth = 3.58" for 10-YEAR event
 Inflow = 4.24 cfs @ 11.91 hrs, Volume= 0.174 af
 Outflow = 4.24 cfs @ 11.91 hrs, Volume= 0.174 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.24 cfs @ 11.91 hrs, Volume= 0.174 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,925.13' @ 11.91 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,924.00'	18.0" Round Culvert L= 30.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,924.00' / 1,923.75' S= 0.0083 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,928.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.23 cfs @ 11.91 hrs HW=1,925.12' (Free Discharge)

- 1=Culvert (Barrel Controls 4.23 cfs @ 4.14 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 57: 16" Steel Culverts

Inflow Area = 1.326 ac, 4.72% Impervious, Inflow Depth = 2.90" for 10-YEAR event
 Inflow = 4.30 cfs @ 12.13 hrs, Volume= 0.320 af
 Outflow = 4.30 cfs @ 12.13 hrs, Volume= 0.320 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.30 cfs @ 12.13 hrs, Volume= 0.320 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,005.32' @ 12.12 hrs
 Flood Elev= 2,008.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,004.00'	16.0" Round 16" Smooth Steel Culvert (old) L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,004.00' / 2,000.00' S= 0.0667 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,006.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=4.29 cfs @ 12.13 hrs HW=2,005.32' (Free Discharge)

- 1=16" Smooth Steel Culvert (old) (Inlet Controls 4.29 cfs @ 3.08 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,004.00' (Free Discharge)

- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 58R: 24" HDPE Pipe

Inflow Area = 3.000 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 10.31 cfs @ 12.09 hrs, Volume= 0.701 af
 Outflow = 10.31 cfs @ 12.09 hrs, Volume= 0.701 af, Atten= 0%, Lag= 0.0 min
 Primary = 10.31 cfs @ 12.09 hrs, Volume= 0.701 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,216.74' @ 12.09 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,215.00'	24.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,215.00' / 2,212.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,218.50'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=10.29 cfs @ 12.09 hrs HW=2,216.74' (Free Discharge)
 ↑1=Culvert (Inlet Controls 10.29 cfs @ 3.55 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,215.00' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 59: 32" Plastic Pipe

Inflow Area = 30.315 ac, 1.06% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 82.05 cfs @ 12.19 hrs, Volume= 7.087 af
 Outflow = 82.05 cfs @ 12.19 hrs, Volume= 7.087 af, Atten= 0%, Lag= 0.0 min
 Primary = 46.42 cfs @ 12.19 hrs, Volume= 6.253 af
 Secondary = 35.63 cfs @ 12.19 hrs, Volume= 0.834 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,333.11' @ 12.19 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,327.00'	32.0" Round 32" Plastic Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,327.00' / 2,324.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,331.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=46.38 cfs @ 12.19 hrs HW=2,333.11' (Free Discharge)

↑1=32" Plastic Culvert (Inlet Controls 46.38 cfs @ 8.30 fps)

Secondary OutFlow Max=35.39 cfs @ 12.19 hrs HW=2,333.11' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 35.39 cfs @ 4.20 fps)

Summary for Pond 60: (2) 16" Steel Culverts

Inflow Area = 123.689 ac, 1.65% Impervious, Inflow Depth = 2.86" for 10-YEAR event
 Inflow = 145.90 cfs @ 13.04 hrs, Volume= 29.526 af
 Outflow = 145.90 cfs @ 13.04 hrs, Volume= 29.526 af, Atten= 0%, Lag= 0.0 min
 Primary = 34.15 cfs @ 13.04 hrs, Volume= 17.944 af
 Secondary = 111.75 cfs @ 13.04 hrs, Volume= 11.582 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,025.12' @ 13.04 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,018.00'	16.0" Round Culvert X 2.00 L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 2,018.00' / 2,017.00' S= 0.0500 '/ n= 0.012 Cc= 0.900
#2	Secondary	2,022.50'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=34.14 cfs @ 13.04 hrs HW=2,025.12' (Free Discharge)

↑1=Culvert (Inlet Controls 34.14 cfs @ 12.23 fps)

Secondary OutFlow Max=111.64 cfs @ 13.04 hrs HW=2,025.12' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 111.64 cfs @ 4.27 fps)

Summary for Pond 67P: 26" Steel Culverts

Inflow Area = 4.195 ac, 7.35% Impervious, Inflow Depth = 2.99" for 10-YEAR event
 Inflow = 16.56 cfs @ 12.07 hrs, Volume= 1.046 af
 Outflow = 16.56 cfs @ 12.07 hrs, Volume= 1.046 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.56 cfs @ 12.07 hrs, Volume= 1.046 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,005.48' @ 12.07 hrs

Flood Elev= 2,008.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,003.00'	26.0" Round 26" Smooth Steel Culvert (old) L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,003.00' / 2,000.00' S= 0.0500 '/ n= 0.012 Cc= 0.900
#2	Secondary	2,006.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50

3.00

Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31
3.32

Primary OutFlow Max=16.46 cfs @ 12.07 hrs HW=2,005.46' (Free Discharge)
 ↑1=26" Smooth Steel Culvert (old) (Inlet Controls 16.46 cfs @ 4.46 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,003.00' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 74: 12" CMP Culvert

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 3.25" for 10-YEAR event
 Inflow = 19.92 cfs @ 11.96 hrs, Volume= 1.002 af
 Outflow = 19.92 cfs @ 11.96 hrs, Volume= 1.002 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.16 cfs @ 11.96 hrs, Volume= 0.795 af
 Secondary = 13.76 cfs @ 11.96 hrs, Volume= 0.207 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,918.64' @ 11.96 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,914.00'	12.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 1,914.00' / 1,911.76' S= 0.0560 '/ Cc= 0.900 n= 0.025
#2	Secondary	1,917.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=6.16 cfs @ 11.96 hrs HW=1,918.62' (Free Discharge)
 ↑1=Culvert (Barrel Controls 6.16 cfs @ 7.84 fps)

Secondary OutFlow Max=13.58 cfs @ 11.96 hrs HW=1,918.62' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Weir Controls 13.58 cfs @ 4.18 fps)

Summary for Pond 74A: 16" CMP Culvert

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 3.25" for 10-YEAR event
 Inflow = 20.04 cfs @ 11.96 hrs, Volume= 1.002 af
 Outflow = 20.04 cfs @ 11.96 hrs, Volume= 1.002 af, Atten= 0%, Lag= 0.0 min
 Primary = 11.39 cfs @ 11.96 hrs, Volume= 0.908 af
 Secondary = 8.65 cfs @ 11.96 hrs, Volume= 0.094 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,925.75' @ 11.96 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,921.50'	16.0" Round Culvert L= 35.0' Ke= 0.500 Inlet / Outlet Invert= 1,921.50' / 1,920.00' S= 0.0429 '/ Cc= 0.900

n= 0.025
 #2 Secondary 1,924.50' **2.0' long x 1.0' breadth Broad-Crested Rectangular Weir**
 Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50
 3.00
 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31
 3.32

Primary OutFlow Max=11.36 cfs @ 11.96 hrs HW=1,925.73' (Free Discharge)

↑1=Culvert (Barrel Controls 11.36 cfs @ 8.14 fps)

Secondary OutFlow Max=8.40 cfs @ 11.96 hrs HW=1,925.73' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 8.40 cfs @ 3.43 fps)

Summary for Pond 76A: culvert

Inflow Area = 3.704 ac, 13.44% Impervious, Inflow Depth = 3.25" for 10-YEAR event
 Inflow = 19.64 cfs @ 11.98 hrs, Volume= 1.002 af
 Outflow = 19.64 cfs @ 11.98 hrs, Volume= 1.002 af, Atten= 0%, Lag= 0.0 min
 Primary = 5.59 cfs @ 11.98 hrs, Volume= 0.780 af
 Secondary = 14.05 cfs @ 11.98 hrs, Volume= 0.222 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,905.66' @ 11.98 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,902.00'	12.0" Round Culvert L= 60.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,902.00' / 1,898.00' S= 0.0667 '/' Cc= 0.900 n= 0.025 Corrugated metal
#2	Secondary	1,904.00'	2.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=5.58 cfs @ 11.98 hrs HW=1,905.65' (Free Discharge)

↑1=Culvert (Barrel Controls 5.58 cfs @ 7.11 fps)

Secondary OutFlow Max=13.90 cfs @ 11.98 hrs HW=1,905.65' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 13.90 cfs @ 4.22 fps)

Summary for Pond 77: 32" Steel Culvert

Inflow Area = 88.881 ac, 1.70% Impervious, Inflow Depth = 2.85" for 10-YEAR event
 Inflow = 130.01 cfs @ 12.97 hrs, Volume= 21.133 af
 Outflow = 130.01 cfs @ 12.97 hrs, Volume= 21.133 af, Atten= 0%, Lag= 0.0 min
 Primary = 51.92 cfs @ 12.97 hrs, Volume= 16.640 af
 Secondary = 78.09 cfs @ 12.97 hrs, Volume= 4.493 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,185.06' @ 12.97 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,180.00'	32.0" Round Culvert L= 40.0' Ke= 0.500 Inlet / Outlet Invert= 2,180.00' / 2,179.00' S= 0.0250 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,183.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=51.90 cfs @ 12.97 hrs HW=2,185.06' (Free Discharge)

↳1=Culvert (Inlet Controls 51.90 cfs @ 9.29 fps)

Secondary OutFlow Max=77.95 cfs @ 12.97 hrs HW=2,185.06' (Free Discharge)

↳2=Broad-Crested Rectangular Weir (Weir Controls 77.95 cfs @ 3.79 fps)

Summary for Pond 79: 16" Steel Culvert

Inflow Area = 90.881 ac, 1.66% Impervious, Inflow Depth = 2.85" for 10-YEAR event
 Inflow = 130.41 cfs @ 13.01 hrs, Volume= 21.601 af
 Outflow = 130.41 cfs @ 13.01 hrs, Volume= 21.601 af, Atten= 0%, Lag= 0.0 min
 Primary = 19.54 cfs @ 13.01 hrs, Volume= 9.968 af
 Secondary = 110.87 cfs @ 13.01 hrs, Volume= 11.633 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,065.11' @ 13.01 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,056.00'	16.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 2,056.00' / 2,055.00' S= 0.0500 '/ Cc= 0.900 n= 0.012
#2	Secondary	2,057.50'	2.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=19.53 cfs @ 13.01 hrs HW=2,065.11' (Free Discharge)

↳1=Culvert (Inlet Controls 19.53 cfs @ 13.99 fps)

Secondary OutFlow Max=110.74 cfs @ 13.01 hrs HW=2,065.11' (Free Discharge)

↳2=Broad-Crested Rectangular Weir (Weir Controls 110.74 cfs @ 7.28 fps)

Summary for Pond 83: 24" HPDE Culvert

Inflow Area = 1.300 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 4.87 cfs @ 12.06 hrs, Volume= 0.304 af
 Outflow = 4.87 cfs @ 12.06 hrs, Volume= 0.304 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.87 cfs @ 12.06 hrs, Volume= 0.304 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,361.08' @ 12.06 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,360.00'	24.0" Round 24" Plastic Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,360.00' / 2,357.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,364.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=4.85 cfs @ 12.06 hrs HW=2,361.08' (Free Discharge)

↳1=**24" Plastic Culvert** (Inlet Controls 4.85 cfs @ 2.80 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,360.00' (Free Discharge)

↳2=**Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond 84: 24" HDPE Pipe

Inflow Area =	31.013 ac,	2.16% Impervious,	Inflow Depth = 3.22" for 10-YEAR event
Inflow =	106.20 cfs @ 12.23 hrs,	Volume=	8.325 af
Outflow =	106.20 cfs @ 12.23 hrs,	Volume=	8.325 af, Atten= 0%, Lag= 0.0 min
Primary =	64.69 cfs @ 12.23 hrs,	Volume=	7.434 af
Secondary =	41.51 cfs @ 12.23 hrs,	Volume=	0.891 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,322.30' @ 12.23 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,315.00'	36.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,315.00' / 2,312.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,320.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=64.65 cfs @ 12.23 hrs HW=2,322.29' (Free Discharge)

↳1=**Culvert** (Inlet Controls 64.65 cfs @ 9.15 fps)

Secondary OutFlow Max=41.22 cfs @ 12.23 hrs HW=2,322.29' (Free Discharge)

↳2=**Broad-Crested Rectangular Weir** (Weir Controls 41.22 cfs @ 4.50 fps)

Summary for Pond 85: 28" HDPE Pipe

Inflow Area = 4.281 ac, 0.54% Impervious, Inflow Depth = 5.30" for 10-YEAR event
 Inflow = 52.58 cfs @ 12.21 hrs, Volume= 1.892 af
 Outflow = 52.58 cfs @ 12.21 hrs, Volume= 1.892 af, Atten= 0%, Lag= 0.0 min
 Primary = 40.92 cfs @ 12.21 hrs, Volume= 1.765 af
 Secondary = 11.65 cfs @ 12.21 hrs, Volume= 0.127 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,301.06' @ 12.21 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,295.00'	30.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,295.00' / 2,292.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,300.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=40.89 cfs @ 12.21 hrs HW=2,301.05' (Free Discharge)
 ↑1=Culvert (Inlet Controls 40.89 cfs @ 8.33 fps)

Secondary OutFlow Max=11.52 cfs @ 12.21 hrs HW=2,301.05' (Free Discharge)
 ↑2=Broad-Crested Rectangular Weir (Weir Controls 11.52 cfs @ 2.74 fps)

Summary for Pond 86: 24" HDPE Pipe

Inflow Area = 4.340 ac, 0.76% Impervious, Inflow Depth = 3.16" for 10-YEAR event
 Inflow = 19.66 cfs @ 12.19 hrs, Volume= 1.142 af
 Outflow = 19.66 cfs @ 12.19 hrs, Volume= 1.142 af, Atten= 0%, Lag= 0.0 min
 Primary = 19.66 cfs @ 12.19 hrs, Volume= 1.142 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,243.71' @ 12.19 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,240.00'	24.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,240.00' / 2,237.00' S= 0.0500 '/ Cc= 0.900 n= 0.011
#2	Secondary	2,245.00'	4.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=19.41 cfs @ 12.19 hrs HW=2,243.64' (Free Discharge)

↑1=Culvert (Inlet Controls 19.41 cfs @ 6.18 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=2,240.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 87: 18" Steel Culvert

Inflow Area = 2.000 ac, 0.00% Impervious, Inflow Depth = 2.81" for 10-YEAR event
 Inflow = 7.10 cfs @ 12.08 hrs, Volume= 0.468 af
 Outflow = 7.10 cfs @ 12.08 hrs, Volume= 0.468 af, Atten= 0%, Lag= 0.0 min
 Primary = 7.10 cfs @ 12.08 hrs, Volume= 0.468 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,209.87' @ 12.08 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,208.00'	18.0" Round Culvert L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 2,208.00' / 2,207.00' S= 0.0167 '/ Cc= 0.900 n= 0.012

Primary OutFlow Max=7.05 cfs @ 12.08 hrs HW=2,209.85' (Free Discharge)

↑1=Culvert (Inlet Controls 7.05 cfs @ 3.99 fps)

Summary for Pond 90: 24" Steel Culvert

Inflow Area = 9.707 ac, 4.57% Impervious, Inflow Depth = 2.70" for 10-YEAR event
 Inflow = 27.22 cfs @ 12.09 hrs, Volume= 2.183 af
 Outflow = 27.22 cfs @ 12.09 hrs, Volume= 2.183 af, Atten= 0%, Lag= 0.0 min
 Primary = 27.22 cfs @ 12.09 hrs, Volume= 2.183 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,894.24' @ 12.09 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,890.00'	24.0" Round Culvert L= 25.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 1,890.00' / 1,889.50' S= 0.0200 '/ Cc= 0.900 n= 0.012
#2	Secondary	1,895.00'	10.0' long x 10.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64

Primary OutFlow Max=27.07 cfs @ 12.09 hrs HW=1,894.20' (Free Discharge)

↑1=Culvert (Inlet Controls 27.07 cfs @ 8.62 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,890.00' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 122: 18" HDPE Storm

Inflow Area = 0.477 ac, 83.18% Impervious, Inflow Depth = 5.30" for 10-YEAR event
 Inflow = 4.37 cfs @ 11.93 hrs, Volume= 0.210 af
 Outflow = 4.37 cfs @ 11.93 hrs, Volume= 0.210 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.37 cfs @ 11.93 hrs, Volume= 0.210 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,947.23' @ 11.93 hrs
 Flood Elev= 1,961.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,946.00'	18.0" Round Culvert L= 22.0' Ke= 0.500 Inlet / Outlet Invert= 1,946.00' / 1,945.89' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,949.33'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.25 cfs @ 11.93 hrs HW=1,947.21' (Free Discharge)

- 1=Culvert (Barrel Controls 4.25 cfs @ 3.79 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 123: 18" HDPE Storm

Inflow Area = 0.667 ac, 80.73% Impervious, Inflow Depth = 5.23" for 10-YEAR event
 Inflow = 6.02 cfs @ 11.92 hrs, Volume= 0.291 af
 Outflow = 6.02 cfs @ 11.92 hrs, Volume= 0.291 af, Atten= 0%, Lag= 0.0 min
 Primary = 6.02 cfs @ 11.92 hrs, Volume= 0.291 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,947.34' @ 11.92 hrs
 Flood Elev= 1,961.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,945.89'	18.0" Round Culvert L= 124.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,945.89' / 1,945.27' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,949.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=5.92 cfs @ 11.92 hrs HW=1,947.32' (Free Discharge)

- 1=Culvert (Barrel Controls 5.92 cfs @ 4.37 fps)
- 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond 140: culvert

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 3.56" for 10-YEAR event
 Inflow = 84.46 cfs @ 11.94 hrs, Volume= 5.410 af
 Outflow = 84.46 cfs @ 11.94 hrs, Volume= 5.410 af, Atten= 0%, Lag= 0.0 min
 Primary = 84.46 cfs @ 11.94 hrs, Volume= 5.410 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,995.58' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,991.50'	36.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 1,991.50' / 1,991.00' S= 0.0250 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,995.00'	25.0' long x 20.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=83.93 cfs @ 11.94 hrs HW=1,995.57' (Free Discharge)

- 1=Culvert (Inlet Controls 54.60 cfs @ 7.72 fps)
- 2=Broad-Crested Rectangular Weir (Weir Controls 29.33 cfs @ 2.05 fps)

Summary for Pond 141: culvert

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 3.56" for 10-YEAR event
 Inflow = 84.00 cfs @ 11.94 hrs, Volume= 5.410 af
 Outflow = 84.00 cfs @ 11.94 hrs, Volume= 5.410 af, Atten= 0%, Lag= 0.0 min
 Primary = 84.00 cfs @ 11.94 hrs, Volume= 5.410 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,980.51' @ 11.94 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,976.00'	36.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 1,976.00' / 1,975.00' S= 0.0500 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,980.00'	25.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=83.71 cfs @ 11.94 hrs HW=1,980.51' (Free Discharge)

- 1=Culvert (Inlet Controls 59.06 cfs @ 8.36 fps)
- 2=Broad-Crested Rectangular Weir (Weir Controls 24.65 cfs @ 1.93 fps)

Summary for Pond I18: Manhole

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 3.56" for 10-YEAR event
 Inflow = 84.95 cfs @ 11.93 hrs, Volume= 5.410 af
 Outflow = 84.95 cfs @ 11.93 hrs, Volume= 5.410 af, Atten= 0%, Lag= 0.0 min
 Primary = 84.95 cfs @ 11.93 hrs, Volume= 5.410 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,009.95' @ 11.93 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,006.00'	48.0" Round Culvert L= 304.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,006.00' / 2,000.00' S= 0.0197 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=84.03 cfs @ 11.93 hrs HW=2,009.91' (Free Discharge)

↳1=Culvert (Inlet Controls 84.03 cfs @ 6.73 fps)

Summary for Pond I19: Manhole

Inflow Area = 18.217 ac, 27.41% Impervious, Inflow Depth = 3.56" for 10-YEAR event
 Inflow = 84.95 cfs @ 11.93 hrs, Volume= 5.410 af
 Outflow = 84.95 cfs @ 11.93 hrs, Volume= 5.410 af, Atten= 0%, Lag= 0.0 min
 Primary = 84.95 cfs @ 11.93 hrs, Volume= 5.410 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,020.95' @ 11.93 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	2,017.00'	48.0" Round Culvert L= 348.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,017.00' / 2,006.00' S= 0.0316 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=84.03 cfs @ 11.93 hrs HW=2,020.91' (Free Discharge)

↳1=Culvert (Inlet Controls 84.03 cfs @ 6.73 fps)

Summary for Pond I2: 30" HDPE Storm

Inflow Area = 3.692 ac, 57.82% Impervious, Inflow Depth = 4.62" for 10-YEAR event
 Inflow = 23.21 cfs @ 11.95 hrs, Volume= 1.420 af
 Outflow = 23.21 cfs @ 11.95 hrs, Volume= 1.420 af, Atten= 0%, Lag= 0.0 min
 Primary = 23.21 cfs @ 11.95 hrs, Volume= 1.420 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,946.36' @ 11.95 hrs
 Flood Elev= 1,955.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,943.90'	30.0" Round Culvert L= 170.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,943.90' / 1,943.00' S= 0.0053 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=23.02 cfs @ 11.95 hrs HW=1,946.34' (Free Discharge)

↳1=Culvert (Barrel Controls 23.02 cfs @ 5.97 fps)

Summary for Pond I22: Manhole- 48" HDPE Storm

Inflow Area = 7.912 ac, 63.11% Impervious, Inflow Depth = 4.79" for 10-YEAR event
 Inflow = 60.29 cfs @ 11.95 hrs, Volume= 3.159 af
 Outflow = 60.29 cfs @ 11.95 hrs, Volume= 3.159 af, Atten= 0%, Lag= 0.0 min
 Primary = 60.29 cfs @ 11.95 hrs, Volume= 3.159 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,173.94' @ 11.95 hrs

Flood Elev= 2,182.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,170.15'	48.0" Round Culvert L= 49.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,170.15' / 2,170.05' S= 0.0020 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,182.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=59.45 cfs @ 11.95 hrs HW=2,173.91' (Free Discharge)

1=Culvert (Barrel Controls 59.45 cfs @ 6.29 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I23: Manhole -30" HDPE Storm

Inflow Area = 3.957 ac, 45.04% Impervious, Inflow Depth = 4.33" for 10-YEAR event
 Inflow = 27.81 cfs @ 11.94 hrs, Volume= 1.426 af
 Outflow = 27.81 cfs @ 11.94 hrs, Volume= 1.426 af, Atten= 0%, Lag= 0.0 min
 Primary = 27.81 cfs @ 11.94 hrs, Volume= 1.426 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,186.35' @ 11.94 hrs

Flood Elev= 2,189.20'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,183.72'	30.0" Round Culvert L= 171.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,183.72' / 2,176.64' S= 0.0414 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,189.19'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=27.60 cfs @ 11.94 hrs HW=2,186.33' (Free Discharge)

1=Culvert (Inlet Controls 27.60 cfs @ 5.62 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I24: 30" HDPE Storm

Inflow Area = 3.957 ac, 45.04% Impervious, Inflow Depth = 4.33" for 10-YEAR event
 Inflow = 27.81 cfs @ 11.94 hrs, Volume= 1.426 af
 Outflow = 27.81 cfs @ 11.94 hrs, Volume= 1.426 af, Atten= 0%, Lag= 0.0 min
 Primary = 27.81 cfs @ 11.94 hrs, Volume= 1.426 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,191.66' @ 11.94 hrs

Flood Elev= 2,194.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,189.03'	30.0" Round Culvert L= 63.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,189.03' / 2,183.82' S= 0.0827 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,194.48'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=27.60 cfs @ 11.94 hrs HW=2,191.64' (Free Discharge)

1=Culvert (Inlet Controls 27.60 cfs @ 5.62 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I25: 30" HDPE Storm

Inflow Area = 3.059 ac, 51.35% Impervious, Inflow Depth = 4.49" for 10-YEAR event
 Inflow = 22.03 cfs @ 11.94 hrs, Volume= 1.143 af
 Outflow = 22.03 cfs @ 11.94 hrs, Volume= 1.143 af, Atten= 0%, Lag= 0.0 min
 Primary = 22.03 cfs @ 11.94 hrs, Volume= 1.143 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,193.62' @ 11.94 hrs

Flood Elev= 2,205.80'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,191.50'	30.0" Round Culvert L= 253.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,191.50' / 2,189.13' S= 0.0094 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,205.80'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=21.99 cfs @ 11.94 hrs HW=2,193.62' (Free Discharge)

1=Culvert (Inlet Controls 21.99 cfs @ 4.96 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I26: 30" HDPE Storm

Inflow Area = 2.407 ac, 48.55% Impervious, Inflow Depth = 4.42" for 10-YEAR event
 Inflow = 18.58 cfs @ 11.93 hrs, Volume= 0.886 af
 Outflow = 18.58 cfs @ 11.93 hrs, Volume= 0.886 af, Atten= 0%, Lag= 0.0 min
 Primary = 18.58 cfs @ 11.93 hrs, Volume= 0.886 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,194.49' @ 11.93 hrs

Flood Elev= 2,208.54'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,191.80'	30.0" Round Culvert L= 201.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,191.80' / 2,191.60' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,195.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=18.32 cfs @ 11.93 hrs HW=2,194.46' (Free Discharge)

1=Culvert (Barrel Controls 18.32 cfs @ 4.36 fps)

2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I27: 30" HDPE Storm

Inflow Area = 2.129 ac, 53.13% Impervious, Inflow Depth = 4.54" for 10-YEAR event
 Inflow = 16.70 cfs @ 11.93 hrs, Volume= 0.805 af
 Outflow = 16.70 cfs @ 11.93 hrs, Volume= 0.805 af, Atten= 0%, Lag= 0.0 min
 Primary = 16.70 cfs @ 11.93 hrs, Volume= 0.805 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,194.37' @ 11.93 hrs
 Flood Elev= 2,208.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,192.00'	30.0" Round Culvert L= 98.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,192.00' / 2,191.90' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,208.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=16.45 cfs @ 11.93 hrs HW=2,194.34' (Free Discharge)
 1=Culvert (Barrel Controls 16.45 cfs @ 4.46 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I28: 30" HDPE Storm

Inflow Area = 1.459 ac, 77.51% Impervious, Inflow Depth = 5.16" for 10-YEAR event
 Inflow = 12.46 cfs @ 11.94 hrs, Volume= 0.628 af
 Outflow = 12.46 cfs @ 11.94 hrs, Volume= 0.628 af, Atten= 0%, Lag= 0.0 min
 Primary = 12.46 cfs @ 11.94 hrs, Volume= 0.628 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,194.40' @ 11.94 hrs
 Flood Elev= 2,195.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,192.30'	30.0" Round Culvert L= 236.0' Ke= 0.500 Inlet / Outlet Invert= 2,192.30' / 2,192.07' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,197.80'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=12.32 cfs @ 11.94 hrs HW=2,194.39' (Free Discharge)
 1=Culvert (Barrel Controls 12.32 cfs @ 3.80 fps)
 2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I29: Manhole

Inflow Area = 1.039 ac, 100.00% Impervious, Inflow Depth = 5.76" for 10-YEAR event
 Inflow = 9.65 cfs @ 11.93 hrs, Volume= 0.499 af
 Outflow = 9.65 cfs @ 11.93 hrs, Volume= 0.499 af, Atten= 0%, Lag= 0.0 min
 Primary = 9.65 cfs @ 11.93 hrs, Volume= 0.499 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,194.22' @ 11.93 hrs

Flood Elev= 2,208.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,192.50'	30.0" Round Culvert L= 98.0' Ke= 0.500 Inlet / Outlet Invert= 2,192.50' / 2,192.40' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=9.47 cfs @ 11.93 hrs HW=2,194.20' (Free Discharge)

↳1=Culvert (Barrel Controls 9.47 cfs @ 3.76 fps)

Summary for Pond I3: 30" HDPE Storm

Inflow Area = 3.323 ac, 53.14% Impervious, Inflow Depth = 4.49" for 10-YEAR event
 Inflow = 21.25 cfs @ 11.97 hrs, Volume= 1.243 af
 Outflow = 21.25 cfs @ 11.97 hrs, Volume= 1.243 af, Atten= 0%, Lag= 0.0 min
 Primary = 21.25 cfs @ 11.97 hrs, Volume= 1.243 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 1,947.47' @ 11.97 hrs

Flood Elev= 1,949.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	1,945.17'	30.0" Round Culvert L= 231.0' Ke= 0.500 Inlet / Outlet Invert= 1,945.17' / 1,944.02' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,949.50'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=21.24 cfs @ 11.97 hrs HW=1,947.47' (Free Discharge)

↳1=Culvert (Barrel Controls 21.24 cfs @ 5.88 fps)

↳2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I30: 30" HDPE Storm

Inflow Area = 1.039 ac, 100.00% Impervious, Inflow Depth = 5.76" for 10-YEAR event
 Inflow = 9.65 cfs @ 11.93 hrs, Volume= 0.499 af
 Outflow = 9.65 cfs @ 11.93 hrs, Volume= 0.499 af, Atten= 0%, Lag= 0.0 min
 Primary = 9.65 cfs @ 11.93 hrs, Volume= 0.499 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Peak Elev= 2,195.78' @ 11.93 hrs

Flood Elev= 2,204.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,194.08'	30.0" Round Culvert L= 79.0' Ke= 0.500 Inlet / Outlet Invert= 2,194.08' / 2,194.00' S= 0.0010 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,199.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=9.47 cfs @ 11.93 hrs HW=2,195.76' (Free Discharge)

- └1=Culvert (Barrel Controls 9.47 cfs @ 3.81 fps)
- └2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I31: 30" HDPE Storm

Inflow Area = 1.141 ac, 34.78% Impervious, Inflow Depth = 4.01" for 10-YEAR event
 Inflow = 8.10 cfs @ 11.95 hrs, Volume= 0.381 af
 Outflow = 8.10 cfs @ 11.95 hrs, Volume= 0.381 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.10 cfs @ 11.95 hrs, Volume= 0.381 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,171.94' @ 11.95 hrs
 Flood Elev= 2,180.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,170.50'	30.0" Round Culvert L= 55.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,170.50' / 2,170.35' S= 0.0027 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=7.97 cfs @ 11.95 hrs HW=2,171.93' (Free Discharge)

- └1=Culvert (Barrel Controls 7.97 cfs @ 3.96 fps)

Summary for Pond I32: 30" HDPE Storm

Inflow Area = 1.141 ac, 34.78% Impervious, Inflow Depth = 4.01" for 10-YEAR event
 Inflow = 8.10 cfs @ 11.95 hrs, Volume= 0.381 af
 Outflow = 8.10 cfs @ 11.95 hrs, Volume= 0.381 af, Atten= 0%, Lag= 0.0 min
 Primary = 8.10 cfs @ 11.95 hrs, Volume= 0.381 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,172.33' @ 11.95 hrs
 Flood Elev= 2,180.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,170.85'	30.0" Round Culvert L= 119.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,170.85' / 2,170.60' S= 0.0021 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,180.00'	24.0" W x 24.0" H Vert. Orifice/Grate C= 0.600

Primary OutFlow Max=7.97 cfs @ 11.95 hrs HW=2,172.32' (Free Discharge)

- └1=Culvert (Barrel Controls 7.97 cfs @ 3.82 fps)
- └2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I33: 24" HDPE Storm

Inflow Area = 0.677 ac, 30.81% Impervious, Inflow Depth = 3.88" for 10-YEAR event
 Inflow = 4.65 cfs @ 11.96 hrs, Volume= 0.219 af
 Outflow = 4.65 cfs @ 11.96 hrs, Volume= 0.219 af, Atten= 0%, Lag= 0.0 min
 Primary = 4.65 cfs @ 11.96 hrs, Volume= 0.219 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 2,172.52' @ 11.96 hrs
 Flood Elev= 2,175.80'

Device	Routing	Invert	Outlet Devices
#1	Primary	2,171.30'	24.0" Round Culvert L= 175.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2,171.30' / 2,170.95' S= 0.0020 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	2,175.80'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=4.58 cfs @ 11.96 hrs HW=2,172.51' (Free Discharge)
 ↑1=Culvert (Barrel Controls 4.58 cfs @ 3.30 fps)
 ↓2=Orifice/Grate (Controls 0.00 cfs)

Summary for Pond I4: 15" HDPE Storm

Inflow Area = 0.369 ac, 100.00% Impervious, Inflow Depth = 5.76" for 10-YEAR event
 Inflow = 3.62 cfs @ 11.90 hrs, Volume= 0.177 af
 Outflow = 3.62 cfs @ 11.90 hrs, Volume= 0.177 af, Atten= 0%, Lag= 0.0 min
 Primary = 3.62 cfs @ 11.90 hrs, Volume= 0.177 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,952.51' @ 11.90 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	1,951.50'	15.0" Round Culvert L= 140.0' Ke= 0.500 Inlet / Outlet Invert= 1,951.50' / 1,950.00' S= 0.0107 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=3.50 cfs @ 11.90 hrs HW=1,952.48' (Free Discharge)
 ↑1=Culvert (Inlet Controls 3.50 cfs @ 3.38 fps)

Summary for Pond I6: Manhole

Inflow Area = 8.896 ac, 31.70% Impervious, Inflow Depth = 3.10" for 10-YEAR event
 Inflow = 19.76 cfs @ 12.20 hrs, Volume= 2.300 af
 Outflow = 19.76 cfs @ 12.20 hrs, Volume= 2.300 af, Atten= 0%, Lag= 0.0 min
 Primary = 19.76 cfs @ 12.20 hrs, Volume= 2.300 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,954.70' @ 12.20 hrs

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 19

Device	Routing	Invert	Outlet Devices
#1	Primary	1,952.50'	36.0" Round Culvert L= 186.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,952.50' / 1,952.00' S= 0.0027 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior

Primary OutFlow Max=19.73 cfs @ 12.20 hrs HW=1,954.70' (Free Discharge)

↑1=Culvert (Barrel Controls 19.73 cfs @ 4.96 fps)

Pond Summaries
1, 10 & 100-yr Storm Events

Summary for Pond 6P: Overflow Basin @ 8 tee

Inflow = 0.28 cfs @ 13.50 hrs, Volume= 0.029 af
 Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 100%, Lag= 0.0 min
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,961.36' @ 16.05 hrs Surf.Area= 3,823 sf Storage= 1,251 cf

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
 Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Storage Description
#1	1,961.00'	25,500 cf	surface storage (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,961.00	3,100	0	0
1,962.00	5,100	4,100	4,100
1,963.00	6,100	5,600	9,700
1,964.00	8,250	7,175	16,875
1,965.00	9,000	8,625	25,500

Device	Routing	Invert	Outlet Devices
#1	Primary	1,962.50'	36.0" Round Culvert L= 145.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,962.50' / 1,958.00' S= 0.0310 1/4' Cc= 0.900 n= 0.010 PVC, smooth interior

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,961.00' (Free Discharge)
 ↑1=Culvert (Controls 0.00 cfs)

Summary for Pond A1: A1 - OPEN SWALE

Inflow Area = 1.159 ac, 7.80% Impervious, Inflow Depth = 0.69" for 1-YEAR event
 Inflow = 1.12 cfs @ 12.04 hrs, Volume= 0.067 af
 Outflow = 0.03 cfs @ 17.21 hrs, Volume= 0.063 af, Atten= 97%, Lag= 310.4 min
 Primary = 0.03 cfs @ 17.21 hrs, Volume= 0.063 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,909.33' @ 17.21 hrs Surf.Area= 1,975 sf Storage= 1,653 cf

Plug-Flow detention time= 573.1 min calculated for 0.063 af (94% of inflow)
 Center-of-Mass det. time= 540.6 min (1,420.3 - 879.6)

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 2

Volume	Invert	Avail.Storage	Storage Description
#1	1,904.50'	186 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 464 cf Overall x 40.0% Voids
#2	1,905.50'	139 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 928 cf Overall x 15.0% Voids
#3	1,907.50'	2,803 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,128 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,904.50	464	0	0
1,905.50	464	464	464

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,905.50	464	0	0
1,907.50	464	928	928

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,907.50	464	0	0
1,908.00	567	258	258
1,910.00	1,291	1,858	2,116
1,910.50	1,457	687	2,803

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,904.50'	1.000 in/hr Exfiltration over Surface area above 1,904.50' Excluded Surface area = 464 sf
#2	Primary	1,904.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,910.00'	15.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.03 cfs @ 17.21 hrs HW=1,909.33' (Free Discharge)

2=Orifice/Grate (Passes 0.03 cfs of 2.02 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.03 cfs)

3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond A2: A2 - OPEN SWALE

Inflow Area = 1.621 ac, 6.50% Impervious, Inflow Depth = 0.60" for 1-YEAR event
 Inflow = 0.31 cfs @ 12.05 hrs, Volume= 0.082 af
 Outflow = 0.04 cfs @ 19.27 hrs, Volume= 0.079 af, Atten= 86%, Lag= 433.6 min
 Primary = 0.04 cfs @ 19.27 hrs, Volume= 0.079 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,907.00' @ 19.27 hrs Surf.Area= 1,427 sf Storage= 1,019 cf

Plug-Flow detention time= 491.8 min calculated for 0.079 af (96% of inflow)

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 3

Center-of-Mass det. time= 455.6 min (1,756.2 - 1,300.6)

Volume	Invert	Avail.Storage	Storage Description
#1	1,902.50'	134 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 336 cf Overall x 40.0% Voids
#2	1,903.50'	101 cf	FILTER BED (Prismatic) Listed below (Recalc) 672 cf Overall x 15.0% Voids
#3	1,905.50'	2,316 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		2,551 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,902.50	336	0	0
1,903.50	336	336	336

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,903.50	336	0	0
1,905.50	336	672	672

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,905.50	336	0	0
1,906.00	428	191	191
1,908.00	1,080	1,508	1,699
1,908.50	1,386	617	2,316

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,902.50'	1.000 in/hr Exfiltration over Surface area above 1,902.50' Excluded Surface area = 336 sf
#2	Primary	1,902.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,907.00'	15.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.03 cfs @ 19.27 hrs HW=1,907.00' (Free Discharge)

2=Orifice/Grate (Passes 0.03 cfs of 1.95 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.03 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 0.00 cfs @ 0.12 fps)

Summary for Pond A3: A3 - OPEN SWALE

Inflow Area = 2.379 ac, 6.95% Impervious, Inflow Depth = 0.54" for 1-YEAR event
 Inflow = 0.41 cfs @ 12.05 hrs, Volume= 0.107 af
 Outflow = 0.03 cfs @ 24.50 hrs, Volume= 0.103 af, Atten= 92%, Lag= 747.2 min
 Primary = 0.03 cfs @ 24.50 hrs, Volume= 0.103 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 4

Peak Elev= 1,904.86' @ 24.50 hrs Surf.Area= 1,930 sf Storage= 1,296 cf

Plug-Flow detention time= 511.9 min calculated for 0.103 af (96% of inflow)

Center-of-Mass det. time= 451.8 min (1,981.7 - 1,529.9)

Volume	Invert	Avail.Storage	Storage Description
#1	1,900.50'	206 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 514 cf Overall x 40.0% Voids
#2	1,901.50'	154 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 1,028 cf Overall x 15.0% Voids
#3	1,903.50'	2,895 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,255 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,900.50	514	0	0
1,901.50	514	514	514

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,901.50	514	0	0
1,903.50	514	1,028	1,028

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,903.50	514	0	0
1,904.00	613	282	282
1,906.00	1,283	1,896	2,178
1,906.50	1,585	717	2,895

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,900.50'	1.000 in/hr Exfiltration over Surface area above 1,900.50' Excluded Surface area = 514 sf
#2	Primary	1,900.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,905.50'	20.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.03 cfs @ 24.50 hrs HW=1,904.86' (Free Discharge)

- 2=Orifice/Grate (Passes 0.03 cfs of 1.92 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.03 cfs)
- 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond A4: A4 - OPEN SWALE

Inflow Area = 2.923 ac, 6.68% Impervious, Inflow Depth = 0.50" for 1-YEAR event
 Inflow = 0.26 cfs @ 12.05 hrs, Volume= 0.122 af
 Outflow = 0.03 cfs @ 34.55 hrs, Volume= 0.119 af, Atten= 88%, Lag= 1,349.9 min
 Primary = 0.03 cfs @ 34.55 hrs, Volume= 0.119 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,903.50' @ 34.55 hrs Surf.Area= 1,504 sf Storage= 1,365 cf

Plug-Flow detention time= 678.2 min calculated for 0.119 af (98% of inflow)
 Center-of-Mass det. time= 640.4 min (2,455.5 - 1,815.1)

Volume	Invert	Avail.Storage	Storage Description
#1	1,898.50'	137 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 343 cf Overall x 40.0% Voids
#2	1,899.50'	103 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 686 cf Overall x 15.0% Voids
#3	1,901.50'	2,105 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		2,345 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,898.50	343	0	0
1,899.50	343	343	343

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.50	343	0	0
1,901.50	343	686	686

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,901.50	343	0	0
1,902.00	425	192	192
1,904.00	949	1,374	1,566
1,904.50	1,207	539	2,105

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,898.50'	1.000 in/hr Exfiltration over Surface area above 1,898.50' Excluded Surface area = 343 sf
#2	Primary	1,898.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,903.50'	20.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.03 cfs @ 34.55 hrs HW=1,903.50' (Free Discharge)

2=Orifice/Grate (Passes 0.03 cfs of 2.06 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.03 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 0.00 cfs @ 0.05 fps)

Summary for Pond A5: A5 - OPEN SWALE

Inflow Area = 4.411 ac, 6.47% Impervious, Inflow Depth = 0.51" for 1-YEAR event
 Inflow = 1.11 cfs @ 12.04 hrs, Volume= 0.189 af
 Outflow = 0.04 cfs @ 24.12 hrs, Volume= 0.186 af, Atten= 96%, Lag= 724.5 min
 Primary = 0.04 cfs @ 24.12 hrs, Volume= 0.186 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,901.83' @ 24.12 hrs Surf.Area= 2,138 sf Storage= 2,295 cf

Plug-Flow detention time= 715.4 min calculated for 0.186 af (98% of inflow)
 Center-of-Mass det. time= 676.7 min (2,551.5 - 1,874.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,896.50'	138 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 346 cf Overall x 40.0% Voids
#2	1,897.50'	104 cf	FILTER BED (Prismatic) Listed below (Recalc) 692 cf Overall x 15.0% Voids
#3	1,899.50'	3,125 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,367 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,896.50	346	0	0
1,897.50	346	346	346

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,897.50	346	0	0
1,899.50	346	692	692

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.50	346	0	0
1,900.00	550	224	224
1,902.00	1,528	2,078	2,302
1,902.50	1,764	823	3,125

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,896.50'	1.000 in/hr Exfiltration over Surface area above 1,896.50' Excluded Surface area = 346 sf
#2	Primary	1,896.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,902.00'	50.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50

3.00 3.50

Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07

3.20 3.32

Primary OutFlow Max=0.04 cfs @ 24.12 hrs HW=1,901.83' (Free Discharge)

↳ **2=Orifice/Grate** (Passes 0.04 cfs of 2.13 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.04 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,896.50' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond B: OPEN SWALE

Inflow Area = 3.361 ac, 5.72% Impervious, Inflow Depth = 0.57" for 1-YEAR event
 Inflow = 2.31 cfs @ 12.06 hrs, Volume= 0.158 af
 Outflow = 0.10 cfs @ 16.01 hrs, Volume= 0.145 af, Atten= 96%, Lag= 236.9 min
 Primary = 0.10 cfs @ 16.01 hrs, Volume= 0.145 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,867.10' @ 16.01 hrs Surf.Area= 5,940 sf Storage= 3,465 cf

Plug-Flow detention time= 419.0 min calculated for 0.145 af (91% of inflow)
 Center-of-Mass det. time= 375.2 min (1,269.3 - 894.1)

Volume	Invert	Avail.Storage	Storage Description
#1	1,863.00'	595 cf	stone underdrain (Prismatic) Listed below (Recalc) 1,488 cf Overall x 40.0% Voids
#2	1,864.00'	446 cf	filter media (Prismatic) Listed below (Recalc) 2,976 cf Overall x 15.0% Voids
#3	1,866.00'	8,167 cf	surface storage (Prismatic) Listed below (Recalc)
		9,209 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,863.00	1,488	0	0
1,864.00	1,488	1,488	1,488

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,864.00	1,488	0	0
1,866.00	1,488	2,976	2,976

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,866.00	1,488	0	0
1,867.00	2,798	2,143	2,143
1,868.00	4,500	3,649	5,792
1,868.50	5,000	2,375	8,167

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,863.00'	1.000 in/hr Exfiltration over Surface area above 1,863.00' Excluded Surface area = 1,488 sf
#2	Primary	1,863.00'	6.0" Vert. culvert C= 0.600
#3	Primary	1,868.00'	30.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=0.10 cfs @ 16.01 hrs HW=1,867.10' (Free Discharge)

- 2=culvert (Passes 0.10 cfs of 1.85 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.10 cfs)
- 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond B1: bioretention @ 8 tee

Inflow Area =	10.459 ac,	5.58% Impervious,	Inflow Depth = 0.49"	for 1-YEAR event
Inflow =	3.84 cfs @	12.22 hrs,	Volume=	0.426 af
Outflow =	0.60 cfs @	13.50 hrs,	Volume=	0.426 af, Atten= 84%, Lag= 77.2 min
Primary =	0.33 cfs @	13.50 hrs,	Volume=	0.397 af
Secondary =	0.28 cfs @	13.50 hrs,	Volume=	0.029 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Peak Elev= 1,965.55' @ 13.50 hrs Surf.Area= 14,102 sf Storage= 7,126 cf

Plug-Flow detention time= 274.7 min calculated for 0.426 af (100% of inflow)
Center-of-Mass det. time= 274.8 min (1,188.9 - 914.1)

Volume	Invert	Avail.Storage	Storage Description
#1	1,960.00'	1,800 cf	stone underdrain (Prismatic) Listed below (Recalc) 4,500 cf Overall x 40.0% Voids
#2	1,961.00'	2,700 cf	filter media (Prismatic) Listed below (Recalc) 18,000 cf Overall x 15.0% Voids
#3	1,965.00'	12,150 cf	surface storage (Prismatic) Listed below (Recalc)
		16,650 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,960.00	4,500	0	0
1,961.00	4,500	4,500	4,500

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,961.00	4,500	0	0
1,965.00	4,500	18,000	18,000

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 9

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,965.00	4,500	0	0
1,966.00	5,600	5,050	5,050
1,967.00	8,600	7,100	12,150

Device	Routing	Invert	Outlet Devices
#1	Primary	1,960.00'	12.0" Round Culvert L= 100.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,960.00' / 1,958.00' S= 0.0200 1/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	1,960.00'	1.000 in/hr Exfiltration over Surface area
#3	Secondary	1,965.50'	10.0' long x 4.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

Primary OutFlow Max=0.33 cfs @ 13.50 hrs HW=1,965.55' (Free Discharge)

↑1=Culvert (Passes 0.33 cfs of 8.50 cfs potential flow)

↑2=Exfiltration (Exfiltration Controls 0.33 cfs)

Secondary OutFlow Max=0.24 cfs @ 13.50 hrs HW=1,965.55' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Weir Controls 0.24 cfs @ 0.52 fps)

Summary for Pond B3: bioretention @ blvd

Inflow Area =	5.445 ac, 51.78% Impervious, Inflow Depth = 1.49" for 1-YEAR event
Inflow =	10.09 cfs @ 12.09 hrs, Volume= 0.677 af
Outflow =	0.82 cfs @ 13.10 hrs, Volume= 0.677 af, Atten= 92%, Lag= 61.0 min
Primary =	0.82 cfs @ 13.10 hrs, Volume= 0.677 af
Secondary =	0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

Peak Elev= 1,959.25' @ 13.10 hrs Surf.Area= 35,540 sf Storage= 14,769 cf

Plug-Flow detention time= 245.2 min calculated for 0.677 af (100% of inflow)

Center-of-Mass det. time= 245.6 min (1,080.4 - 834.9)

Volume	Invert	Avail.Storage	Storage Description
#1	1,954.00'	4,700 cf	stone underdrain (Prismatic) Listed below (Recalc) 11,750 cf Overall x 40.0% Voids
#2	1,955.00'	7,050 cf	filter media (Prismatic) Listed below (Recalc) 47,000 cf Overall x 15.0% Voids
#3	1,959.00'	26,092 cf	surface storage (Prismatic) Listed below (Recalc)
		37,842 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,954.00	11,750	0	0
1,955.00	11,750	11,750	11,750

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 10

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,955.00	11,750	0	0
1,959.00	11,750	47,000	47,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,959.00	11,750	0	0
1,960.00	12,892	12,321	12,321
1,961.00	14,650	13,771	26,092

Device	Routing	Invert	Outlet Devices
#1	Primary	1,954.00'	21.0" Round Culvert L= 85.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,954.00' / 1,953.00' S= 0.0118 '/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	1,954.00'	1.000 in/hr Exfiltration over Surface area
#3	Device 1	1,959.50'	12.0" Horiz. Orifice/Grate X 6.00 C= 0.600 Limited to weir flow at low heads
#4	Secondary	1,960.50'	25.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=0.82 cfs @ 13.10 hrs HW=1,959.25' (Free Discharge)

- ↑ 1=Culvert (Passes 0.82 cfs of 24.23 cfs potential flow)
- ↑ 2=Exfiltration (Exfiltration Controls 0.82 cfs)
- ↑ 3=Orifice/Grate (Controls 0.00 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,954.00' (Free Discharge)

- ↑ 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond F1: Open Swale-F

Inflow Area = 2.052 ac, 7.70% Impervious, Inflow Depth = 0.57" for 1-YEAR event
 Inflow = 1.75 cfs @ 12.01 hrs, Volume= 0.097 af
 Outflow = 0.06 cfs @ 15.87 hrs, Volume= 0.090 af, Atten= 96%, Lag= 231.6 min
 Primary = 0.06 cfs @ 15.87 hrs, Volume= 0.090 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,894.55' @ 15.87 hrs Surf.Area= 3,561 sf Storage= 2,092 cf

Plug-Flow detention time= 406.9 min calculated for 0.090 af (93% of inflow)
 Center-of-Mass det. time= 369.4 min (1,259.2 - 889.8)

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 11

Volume	Invert	Avail.Storage	Storage Description
#1	1,890.50'	317 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 792 cf Overall x 40.0% Voids
#2	1,891.50'	238 cf	Filter Bed (Prismatic) Listed below 1,584 cf Overall x 15.0% Voids
#3	1,893.50'	6,962 cf	surface storage (Prismatic) Listed below (Recalc)
		7,516 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,890.50	792	0	0
1,891.50	792	792	792

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,891.50	792	0	0
1,893.50	792	1,584	1,584

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,893.50	792	0	0
1,894.00	1,526	580	580
1,896.00	3,175	4,701	5,281
1,896.50	3,550	1,681	6,962

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,890.50'	1.000 in/hr Exfiltration over Surface area above 1,890.50' Excluded Surface area = 792 sf
#2	Primary	1,890.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,895.50'	75.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.06 cfs @ 15.87 hrs HW=1,894.55' (Free Discharge)

↑2=**Orifice/Grate** (Passes 0.06 cfs of 1.84 cfs potential flow)

↑1=**Exfiltration** (Exfiltration Controls 0.06 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,890.50' (Free Discharge)

↑3=**Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond FIP: FOREBAY

Inflow Area = 18.401 ac, 27.13% Impervious, Inflow Depth = 1.12" for 1-YEAR event
 Inflow = 22.35 cfs @ 12.08 hrs, Volume= 1.712 af
 Outflow = 22.24 cfs @ 12.09 hrs, Volume= 1.483 af, Atten= 0%, Lag= 0.2 min
 Primary = 22.24 cfs @ 12.09 hrs, Volume= 1.483 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 12

Peak Elev= 1,940.73' @ 12.09 hrs Surf.Area= 5,006 sf Storage= 11,077 cf

Plug-Flow detention time= 106.4 min calculated for 1.483 af (87% of inflow)
 Center-of-Mass det. time= 39.0 min (863.0 - 824.1)

Volume	Invert	Avail.Storage	Storage Description
#1	1,937.50'	15,249 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,937.50	1,937	0	0
1,938.00	2,369	1,077	1,077
1,940.00	4,256	6,625	7,702
1,940.50	4,764	2,255	9,957
1,941.50	5,821	5,293	15,249

Device	Routing	Invert	Outlet Devices
#1	Primary	1,940.50'	75.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=22.16 cfs @ 12.09 hrs HW=1,940.73' (Free Discharge)
 ↑1=**Broad-Crested Rectangular Weir** (Weir Controls 22.16 cfs @ 1.29 fps)

Summary for Pond G: OPEN SWALE

Inflow Area = 3.700 ac, 7.39% Impervious, Inflow Depth = 0.45" for 1-YEAR event
 Inflow = 2.15 cfs @ 12.03 hrs, Volume= 0.140 af
 Outflow = 0.20 cfs @ 13.26 hrs, Volume= 0.139 af, Atten= 91%, Lag= 73.8 min
 Primary = 0.20 cfs @ 13.26 hrs, Volume= 0.139 af
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,902.03' @ 13.26 hrs Surf.Area= 8,644 sf Storage= 2,080 cf

Plug-Flow detention time= 202.0 min calculated for 0.139 af (100% of inflow)
 Center-of-Mass det. time= 201.5 min (1,107.3 - 905.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,899.00'	1,146 cf	stone underdrain (Prismatic) Listed below (Recalc) 2,865 cf Overall x 40.0% Voids
#2	1,900.00'	860 cf	filter media (Prismatic) Listed below (Recalc) 5,730 cf Overall x 15.0% Voids
#3	1,902.00'	12,721 cf	surface storage (Prismatic) Listed below (Recalc)
		14,726 cf	Total Available Storage

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 13

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.00	2,865	0	0
1,900.00	2,865	2,865	2,865

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,900.00	2,865	0	0
1,902.00	2,865	5,730	5,730

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,902.00	2,865	0	0
1,903.00	4,783	3,824	3,824
1,904.00	6,154	5,469	9,293
1,904.50	7,558	3,428	12,721

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,899.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,899.00'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,903.50'	50.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=0.20 cfs @ 13.26 hrs HW=1,902.03' (Free Discharge)

↳ **2=Orifice/Grate** (Passes 0.20 cfs of 1.58 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.20 cfs)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,899.00' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Summary for Pond IP: P2

Inflow Area = 45.186 ac, 28.04% Impervious, Inflow Depth = 1.01" for 1-YEAR event
 Inflow = 45.93 cfs @ 12.01 hrs, Volume= 3.790 af
 Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 100%, Lag= 0.0 min
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,940.38' @ 95.82 hrs Surf.Area= 78,250 sf Storage= 165,092 cf

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)

Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Storage Description
#1	1,938.00'	463,648 cf	Storage above Perm Pool (Irregular) Listed below (Recalc)

07074_Pro-WildacresEast

Type II 24-hr 1-YEAR Rainfall=2.80"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 14

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
1,938.00	56,286	1,229.0	0	0	56,286
1,939.00	70,553	1,304.0	63,285	63,285	71,457
1,940.00	74,969	1,432.0	72,750	136,035	99,359
1,942.00	93,060	2,050.0	167,703	303,739	270,635
1,942.25	97,168	2,034.0	23,777	327,515	275,860
1,943.00	111,843	1,898.0	78,315	405,830	318,440
1,943.50	119,472	1,918.0	57,818	463,648	324,588

Device	Routing	Invert	Outlet Devices
#1	Primary	1,940.40'	18.0" Round Culvert L= 130.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 1,940.40' / 1,937.00' S= 0.0262 1/1 Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,943.00'	25.0' long x 20.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,938.00' (Free Discharge)

1=Culvert (Controls 0.00 cfs)

2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 6P: Overflow Basin @ 8 tee

Inflow = 24.51 cfs @ 12.23 hrs, Volume= 1.689 af
 Outflow = 16.95 cfs @ 12.40 hrs, Volume= 1.534 af, Atten= 31%, Lag= 10.5 min
 Primary = 16.95 cfs @ 12.40 hrs, Volume= 1.534 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,964.12' @ 12.40 hrs Surf.Area= 8,343 sf Storage= 17,905 cf

Plug-Flow detention time= 78.6 min calculated for 1.533 af (91% of inflow)
 Center-of-Mass det. time= 37.4 min (871.4 - 834.0)

Volume	Invert	Avail.Storage	Storage Description
#1	1,961.00'	25,500 cf	surface storage (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,961.00	3,100	0	0
1,962.00	5,100	4,100	4,100
1,963.00	6,100	5,600	9,700
1,964.00	8,250	7,175	16,875
1,965.00	9,000	8,625	25,500

Device	Routing	Invert	Outlet Devices
#1	Primary	1,962.50'	36.0" Round Culvert L= 145.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,962.50' / 1,958.00' S= 0.0310 '/ Cc= 0.900 n= 0.010 PVC, smooth interior

Primary OutFlow Max=16.89 cfs @ 12.40 hrs HW=1,964.12' (Free Discharge)

↑1=Culvert (Inlet Controls 16.89 cfs @ 4.33 fps)

Summary for Pond A1: A1 - OPEN SWALE

Inflow Area = 1.159 ac, 7.80% Impervious, Inflow Depth = 2.99" for 10-YEAR event
 Inflow = 5.24 cfs @ 12.02 hrs, Volume= 0.289 af
 Outflow = 5.16 cfs @ 12.04 hrs, Volume= 0.286 af, Atten= 1%, Lag= 0.9 min
 Primary = 5.16 cfs @ 12.04 hrs, Volume= 0.286 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,910.25' @ 12.04 hrs Surf.Area= 2,302 sf Storage= 2,776 cf

Plug-Flow detention time= 249.2 min calculated for 0.285 af (99% of inflow)
 Center-of-Mass det. time= 242.1 min (1,076.6 - 834.5)

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 16

Volume	Invert	Avail.Storage	Storage Description
#1	1,904.50'	186 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 464 cf Overall x 40.0% Voids
#2	1,905.50'	139 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 928 cf Overall x 15.0% Voids
#3	1,907.50'	2,803 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,128 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,904.50	464	0	0
1,905.50	464	464	464

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,905.50	464	0	0
1,907.50	464	928	928

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,907.50	464	0	0
1,908.00	567	258	258
1,910.00	1,291	1,858	2,116
1,910.50	1,457	687	2,803

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,904.50'	1.000 in/hr Exfiltration over Surface area above 1,904.50' Excluded Surface area = 464 sf
#2	Primary	1,904.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,910.00'	15.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=5.08 cfs @ 12.04 hrs HW=1,910.25' (Free Discharge)

2=Orifice/Grate (Passes 0.04 cfs of 2.22 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.04 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 5.04 cfs @ 1.35 fps)

Summary for Pond A2: A2 - OPEN SWALE

Inflow Area = 1.621 ac, 6.50% Impervious, Inflow Depth = 2.83" for 10-YEAR event
 Inflow = 6.91 cfs @ 12.04 hrs, Volume= 0.383 af
 Outflow = 6.88 cfs @ 12.04 hrs, Volume= 0.379 af, Atten= 0%, Lag= 0.5 min
 Primary = 6.88 cfs @ 12.04 hrs, Volume= 0.379 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,907.31' @ 12.04 hrs Surf.Area= 1,526 sf Storage= 1,263 cf

Plug-Flow detention time= 144.4 min calculated for 0.379 af (99% of inflow)

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 17

Center-of-Mass det. time= 127.8 min (1,145.8 - 1,018.0)

Volume	Invert	Avail.Storage	Storage Description
#1	1,902.50'	134 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 336 cf Overall x 40.0% Voids
#2	1,903.50'	101 cf	FILTER BED (Prismatic) Listed below (Recalc) 672 cf Overall x 15.0% Voids
#3	1,905.50'	2,316 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		2,551 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,902.50	336	0	0
1,903.50	336	336	336

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,903.50	336	0	0
1,905.50	336	672	672

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,905.50	336	0	0
1,906.00	428	191	191
1,908.00	1,080	1,508	1,699
1,908.50	1,386	617	2,316

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,902.50'	1.000 in/hr Exfiltration over Surface area above 1,902.50' Excluded Surface area = 336 sf
#2	Primary	1,902.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,907.00'	15.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=6.73 cfs @ 12.04 hrs HW=1,907.30' (Free Discharge)

2=Orifice/Grate (Passes 0.03 cfs of 2.02 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.03 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 6.71 cfs @ 1.48 fps)

Summary for Pond A3: A3 - OPEN SWALE

Inflow Area = 2.379 ac, 6.95% Impervious, Inflow Depth = 2.69" for 10-YEAR event
 Inflow = 9.62 cfs @ 12.04 hrs, Volume= 0.533 af
 Outflow = 9.39 cfs @ 12.05 hrs, Volume= 0.529 af, Atten= 2%, Lag= 0.9 min
 Primary = 9.39 cfs @ 12.05 hrs, Volume= 0.529 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 18

Peak Elev= 1,905.81' @ 12.05 hrs Surf.Area= 2,247 sf Storage= 2,299 cf

Plug-Flow detention time= 204.9 min calculated for 0.529 af (99% of inflow)

Center-of-Mass det. time= 186.1 min (1,246.0 - 1,059.9)

Volume	Invert	Avail.Storage	Storage Description
#1	1,900.50'	206 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 514 cf Overall x 40.0% Voids
#2	1,901.50'	154 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 1,028 cf Overall x 15.0% Voids
#3	1,903.50'	2,895 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,255 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,900.50	514	0	0
1,901.50	514	514	514

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,901.50	514	0	0
1,903.50	514	1,028	1,028

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,903.50	514	0	0
1,904.00	613	282	282
1,906.00	1,283	1,896	2,178
1,906.50	1,585	717	2,895

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,900.50'	1.000 in/hr Exfiltration over Surface area above 1,900.50' Excluded Surface area = 514 sf
#2	Primary	1,900.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,905.50'	20.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=9.26 cfs @ 12.05 hrs HW=1,905.81' (Free Discharge)

2=Orifice/Grate (Passes 0.04 cfs of 2.13 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.04 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 9.22 cfs @ 1.50 fps)

Summary for Pond A4: A4 - OPEN SWALE

Inflow Area = 2.923 ac, 6.68% Impervious, Inflow Depth = 2.61" for 10-YEAR event
 Inflow = 11.23 cfs @ 12.05 hrs, Volume= 0.636 af
 Outflow = 11.46 cfs @ 12.07 hrs, Volume= 0.631 af, Atten= 0%, Lag= 1.2 min
 Primary = 11.46 cfs @ 12.07 hrs, Volume= 0.631 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,903.86' @ 12.07 hrs Surf.Area= 1,597 sf Storage= 1,672 cf

Plug-Flow detention time= 184.7 min calculated for 0.631 af (99% of inflow)
 Center-of-Mass det. time= 165.8 min (1,345.6 - 1,179.7)

Volume	Invert	Avail.Storage	Storage Description
#1	1,898.50'	137 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 343 cf Overall x 40.0% Voids
#2	1,899.50'	103 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 686 cf Overall x 15.0% Voids
#3	1,901.50'	2,105 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		2,345 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,898.50	343	0	0
1,899.50	343	343	343

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.50	343	0	0
1,901.50	343	686	686

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,901.50	343	0	0
1,902.00	425	192	192
1,904.00	949	1,374	1,566
1,904.50	1,207	539	2,105

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,898.50'	1.000 in/hr Exfiltration over Surface area above 1,898.50' Excluded Surface area = 343 sf
#2	Primary	1,898.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,903.50'	20.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=10.68 cfs @ 12.07 hrs HW=1,903.84' (Free Discharge)

2=Orifice/Grate (Passes 0.03 cfs of 2.13 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.03 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 10.65 cfs @ 1.58 fps)

Summary for Pond A5: A5 - OPEN SWALE

Inflow Area = 4.411 ac, 6.47% Impervious, Inflow Depth = 2.63" for 10-YEAR event
 Inflow = 16.91 cfs @ 12.07 hrs, Volume= 0.967 af
 Outflow = 16.31 cfs @ 12.07 hrs, Volume= 0.966 af, Atten= 4%, Lag= 0.3 min
 Primary = 0.05 cfs @ 12.07 hrs, Volume= 0.242 af
 Secondary = 16.27 cfs @ 12.07 hrs, Volume= 0.723 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,902.25' @ 12.07 hrs Surf.Area= 2,339 sf Storage= 2,945 cf

Plug-Flow detention time= 199.1 min calculated for 0.965 af (100% of inflow)
 Center-of-Mass det. time= 192.6 min (1,363.0 - 1,170.4)

Volume	Invert	Avail.Storage	Storage Description
#1	1,896.50'	138 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 346 cf Overall x 40.0% Voids
#2	1,897.50'	104 cf	FILTER BED (Prismatic) Listed below (Recalc) 692 cf Overall x 15.0% Voids
#3	1,899.50'	3,125 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,367 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,896.50	346	0	0
1,897.50	346	346	346

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,897.50	346	0	0
1,899.50	346	692	692

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.50	346	0	0
1,900.00	550	224	224
1,902.00	1,528	2,078	2,302
1,902.50	1,764	823	3,125

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,896.50'	1.000 in/hr Exfiltration over Surface area above 1,896.50' Excluded Surface area = 346 sf
#2	Primary	1,896.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,902.00'	50.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50

3.00 3.50

Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07

3.20 3.32

Primary OutFlow Max=0.05 cfs @ 12.07 hrs HW=1,902.24' (Free Discharge)

↳ **2=Orifice/Grate** (Passes 0.05 cfs of 2.22 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.05 cfs)

Secondary OutFlow Max=15.47 cfs @ 12.07 hrs HW=1,902.24' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 15.47 cfs @ 1.26 fps)

Summary for Pond B: OPEN SWALE

Inflow Area = 3.361 ac, 5.72% Impervious, Inflow Depth = 2.71" for 10-YEAR event
 Inflow = 12.83 cfs @ 12.05 hrs, Volume= 0.760 af
 Outflow = 11.91 cfs @ 12.09 hrs, Volume= 0.746 af, Atten= 7%, Lag= 2.6 min
 Primary = 11.91 cfs @ 12.09 hrs, Volume= 0.746 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,868.29' @ 12.09 hrs Surf.Area= 7,761 sf Storage= 8,158 cf

Plug-Flow detention time= 248.1 min calculated for 0.746 af (98% of inflow)
 Center-of-Mass det. time= 237.3 min (1,080.6 - 843.3)

Volume	Invert	Avail.Storage	Storage Description
#1	1,863.00'	595 cf	stone underdrain (Prismatic) Listed below (Recalc) 1,488 cf Overall x 40.0% Voids
#2	1,864.00'	446 cf	filter media (Prismatic) Listed below (Recalc) 2,976 cf Overall x 15.0% Voids
#3	1,866.00'	8,167 cf	surface storage (Prismatic) Listed below (Recalc)
		9,209 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,863.00	1,488	0	0
1,864.00	1,488	1,488	1,488

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,864.00	1,488	0	0
1,866.00	1,488	2,976	2,976

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,866.00	1,488	0	0
1,867.00	2,798	2,143	2,143
1,868.00	4,500	3,649	5,792
1,868.50	5,000	2,375	8,167

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,863.00'	1.000 in/hr Exfiltration over Surface area above 1,863.00' Excluded Surface area = 1,488 sf
#2	Primary	1,863.00'	6.0" Vert. culvert C= 0.600
#3	Primary	1,868.00'	30.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=11.87 cfs @ 12.09 hrs HW=1,868.28' (Free Discharge)

- 2=culvert (Passes 0.15 cfs of 2.12 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.15 cfs)
- 3=Broad-Crested Rectangular Weir (Weir Controls 11.73 cfs @ 1.37 fps)

Summary for Pond B1: bioretention @ 8 tee

Inflow Area =	10.459 ac,	5.58% Impervious,	Inflow Depth = 2.53"	for 10-YEAR event
Inflow =	26.12 cfs @	12.18 hrs,	Volume=	2.205 af
Outflow =	24.88 cfs @	12.23 hrs,	Volume=	2.205 af, Atten= 5%, Lag= 3.2 min
Primary =	0.37 cfs @	12.23 hrs,	Volume=	0.516 af
Secondary =	24.51 cfs @	12.23 hrs,	Volume=	1.689 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Peak Elev= 1,966.44' @ 12.23 hrs Surf.Area= 15,932 sf Storage= 12,332 cf

Plug-Flow detention time= 77.4 min calculated for 2.205 af (100% of inflow)
Center-of-Mass det. time= 77.7 min (936.2 - 858.4)

Volume	Invert	Avail.Storage	Storage Description
#1	1,960.00'	1,800 cf	stone underdrain (Prismatic) Listed below (Recalc) 4,500 cf Overall x 40.0% Voids
#2	1,961.00'	2,700 cf	filter media (Prismatic) Listed below (Recalc) 18,000 cf Overall x 15.0% Voids
#3	1,965.00'	12,150 cf	surface storage (Prismatic) Listed below (Recalc)
		16,650 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,960.00	4,500	0	0
1,961.00	4,500	4,500	4,500

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,961.00	4,500	0	0
1,965.00	4,500	18,000	18,000

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 23

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,965.00	4,500	0	0
1,966.00	5,600	5,050	5,050
1,967.00	8,600	7,100	12,150

Device	Routing	Invert	Outlet Devices
#1	Primary	1,960.00'	12.0" Round Culvert L= 100.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,960.00' / 1,958.00' S= 0.0200 1/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	1,960.00'	1.000 in/hr Exfiltration over Surface area
#3	Secondary	1,965.50'	10.0' long x 4.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

Primary OutFlow Max=0.37 cfs @ 12.23 hrs HW=1,966.44' (Free Discharge)

↑1=Culvert (Passes 0.37 cfs of 9.22 cfs potential flow)

↑2=Exfiltration (Exfiltration Controls 0.37 cfs)

Secondary OutFlow Max=24.43 cfs @ 12.23 hrs HW=1,966.44' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Weir Controls 24.43 cfs @ 2.59 fps)

Summary for Pond B3: bioretention @ blvd

Inflow Area =	5.445 ac, 51.78% Impervious, Inflow Depth = 4.41" for 10-YEAR event
Inflow =	29.02 cfs @ 12.08 hrs, Volume= 2.001 af
Outflow =	19.76 cfs @ 12.20 hrs, Volume= 2.002 af, Atten= 32%, Lag= 7.2 min
Primary =	19.76 cfs @ 12.20 hrs, Volume= 2.002 af
Secondary =	0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

Peak Elev= 1,960.20' @ 12.20 hrs Surf.Area= 36,735 sf Storage= 26,622 cf

Plug-Flow detention time= 162.9 min calculated for 2.000 af (100% of inflow)

Center-of-Mass det. time= 163.7 min (967.8 - 804.1)

Volume	Invert	Avail.Storage	Storage Description
#1	1,954.00'	4,700 cf	stone underdrain (Prismatic) Listed below (Recalc) 11,750 cf Overall x 40.0% Voids
#2	1,955.00'	7,050 cf	filter media (Prismatic) Listed below (Recalc) 47,000 cf Overall x 15.0% Voids
#3	1,959.00'	26,092 cf	surface storage (Prismatic) Listed below (Recalc)
		37,842 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,954.00	11,750	0	0
1,955.00	11,750	11,750	11,750

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 24

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,955.00	11,750	0	0
1,959.00	11,750	47,000	47,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,959.00	11,750	0	0
1,960.00	12,892	12,321	12,321
1,961.00	14,650	13,771	26,092

Device	Routing	Invert	Outlet Devices
#1	Primary	1,954.00'	21.0" Round Culvert L= 85.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,954.00' / 1,953.00' S= 0.0118 '/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	1,954.00'	1.000 in/hr Exfiltration over Surface area
#3	Device 1	1,959.50'	12.0" Horiz. Orifice/Grate X 6.00 C= 0.600 Limited to weir flow at low heads
#4	Secondary	1,960.50'	25.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=19.73 cfs @ 12.20 hrs HW=1,960.19' (Free Discharge)

- ↑ 1=Culvert (Passes 19.73 cfs of 26.71 cfs potential flow)
- ↑ 2=Exfiltration (Exfiltration Controls 0.85 cfs)
- ↑ 3=Orifice/Grate (Orifice Controls 18.88 cfs @ 4.01 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=1,954.00' (Free Discharge)

- ↑ 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond F1: Open Swale-F

Inflow Area =	2.052 ac,	7.70% Impervious,	Inflow Depth = 2.71" for 10-YEAR event
Inflow =	9.31 cfs @	11.99 hrs,	Volume= 0.464 af
Outflow =	9.23 cfs @	12.01 hrs,	Volume= 0.459 af, Atten= 1%, Lag= 0.7 min
Primary =	0.08 cfs @	12.01 hrs,	Volume= 0.179 af
Secondary =	9.15 cfs @	12.01 hrs,	Volume= 0.280 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Peak Elev= 1,895.63' @ 12.01 hrs Surf.Area= 4,450 sf Storage= 4,704 cf

Plug-Flow detention time= 258.2 min calculated for 0.458 af (99% of inflow)
Center-of-Mass det. time= 251.8 min (1,090.7 - 838.9)

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 25

Volume	Invert	Avail.Storage	Storage Description
#1	1,890.50'	317 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 792 cf Overall x 40.0% Voids
#2	1,891.50'	238 cf	Filter Bed (Prismatic) Listed below 1,584 cf Overall x 15.0% Voids
#3	1,893.50'	6,962 cf	surface storage (Prismatic) Listed below (Recalc)
		7,516 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,890.50	792	0	0
1,891.50	792	792	792

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,891.50	792	0	0
1,893.50	792	1,584	1,584

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,893.50	792	0	0
1,894.00	1,526	580	580
1,896.00	3,175	4,701	5,281
1,896.50	3,550	1,681	6,962

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,890.50'	1.000 in/hr Exfiltration over Surface area above 1,890.50' Excluded Surface area = 792 sf
#2	Primary	1,890.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,895.50'	75.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.08 cfs @ 12.01 hrs HW=1,895.62' (Free Discharge)

↑2=**Orifice/Grate** (Passes 0.08 cfs of 2.09 cfs potential flow)

↑1=**Exfiltration** (Exfiltration Controls 0.08 cfs)

Secondary OutFlow Max=8.82 cfs @ 12.01 hrs HW=1,895.62' (Free Discharge)

↑3=**Broad-Crested Rectangular Weir** (Weir Controls 8.82 cfs @ 0.95 fps)

Summary for Pond FIP: FOREBAY

Inflow Area = 18.401 ac, 27.13% Impervious, Inflow Depth = 3.59" for 10-YEAR event
 Inflow = 84.13 cfs @ 11.96 hrs, Volume= 5.498 af
 Outflow = 83.52 cfs @ 11.97 hrs, Volume= 5.269 af, Atten= 1%, Lag= 0.4 min
 Primary = 83.52 cfs @ 11.97 hrs, Volume= 5.269 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 26

Peak Elev= 1,941.05' @ 11.97 hrs Surf.Area= 5,343 sf Storage= 12,727 cf

Plug-Flow detention time= 44.4 min calculated for 5.269 af (96% of inflow)
Center-of-Mass det. time= 19.4 min (823.2 - 803.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,937.50'	15,249 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,937.50	1,937	0	0
1,938.00	2,369	1,077	1,077
1,940.00	4,256	6,625	7,702
1,940.50	4,764	2,255	9,957
1,941.50	5,821	5,293	15,249

Device	Routing	Invert	Outlet Devices
#1	Primary	1,940.50'	75.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=83.33 cfs @ 11.97 hrs HW=1,941.05' (Free Discharge)

↑1=**Broad-Crested Rectangular Weir** (Weir Controls 83.33 cfs @ 2.03 fps)

Summary for Pond G: OPEN SWALE

Inflow Area = 3.700 ac, 7.39% Impervious, Inflow Depth = 2.44" for 10-YEAR event
 Inflow = 14.22 cfs @ 12.01 hrs, Volume= 0.752 af
 Outflow = 11.86 cfs @ 12.07 hrs, Volume= 0.753 af, Atten= 17%, Lag= 3.7 min
 Primary = 0.27 cfs @ 12.07 hrs, Volume= 0.440 af
 Secondary = 11.60 cfs @ 12.07 hrs, Volume= 0.313 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Peak Elev= 1,903.70' @ 12.07 hrs Surf.Area= 11,477 sf Storage= 9,531 cf

Plug-Flow detention time= 250.0 min calculated for 0.752 af (100% of inflow)
Center-of-Mass det. time= 252.0 min (1,099.4 - 847.4)

Volume	Invert	Avail.Storage	Storage Description
#1	1,899.00'	1,146 cf	stone underdrain (Prismatic) Listed below (Recalc) 2,865 cf Overall x 40.0% Voids
#2	1,900.00'	860 cf	filter media (Prismatic) Listed below (Recalc) 5,730 cf Overall x 15.0% Voids
#3	1,902.00'	12,721 cf	surface storage (Prismatic) Listed below (Recalc)
		14,726 cf	Total Available Storage

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 27

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.00	2,865	0	0
1,900.00	2,865	2,865	2,865

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,900.00	2,865	0	0
1,902.00	2,865	5,730	5,730

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,902.00	2,865	0	0
1,903.00	4,783	3,824	3,824
1,904.00	6,154	5,469	9,293
1,904.50	7,558	3,428	12,721

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,899.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,899.00'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,903.50'	50.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=0.27 cfs @ 12.07 hrs HW=1,903.69' (Free Discharge)

↳ **2=Orifice/Grate** (Passes 0.27 cfs of 1.99 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.27 cfs)

Secondary OutFlow Max=10.68 cfs @ 12.07 hrs HW=1,903.69' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 10.68 cfs @ 1.11 fps)

Summary for Pond IP: P2

Inflow Area = 45.186 ac, 28.04% Impervious, Inflow Depth = 3.47" for 10-YEAR event
 Inflow = 167.75 cfs @ 11.98 hrs, Volume= 13.051 af
 Outflow = 9.18 cfs @ 13.90 hrs, Volume= 9.123 af, Atten= 95%, Lag= 115.0 min
 Primary = 9.18 cfs @ 13.90 hrs, Volume= 9.123 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,942.32' @ 13.90 hrs Surf.Area= 98,399 sf Storage= 333,873 cf

Plug-Flow detention time= 544.1 min calculated for 9.123 af (70% of inflow)
 Center-of-Mass det. time= 414.5 min (1,268.3 - 853.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,938.00'	463,648 cf	Storage above Perm Pool (Irregular) Listed below (Recalc)

07074_Pro-WildacresEast

Type II 24-hr 10-YEAR Rainfall=6.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 28

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
1,938.00	56,286	1,229.0	0	0	56,286
1,939.00	70,553	1,304.0	63,285	63,285	71,457
1,940.00	74,969	1,432.0	72,750	136,035	99,359
1,942.00	93,060	2,050.0	167,703	303,739	270,635
1,942.25	97,168	2,034.0	23,777	327,515	275,860
1,943.00	111,843	1,898.0	78,315	405,830	318,440
1,943.50	119,472	1,918.0	57,818	463,648	324,588

Device	Routing	Invert	Outlet Devices
#1	Primary	1,940.40'	18.0" Round Culvert L= 130.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 1,940.40' / 1,937.00' S= 0.0262 1/1 Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,943.00'	25.0' long x 20.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=9.18 cfs @ 13.90 hrs HW=1,942.32' (Free Discharge)

- 1=Culvert (Inlet Controls 9.18 cfs @ 5.20 fps)
- 2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Summary for Pond 6P: Overflow Basin @ 8 tee

Inflow = 41.05 cfs @ 12.22 hrs, Volume= 3.047 af
 Outflow = 33.80 cfs @ 12.34 hrs, Volume= 2.892 af, Atten= 18%, Lag= 7.3 min
 Primary = 33.80 cfs @ 12.34 hrs, Volume= 2.892 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,965.00' @ 12.34 hrs Surf.Area= 8,997 sf Storage= 25,460 cf

Plug-Flow detention time= 53.4 min calculated for 2.891 af (95% of inflow)
 Center-of-Mass det. time= 26.2 min (859.9 - 833.7)

Volume	Invert	Avail.Storage	Storage Description
#1	1,961.00'	25,500 cf	surface storage (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,961.00	3,100	0	0
1,962.00	5,100	4,100	4,100
1,963.00	6,100	5,600	9,700
1,964.00	8,250	7,175	16,875
1,965.00	9,000	8,625	25,500

Device	Routing	Invert	Outlet Devices
#1	Primary	1,962.50'	36.0" Round Culvert L= 145.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,962.50' / 1,958.00' S= 0.0310 1/1 Cc= 0.900 n= 0.010 PVC, smooth interior

Primary OutFlow Max=33.72 cfs @ 12.34 hrs HW=1,964.99' (Free Discharge)

↑1=Culvert (Inlet Controls 33.72 cfs @ 5.37 fps)

Summary for Pond A1: A1 - OPEN SWALE

Inflow Area = 1.159 ac, 7.80% Impervious, Inflow Depth = 4.69" for 100-YEAR event
 Inflow = 8.15 cfs @ 12.02 hrs, Volume= 0.453 af
 Outflow = 8.05 cfs @ 12.03 hrs, Volume= 0.449 af, Atten= 1%, Lag= 0.6 min
 Primary = 8.05 cfs @ 12.03 hrs, Volume= 0.449 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,910.34' @ 12.03 hrs Surf.Area= 2,331 sf Storage= 2,896 cf

Plug-Flow detention time= 164.6 min calculated for 0.449 af (99% of inflow)
 Center-of-Mass det. time= 158.8 min (980.4 - 821.7)

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 30

Volume	Invert	Avail.Storage	Storage Description
#1	1,904.50'	186 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 464 cf Overall x 40.0% Voids
#2	1,905.50'	139 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 928 cf Overall x 15.0% Voids
#3	1,907.50'	2,803 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,128 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,904.50	464	0	0
1,905.50	464	464	464

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,905.50	464	0	0
1,907.50	464	928	928

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,907.50	464	0	0
1,908.00	567	258	258
1,910.00	1,291	1,858	2,116
1,910.50	1,457	687	2,803

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,904.50'	1.000 in/hr Exfiltration over Surface area above 1,904.50' Excluded Surface area = 464 sf
#2	Primary	1,904.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,910.00'	15.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=8.01 cfs @ 12.03 hrs HW=1,910.34' (Free Discharge)

2=Orifice/Grate (Passes 0.04 cfs of 2.23 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.04 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 7.97 cfs @ 1.57 fps)

Summary for Pond A2: A2 - OPEN SWALE

Inflow Area = 1.621 ac, 6.50% Impervious, Inflow Depth = 4.50" for 100-YEAR event
 Inflow = 10.92 cfs @ 12.03 hrs, Volume= 0.608 af
 Outflow = 10.83 cfs @ 12.04 hrs, Volume= 0.605 af, Atten= 1%, Lag= 0.3 min
 Primary = 10.83 cfs @ 12.04 hrs, Volume= 0.605 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,907.41' @ 12.04 hrs Surf.Area= 1,560 sf Storage= 1,355 cf

Plug-Flow detention time= 88.1 min calculated for 0.605 af (100% of inflow)

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 31

Center-of-Mass det. time= 80.6 min (1,022.3 - 941.7)

Volume	Invert	Avail.Storage	Storage Description
#1	1,902.50'	134 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 336 cf Overall x 40.0% Voids
#2	1,903.50'	101 cf	FILTER BED (Prismatic) Listed below (Recalc) 672 cf Overall x 15.0% Voids
#3	1,905.50'	2,316 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		2,551 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,902.50	336	0	0
1,903.50	336	336	336

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,903.50	336	0	0
1,905.50	336	672	672

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,905.50	336	0	0
1,906.00	428	191	191
1,908.00	1,080	1,508	1,699
1,908.50	1,386	617	2,316

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,902.50'	1.000 in/hr Exfiltration over Surface area above 1,902.50' Excluded Surface area = 336 sf
#2	Primary	1,902.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,907.00'	15.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=10.75 cfs @ 12.04 hrs HW=1,907.41' (Free Discharge)

2=Orifice/Grate (Passes 0.03 cfs of 2.04 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.03 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 10.72 cfs @ 1.74 fps)

Summary for Pond A3: A3 - OPEN SWALE

Inflow Area = 2.379 ac, 6.95% Impervious, Inflow Depth = 4.33" for 100-YEAR event
 Inflow = 15.39 cfs @ 12.03 hrs, Volume= 0.858 af
 Outflow = 15.26 cfs @ 12.04 hrs, Volume= 0.852 af, Atten= 1%, Lag= 0.4 min
 Primary = 15.26 cfs @ 12.04 hrs, Volume= 0.852 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 32

Peak Elev= 1,905.93' @ 12.04 hrs Surf.Area= 2,286 sf Storage= 2,444 cf

Plug-Flow detention time= 134.8 min calculated for 0.852 af (99% of inflow)

Center-of-Mass det. time= 117.1 min (1,084.0 - 966.9)

Volume	Invert	Avail.Storage	Storage Description
#1	1,900.50'	206 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 514 cf Overall x 40.0% Voids
#2	1,901.50'	154 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 1,028 cf Overall x 15.0% Voids
#3	1,903.50'	2,895 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,255 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,900.50	514	0	0
1,901.50	514	514	514

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,901.50	514	0	0
1,903.50	514	1,028	1,028

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,903.50	514	0	0
1,904.00	613	282	282
1,906.00	1,283	1,896	2,178
1,906.50	1,585	717	2,895

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,900.50'	1.000 in/hr Exfiltration over Surface area above 1,900.50' Excluded Surface area = 514 sf
#2	Primary	1,900.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,905.50'	20.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=15.10 cfs @ 12.04 hrs HW=1,905.92' (Free Discharge)

2=Orifice/Grate (Passes 0.04 cfs of 2.15 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.04 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 15.06 cfs @ 1.77 fps)

Summary for Pond A4: A4 - OPEN SWALE

Inflow Area = 2.923 ac, 6.68% Impervious, Inflow Depth = 4.22" for 100-YEAR event
 Inflow = 18.43 cfs @ 12.04 hrs, Volume= 1.029 af
 Outflow = 18.30 cfs @ 12.04 hrs, Volume= 1.025 af, Atten= 1%, Lag= 0.3 min
 Primary = 18.30 cfs @ 12.04 hrs, Volume= 1.025 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,903.98' @ 12.04 hrs Surf.Area= 1,630 sf Storage= 1,789 cf

Plug-Flow detention time= 111.6 min calculated for 1.025 af (100% of inflow)
 Center-of-Mass det. time= 102.1 min (1,143.6 - 1,041.5)

Volume	Invert	Avail.Storage	Storage Description
#1	1,898.50'	137 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 343 cf Overall x 40.0% Voids
#2	1,899.50'	103 cf	FILTER MEDIA (Prismatic) Listed below (Recalc) 686 cf Overall x 15.0% Voids
#3	1,901.50'	2,105 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		2,345 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,898.50	343	0	0
1,899.50	343	343	343

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.50	343	0	0
1,901.50	343	686	686

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,901.50	343	0	0
1,902.00	425	192	192
1,904.00	949	1,374	1,566
1,904.50	1,207	539	2,105

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,898.50'	1.000 in/hr Exfiltration over Surface area above 1,898.50' Excluded Surface area = 343 sf
#2	Primary	1,898.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Primary	1,903.50'	20.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=18.12 cfs @ 12.04 hrs HW=1,903.98' (Free Discharge)

2=Orifice/Grate (Passes 0.03 cfs of 2.16 cfs potential flow)

1=Exfiltration (Exfiltration Controls 0.03 cfs)

3=Broad-Crested Rectangular Weir (Weir Controls 18.09 cfs @ 1.89 fps)

Summary for Pond A5: A5 - OPEN SWALE

Inflow Area = 4.411 ac, 6.47% Impervious, Inflow Depth = 4.26" for 100-YEAR event
 Inflow = 27.95 cfs @ 12.03 hrs, Volume= 1.564 af
 Outflow = 27.77 cfs @ 12.04 hrs, Volume= 1.562 af, Atten= 1%, Lag= 0.2 min
 Primary = 0.05 cfs @ 12.04 hrs, Volume= 0.245 af
 Secondary = 27.72 cfs @ 12.04 hrs, Volume= 1.317 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,902.36' @ 12.04 hrs Surf.Area= 2,388 sf Storage= 3,119 cf

Plug-Flow detention time= 124.9 min calculated for 1.562 af (100% of inflow)
 Center-of-Mass det. time= 120.3 min (1,155.2 - 1,034.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,896.50'	138 cf	STONE UNDERDRAIN (Prismatic) Listed below (Recalc) 346 cf Overall x 40.0% Voids
#2	1,897.50'	104 cf	FILTER BED (Prismatic) Listed below (Recalc) 692 cf Overall x 15.0% Voids
#3	1,899.50'	3,125 cf	SURFACE STORAGE (Prismatic) Listed below (Recalc)
		3,367 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,896.50	346	0	0
1,897.50	346	346	346

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,897.50	346	0	0
1,899.50	346	692	692

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.50	346	0	0
1,900.00	550	224	224
1,902.00	1,528	2,078	2,302
1,902.50	1,764	823	3,125

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,896.50'	1.000 in/hr Exfiltration over Surface area above 1,896.50' Excluded Surface area = 346 sf
#2	Primary	1,896.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,902.00'	50.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50

3.00 3.50

Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07

3.20 3.32

Primary OutFlow Max=0.05 cfs @ 12.04 hrs HW=1,902.35' (Free Discharge)

↳ **2=Orifice/Grate** (Passes 0.05 cfs of 2.24 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.05 cfs)

Secondary OutFlow Max=27.42 cfs @ 12.04 hrs HW=1,902.35' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 27.42 cfs @ 1.55 fps)

Summary for Pond B: OPEN SWALE

Inflow Area = 3.361 ac, 5.72% Impervious, Inflow Depth = 4.35" for 100-YEAR event
 Inflow = 20.59 cfs @ 12.04 hrs, Volume= 1.218 af
 Outflow = 20.21 cfs @ 12.06 hrs, Volume= 1.204 af, Atten= 2%, Lag= 1.1 min
 Primary = 20.21 cfs @ 12.06 hrs, Volume= 1.204 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,868.40' @ 12.06 hrs Surf.Area= 7,879 sf Storage= 8,730 cf

Plug-Flow detention time= 158.3 min calculated for 1.204 af (99% of inflow)
 Center-of-Mass det. time= 151.4 min (981.1 - 829.7)

Volume	Invert	Avail.Storage	Storage Description
#1	1,863.00'	595 cf	stone underdrain (Prismatic) Listed below (Recalc) 1,488 cf Overall x 40.0% Voids
#2	1,864.00'	446 cf	filter media (Prismatic) Listed below (Recalc) 2,976 cf Overall x 15.0% Voids
#3	1,866.00'	8,167 cf	surface storage (Prismatic) Listed below (Recalc)
		9,209 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,863.00	1,488	0	0
1,864.00	1,488	1,488	1,488

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,864.00	1,488	0	0
1,866.00	1,488	2,976	2,976

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,866.00	1,488	0	0
1,867.00	2,798	2,143	2,143
1,868.00	4,500	3,649	5,792
1,868.50	5,000	2,375	8,167

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,863.00'	1.000 in/hr Exfiltration over Surface area above 1,863.00' Excluded Surface area = 1,488 sf
#2	Primary	1,863.00'	6.0" Vert. culvert C= 0.600
#3	Primary	1,868.00'	30.0' long x 2.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07 3.20 3.32

Primary OutFlow Max=20.18 cfs @ 12.06 hrs HW=1,868.40' (Free Discharge)

- 2=culvert (Passes 0.15 cfs of 2.15 cfs potential flow)
- 1=Exfiltration (Exfiltration Controls 0.15 cfs)
- 3=Broad-Crested Rectangular Weir (Weir Controls 20.04 cfs @ 1.66 fps)

Summary for Pond B1: bioretention @ 8 tee

Inflow Area = 10.459 ac, 5.58% Impervious, Inflow Depth = 4.12" for 100-YEAR event
 Inflow = 43.23 cfs @ 12.17 hrs, Volume= 3.592 af
 Outflow = 41.45 cfs @ 12.22 hrs, Volume= 3.592 af, Atten= 4%, Lag= 3.0 min
 Primary = 0.40 cfs @ 12.22 hrs, Volume= 0.545 af
 Secondary = 41.05 cfs @ 12.22 hrs, Volume= 3.047 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,966.84' @ 12.22 hrs Surf.Area= 17,110 sf Storage= 15,284 cf

Plug-Flow detention time= 51.3 min calculated for 3.591 af (100% of inflow)
 Center-of-Mass det. time= 51.6 min (895.9 - 844.4)

Volume	Invert	Avail.Storage	Storage Description
#1	1,960.00'	1,800 cf	stone underdrain (Prismatic) Listed below (Recalc) 4,500 cf Overall x 40.0% Voids
#2	1,961.00'	2,700 cf	filter media (Prismatic) Listed below (Recalc) 18,000 cf Overall x 15.0% Voids
#3	1,965.00'	12,150 cf	surface storage (Prismatic) Listed below (Recalc)
		16,650 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,960.00	4,500	0	0
1,961.00	4,500	4,500	4,500

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,961.00	4,500	0	0
1,965.00	4,500	18,000	18,000

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 37

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,965.00	4,500	0	0
1,966.00	5,600	5,050	5,050
1,967.00	8,600	7,100	12,150

Device	Routing	Invert	Outlet Devices
#1	Primary	1,960.00'	12.0" Round Culvert L= 100.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,960.00' / 1,958.00' S= 0.0200 1/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	1,960.00'	1.000 in/hr Exfiltration over Surface area
#3	Secondary	1,965.50'	10.0' long x 4.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

Primary OutFlow Max=0.40 cfs @ 12.22 hrs HW=1,966.83' (Free Discharge)

↑1=Culvert (Passes 0.40 cfs of 9.52 cfs potential flow)

↑2=Exfiltration (Exfiltration Controls 0.40 cfs)

Secondary OutFlow Max=40.91 cfs @ 12.22 hrs HW=1,966.83' (Free Discharge)

↑3=Broad-Crested Rectangular Weir (Weir Controls 40.91 cfs @ 3.07 fps)

Summary for Pond B3: bioretention @ blvd

Inflow Area = 5.445 ac, 51.78% Impervious, Inflow Depth = 6.33" for 100-YEAR event
 Inflow = 40.93 cfs @ 12.08 hrs, Volume= 2.873 af
 Outflow = 31.27 cfs @ 12.18 hrs, Volume= 2.873 af, Atten= 24%, Lag= 6.0 min
 Primary = 25.63 cfs @ 12.18 hrs, Volume= 2.816 af
 Secondary = 5.65 cfs @ 12.18 hrs, Volume= 0.057 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
 Peak Elev= 1,960.69' @ 12.18 hrs Surf.Area= 37,606 sf Storage= 33,393 cf

Plug-Flow detention time= 135.5 min calculated for 2.873 af (100% of inflow)
 Center-of-Mass det. time= 135.0 min (929.1 - 794.1)

Volume	Invert	Avail.Storage	Storage Description
#1	1,954.00'	4,700 cf	stone underdrain (Prismatic) Listed below (Recalc) 11,750 cf Overall x 40.0% Voids
#2	1,955.00'	7,050 cf	filter media (Prismatic) Listed below (Recalc) 47,000 cf Overall x 15.0% Voids
#3	1,959.00'	26,092 cf	surface storage (Prismatic) Listed below (Recalc)
		37,842 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,954.00	11,750	0	0
1,955.00	11,750	11,750	11,750

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 38

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,955.00	11,750	0	0
1,959.00	11,750	47,000	47,000

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,959.00	11,750	0	0
1,960.00	12,892	12,321	12,321
1,961.00	14,650	13,771	26,092

Device	Routing	Invert	Outlet Devices
#1	Primary	1,954.00'	21.0" Round Culvert L= 85.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1,954.00' / 1,953.00' S= 0.0118 '/ Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	1,954.00'	1.000 in/hr Exfiltration over Surface area
#3	Device 1	1,959.50'	12.0" Horiz. Orifice/Grate X 6.00 C= 0.600 Limited to weir flow at low heads
#4	Secondary	1,960.50'	25.0' long x 25.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=25.62 cfs @ 12.18 hrs HW=1,960.69' (Free Discharge)

- ↑1=Culvert (Passes 25.62 cfs of 27.93 cfs potential flow)
- ↑2=Exfiltration (Exfiltration Controls 0.87 cfs)
- ↑3=Orifice/Grate (Orifice Controls 24.75 cfs @ 5.25 fps)

Secondary OutFlow Max=5.53 cfs @ 12.18 hrs HW=1,960.69' (Free Discharge)

- ↑4=Broad-Crested Rectangular Weir (Weir Controls 5.53 cfs @ 1.17 fps)

Summary for Pond F1: Open Swale-F

Inflow Area =	2.052 ac,	7.70% Impervious,	Inflow Depth = 4.35" for 100-YEAR event
Inflow =	14.84 cfs @	11.99 hrs,	Volume= 0.744 af
Outflow =	14.69 cfs @	12.00 hrs,	Volume= 0.738 af, Atten= 1%, Lag= 0.3 min
Primary =	0.09 cfs @	12.00 hrs,	Volume= 0.184 af
Secondary =	14.60 cfs @	12.00 hrs,	Volume= 0.553 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Peak Elev= 1,895.67' @ 12.00 hrs Surf.Area= 4,489 sf Storage= 4,840 cf

Plug-Flow detention time= 165.4 min calculated for 0.738 af (99% of inflow)
Center-of-Mass det. time= 160.5 min (985.8 - 825.4)

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 39

Volume	Invert	Avail.Storage	Storage Description
#1	1,890.50'	317 cf	Stone Underdrain (Prismatic) Listed below (Recalc) 792 cf Overall x 40.0% Voids
#2	1,891.50'	238 cf	Filter Bed (Prismatic) Listed below 1,584 cf Overall x 15.0% Voids
#3	1,893.50'	6,962 cf	surface storage (Prismatic) Listed below (Recalc)
		7,516 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,890.50	792	0	0
1,891.50	792	792	792

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,891.50	792	0	0
1,893.50	792	1,584	1,584

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,893.50	792	0	0
1,894.00	1,526	580	580
1,896.00	3,175	4,701	5,281
1,896.50	3,550	1,681	6,962

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,890.50'	1.000 in/hr Exfiltration over Surface area above 1,890.50' Excluded Surface area = 792 sf
#2	Primary	1,890.50'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,895.50'	75.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=0.09 cfs @ 12.00 hrs HW=1,895.67' (Free Discharge)

↑2=**Orifice/Grate** (Passes 0.09 cfs of 2.10 cfs potential flow)

↑1=**Exfiltration** (Exfiltration Controls 0.09 cfs)

Secondary OutFlow Max=14.42 cfs @ 12.00 hrs HW=1,895.67' (Free Discharge)

↑3=**Broad-Crested Rectangular Weir** (Weir Controls 14.42 cfs @ 1.12 fps)

Summary for Pond FIP: FOREBAY

Inflow Area = 18.401 ac, 27.13% Impervious, Inflow Depth = 5.34" for 100-YEAR event
 Inflow = 124.88 cfs @ 11.97 hrs, Volume= 8.181 af
 Outflow = 124.17 cfs @ 11.98 hrs, Volume= 7.953 af, Atten= 1%, Lag= 0.3 min
 Primary = 124.17 cfs @ 11.98 hrs, Volume= 7.953 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 40

Peak Elev= 1,941.20' @ 11.98 hrs Surf.Area= 5,508 sf Storage= 13,572 cf

Plug-Flow detention time= 32.3 min calculated for 7.953 af (97% of inflow)
Center-of-Mass det. time= 14.9 min (810.8 - 795.9)

Volume	Invert	Avail.Storage	Storage Description
#1	1,937.50'	15,249 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,937.50	1,937	0	0
1,938.00	2,369	1,077	1,077
1,940.00	4,256	6,625	7,702
1,940.50	4,764	2,255	9,957
1,941.50	5,821	5,293	15,249

Device	Routing	Invert	Outlet Devices
#1	Primary	1,940.50'	75.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Primary OutFlow Max=123.44 cfs @ 11.98 hrs HW=1,941.20' (Free Discharge)

↑1=**Broad-Crested Rectangular Weir** (Weir Controls 123.44 cfs @ 2.35 fps)

Summary for Pond G: OPEN SWALE

Inflow Area = 3.700 ac, 7.39% Impervious, Inflow Depth = 4.01" for 100-YEAR event
 Inflow = 23.42 cfs @ 12.01 hrs, Volume= 1.236 af
 Outflow = 22.96 cfs @ 12.02 hrs, Volume= 1.235 af, Atten= 2%, Lag= 0.9 min
 Primary = 0.27 cfs @ 12.02 hrs, Volume= 0.476 af
 Secondary = 22.69 cfs @ 12.02 hrs, Volume= 0.758 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs / 2
Peak Elev= 1,903.81' @ 12.02 hrs Surf.Area= 11,628 sf Storage= 10,173 cf

Plug-Flow detention time= 169.1 min calculated for 1.234 af (100% of inflow)
Center-of-Mass det. time= 168.9 min (1,001.9 - 833.0)

Volume	Invert	Avail.Storage	Storage Description
#1	1,899.00'	1,146 cf	stone underdrain (Prismatic) Listed below (Recalc) 2,865 cf Overall x 40.0% Voids
#2	1,900.00'	860 cf	filter media (Prismatic) Listed below (Recalc) 5,730 cf Overall x 15.0% Voids
#3	1,902.00'	12,721 cf	surface storage (Prismatic) Listed below (Recalc)
		14,726 cf	Total Available Storage

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 41

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,899.00	2,865	0	0
1,900.00	2,865	2,865	2,865

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,900.00	2,865	0	0
1,902.00	2,865	5,730	5,730

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
1,902.00	2,865	0	0
1,903.00	4,783	3,824	3,824
1,904.00	6,154	5,469	9,293
1,904.50	7,558	3,428	12,721

Device	Routing	Invert	Outlet Devices
#1	Device 2	1,899.00'	1.000 in/hr Exfiltration over Surface area
#2	Primary	1,899.00'	6.0" Vert. Orifice/Grate C= 0.600
#3	Secondary	1,903.50'	50.0' long x 2.0' breadth Broad-Crested Rectangular Weir
Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50			
3.00 3.50			
Coef. (English) 2.54 2.61 2.61 2.60 2.66 2.70 2.77 2.89 2.88 2.85 3.07			
3.20 3.32			

Primary OutFlow Max=0.27 cfs @ 12.02 hrs HW=1,903.81' (Free Discharge)

↳ **2=Orifice/Grate** (Passes 0.27 cfs of 2.02 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.27 cfs)

Secondary OutFlow Max=22.42 cfs @ 12.02 hrs HW=1,903.81' (Free Discharge)

↳ **3=Broad-Crested Rectangular Weir** (Weir Controls 22.42 cfs @ 1.44 fps)

Summary for Pond IP: P2

Inflow Area = 45.186 ac, 28.04% Impervious, Inflow Depth = 5.25" for 100-YEAR event
 Inflow = 263.71 cfs @ 11.99 hrs, Volume= 19.768 af
 Outflow = 35.97 cfs @ 12.62 hrs, Volume= 15.838 af, Atten= 86%, Lag= 37.9 min
 Primary = 35.97 cfs @ 12.62 hrs, Volume= 15.838 af

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs
 Peak Elev= 1,943.49' @ 12.62 hrs Surf.Area= 119,270 sf Storage= 462,096 cf

Plug-Flow detention time= 440.9 min calculated for 15.838 af (80% of inflow)
 Center-of-Mass det. time= 341.6 min (1,178.4 - 836.8)

Volume	Invert	Avail.Storage	Storage Description
#1	1,938.00'	463,648 cf	Storage above Perm Pool (Irregular) Listed below (Recalc)

07074_Pro-WildacresEast

Type II 24-hr 100-YEAR Rainfall=8.00"

Prepared by The LA group

Printed 2/27/2012

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Page 42

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
1,938.00	56,286	1,229.0	0	0	56,286
1,939.00	70,553	1,304.0	63,285	63,285	71,457
1,940.00	74,969	1,432.0	72,750	136,035	99,359
1,942.00	93,060	2,050.0	167,703	303,739	270,635
1,942.25	97,168	2,034.0	23,777	327,515	275,860
1,943.00	111,843	1,898.0	78,315	405,830	318,440
1,943.50	119,472	1,918.0	57,818	463,648	324,588

Device	Routing	Invert	Outlet Devices
#1	Primary	1,940.40'	18.0" Round Culvert L= 130.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 1,940.40' / 1,937.00' S= 0.0262 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior
#2	Primary	1,943.00'	25.0' long x 20.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 Coef. (English) 2.68 2.70 2.70 2.64 2.63 2.64 2.64 2.63

Primary OutFlow Max=35.93 cfs @ 12.62 hrs HW=1,943.49' (Free Discharge)

1=Culvert (Inlet Controls 13.01 cfs @ 7.36 fps)

2=Broad-Crested Rectangular Weir (Weir Controls 22.92 cfs @ 1.88 fps)

Design Point Summary

1-yr Storm Event

Design Point Totals

10, 25 & 100-yr Storm Events

Summary for Pond DP 10: Design Point 10

Inflow Area = 157.341 ac, 1.75% Impervious, Inflow Depth = 0.64" for 1-YEAR event
Inflow = 42.75 cfs @ 11.94 hrs, Volume= 8.340 af
Primary = 42.75 cfs @ 11.94 hrs, Volume= 8.340 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 11: Design Point 11

Inflow Area = 89.648 ac, 16.86% Impervious, Inflow Depth = 0.31" for 1-YEAR event
Inflow = 16.06 cfs @ 12.05 hrs, Volume= 2.309 af
Primary = 16.06 cfs @ 12.05 hrs, Volume= 2.309 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 12: Design Point 12

Inflow Area = 5.266 ac, 20.67% Impervious, Inflow Depth = 0.94" for 1-YEAR event
Inflow = 7.22 cfs @ 11.93 hrs, Volume= 0.411 af
Primary = 7.22 cfs @ 11.93 hrs, Volume= 0.411 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

Summary for Pond DP 16: Design Point 16 24" CMP

Inflow Area = 18.370 ac, 7.89% Impervious, Inflow Depth = 0.58" for 1-YEAR event
Inflow = 5.55 cfs @ 12.20 hrs, Volume= 0.886 af
Primary = 5.55 cfs @ 12.20 hrs, Volume= 0.886 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-96.00 hrs, dt= 0.03 hrs

07074_Pro-WildacresEast

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 10-YEAR Rainfall=6.00"

Printed 2/27/2012

Page 1

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 10: Design Point 10

Inflow=211.67 cfs 37.655 af
Primary=211.67 cfs 37.655 af

Pond DP 11: Design Point 11

Inflow=72.97 cfs 19.678 af
Primary=72.97 cfs 19.678 af

Pond DP 12: Design Point 12

Inflow=28.05 cfs 1.521 af
Primary=28.05 cfs 1.521 af

Pond DP 16: Design Point 16 24" CMP

Inflow=31.46 cfs 4.090 af
Primary=31.46 cfs 4.090 af

07074_Pro-WildacresEast

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 25-YEAR Rainfall=6.50"

Printed 2/27/2012

Page 2

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 10: Design Point 10

Inflow=243.46 cfs 42.980 af
Primary=243.46 cfs 42.980 af

Pond DP 11: Design Point 11

Inflow=89.12 cfs 22.823 af
Primary=89.12 cfs 22.823 af

Pond DP 12: Design Point 12

Inflow=31.56 cfs 1.713 af
Primary=31.56 cfs 1.713 af

Pond DP 16: Design Point 16 24" CMP

Inflow=38.99 cfs 4.700 af
Primary=38.99 cfs 4.700 af

07074_Pro-WildacresEast

Prepared by The LA group

HydroCAD® 9.10 s/n 00439 © 2010 HydroCAD Software Solutions LLC

Type II 24-hr 100-YEAR Rainfall=8.00"

Printed 2/27/2012

Page 3

Time span=0.00-96.00 hrs, dt=0.03 hrs, 3201 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Pond DP 10: Design Point 10

Inflow=343.05 cfs 59.609 af
Primary=343.05 cfs 59.609 af

Pond DP 11: Design Point 11

Inflow=146.19 cfs 32.571 af
Primary=146.19 cfs 32.571 af

Pond DP 12: Design Point 12

Inflow=42.25 cfs 2.306 af
Primary=42.25 cfs 2.306 af

Pond DP 16: Design Point 16 24" CMP

Inflow=61.92 cfs 6.611 af
Primary=61.92 cfs 6.611 af

APPENDIX H

Soil Test Pit Logs



The Belleayre Resort at Catskill Park **Soil Test Pit Summary**

Deep hole test pits and percolation tests were performed on the site in the Fall of 2000, by certified soil scientist, Roger J. Case of the LA Group. Subsequent deep hole test pits and percolation tests were conducted by Roger in September 2002 at Wildacres, and November, 2007 on the Highmount parcel. The summary below includes only the test pits located on the properties that make up the 'Modified Project', specifically Wildacres and Highmount.

November, 2000

These deep soil test pits observations were made November 2000. Present at the time were Roger Case, soil scientist, cpss, cpsc, LA Group and representatives from the New York City DEP.

Test pit WA119:

Oe horizon: 0 to 2 inches, black (10YR2/1) mucky silt loam duff layer
E horizon: 2 to 3 inches, light gray (10YR7/2) gravelly silt loam
Bw1 horizon: 3 to 10 inches, (5YR4/6) yellowish red channery* silt loam with common small flagstones.
Bw2 horizon: 10 to 16 inches, brown (7.5YR 4/4) very channery silt loam with common flagstones of varying sizes.
Bw3 horizon: 16 to 38 inches, firm, dark yellowish brown (10YR 4/4) very channery silt loam with many flagstones.
Bx horizon**: 38 to 72 inches, very firm, brown (7.5YR 4/4) very channery silt loam, many flagstones.
R horizon: 72+ fractured sandstone and silt stone over hard bedrock.

*channers are elongated thin gravel fragments derived from shale and silt and sandstone, as opposed to typical gravel which is rounded or at least irregularly shaped.

**The Bx horizon designates the beginning of the fragipan.

There are no seeps and no mottles, however the Bx horizon is very firm and essentially impervious. A deep "perc" test exceeded one hour.

Percolation rate @ 26 inches is: 5 minutes 35 seconds (5:35)

Soil Series: Lewbeach

Test pit WA120:

Oe horizon: 0 to 1 inches, black (10YR2/1) mucky silt loam duff layer
E horizon: 1 to 2 inches, light gray (10YR7/2) gravelly silt loam (discontinuous)
Bw1 horizon: 2 to 12 inches, (7.5YR6/8) reddish yellow channery silt loam with common small flagstones.
Bw2 horizon: 12 to 24 inches, dark yellowish brown (10YR 4/4) very channery silt loam with many flagstones of varying sizes.
Bx horizon: 24 to 54 inches, very firm, brown (7.5YR 4/4) very channery silt loam, many flagstones.
R horizon: 54+ fractured sandstone and silt stone over hard bedrock.

There are no seeps and no mottles, however the Bx horizon is very firm and essentially impervious.

Percolation rate @ 22 inches is: 7 minutes 45 seconds (7:45)

Soil Series: Lewbeach

Test pit WA122:

Ap horizon: 0 to 5 inches, dark brown (10YR3/3) very channery silt loam, with common flagstones and boulders.

Bw1 horizon: 5 to 19 inches, brown (7.5YR4/4) very channery silt loam with common flagstones.

Bw2 horizon: 19 to 34 inches, dark yellowish brown (10YR 4/4) very channery silt loam with many flagstones of varying sizes.

Bx horizon: 34 to 58 inches, very firm, brown (7.5YR 4/4) very channery silt loam, many flagstones and boulders.

Cd horizon: 58 to 84 inches, very firm layers of sand and gravel.

There are no seeps and no mottles, however the Bx horizon is very firm and essentially impervious.

Percolation rate @ 18 inches is: 9 minutes 30 seconds (9:30)

Soil Series: Lewbeach

Test pit WA Pond 3:

Oe horizon: 0 to 4 inches, black (10YR2/1) mucky silt loam duff layer

E horizon: 4 to 6 inches, light gray (10YR7/2) gravelly silt loam

Bw1 horizon: 6 to 16 inches, (7.5YR 6/8) reddish yellowish very channery fine sandy loam with common small boulders.

Bw2 horizon: 16 to 26 inches, yellowish brown (10YR 5/4) very channery fine sandy loam with some small boulders.

Bx horizon: 26 to 42 inches, very firm, grayish brown (2.5Y 5/2) very bouldery loam

Cd horizon: 42 to 86+ inches, very firm, brown (2.5Y 5/2) very channery loam.

There are no seeps and no mottles, however the Bx horizon is very firm and essentially impervious. This location was investigated as a future location for pond construction, no percolation test was run. These impervious hardpan soils should make successful ponds.

Soil Series: Lewbeach

Test pit WA117001:

Oe horizon: 0 to 2 inches, black (10YR2/1) mucky silt loam duff layer

Bw1 horizon: 2 to 10 inches, (10YR 6/8) brownish yellowish channery loam.

Bw2 horizon: 10 to 24 inches, brown (7.5YR 6/4) very channery loam.

Bx horizon: 24 to 48 inches, very firm, brown (7.5YR 4/4) very channery silt loam with a few small boulders.

C horizon: 48 to 84 inches, firm, brown (7.5YR 6/4) very gravelly sandy loam.

There are no seeps and no mottles, however the Bx horizon is very firm and essentially impervious. This test pit was excavated to confirm soil mapping. The test pit confirms the map unit for Lewbeach soils which are deep, well drained soils formed in coarse textured glacial till soils. This particular area of Lewbeach is not quite a red as typical Lewbeach soils.

Test pit WA117:

Ap horizon: 0 to 7 inches, dark brown (10YR3/3) silt loam, very stony
Bw1 horizon: 7 to 16 inches, yellowish brown (10YR3/6) very gravelly silt loam.
Bw2 horizon: 16 to 28 inches, brown (7.5YR 5/4) very gravelly silt loam
Bx horizon: 28 to 52 inches, very firm, reddish brown (5YR 5/3) very channery silt loam with many mixed flagstones.
C horizon: 52 to 84 inches, very firm, very flaggy silt loam.

There are no seeps and no mottles, however the Bx horizon is very firm and essentially impervious. No percolation test was run, this area was investigated as a proposed pond site and should be successful.

Soil Series: Lewbeach

Test pit WA117002:

Oe horizon: 0 to 1 inches, black (10YR2/1) mucky silt loam duff layer
E horizon: 1 to 2 inches, light gray (10YR7/2) gravelly silt loam (discontinuous)
Bw1 horizon: 2 to 12 inches, (7.5YR6/8) reddish yellow channery silt loam with common small flag stones.
Bw2 horizon: 12 to 24 inches, dark yellowish brown (10YR 4/4) very channery silt loam with many flagstones of varying sizes.
BC horizon: 24 to 38 inches, firm, brown (7.5YR 4/4) very channery silt loam, many flagstones.
R horizon: 38+ fractured sandstone and silt stone over hard bedrock.

The depth to bedrock varied in the pit from 38 inches at one end to 72 inches at the other end. There are no seeps and no mottles, however there is a very firm Bx horizon at the deeper end of the pit and it is essentially impervious.

Soil Series: Vly (slightly brown phase)

Test pit #WA116:

This test pit was excavated in the lawn, west of the existing motel on the property. The soil consists of old stable fill excavated from the hillside behind the motel.

Ap horizon: 0 to 6 inches, dark reddish brown (5YR 3/2) silt loam.
C horizon: 6 to 84 inches, reddish brown (5YR 5/4) very gravelly/channery silt loam.

This area is intended for construction. No percolation tests were run. There were no seeps or mottles.

Udorthents, smoothed

Test pit WA117003:

Oe horizon: 0 to 25 inches, black (10YR2/1) fibrous organic duff layer mixed in a near pavement of large flagstones and boulders.

Bw1 horizon: 25 to 41 inches, reddish brown (5YR 4/4) very channery silt loam with common mixed flagstones.

Bw2 horizon: 41 to 60 inches, reddish brown (5YR 5/4) very channery loam, slightly firm, with many flagstones of varying sizes.

C horizon: 60 to 72 inches, slightly firm, reddish brown (7.5YR 4/4) very channery silt loam, many flagstones and boulders.

There are no seeps and no mottles. No perc test was run.

Soil Series: Elka

Test pit WA117004:

Ap horizon: 0 to 9 inches, dark brown (10YR3/3) channery silt loam.

Bw1 horizon: 9 to 19 inches, reddish brown(5YR 4/6) channery loam.

Bw2 horizon: 19 to 35 inches, reddish brown (7.5YR 4/3) very channery silt loam.

Bx horizon: 35 to 84 inches, very firm, light reddish brown (5YR 6/3) very channery silt loam with thick beds of flag stone in the lower part.

There are no seeps and no mottles, however the Bx horizon is very firm and essentially impervious. This test pit was excavated to confirm soil mapping. The test pit confirms the map unit for Lewbeach soils which are deep, well drained soils formed in coarse textured glacial till soils.

Test pit WA115:

Oe horizon: 0 to 1 inches, black (10YR2/1) fibrous organic duff layer

A horizon: 1 to 6 inches, dark grayish brown (10YR3/2) gravelly silt loam

Bw1 horizon: 6 to 9 inches, dark brown (10YR 3/3) channery silt loam

Bw2 horizon: 9 to 16 inches, yellowish brown (10YR 5/6) very channery silt loam with many flagstones of varying sizes.

R horizon: 16+ fractured sandstone and silt stone over hard bedrock.

There are no seeps and no mottles. This is an area confirmed as Halcott soils, however there is not the extensive areas of Halcott first predicted.

September, 2002

These deep soil test pits observations were made September 3, 4 & 5, 2002

Test pit DP102: (Wildacres 9-04-02)

Oe horizon: 0 to 1 inches, black (10YR2/1) organic and silt loam duff layer

E horizon: 1 to 2 inches, light gray (10YR7/2) gravelly silt loam
(discontinuous)
Bw1 horizon: 2 to 12 inches, (7.5YR6/8) reddish yellow channery silt loam with common small flagstones.
Bw2 horizon: 12 to 30 inches, dark yellowish brown (10YR 4/4) very channery silt loam with many flagstones of varying sizes.
Bx horizon: 30 to 72 inches, very firm, brown (7.5YR 4/4) very channery silt loam, many flagstones. There are no seeps and no mottles, the Bx horizon is very firm and essentially impervious.
Soil Series: Lewbeach
Test pit DP103: (Wildacres 9-04-02)
Oe horizon: 0 to 2 inches, black (10YR2/1) fibrous organic duff layer mixed in a near pavement of large flagstones and boulders.
Bw1 horizon: 2 to 44 inches, reddish brown (5YR 4/4) very channery silt loam with common mixed flagstones.
Bw2 horizon: 44 to 58 inches, reddish brown (5YR 5/4) very channery loam, slightly firm, with many flagstones of varying sizes.
2C horizon: 58 to 60+ inches, flagstones with cobbles and gravel in stratified layers.

There are no seeps and no mottles. Percolation rate @ 60 inches: <2:00 minutes

Soil Series: Elka o/ Tunnkanoack

Test pit DP104: (Wildacres 9-4-02)

Oe horizon: 0 to 1 inches, black (10YR2/1) mucky silt loam duff layer
Bw1 horizon: 1 to 6 inches, (7.5YR6/8) reddish yellow channery silt loam with common small flagstones.
Bw2 horizon: 6 to 29 inches, dark yellowish brown (10YR 4/4) very channery silt loam with many flagstones of varying sizes.
Bx horizon: 29 to 72 inches, very firm, brown (7.5YR 4/4) very channery silt loam, many flagstones.

There are no seeps and no mottles, the Bx horizon is very firm and essentially impervious.

Soil Series: Lewbeach

Test pit DP105: (Wildacres 9-4-02)

Oe horizon: 0 to 2 inches, black (10YR2/1) mucky silt loam duff layer
E horizon: 2 to 3 inches, light gray (10YR7/2) gravelly silt loam
Bw1 horizon: 3 to 10 inches, (5YR4/6) yellowish red channery silt loam with common small flagstones.
Bw2 horizon: 10 to 33 inches, firm, dark yellowish brown (10YR 4/4) very channery silt loam with many flagstones, common fine faint mottles in the lower part.

Bx horizon: 33 to 72 inches, very firm, brown (7.5YR 4/4) very channery silt loam, many flagstones..

There are mottles @ 24 to 33 inches. The Bx horizon is very firm and essentially impervious

Percolation rate @
20 inches is: 5 minutes (5:00)

Soil Series: Willowemoc

Test pit DP107: (Wildacres 9-05-02)

Oe horizon: 0 to 10 inches, black (10YR2/1) fibrous organic duff layer mixed in a near pavement of large flagstones and boulders.

Bw1 horizon: 10 to 30 inches, reddish brown (5YR 4/4) very channery silt loam with common mixed flagstones.

Bw2 horizon: 30 to 49 inches, reddish brown (5YR 5/4) very channery loam, slightly firm, with many flagstones of varying sizes.

C horizon: 49 to 60+ inches, slightly firm, reddish brown (7.5YR 4/4) very channery silt loam, many flagstones and boulders.

There are no seeps and no mottles. Percolation rate @ 60 inches: 9:00 minutes

Soil Series: Elka

Test pit DP108: (Wildacres 9-05-02)

Oe horizon: 0 to 10 inches, black (10YR2/1) fibrous organic duff layer mixed in a near pavement of large flagstones and boulders.

Bw1 horizon: 10 to 34 inches, reddish brown (5YR 4/4) very channery silt loam with common mixed flagstones.

Bw2 horizon: 34 to 55 inches, reddish brown (5YR 5/4) very channery loam, slightly firm, with many flagstones of varying sizes.

C horizon: 55 to 60+ inches, reddish brown (7.5YR 4/4) very channery silt loam, many flagstones and mixed gravel.

There are no seeps and no mottles. Percolation rate @ 60 inches: 4:00 minutes

Soil Series: Elka

Test pit DP109: (Wildacres 9-04-02)

Oe horizon: 0 to 5 inches, black (10YR2/1) fibrous organic duff layer mixed in a near pavement of large flagstones and boulders.

Bw1 horizon: 5 to 33 inches, reddish brown (5YR 4/4) very channery silt loam with common mixed flagstones.

Bw2 horizon: 33 to 49 inches, reddish brown (5YR 5/4) very channery loam, few, fine, faint mottles in the lower part, firm, with many flagstones of varying sizes.

C horizon: 49 to 60+ inches, friable, reddish brown (7.5YR 4/4) very channery silt loam, many flagstones and boulders.

There are no seeps and few fine mottles. Percolation rate @ 60 inches: 4:40 minutes

Soil Series: Lewbeach o/ Elka

Test pit DP110: (Wildacres 9-4-02)

Oe horizon: 0 to 2 inches, black (10YR2/1) mucky silt loam duff layer

E horizon: 2 to 3 inches, light gray (10YR7/2) gravelly silt loam

Bw1 horizon: 3 to 10 inches, (5YR4/6) yellowish red channery silt loam with common small flagstones.

Bw2 horizon: 10 to 30 inches, firm, dark yellowish brown (10YR 4/4) very channery silt loam with many flagstones, common fine faint mottles in the lower part.

Bx horizon: 30 to 72 inches, very firm, brown (7.5YR 4/4) very channery silt loam, many flagstones.

There are mottles @ 24 to 30 inches. The Bx horizon is very firm and essentially impervious

Soil Series: Willowemoc

Test pit DP113: (Wildacres 9-4-02)

Oe horizon: 0 to 1 inches, black (10YR2/1) organic duff layer

Ap horizon: 1 to 5 inches, dark brown (7.5YR3/3) gravelly silt loam.

Bw1 horizon: 5 to 26 inches, (7.5YR6/8) reddish yellow channery silt loam with common small flagstones.

Bx horizon: 26 to 72 inches, very firm, brown (7.5YR 4/4) very channery silt loam, many flagstones. There is a discontinuous seam of gravel at 48 to 62 inches. The seam probably had reasonable permeability but was discontinuous within the pit and could be a reliable outlet for infiltration within the matrix of very firm hardpan.

There are no seeps and no mottles, the Bx horizon is very firm and essentially impervious.

Soil Series: Lewbeach

Test pit DP116: (Wildacres 9-03-02)

Oe horizon: 0 to 10 inches, black (10YR2/1) fibrous organic duff layer mixed in a near pavement of large flagstones and boulders.

Bw1 horizon: 10 to 30 inches, reddish brown (5YR 4/4) very channery silt loam with common mixed flagstones.

Bw2 horizon: 30 to 45 inches, reddish brown (5YR 5/4) very channery loam, slightly firm, with many flagstones of varying sizes.

C horizon: 45 to 60+ inches, slightly firm, reddish brown (7.5YR 4/4) very channery silt loam, many flagstones and boulders.

There are no seeps and no mottles. Percolation rate @ 60 inches: 8:00 minutes

Soil Series: Elka

November, 2007

On November 28, 29 & 30, 2007 the following deep soil test pits were observed.

Test pit #11280701: Soil Type: Willowemoc
Strong seeps @ 29 inches
Fractured bedrock @ 42 inches
Hard bedrock @ 60 inches

Test pit #11280702: Soil Type: Lewbeach
Fractured bedrock @ 60 inches
Hard bedrock @ 85 inches

Test pit #11280703: Soil Type: Lewbeach
Fractured bedrock @ 61 inches
Hard bedrock @ 81 inches

Test pit #11280704: Soil Type: Halcott
Hard bedrock @ 17 inches

Test pit #11280705: Soil Type: Vly
Fractured bedrock @ 17 inches
Hard bedrock @ 28 inches

Test pit #11280706: Soil Type: Vly
Seeps @ 12 inches
Fractured bedrock @ 20 inches
Hard bedrock @ 40 inches

Test pit #11280707: Soil Type: Lairdsville
Fractured soft red shale @ 52 inches
Hard red shale bedrock @ 60 inches

Test pit #11280708: Soil Type: Lairdsville
Reddish brown clay 0 to 81 inches
Hard red shale bedrock @ 81 inches

Test pit #11280709: Soil Type: Lewbeach
Very firm @ 33 inches
Hard bedrock @ 108 inches

Test pit #11280710: Soil Type: Lewbeach
Stong seeps @ 66 inches
Soft reddish brown shale bedrock @ 66 inches

Test pit #11280711: Soil Type: Lewbeach
Very firm @ 35 inches
Fractured bedrock with seeps @ 88 inches
Hard bedrock @ 102 inches

Test pit #11280712: Soil Type: Elka
Fractured bedrock @ 52 inches
Hard bedrock @ 83 inches

Test pit #11280713: Soil Type: Vly
Fractured bedrock @ 25 inches
Hard bedrock @ 35 inches

Test pit #11280714: Soil Type: Halcott
Fractured bedrock @ 2 inches
Hard bedrock @ 15 inches

Test pit #11280715: Soil Type: Vly
Fractured bedrock @ 6 inches
Hard bedrock @ 23 inches

Test pit #11280716: Soil Type: Rubble
Fractured bedrock, flagstones and boulders

Test pit #11280717: Soil Type: Lewbeach
Fractured soft red shale bedrock @ 45 inches
Hard (rippable) red shale bedrock @ 68 inches

Test pit #11280718: Soil Type: Rubble
Fractured bedrock, flagstones and boulders

Test pit #11280719: Soil Type: Lewbeach
Fractured bedrock @ 52 inches
Hard bedrock @ 68 inches

Test pit #11280720: Soil Type: Elka
Fractured bedrock @ 45 inches
Hard bedrock @ 60 inches

Test pit #11280721: Soil Type: Vly
Hard bedrock @ 30 inches

Test pit #11280722: Soil Type: Halcott
Hard bedrock @ 10 inches

Test pit #11280723: Soil Type: Elka
Fractured bedrock @ 40 inches
Hard bedrock @ 61 inches

Test pit #11280724: Soil Type: Vly
Hard bedrock @ 35 inches

Test pit #11290725: Soil Type: Vly
Fractured shale and slate bedrock @ 35 inches
Hard bedrock @ 52 inches

Test pit #11290726: Soil Type: Vly
Fractured bedrock @ 26 inches
Hard bedrock @ 30 inches

Test pit #11290727: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 40 inches

Test pit #11290728: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 56 inches

Test pit #11290729: Soil Type: Vly
Hard bedrock @ 31 inches

Test pit #11290730: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 34 inches

Test pit #11290731: Soil Type: Vly
Fractured bedrock @ 32 inches
Hard bedrock @ 42 inches

Test pit #11290732: Soil Type: Vly
Fractured bedrock @ 26 inches
Hard bedrock @ 32 inches

Test pit #11290733: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 34 inches

Test pit #11290734: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 38 inches

Test pit #11290735: Soil Type: Vly
Fractured bedrock @ 16 inches
Hard bedrock @ 31 inches

Test pit #11290736: Soil Type: Willowemoc
Strong seeps @ 24 inches
Fractured bedrock @ 47 inches
Hard bedrock @ 62 inches

Test pit #11290737: Soil Type: Lairdsville
Strong seeps @ 24 inches
Soft red shale bedrock

Test pit #11290738: Soil Type: Rubble
Fractured bedrock, flagstones and boulders
Refusal @ 60 inches

Test pit #11290739: Soil Type: Vly
Fractured bedrock @ 32 inches
Hard bedrock @ 41 inches

Test pit #11290740: Soil Type: Halcott
Fractured bedrock @ 18 inches
Soft red shale bedrock @ 18 inches

Test pit #11290741: Soil Type: Vly
Fractured bedrock @ 27 inches
Soft shale and slate bedrock @ 56 inches
Hard bedrock @ 56 inches

Test pit #11290742: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 40 inches

Test pit #11290743: Soil Type: Rock outcrop
0 inches, bedrock

Test pit #11290744: Soil Type: Vly
Fractured bedrock @ 25 inches
Hard bedrock @ 48 inches

Test pit #11290745: Soil Type: Vly
Fractured bedrock @ 30 inches

Hard bedrock @ 40 inches

Test pit #11290746: Soil Type: Vly
Fractured bedrock @ 19 inches
Hard bedrock @ 31 inches

Test pit #11290747: Soil Type: Halcott
Fractured bedrock @ 10 inches
Hard bedrock @ 19 inches

Test pit #11290748: Soil Type: Vly
Fractured bedrock @ 28 inches
Hard bedrock @ 31 inches

Test pit #11290749: Soil Type: Halcott
Fractured bedrock @ 0 inches
Hard bedrock @ 10 inches

Test pit #11290750: Soil Type: Vly
Fractured bedrock @ 33 inches
Hard bedrock @ 51 inches

Test pit #11290751: Soil Type: Vly
Fractured bedrock @ 18 inches
Hard bedrock @ 23 inches

Test pit #11290752: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 38 inches

Test pit #11300768: Soil Type: Vly
Fractured bedrock @ 15 inches
Hard bedrock @ 22 inches

Test pit #11300769: Soil Type: Halcott
Fractured bedrock @ 15 inches
Hard bedrock @ 19 inches

The stabilized soil percolation rate is 0:15:00 (fifteen minutes)

Test pit #11300770: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 35 inches

Test pit #11300771: Soil Type: Vly
Fractured bedrock @ 19 inches
Hard bedrock @ 25 inches

Test pit #11300772: Soil Type: Halcott

Fractured bedrock @ 10 inches
Hard bedrock @ 15 inches

Test pit #11300773: Soil Type: Vly
Fractured bedrock @ 30 inches
Hard bedrock @ 35 inches

Test pit #11300774: Soil Type: Halcott
Fractured bedrock @ 15 inches
Hard bedrock @ 20 inches

Test pit #11300775: Soil Type: Halcott
Fractured bedrock @ 10 inches
Hard bedrock @ 20 inches

Test pit #11300776: Soil Type: Vly
Gravelly and bouldery native glacial till with
some mixed disturbance from the adjacent
road just north of the test pit
Fractured bedrock @ 30 inches
Hard bedrock @ 40 inches

Test pit #11300777: Soil Type: Paxton
Very gravelly sandy loam
Very firm, very gravelly sandy loam @ 35 inches

The stabilized soil percolation rate is 0:17:00 (seventeen minutes)